

**Builders
Insulation Statement**

8221 TIVOLI COVE DR.



Am West - Estates Lot 159 - Ph 7 - Plan 603AR

InsulSafe III®

Insul-Safe III® has been installed with the manufacturer's recommendations to provide a value of R 30 using 30 bags of insulation to cover 1300 square feet of area at a minimum thickness of 12 inches.

Herb Kupferberg
Insulation Contractor (Sign)

Insulators, Inc.
Company Name

1-16-91
Date

Builder (Sign)

Company Name

Date

Batts and Blanket

| R* Value | Insulation Thickness |
|----------|----------------------|
| R-38 | 12" |
| R-30 | 10" |
| R-22 | 6½" |
| R-19 | 6¼" |
| R-13 | 3½" |
| R-11 | 3½" |

Meets ASTM C 665, replacing Federal Specification HH-I-521F.

Fiber glass batts or rolls have been installed in accordance with the manufacturer's recommendation to provide an R-value of _____ in the ceiling, _____ in the exterior walls, _____ in the floor or crawl space perimeter.

Insulation Contractor (Sign)

Company Name

Date

Builder (Sign)

Company Name

Date

Thermal Performance — Attic Blowing Application

- In accordance with the chart below, you must install the minimum number of bags per 1,000 sq. ft. of net area for each R-Value listed.
- The maximum net coverage must not exceed that specified for each R-Value.
- The installed insulation must be at or above the specified minimum thickness for each R-Value.
- Failure to install the required minimum weight per sq. ft. of insulation at or above the minimum thickness will result in reduced R-Value.
- This product should not be mixed with other blown insulations or the thermal claims will become invalid.

"R" means resistance to heat flow. The higher the R-Value, the greater the insulation power. To get the marked R-Value, it is essential that this insulation be installed properly. If you do-it-yourself, get instructions and follow them carefully. Instructions do not come with this package.

CAUTION: RECESSED LIGHT FIXTURES—TO PREVENT OVERHEATING, DO NOT INSULATE ON TOP OR WITHIN 3" OF SUCH DEVICES. DOES NOT APPLY TO TYPE IC LIGHT FIXTURES OR TO FLUORESCENT FIXTURES WITH THERMALLY PROTECTED BALLASTS.

| R-VALUE To obtain a thermal resistance (R) of: | BAGS PER 1000 SQ. FT. Bags per 1000 sq. ft. of net area: | MAXIMUM SQ. FT. PER BAG Contents of bag should not cover more than: (sq. ft.) | MINIMUM WEIGHT POUNDS PER SQ. FT. Weight per sq. ft. of installed insulation should not be less than: (lbs.) | MINIMUM THICKNESS Should not be less than: (inches) |
|---|---|--|---|--|
| R-49 | 34.3 | 29 | .858 | 19¼" |
| R-44 | 31.1 | 32 | .778 | 17¾" |
| R-38 | 26.6 | 38 | .665 | 15½" |
| R-30 | 20.8 | 48 | .521 | 12½" |
| R-26 | 18.1 | 55 | .452 | 11" |
| R-22 | 15.0 | 67 | .374 | 9¼" |
| R-19 | 13.2 | 76 | .330 | 8¼" |
| R-13 | 9.0 | 111 | .225 | 5¾" |
| R-11 | 7.4 | 136 | .184 | 4¾" |

R-Values are determined in accordance with ASTM C 687 and C 518. Conforms to ASTM C 764 which replaces Federal Specification HH-I-1030B.

Framing Adjustment

To compensate for framing members the number of bags per 1000 sq. ft. of net area should be reduced as follows:

| Joist Size | Bags to Deduct / 1000 sq. ft. Joists 16" O.C. | Bags to Deduct / 1000 sq. ft. Joists 24" O.C. |
|------------|---|---|
| 2" x 4" | .7 | .5 |
| 2" x 6" | 1.0 | .7 |
| 2" x 8" | 1.3 | .9 |
| 2" x 10" | 1.6 | 1.0 |

CertainTeed Corporation
P.O. Box 860, Valley Forge, PA 19482

Code No. 30-24-052

© 1989 CertainTeed Corporation 7/90

AMERICAN WEST DEVELOPMENT, INC.
 ESTATES AT SOUTHSORE UNIT 1 PHASE 7
 SEQUENCE OF CONSTRUCTION

| SEQ. | LOT | BLOCK | PLAN | OPTIONAL FIREPLACE | ADDRESS |
|------|-----|-------|-------|-----------------------|------------------------|
| ↑ 1 | 164 | 5 | 601C | - MBR | 8241 Tivoli Cove Drive |
| 2 | 163 | 5 | 602CR | - MBR | 8237 Tivoli Cove Drive |
| 3 | 162 | 5 | 602B | LR MBR | 8233 Tivoli Cove Drive |
| 4 | 161 | 5 | 604AR | - - | 8229 Tivoli Cove Drive |
| 5 | 160 | 5 | 601C | - - | 8225 Tivoli Cove Drive |
| 6 | 159 | 5 | 603AR | LR MBR | 8221 Tivoli Cove Drive |
| 7 | 158 | 5 | 602B | - MBR | 8217 Tivoli Cove Drive |
| 8 | 157 | 5 | 604AR | - - | 8213 Tivoli Cove Drive |
| 9 | 156 | 5 | 602C | - - | 8209 Tivoli Cove Drive |
| 10 | 155 | 5 | 604BR | LR - | 8205 Tivoli Cove Drive |
| 11 | 154 | 5 | 604A | LR - | 8201 Tivoli Cove Drive |
| 12 | 143 | 4 | 603AR | LR - | 8240 Tivoli Cove Drive |
| 13 | 144 | 4 | 602B | - - | 8236 Tivoli Cove Drive |
| 14 | 145 | 4 | 601CR | - - | 8232 Tivoli Cove Drive |
| 15 | 146 | 4 | 602B | - - | 8228 Tivoli Cove Drive |
| ✓ 16 | 147 | 4 | 604AR | PLYRM | 8224 Tivoli Cove Drive |
| 17 | 148 | 4 | 602C | - - | 8220 Tivoli Cove Drive |
| 18 | 149 | 4 | 603BR | - MBR | 8216 Tivoli Cove Drive |
| 19 | 150 | 4 | 601C | - - | 8212 Tivoli Cove Drive |
| 20 | 151 | 4 | 602BR | - MBR | 8208 Tivoli Cove Drive |
| 21 | 152 | 4 | 602C | - - | 8204 Tivoli Cove Drive |
| 22 | 153 | 4 | 602BR | LR MBR | 8200 Tivoli Cove Drive |

9/4/90

✓

9/5/90

BREAKDOWN:

| | | | | | |
|----------|--------|----------|-------|----------|-------|
| PLAN 601 | A - 0 | PLAN 602 | A - 0 | PLAN 603 | A - 2 |
| | B - 0 | | B - 6 | | B - 1 |
| | C - 4 | | C - 4 | | C - 0 |
| | --- | | --- | | --- |
| | 4 | | 10 | | 3 |
| PLAN 603 | AA - 0 | PLAN 604 | A - 4 | | |
| | BB - 0 | | B - 1 | | |
| | CC - 0 | | C - 0 | | |
| | --- | | --- | | |
| | 0 | | 5 | | |

TOTAL: 22 HOUSES
 PER PLOT PLAN DATED:

AMERICAN WEST DEVELOPMENT, INC.
 THE ESTATES AT SOUTH SHORE

UNIT 1 PHASE 7

LEGEND


LOT#




BLOCK#



PLAN#



ELEVATION

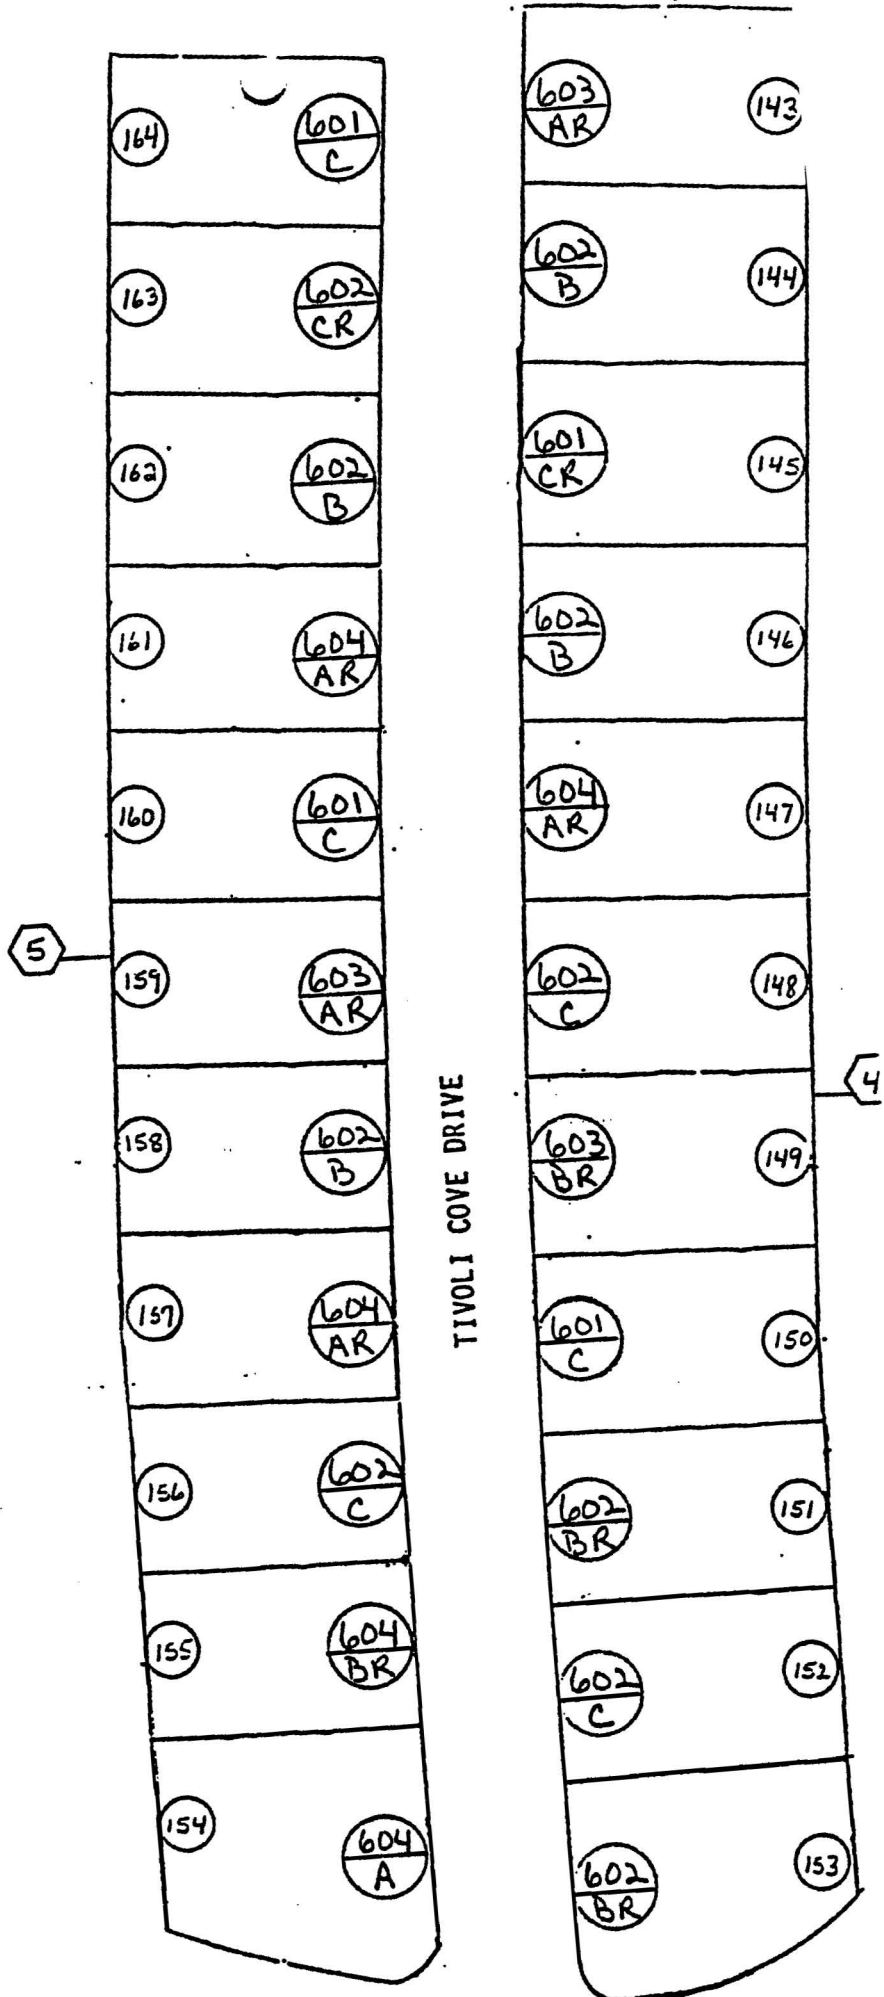

BRIGHTON SHORE STREET

