

301 CLARK, SUITE 270

PROJECT ADDRESS		DATE RECEIVED
PROJECT NAME		PHONE NUMBER
CONTACT	INSPECTOR	DATE INSPECTED

This image shows a single sheet of white paper with horizontal blue or grey ruling lines. The lines are evenly spaced and run across the width of the page. There are approximately 20 lines visible. The paper appears to be a standard notebook page.

☐ COMPLETE INSPECTION301 ☐ REINSPECTION303 ☐ PARTIAL INSPECTION304 ☐ ATTEMPTED INSPECTION305 ☐ CONSULTATION306 ☐ ACTIVITY308 ☐ PRE-PLAN309		☐ FIRE ALARM SYSTEM ☐ SMOKE DETECTORS315 ☐ PULL STATIONS316 ☐ AUDIBLE ALARMS317 ☐ SUPERVISION318 ☐ FINAL319		☐ SPRINKLER SYSTEM ☐ OVERHEAD HYDRO328 ☐ OVERHEAD INSPECTION329 ☐ FLOW/TAMPER TEST330 ☐ SUPERVISION331 ☐ FINAL332		☐ FIRE HYDRANT ☐ THRUST BLOCK/BACKFILL350 ☐ FLOW TEST352		☐ UNDERGROUND TANKS ☐ TANK BEDDING357 ☐ BOTTOM SLAB/DEAD MAN358 ☐ WAND TEST359 ☐ STRAPS360 ☐ TANK PRESSURE361 ☐ BACK FILL362 ☐ PIPING TEST363 ☐ REBAR/MESH WIRE364 ☐ REMOVAL365 ☐ FINAL367		☐ HOOD SYSTEM ☐ INSPECTION370 ☐ TEST371		EMERGENCY LIGHTING APPROVED387 DISAPPROVED388		☐ LPG ☐ OUTSIDE STORAGE/USE401 ☐ INSIDE STORAGE/USE402		SMOKE DETECTORS APPROVED403 DISAPPROVED404		NEW CONSTRUCTION 30-DAY TEMPORARY428 FIELD MGMT INSPECTION429 ☒ BUILDING FINAL430		☐ OTHER _____ ☐ OTHER _____		NOT APPROVED489	
---	--	--	--	--	--	---	--	---	--	--	--	---	--	---	--	--	--	--	--	--	--	-----------------------	--

FOR FURTHER INFORMATION CALL: 383-2888

25x10

**CITY OF LAS VEGAS
DIVISION OF FIRE SAFETY**

PROJECT ADDRESS X 301 Clark Suite 270		DATE RECEIVED 4/25/90
PROJECT NAME		PHONE NUMBER
CONTACT	INSPECTOR Jim Hinkle	DATE INSPECTED 4/26/90

① No one at location:


② No plans or permit but need
Building Card For Signature

☐ APPROVED ☐ PERMIT REQUIRED ☐ REJECTED — REINSPECTION REQUIRED

COMPLETE INSPECTION.....301 REINSPECTION.....303 PARTIAL INSPECTION.....304 ✓ ATTEMPTED INSPECTION.....305 CONSULTATION.....306 ACTIVITY.....308 PRE-PLAN.....309	☐ FIRE HYDRANT ☐ THRUST BLOCK/BACKFILL.....350 ☐ FLOW TEST.....352 ☐ UNDERGROUND TANKS ☐ TANK BEDDING.....357 ☐ BOTTOM SLAB/DEAD MAN.....358 ☐ WAND TEST.....359 ☐ STRAPS.....360 ☐ TANK PRESSURE.....361 ☐ BACK FILL.....362 ☐ PIPING TEST.....363 ☐ REBAR/MESH WIRE.....364 ☐ REMOVAL.....365 ☐ FINAL.....367	EMERGENCY LIGHTING APPROVED.....387 DISAPPROVED.....388 ☐ LPG OUTSIDE STORAGE/USE.....401 INSIDE STORAGE/USE.....402 SMOKE DETECTORS APPROVED.....403 DISAPPROVED.....404 NEW CONSTRUCTION 30-DAY TEMPORARY.....428 FIELD MGMT INSPECTION.....429 ☒ BUILDING FINAL.....430
☐ FIRE ALARM SYSTEM SMOKE DETECTORS.....315 PULL STATIONS.....316 AUDIBLE ALARMS.....317 SUPERVISION.....318 FINAL.....319	☐ HOOD SYSTEM INSPECTION.....370 TEST.....371	☒ OTHER 599- No Contact At Location ☐ OTHER ☒ NOT APPROVED.....489
☐ SPRINKLER SYSTEM ☐ OVERHEAD HYDRO.....328 ☐ OVERHEAD INSPECTION.....329 ☐ FLOW/TAMPER TEST.....330 ☐ SUPERVISION.....331 ☐ FINAL.....332		

FOR INSPECTIONS CALL: 799-2071

FOR FURTHER INFORMATION CALL: 383-2888

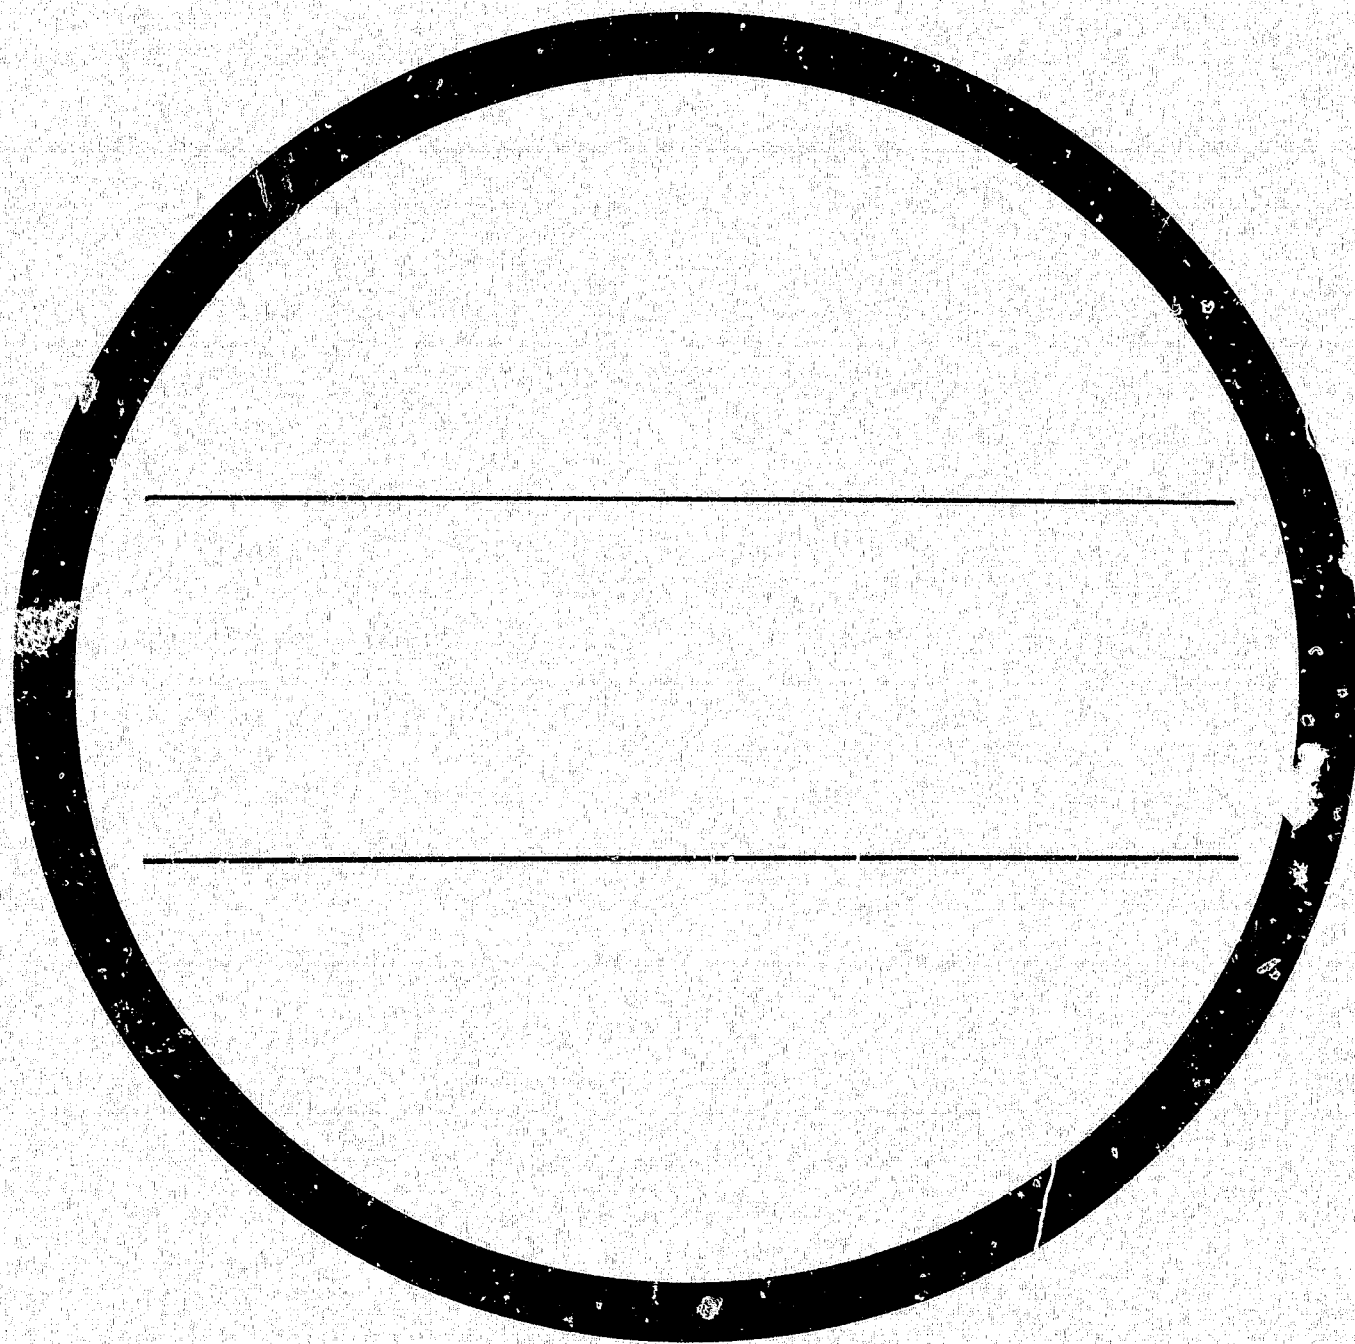

COMGRAPHIX, INC.



Southwest Microfilm Division

25X