

1508 N. Jones
Blvd.

L-Portion Of $W\frac{1}{2}$ $NW\frac{1}{4}$ Sec 25 T20S R-60E

CITY OF LAS VEGAS, NEVADA

ANN.

LOG NO. & AREA

M-122

CONST. VAL. \$

7,000.00

DEPARTMENT OF PUBLIC SERVICES
DIVISION OF BUILDING AND SAFETY

APPLICATION & BUILDING PERMIT - for:
Commercial or Public Structures

ADDRESS OF
CONSTRUCTION

1508 North Jones Boulevard

OWNER: BECKER INVESTMENT COMPANY

LOT(s)

N/A

BLOCK

N/A

SUBDIVISION

N/A

ZONE

C-1

Existing structure on lot:

Dwelling ☐

Accessory Bldgs. ☐

Vacant Lot ☐

Commercial Bldg. ☒

Other ☐

PROPOSED CONSTRUCTION:

Interior finish

USE:

Office

MATERIALS OF CONSTRUCTION:

Wood Frame ☒

Concrete Block ☐

Reinforced Concrete ☐

Steel Frame ☐

SQUARE FEET OF FLOOR AREAS: 1st

1000

2nd

3rd

Other

TOTAL SQ. FT.

1000

FIRE ZONE:

2

Occupancy Group

B-2

CONST. TYPE:

ARCHITECT

BECKER INVESTMENT CO.

ENGINEER

BECKER INVESTMENT CO.

NO. of UNITS

1

NO. of STORIES

1

Plans Submitted:

Yes ☒

No ☐

Calculations Submitted

Yes ☒

No ☐

Sewer Fee Req'd

Yes ☐

No ☒

CONTRACTOR:

BECKER BUILT

STATE
LICENSE #

11092B

CITY
LICENSE #

C11520

ADD'L PERMITS REQ'D:

Air Cond. ☒

Elec. ☒

Plumbing ☐

Sans ☐

Paving ☐

Fence ☐

Public Walks ☐

Curb-gutters ☐

Incinerators ☐

Fire Sprinkling System ☐

CONDITIONS OF THE PERMIT:

1. I agree to call the City Building Department for inspections before concrete is poured, before rough wiring, electrical, plumbing, framing is covered. Also for Air conditioning, drywall and sheathing inspection.
2. I agree that when the job is completed that I will call for final inspection before occupancy.
3. I agree to perform all construction in accordance with City Ordinances and Building Codes.
4. The Contractor's signature below denotes authority from the owner to sign in his behalf and that the owner is aware of all requirements of this application and permit. Separate permits must be taken out for work outlined above this agreement.
5. I have read and understand the contents of this application and permit; I hereby state that the information I have supplied on this application is true and correct.

Approval for the work under this permit will be given only after refuse and debris have been removed from job site and public right of way.

BECKER BUILT

SIGNED:

Ernest A. Becker

11/11/80

\$ 00

Contractor

BY:

Agent

STL

\$ 45.00

Agent or Owner

TOTL

\$ 45.00

CHEK

\$ 45.00

#0662

SR#001/01

CITY - LAS VEGAS

11-80

BLDG. & SAFETY

RECEIPT

PLANNING DEPT.:

J. Robinson

Date:

2/21/80

PUBLIC WORKS DEPT.:

Turner

Date:

2-21-80

BUILDING DIVISION:

MJ

Date:

2-29-80

76-10-13

154-01-220

PERMIT NO.:

0662

PERMIT FEE \$

45.00

03/03/80

MUST BE MACHINE VALIDATED

Mercado Plaza
1508 N. Jones.

2-26-80

GENERAL LIGHTING

1000 SQ. FT. @ 3 WATTS X 1.25

SHOW WINDOW 10 FT. @ 200 W./FT.

WATER HEATER

SIGN

BATH FAN

3750 WATTS

2000 WATTS

1500 WATTS

575 WATTS

180 WATTS

A.C. UNIT 3 TON GAS-HEAT

5980 WATTS

13,985 WATTS

13,985 WATTS ÷ 220 VOLTS. = 60.8 AMPS

PLANS APPROVED-ELECTRICAL

DOES NOT INCLUDE PLUMBING OR CONSTRUCTION

NO CHANGE WITHOUT APPROVAL

APPROVAL OF PLAN IS NOT A PERMIT TO VIOLATE ANY ORDINANCE

DATE 2-28
ELECTRICAL DEPT. - CITY OF LAS VEGAS.

Micardo Laundry 1506 N. JONES,
loads

TOP LOADER WASHERS. (120V.)
14 @ 805 WATTS EA.

11,270.

FRONT LOADER WASHERS. (120V.)
12 @ 920 WATTS EA.

11,040.

DRY CLEANING MACH. (230V.)
2 @ 6,000 WATTS EA.

12,000.

GAS DRYERS. (120V.)
14 @ 1,935

14,490.

35 LB. MELNOR WASH MACH. (230V.)
4 @ 2500 WATTS

10,000.

58,800. WATTS

PLANS APPROVED - ELECTRICAL
DOES NOT INCLUDE PLUMBING OR CONSTRUCTION
MAKE NO CHANGE WITHOUT PERMIT
APPROVAL OF PLANS IS NOT A PERMIT TO VIOLATE ANY ORDINANCE

ELECTRICAL DEPT. - CITY OF LAS VEGAS

DATE

2-28

①

Mechanical Laundry

IRON (120V. 30A)

1 @ 1840 WATT

1840.

SIGNS (120V.)

2 @ 575 WATTS EA.

1150.

SPACE GAS HEATER (120V.)

1 @ 500 WATTS

500.

BATH FAN (120V.)

1 @ 180 WATTS

180.

BOMER PUMP (120V.)

1 @ 370 WATTS

370.

ROOF EX. FANS

2 @ 760 WATTS EA.

1520.

SWAMP COOLERS.

2 @ 1012 WATTS EA.

PLANS APPROVED ELECTRICAL

DOES NOT INCLUDE PLUMBING OR CONSTRUCTION

MAKE NO CHANGE WITHOUT APPROVAL

APPROVAL OF PLAN IS NOT A PERMIT TO VIOLATE ANY ORDINANCE

2024.

DUPLEX RECEPTS

5 @ 180 WATT

ELECTRICAL DEPT. - CITY OF LAS VEGAS

DATE

2-28

900.

8,484. WATTS

Micardo Laundry

lights

2x4 DROP IN FIXTURES
19 @ 175 WATTS EA.

3,325.

DRYER WORK AREA
6 @ 60 WATT EA.

360.

STORAGE RMS
2 @ 175 WATTS EA.
2 @ 100 WATTS EA.

7350.
200.

4235 WATTS

TOTALS

4235 X 1.25

LIGHTS

EQUIP

RECEPTS & FANS

5,293.75
58,800.0
8,484.0

72,577.75 WATTS

72,577.75 WATTS ÷ 230


315.56 AMPS

PAGE 3
PAGE 1
PAGE 2

PLANS APPROVED-ELECTRICAL
DOES NOT INCLUDE PLUMBING OR CONSTRUCTION
MAKE NO CHANGE WITHOUT APPROVAL
APPROVAL OF PLAN IS NOT A PERMIT TO VIOLATE ANY CODES
ELECTRICAL DEPT. - CITY OF LAS VEGAS
Date 2/28

③

600 A. MAIN
2% Cu. GROUND

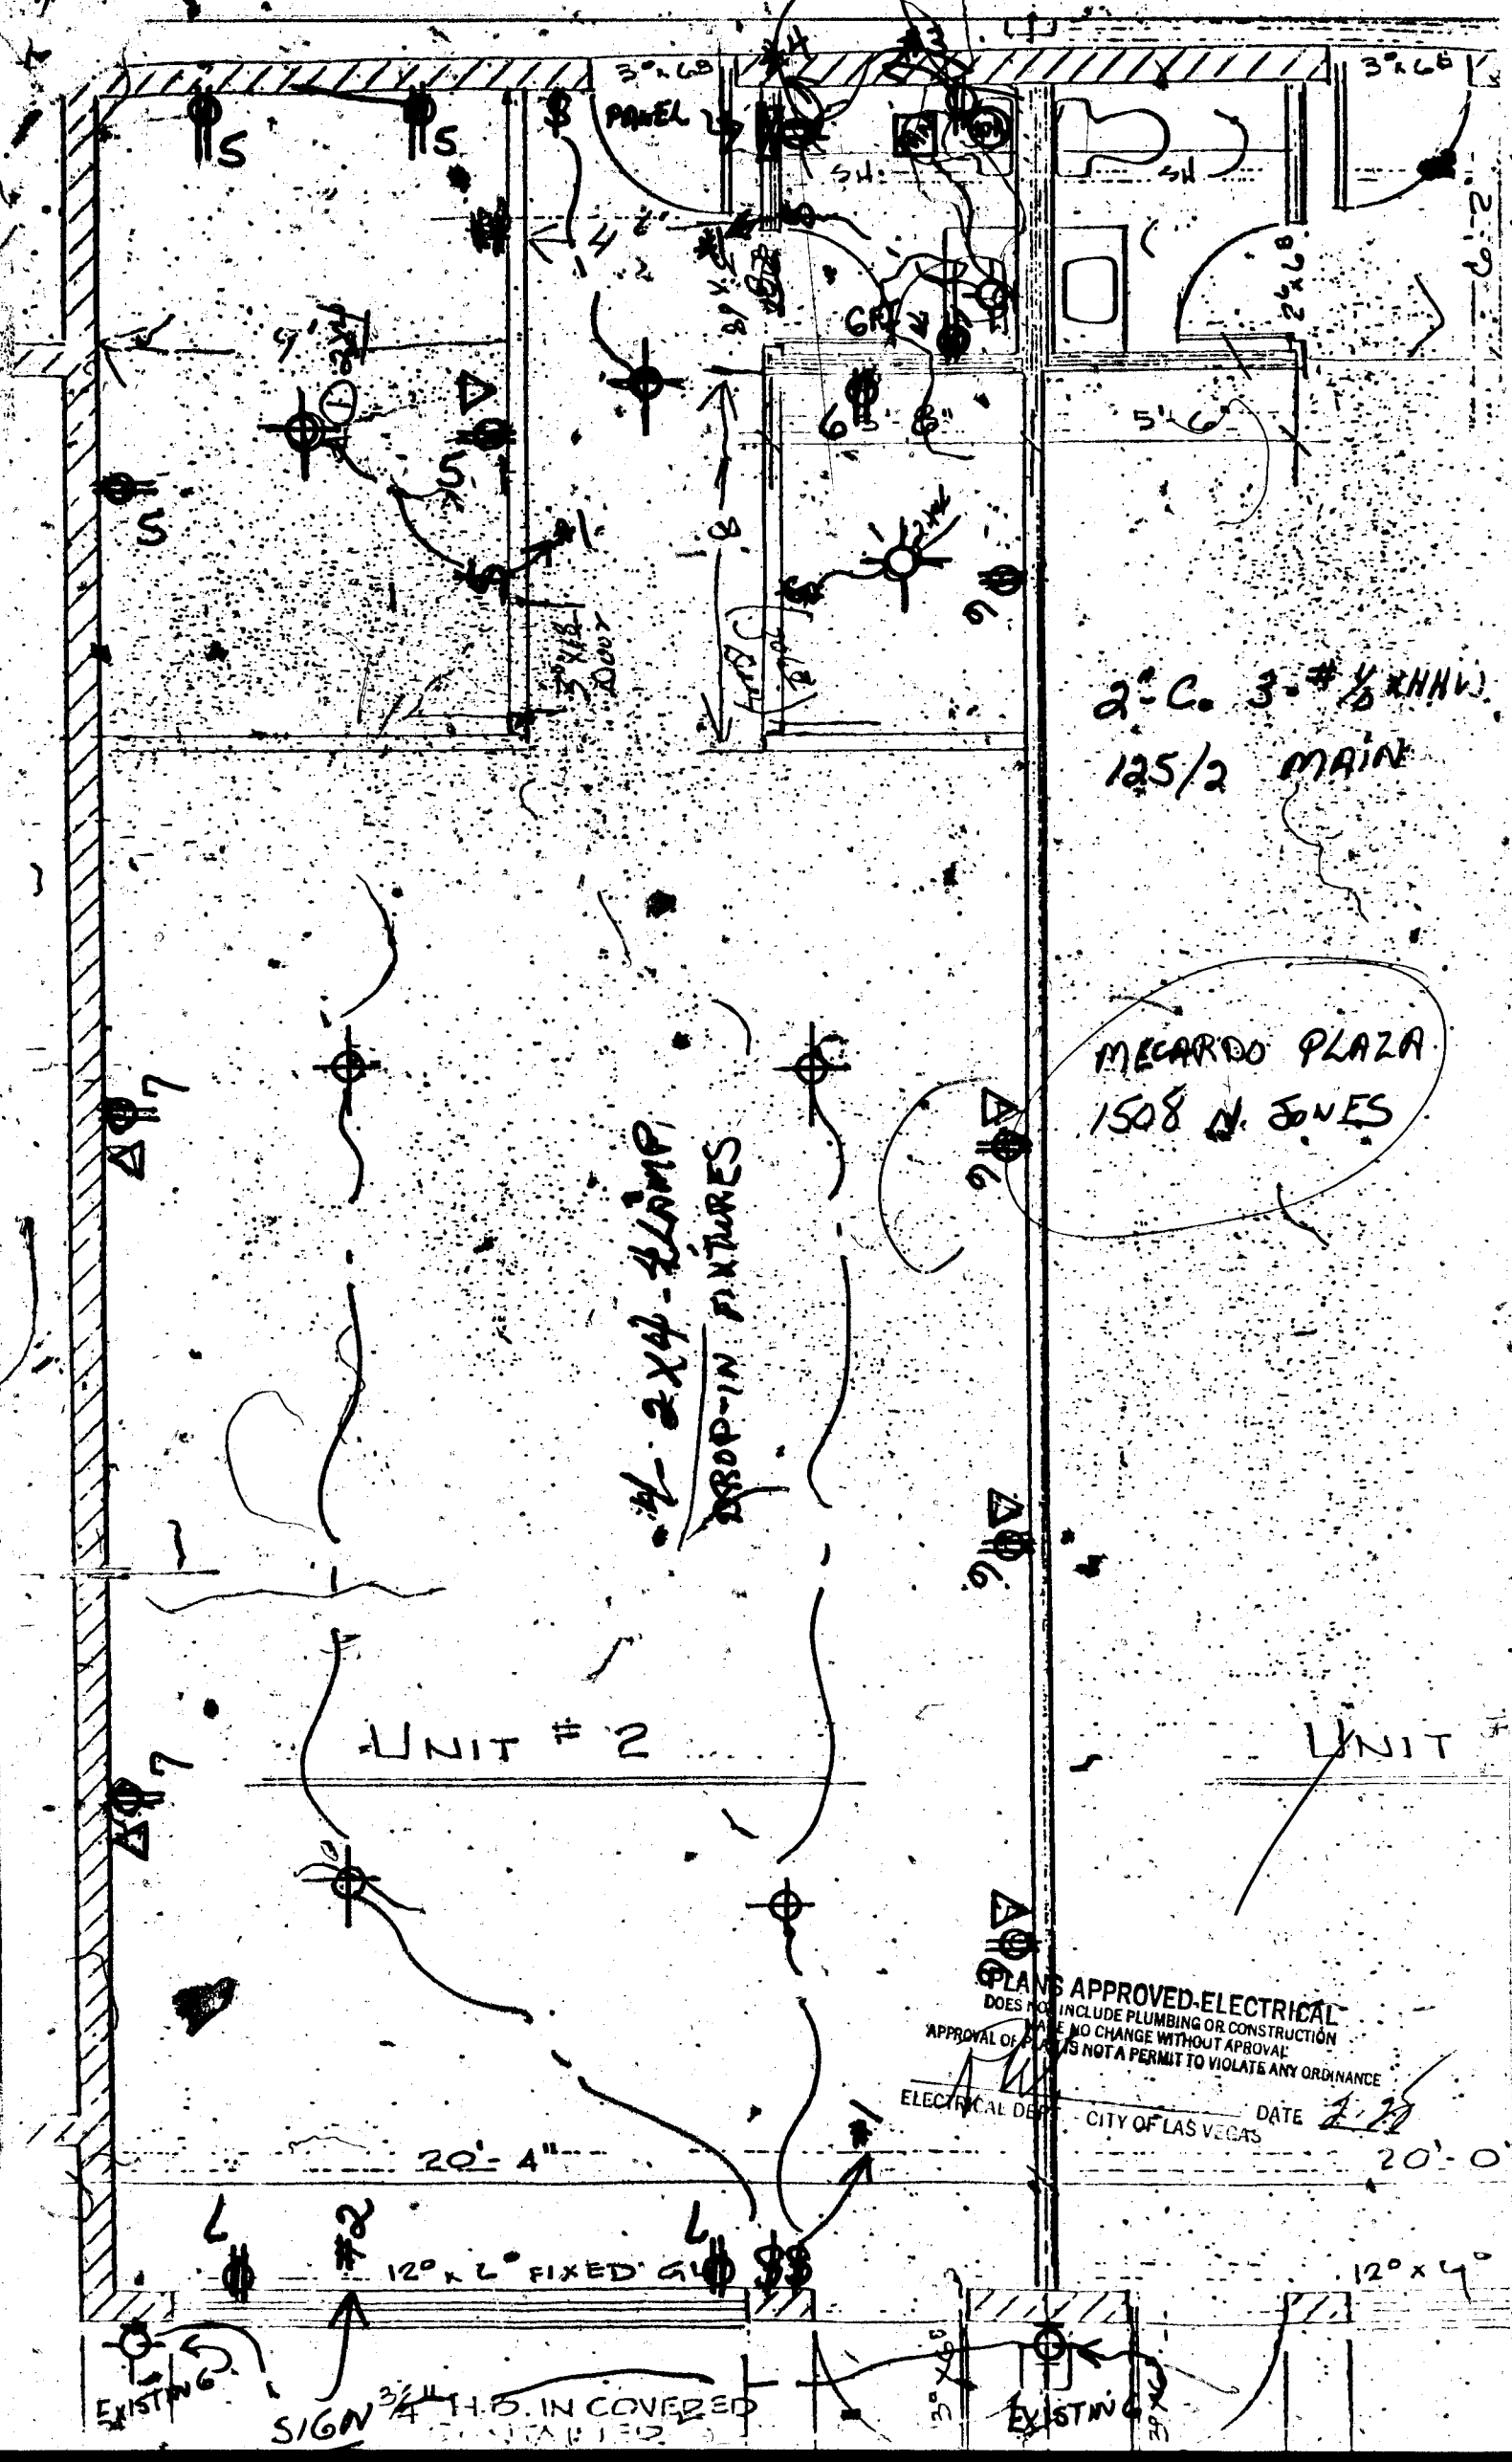

2-C. 3-# 1/8 XHHW
125/2 MAIN

MECARDO PLAZA
1508 N. JONES

4- 2x4-4 AMP
DROP-IN FIXTURES

UNIT # 2

UNIT #

PLANS APPROVED-ELECTRICAL
DOES NOT INCLUDE PLUMBING OR CONSTRUCTION
MADE NO CHANGE WITHOUT APPROVAL
APPROVAL OF PLANS NOT A PERMIT TO VIOLATE ANY ORDINANCE
ELECTRICAL DEPT. CITY OF LAS VEGAS DATE 2-22

EXISTING
SIGN 3'-4" H.B. IN COVERED
12'-0" x 4'-0"

EXISTING

200 A. 10 MLO MAIN 125 AMP.			
CIR. NO.	DISC.	L-1	L-2
1	LIGHTS	1,265	
2	SIGN - FRONT LIGHTS	700	
3	WATER HEATER		1500
4	RECPTS. TELE.		180
5	RECPTS.	720	
6	RECPTS.	900	
7	RECPTS.		720
8	A.C. UNIT.		2990
9	SPACE	-	
10	A.C. UNIT.	1290	
11	SPACE		
12	SPACE		

6575. 5390.

$$11,965 \times 1.25 = 14,956 \text{ watts} \div 230 \text{V} = 65 \text{ AMP.}$$

PLANS APPROVED-ELECTRICAL
 DOES NOT INCLUDE PLUMBING OR CONSTRUCTION
 MAKE NO CHANGE WITHOUT THE
 APPROVAL OF THE PERMITTING AGENCY
 ELECTRICAL DEPT.

2.25

