



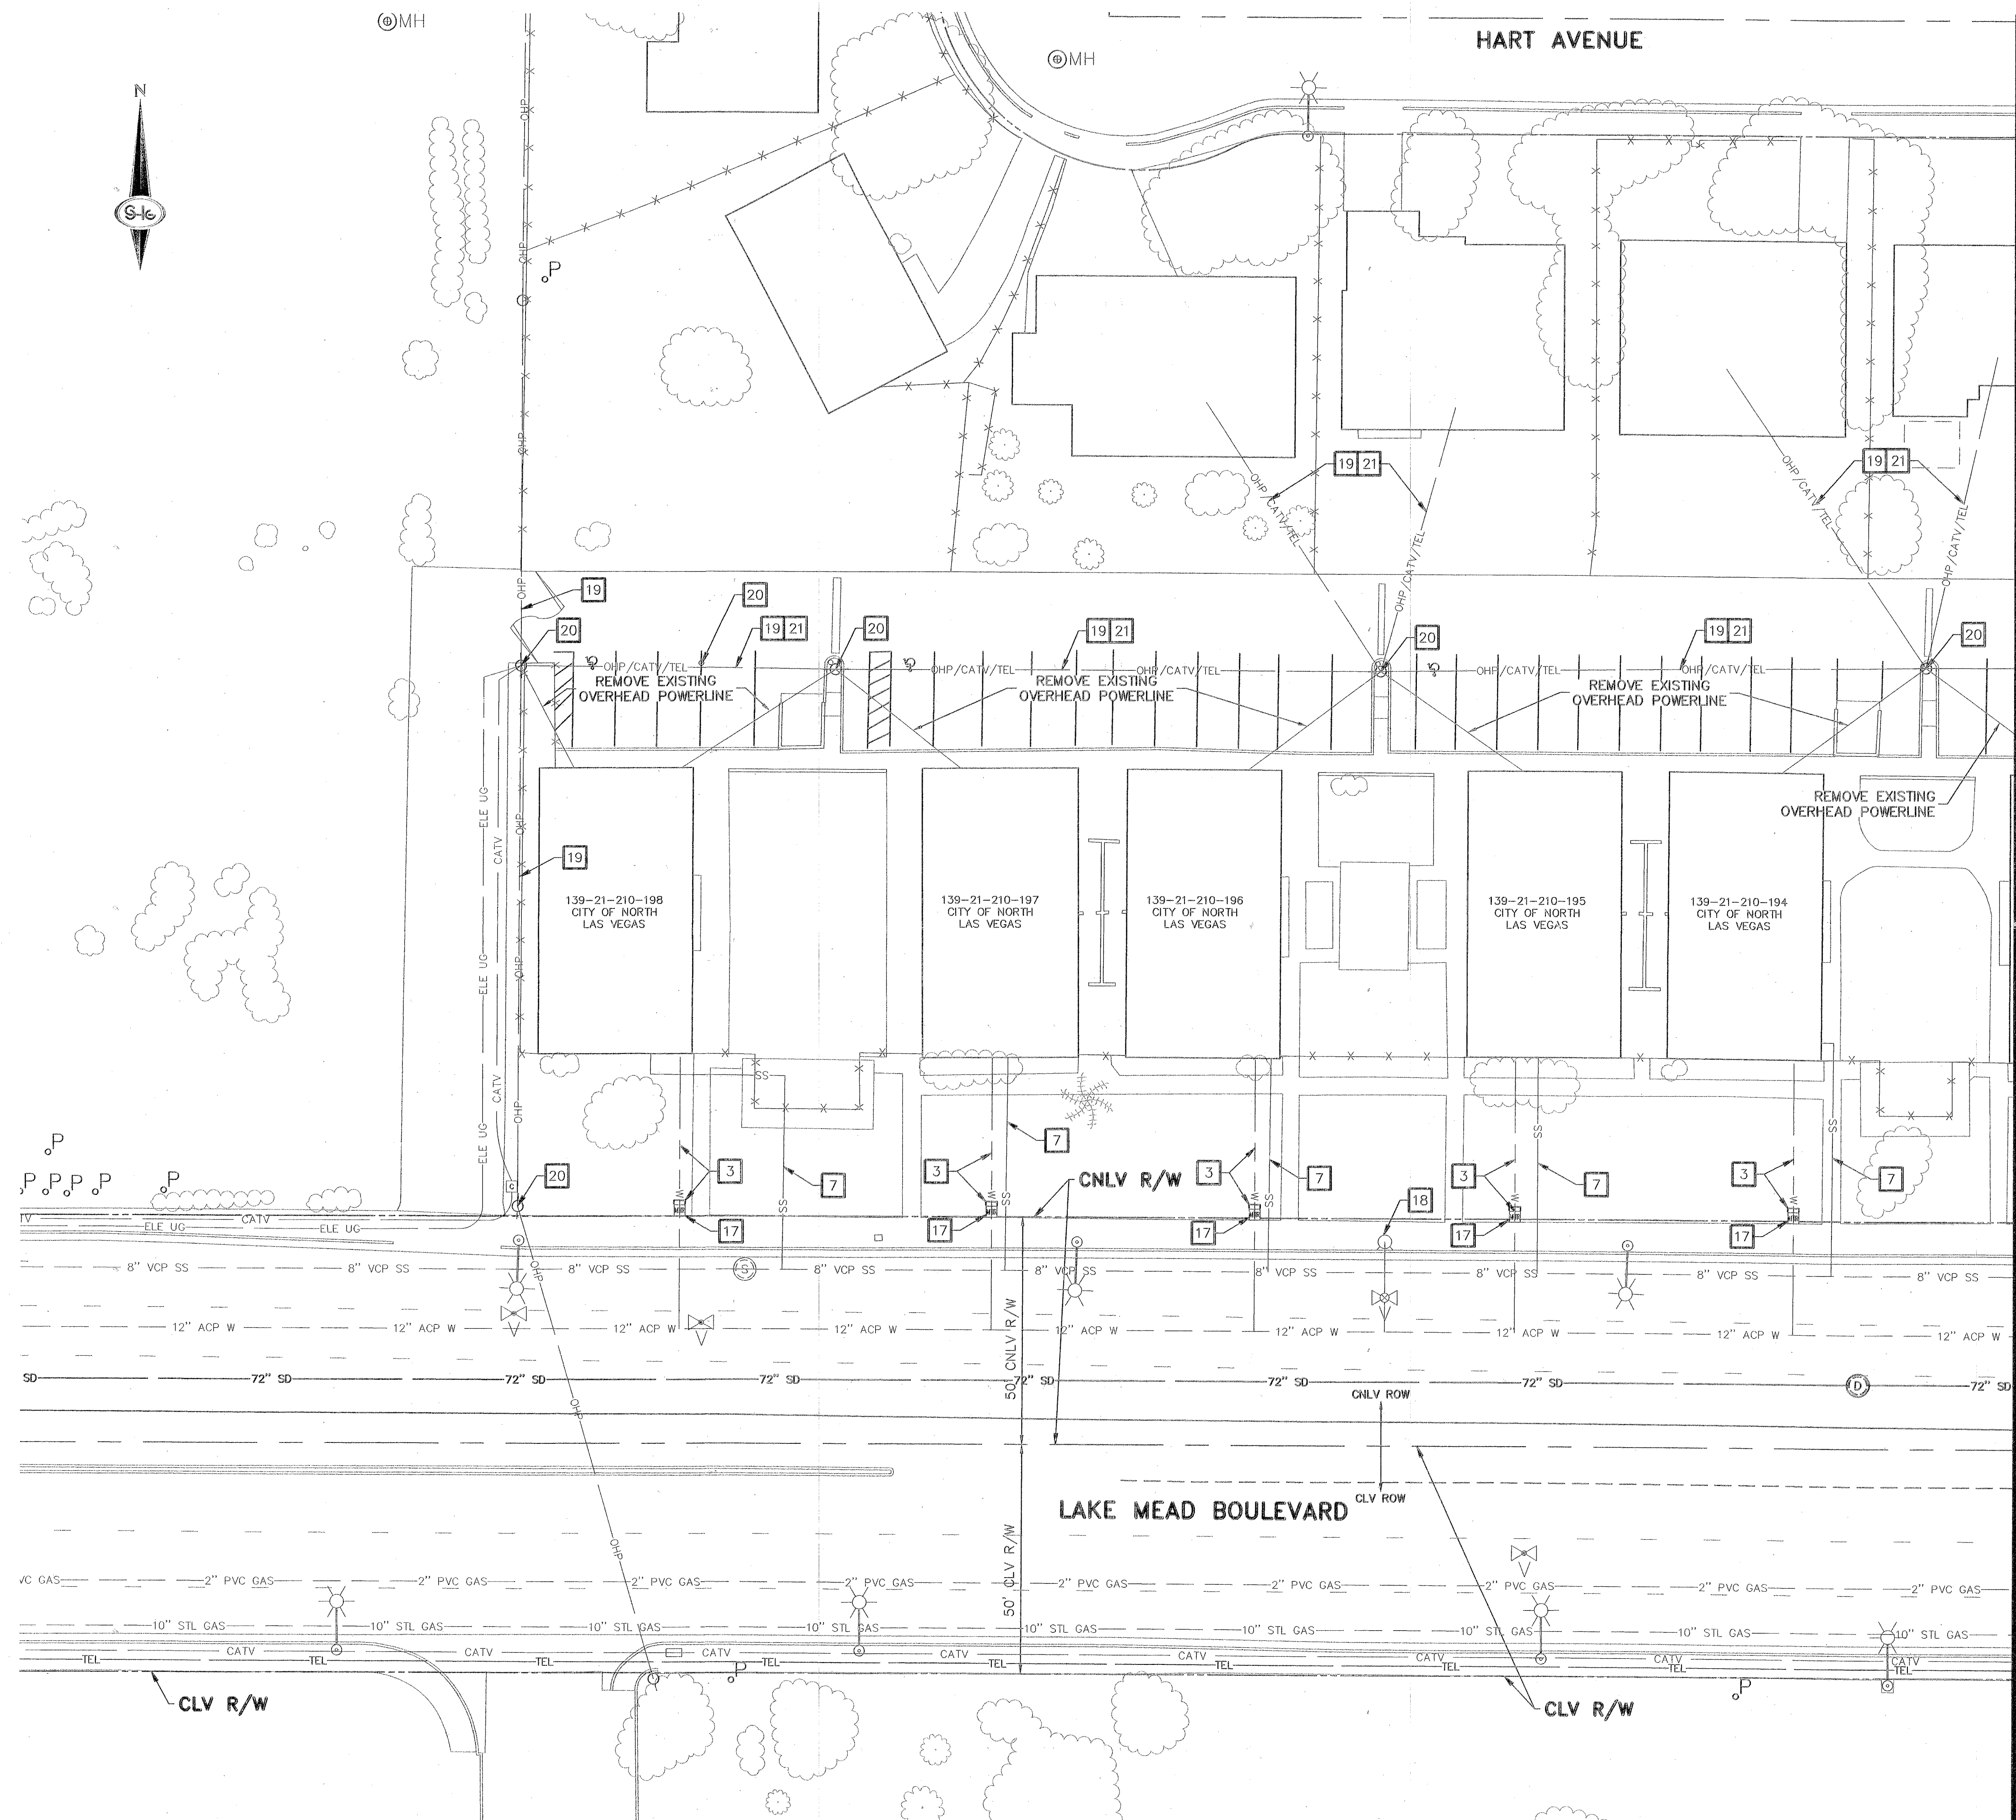

UTILITY NOTES	
1	NOT USED
2	NOT USED
3	CUT, CAP, AND REMOVE EXISTING WATER LATERAL, SEE DETAIL B, SHEET D-01
4	NOT USED
5	REMOVE AND SALVAGE WATER VALVE
6	NOT USED
7	REMOVE EXISTING SANITARY SEWER LATERAL, INSTALL AND SEAL CAP WYE AT MAINLINE.
8	NOT USED
9	NOT USED
10	NOT USED
11	NOT USED
12	NOT USED
13	REMOVE EXISTING 8-INCH DOUBLE CHECK DETECTOR
14	REMOVE FIRE HYDRANT ASSEMBLY
15	NOT USED
16	NOT USED
17	PROTECT WATER METER IN PLACE
18	PROTECT FIRE HYDRANT IN PLACE
19	PROTECT OVERHEAD POWER LINE IN PLACE
20	PROTECT POWER POLE IN PLACE
21	PROTECT OVERHEAD CATV LINE IN PLACE
22	REMOVE 6" PVC WATER LINE
23	REMOVE 8" PVC WATER LINE
24	ABANDON WATER VALVE PER UDACS SECTION 2.11.07

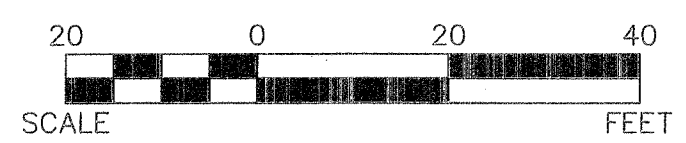

CITY OF NORTH LAS VEGAS - DEPARTMENT OF PUBLIC WORKS - ENGINEERING SERVICES DIVISION

BUENA VISTA SPRINGS II DEMOLITION
CITY OF NORTH LAS VEGAS