




MARK	QUANTITY	DESCRIPTION	BILL OF MATERIAL
①	2 EA.	ELECTRO-MECH. COMPONENTS, INC. (DOUBLE BARRIER) SQUARE PUSH BUTTON SWITCH, CAT. NO. 674-2128-LB11C-W (CLOSED TO READ: "LAMP TEST")	
②	4 EA.	ELECTRO-MECH. COMPONENTS, INC. (DOUBLE BARRIER) SQUARE LIGHTED PUSH BUTTON SWITCH, CAT. NO. 674-2128-LB12C (TOP HALF); CLOSED (BOTTOM HALF).	
③	30 EA.	ELECTRO-MECH. COMPONENTS, INC. (SINGLE BARRIER) SQUARE LIGHTED PUSH BUTTON SWITCH, CAT. NO. 674-2128-LB12C-W/RE, 60-DS LAMPS (LEGEND PLATE TO READ: OPEN (TOP HALF); CLOSED (BOTTOM HALF)).	
④	2 EA.	WESTINGHOUSE ELECTRIC CO. REMOVABLE KEY, OVAL HANDLE, MAINTAINED W-2 CONTACT SWITCH; NO. 505A047601; KEY REMOVABLE IN "12" POSITION.	
⑤	1 EA.	WESTINGHOUSE ELECTRIC CO. STAMPED NAMEPLATE NO. 502A05A405 STAMPED AS FOLLOWS: STAMP IS = MASTER 16 = CONTROL SWITCH 17 = DAILY PANEL (55-1)	
⑥	1 EA.	WESTINGHOUSE ELECTRIC CO. STAMPED NAMEPLATE NO. 502A05A405 STAMPED AS FOLLOWS: STAMP IS = MASTER 16 = CONTROL SWITCH 17 = DAILY PANEL (55-1)	
⑦	1 EA.	ELECTRO-MECH. COMPONENTS, INC. (DOUBLE BARRIER) SQUARE LIGHTED PUSH BUTTON SWITCH, CAT. NO. 674-2129-LB11C-W (LEGEND PLATE TO READ: "ALL GROUPS RESET")	
⑧	1 EA.	ELECTRO-MECH. COMPONENTS, INC. (DOUBLE BARRIER) SQUARE LIGHTED PUSH BUTTON SWITCH, CAT. NO. 647-2128-LB11C-W/RE, 60-DS LAMPS (LEGEND PLATE TO READ: RUN)	
⑨	1 EA.	ELECTRO-MECH. COMPONENTS, INC. (SINGLE BARRIER) SQUARE LIGHTED PUSH BUTTON SWITCH, CAT. NO. 684-2127-LB11C-W/60-DS LAMPS (LEGEND PLATE TO READ: STOP)	
⑩	1 EA.	SAME AS MARK NO. 8, EXCEPT LEGEND PLATE TO READ: OPEN	
⑪	1 EA.	SAME AS MARK NO. 9 EXCEPT LEGEND PLATE TO READ: CLOSE	
⑫	1 EA.	SAME AS ③ EXCEPT PUSHBUTTON NOT USED (DISPLAY ONLY)	

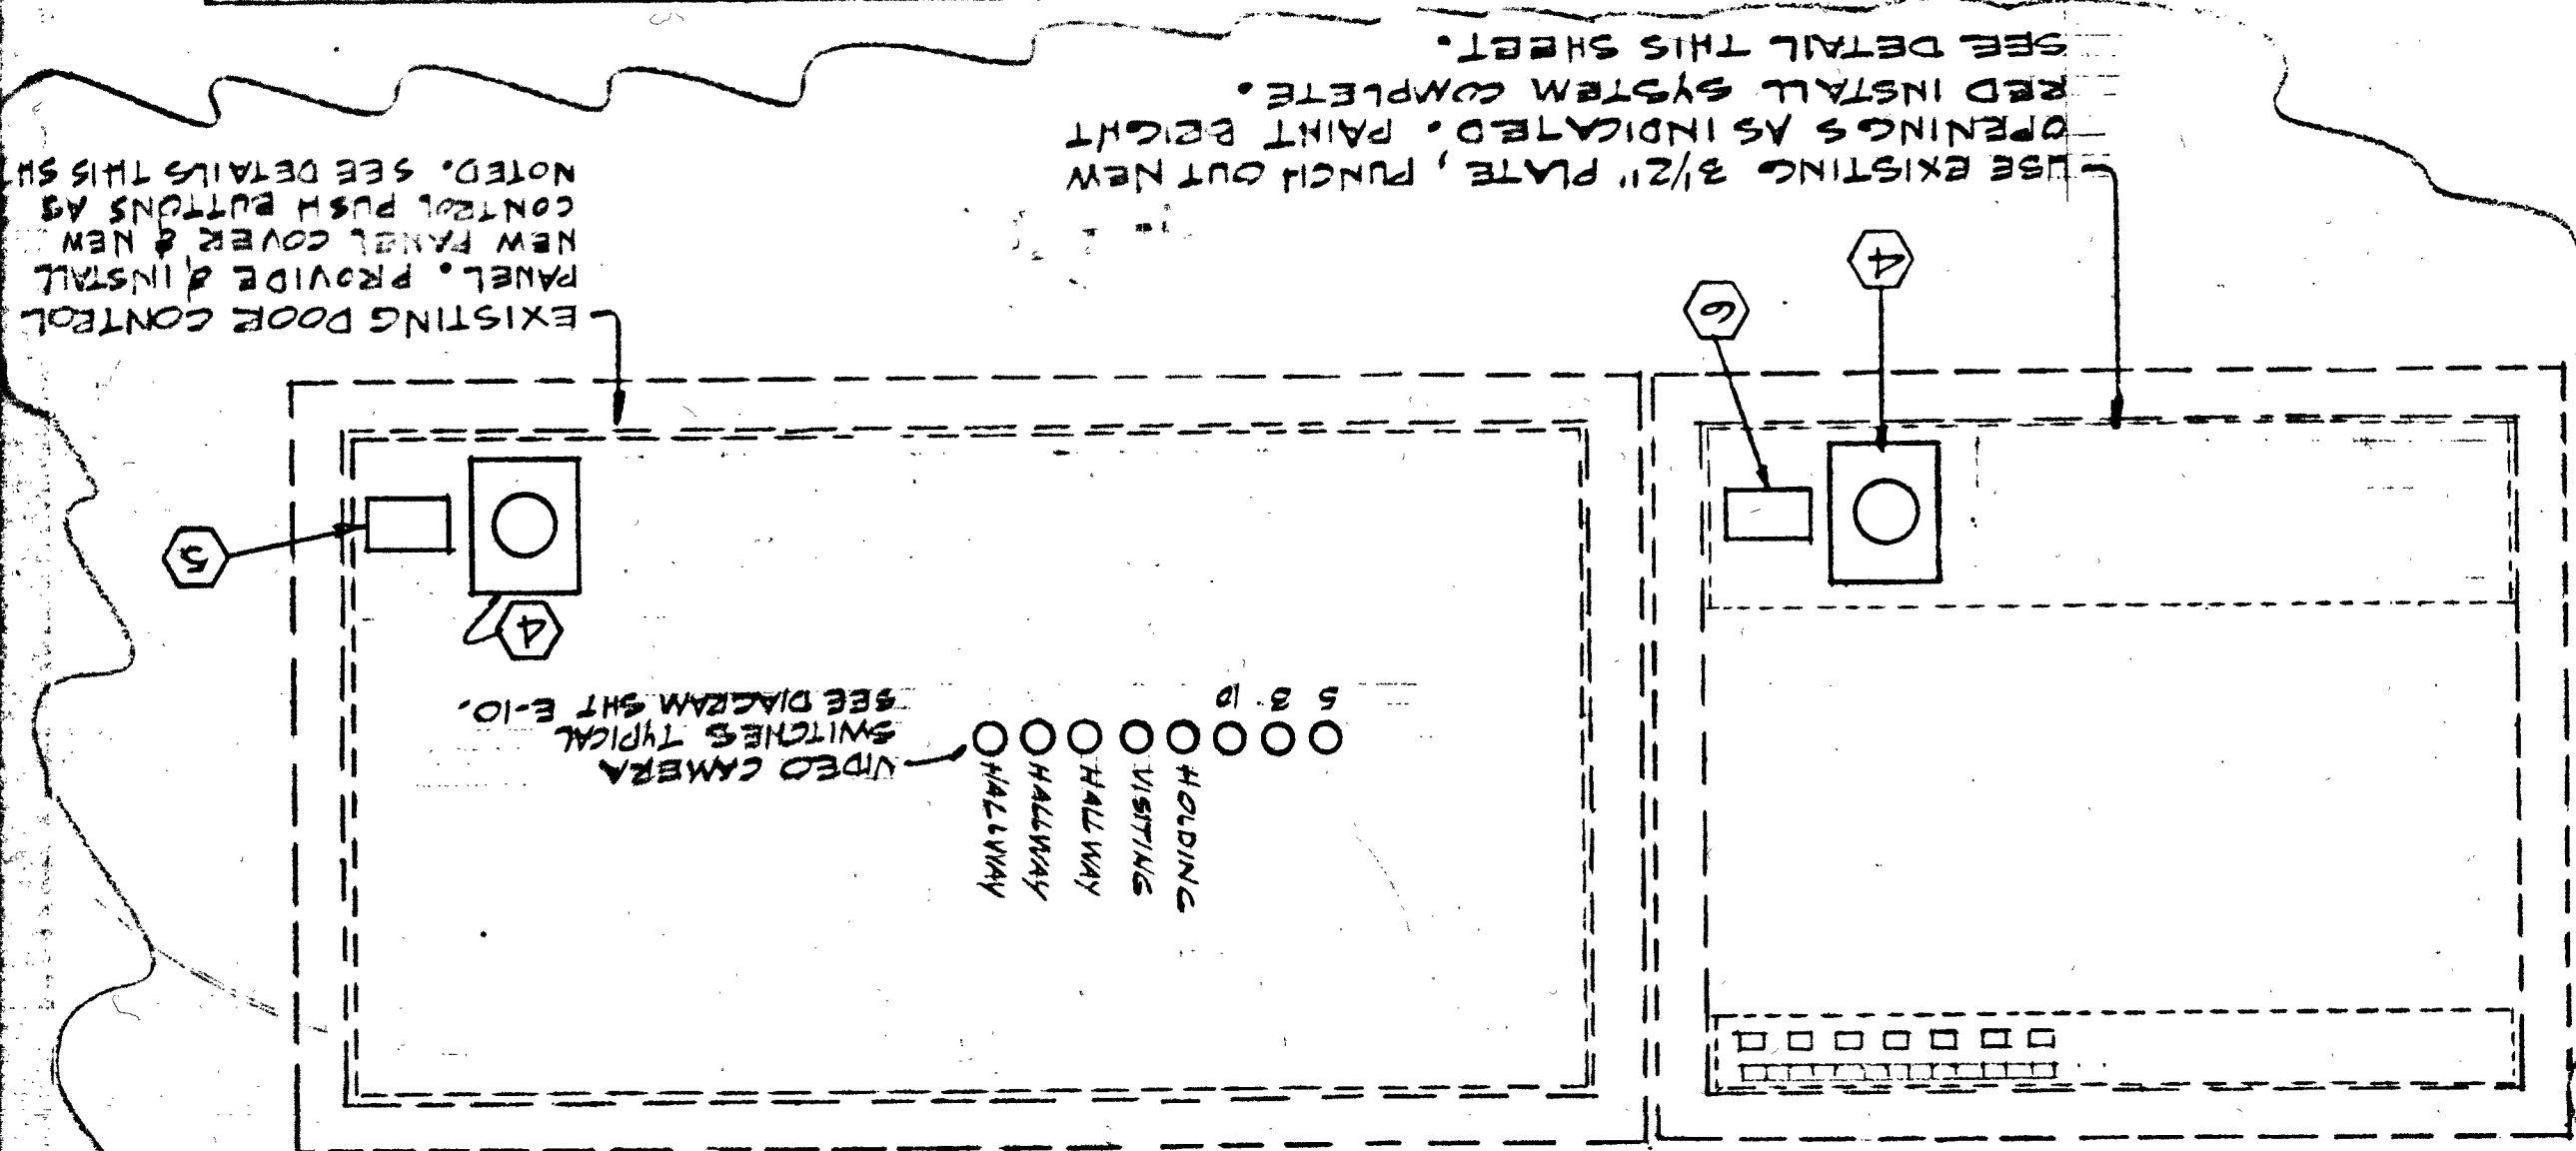


NOTE: ALL ELECTRICAL OPERATING DOOR LOCKS FOR EMERGENCY OPERATION SHALL HAVE CONTINUOUS BATTERY BACKUP. INDICATION FOR DOOR LOCKS, 2" & LATCH LOCK.

USE EXISTING 3/2" PLATE, PUNCH OUT NEW OPENING AS INDICATED. PAINT BRIGHT RED INSIDE SYSTEM COMPLETE. SEE DETAIL THIS SHEET.


EXISTING DOOR CONTROL PANEL. PROVIDE & INSTALL NEW PANEL COVER & NEW CONTROL PUSH BUTTON AS NOTED. SEE DETAILS THIS SHEET.

NOTE: ELECTRICAL CONTRACTOR SHALL COORDINATE THE EXACT DOOR CONTROL NUMBERS WITH THE OWNERS REP. AND L.A.M.B.D. DIRECTOR OF DETENTION FACILITIES PRIOR TO ANY INSTALLATION OR FABRICATION. SUBMIT SHOP DRAWINGS FOR APPROVAL BY ABOVE.

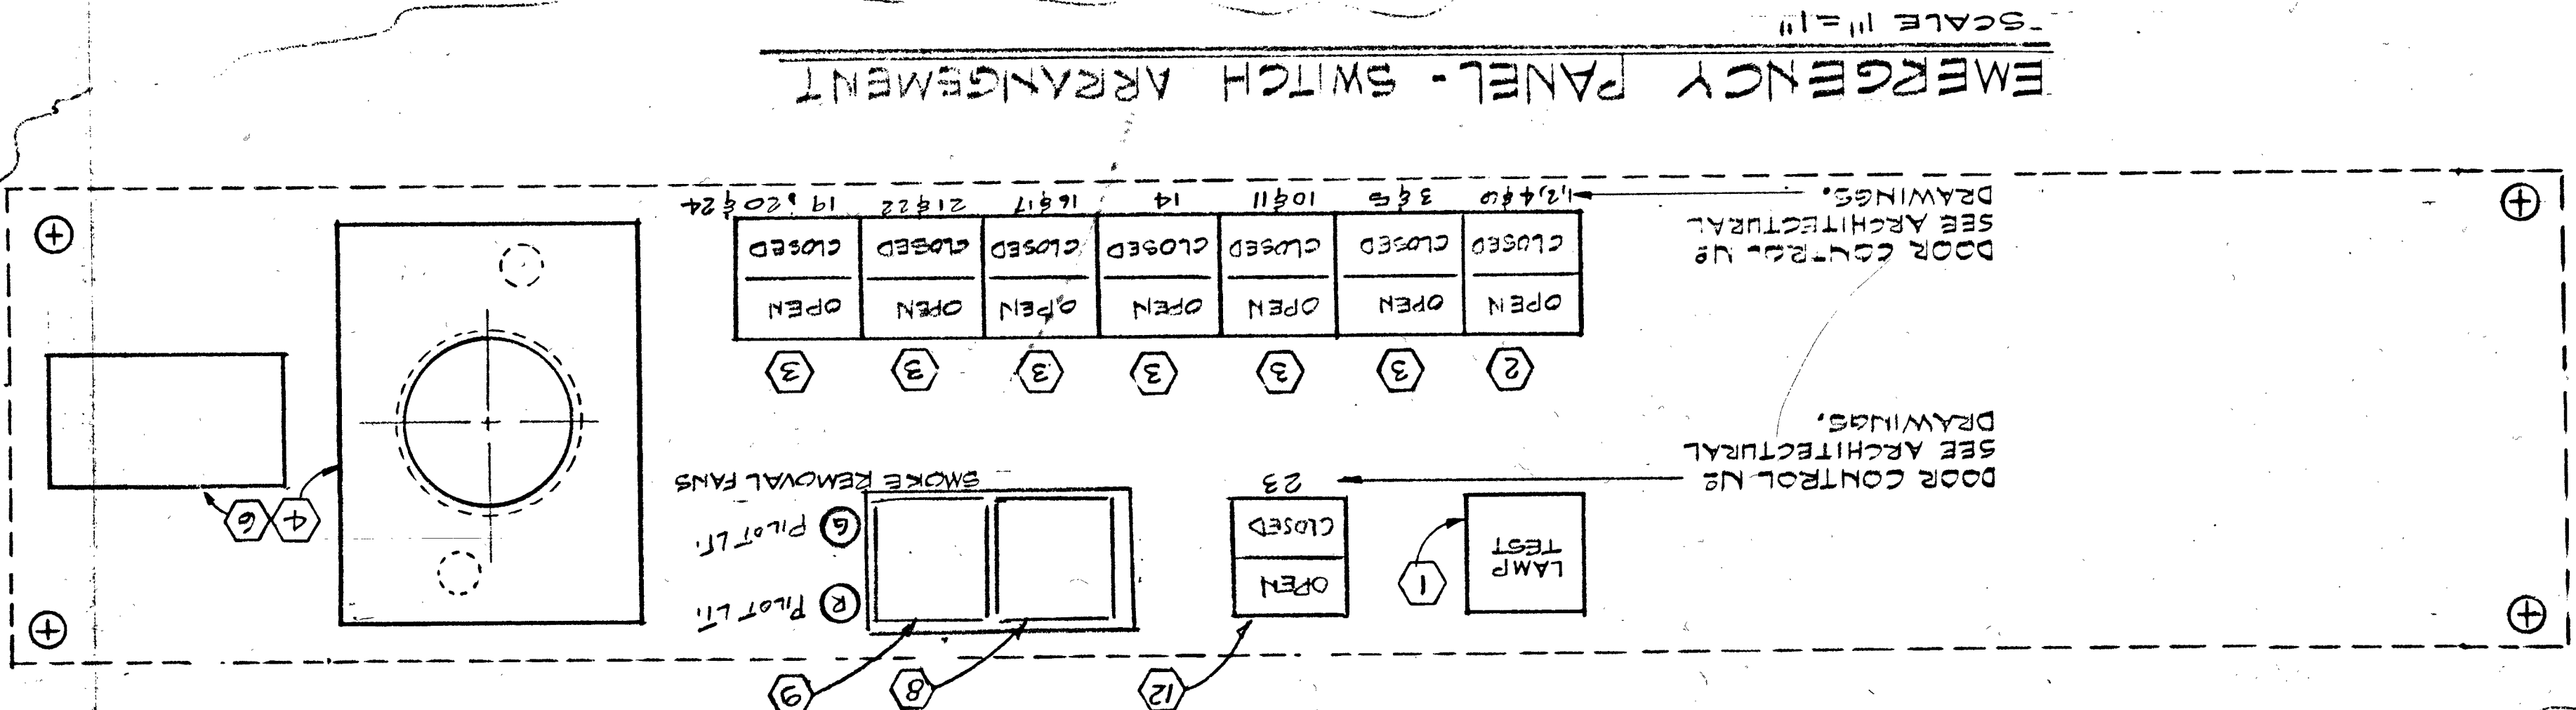

EMERGENCY PANEL - SWITCH ARRANGEMENT

- DOOR 5
- DOOR 3
- DOOR 10
- HOLDING
- VISITING
- HALLS
- HALLS
- HALLS
- VIDEO CAMERA SWITCHES
- VERIFY NUMBER REQUIRED

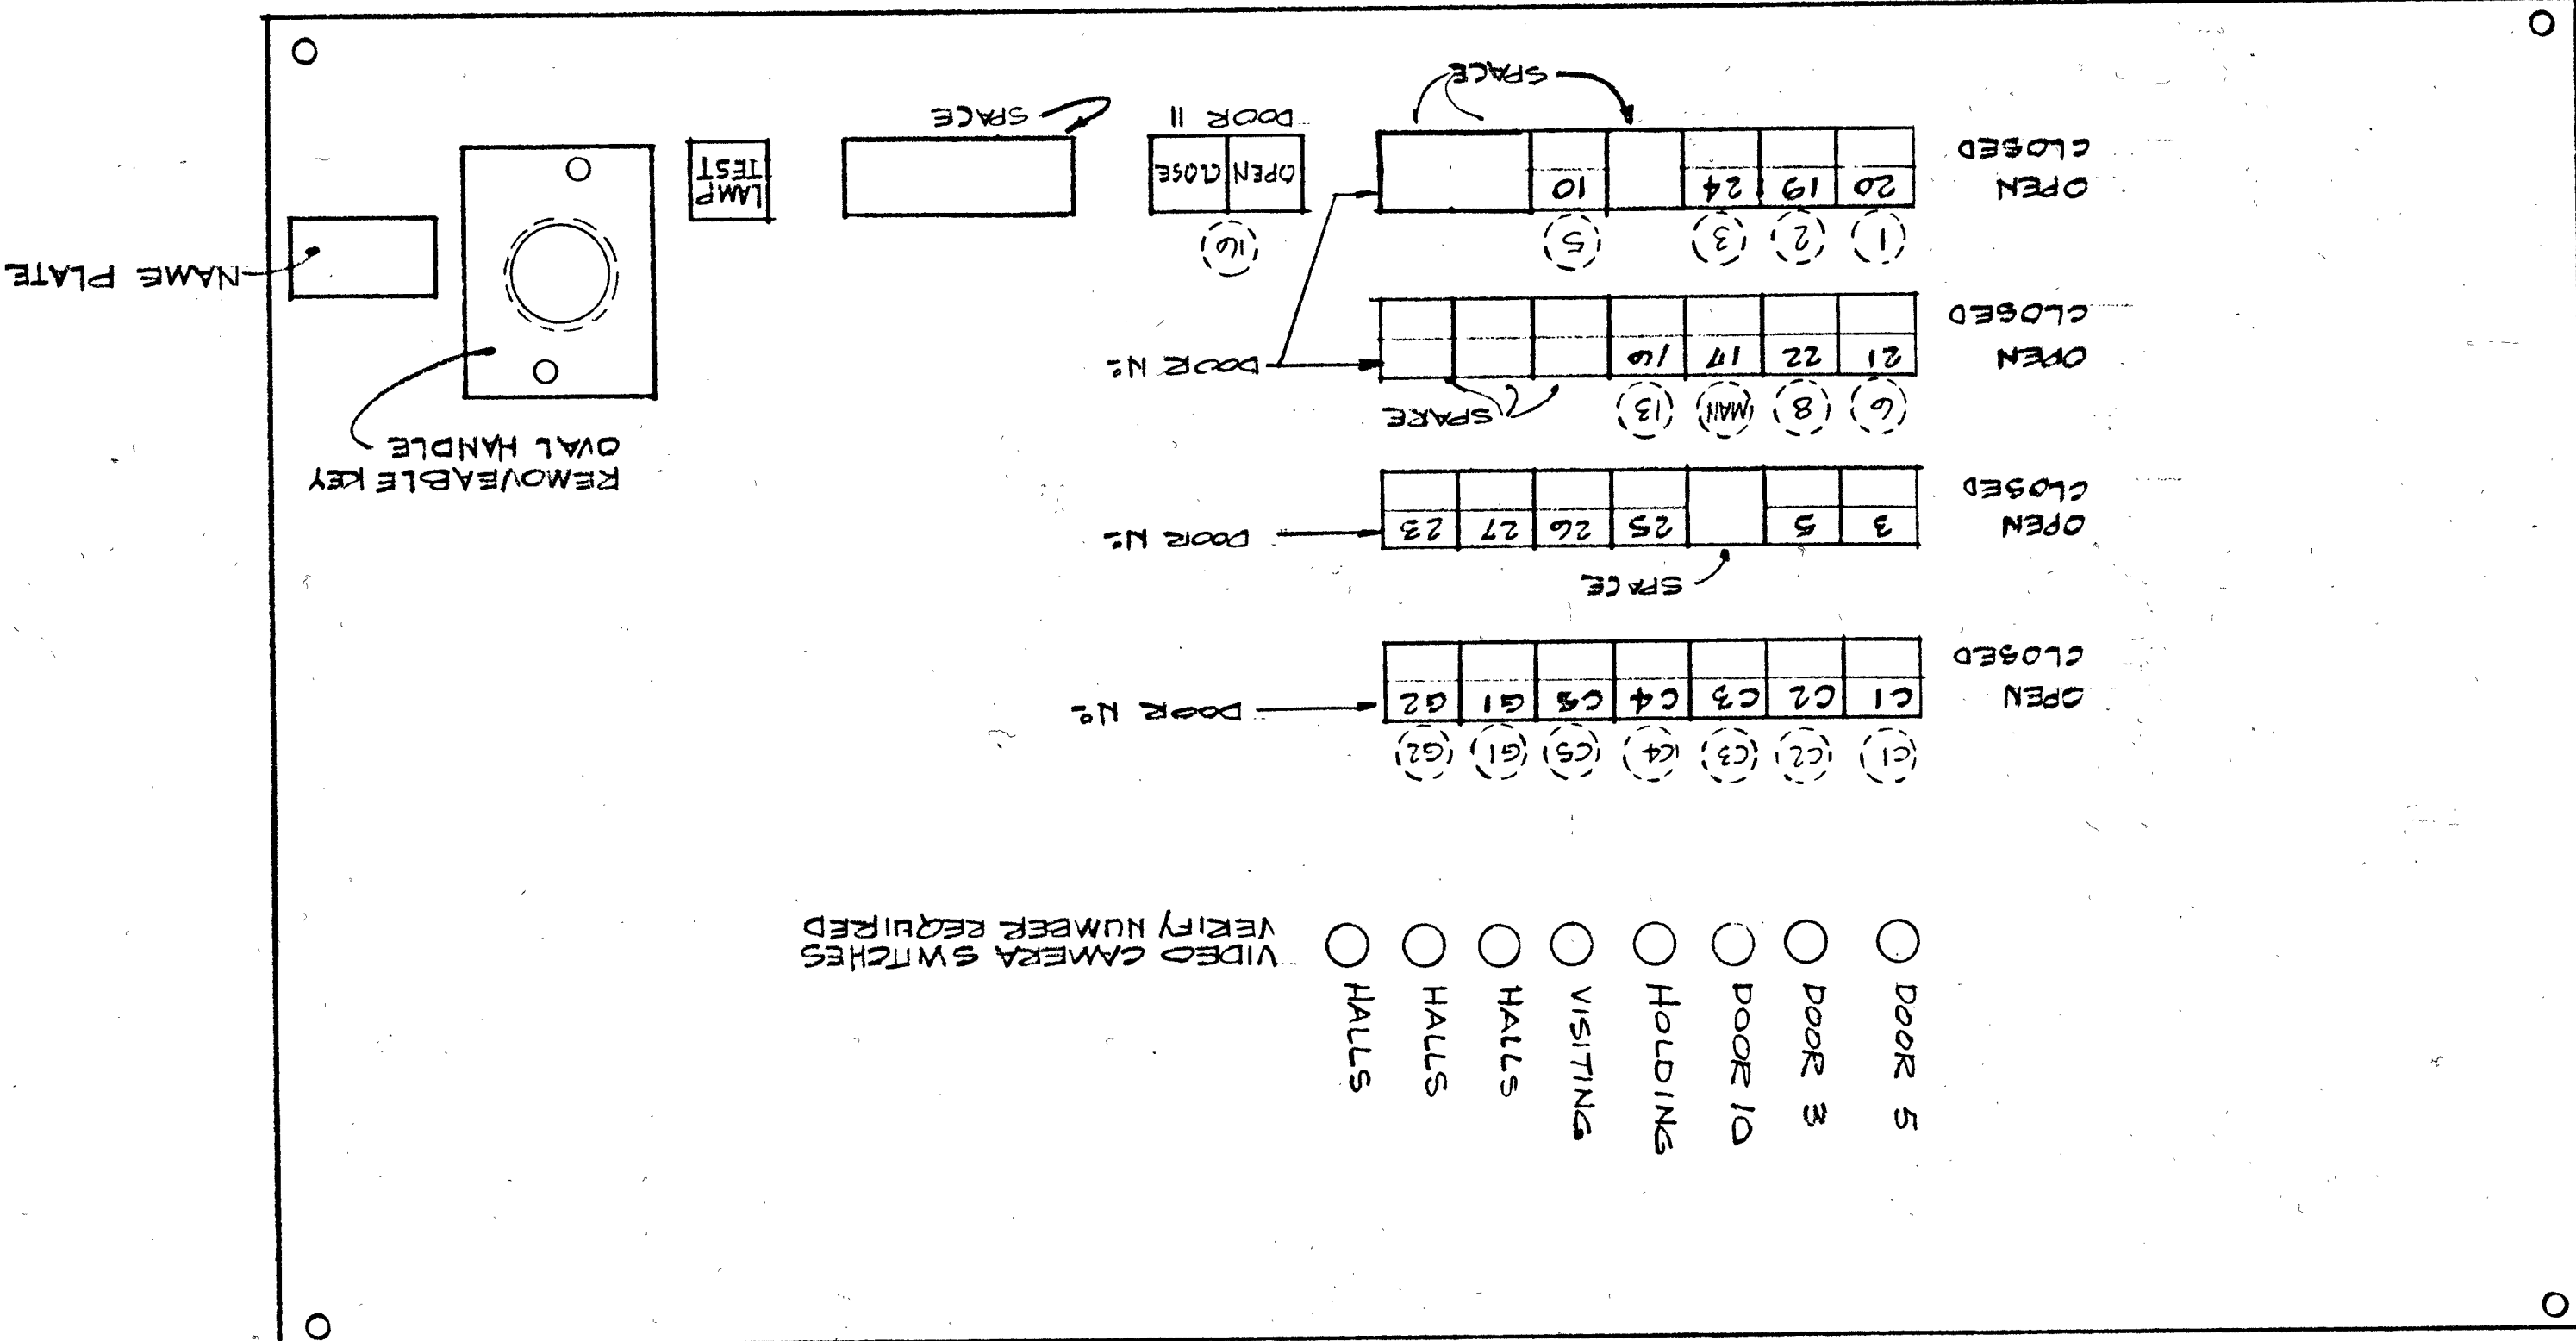

DAILY PANEL - SWITCH ARRANGEMENT