


PROJECT LOCATION

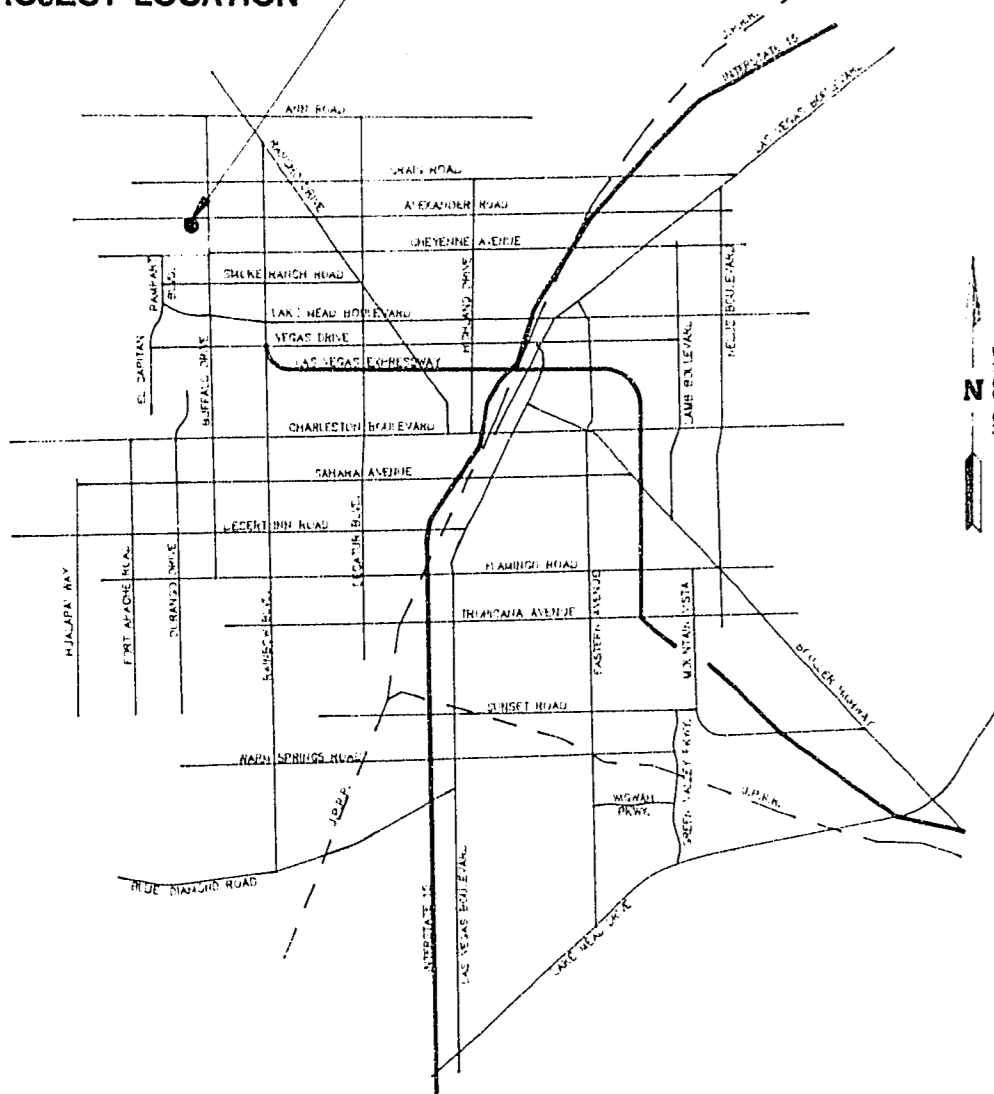

QUANTITY ESTIMATE

- 200 WATT H.P.S. LUMINAIRE 7 EA
- 100 WATT H.P.S. LUMINAIRE 16 EA
- 11 GA. LIGHT STANDARD 16 EA
- 1-1/4" PVC CONDUIT 3115 LF
- #3-1/2 PULL BOX 7 EA
- ⊕ NEW SERVICE POINT 1 EA
- STOP SIGN - R-1(36") 4 EA
- ▽ YIELD SIGN - R1-2 X EA
- ⊥ STREET SIGN 5 EA

NOTE: THESE QUANTITIES ARE ESTIMATES ONLY, CONTRACTOR TO VERIFY.



VICINITY MAP



FUTURE CIMARRON MEADOWS UNIT 2

UNDEVELOPED

Call before you Dig.
1-800-227-2600
UNDERGROUND SERVICE (USA)

BENCHMARK

1LV00101WA
2" ALUMINUM DISK IN THE N.E. CORNER OF A TRANSFORMER PAD AT THE S.W. QUADRANT OF GOWAN ROAD AND BUFFALO DRIVE
ELEVATION = 2348.65

CITY OF LAS VEGAS STREET LIGHT NOTE

ALL STREET LIGHTING INSTALLATIONS SHALL CONFORM TO THE LATEST ISSUE OF THE STANDARD DETAIL AND SPECIFICATIONS OF THE CITY OF LAS VEGAS, AND SHALL ALSO CONFORM TO THE UNIFORM STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION OF OFF-SITE IMPROVEMENTS, CLARK COUNTY AREA, LATEST EDITION, UNLESS OTHERWISE NOTED. ALL HAND HOLE COVERS MUST BE INSTALLED, POLE CAPS POURED AND PULL BOX LIDS BOLTED DOWN PRIOR TO ENERGIZING CIRCUIT. ALL WIRE MUST HAVE THW INSULATIONS.


NOTE

EXISTING UTILITY LOCATIONS SHOWN HEREIN ARE APPROXIMATE ONLY. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE EXACT VERTICAL AND HORIZONTAL LOCATION OF ALL EXISTING UNDERGROUND UTILITIES PRIOR TO COMMENCING CONSTRUCTION. NO REPRESENTATION IS MADE THAT ALL EXISTING UTILITIES ARE SHOWN HEREON. THE ENGINEER ASSUMES NO RESPONSIBILITY FOR UTILITIES NOT SHOWN OR UTILITIES NOT SHOWN IN THEIR PROPER LOCATION.

APPROVAL

Sharon McShea for Curt Lambert 2.3.94
NEVADA POWER COMPANY
THIS APPROVAL IS ONLY FOR THE PLACEMENT AND CLEARANCE OF STREET LIGHT AND SIGNAL LIGHT INSTALLATIONS.

MASTER STREET LIGHT PLAN
CIMARRON MEADOWS UNIT 1

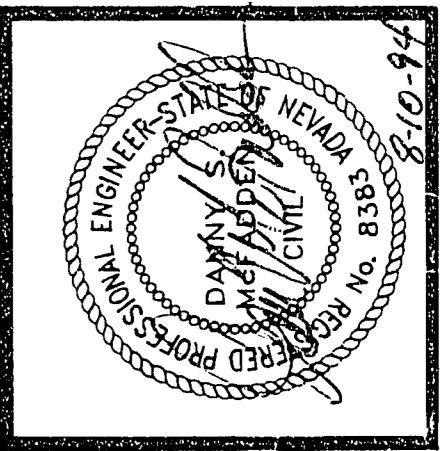

ESI ENGINEERS AND SURVEYORS INC
1100 W. 2000 S. SUITE 100 • LAS VEGAS, NEVADA 89117 • (702) 245-6415
NO. # 1: 844-B490
BY: SLH
DATE: AUGUST 1994
SCALE: 1" = 50'
SHEET 14 OF 20

APPROVAL	DATE	BY	REVISION
	1-10-21-94	P.L.L. PENNIP, ENGINEER	PRELIMINARY
	2-27-94	P.L.L. PENNIP, ENGINEER	REVISED PER COMMENTS
		P.L.L. PENNIP, ENGINEER	REVISED PER COMMENTS

20-60-09

11-13-79

207X-4365-1