



**PARTIAL 1<sup>ST</sup> FLOOR PLAN - LIGHTING & POWER.**  
 SCALE: 1/4" = 1'-0"

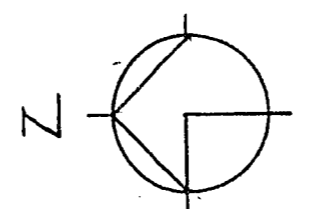

**NOTES**

- ① WIREWAY END CAP, UNISTRUT #P1280 W.
- ② WIREWAY SPLICE FITTINGS AS REQ'D., UNISTRUT #P3922.
- ③ JUNCTION BOX, UNISTRUT #P2810.
- ④ FIXTURES CIRCUITED FOR TWO-LEVEL LIGHTING OPERATION.
- ⑤ UNISTRUT WIREWAY W/6 #12 THHN CONDUCTORS (CKT 3A, 7 15).
- ⑥ UNISTRUT WIREWAY W/4 #12 THHN CONDUCTORS (CKT 3A, 15).
- ⑦ 30A/1P S/N FUSIBLE SAFETY SWITCH, NEMA 3R, W/(1) 17½A DUAL ELEMENT TIME DELAY FUSE.
- ⑧ PROVIDE NAMEPLATE FOR GANGED SWITCHES "EVAP COOLERS".
- ⑨ 30A/1P, S/N, FUSIBLE SAFETY SWITCH, NEMA 3R, W/(1) 10A DUAL ELEMENT TIME DELAY FUSE.
- ⑩ 30A, 250V, 2P/3W GROUNDING RECEPTACLE, NEMA 6 - 30R CONFIGURATION.
- ⑪ RECONNECT EXISTING RADIANT HEATER.
- ⑫ RECONNECT EXISTING UNIT HEATER.
- ⑬ CONDUIT CONNECTION TO UNISTRUT CHANNEL, #P2535.
- ⑭ UNISTRUT WIREWAY W/4 #12 THHN CONDUCTORS (CKT 5B, 7).
- ⑮ UNISTRUT WIREWAY W/6 #12 THHN CONDUCTORS (CKT 5C, 7, 13).
- ⑯ UNISTRUT WIREWAY W/4 #12 THHN CONDUCTORS (CKT 5C, 13).
- ⑰ MAINTENANCE RECEPTACLE ON ROOF.
- ⑱ SURFACE INSTALLATION OF RACEWAY & OUTLET BOX SYSTEM PERMITTED IN THIS SPACE.

CONTRACT DRAWING  
 JAN 12 1984

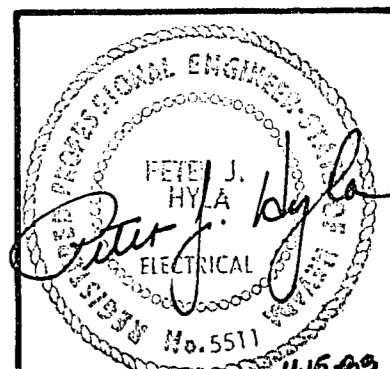

REVISIONS	

DESIGN: P.J. HYLA  
 DRAWN: S.F. TOTTEN  
 CHECK: P.J. HYLA  
 DATE:  

ELECTRICAL AND MECHANICAL ENGINEERS  
 NEVADA, CALIFORNIA, BRITISH COLUMBIA, ARIZONA  
 A PROFESSIONAL CORPORATION  
 DINTER ENGINEERING CO. LTD.  
 CONSULTING ENGINEERS

OFFICE: 958 WILLOW ST., SUITE 200  
 LAS VEGAS, NEVADA 89102  
 PHONE: (702) 389-9006  
 FAX: (702) 389-9109

BUILDING REMODEL AT  
 300 LAS VEGAS BLVD. N.  
 LAS VEGAS, NEVADA  
 ELECTRICAL - ADDITIVE ITEM I

JOB NO.    
 CONSEC. SHT. 43 OF 46  
 SHEET NO.  OF    
 11509