

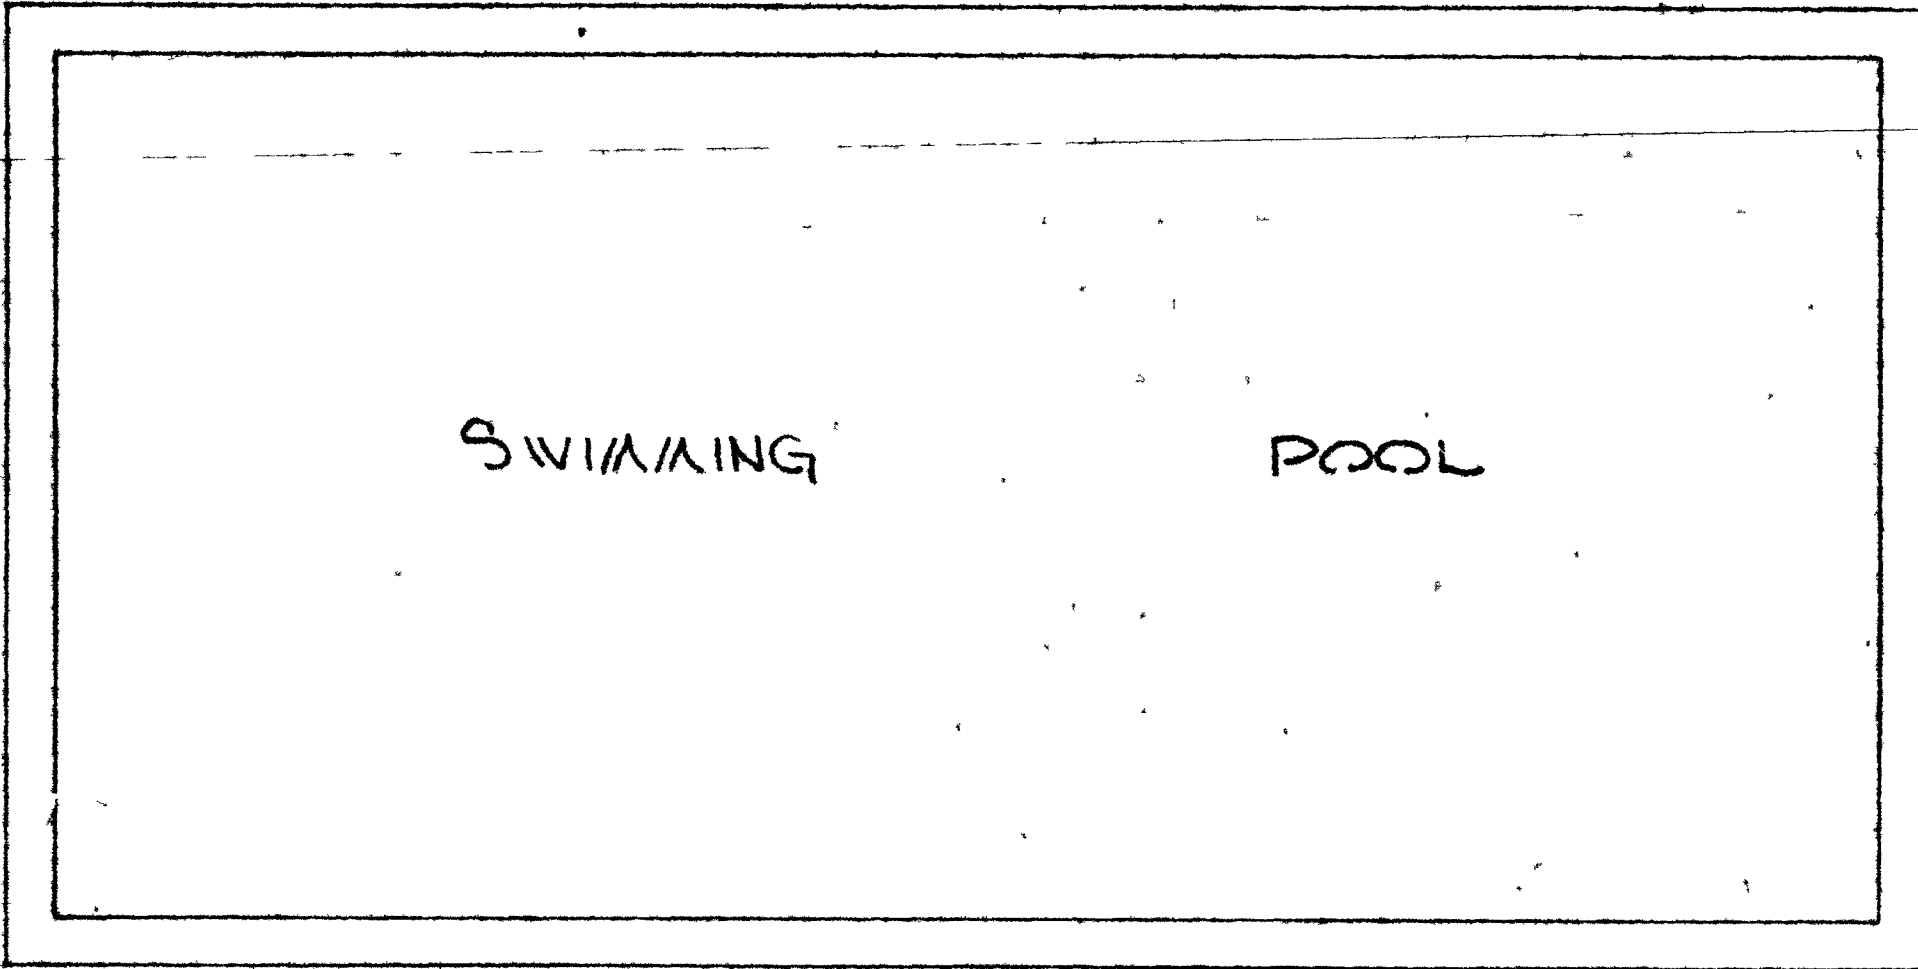


24-17-16

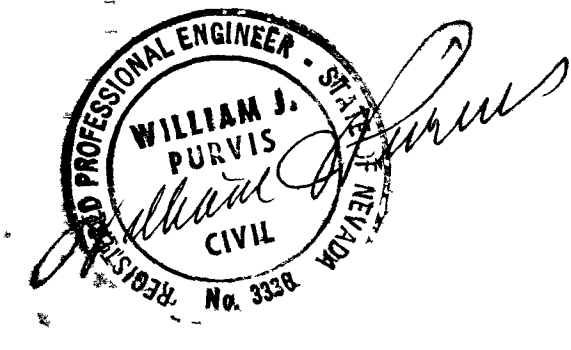


ROBERTSON VENTILATORS - CAT. NO. V-24
 UPWARD DISCHARGE. MOTOR SHALL BE OF
 STANDARD ENCAPSULATED BALL-BEARING TYPE
 IN NEMA TYPE FRAME AND SHALL HAVE THE
 FOLLOWING CHARACTERISTICS:
 1/4 H.P. @ 1/8" S.P., 1328 R.P.M., 120 VOLTS,
 1 PHASE UPWARD DISCHARGE VENTILATOR
 2155 C.F.M. w/ 12" x 12" DIFFUSERS.

HART & COOLEY OR APPROVED EQUAL CEILING
 GRILLE CAT. NO. CG-4, FOUR-WAY DEFLECTION
 GRILLE, NO VALVE (2) REQ'D

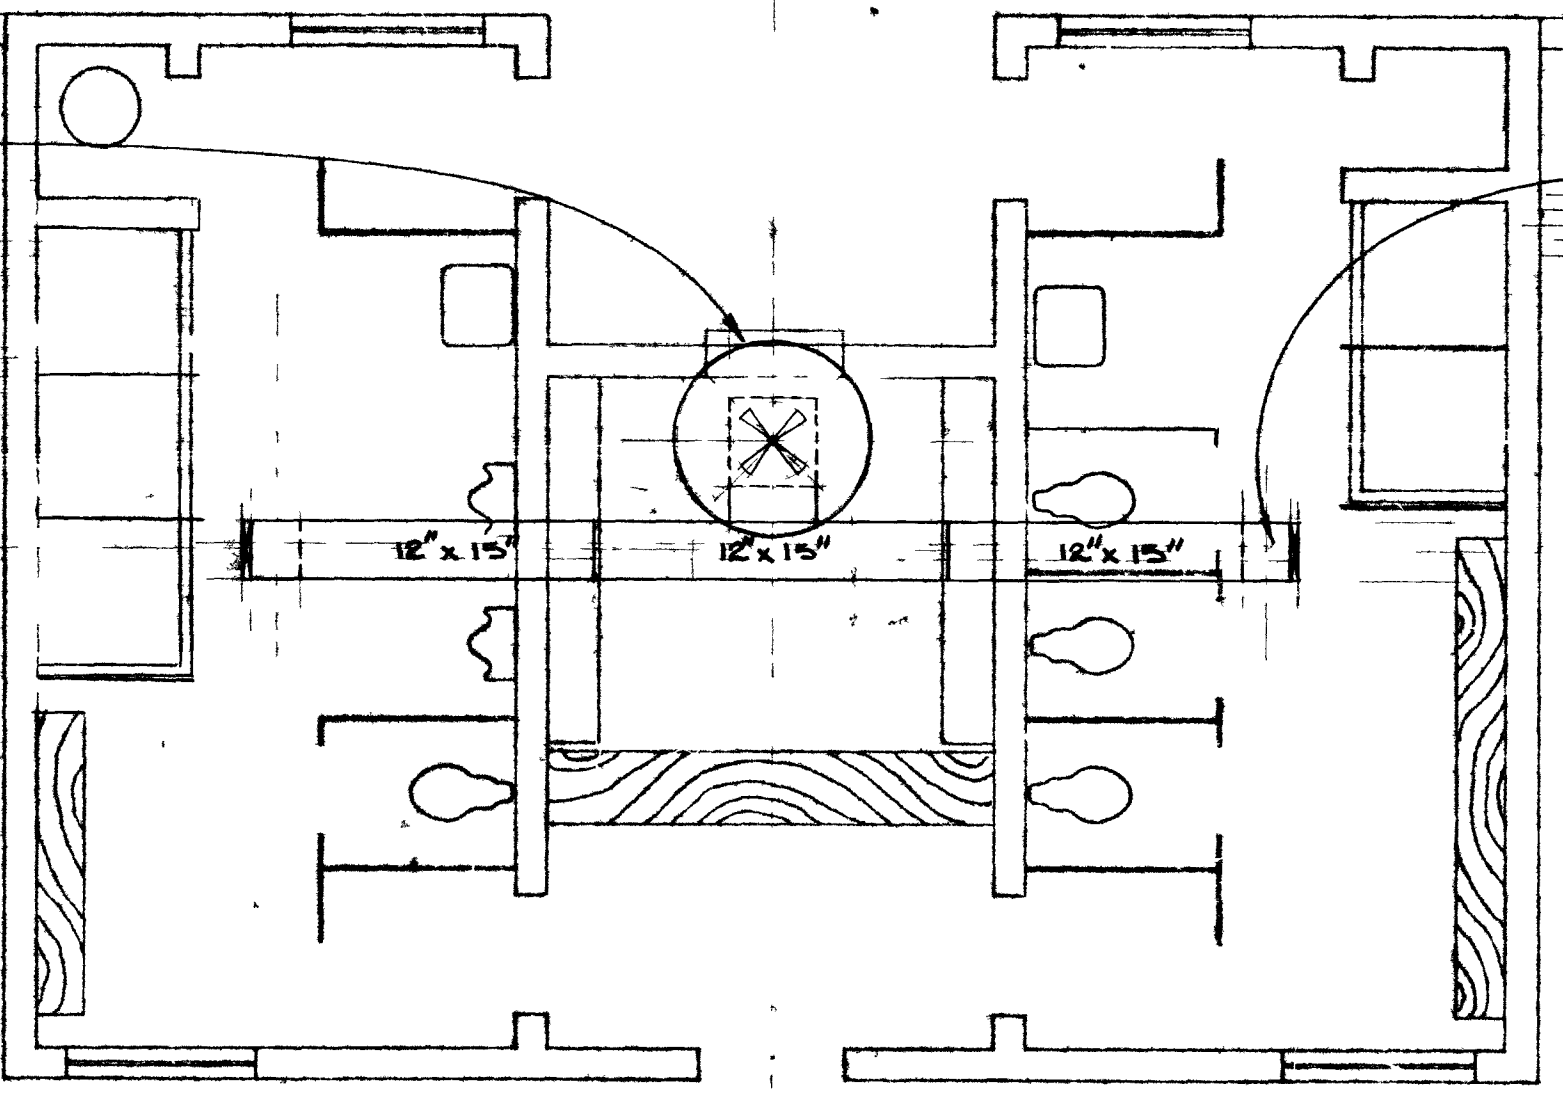



SCALE: 1/4" = 1'-0"

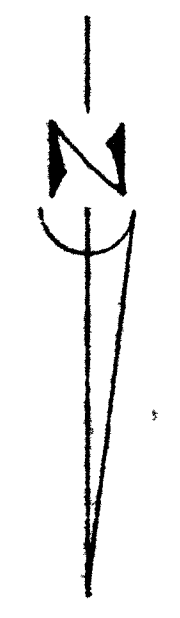

EXISTING UTILITIES ARE LOCATED ON THE PLANS
 FOR THE CONVENIENCE OF THE CONTRACTOR ONLY.
 THE CONTRACTOR SHALL BE FULL RESPONSIBIL-
 ITY FOR PROTECTING ALL UTILITIES AND THE CITY
 BEARS NO RESPONSIBILITY FOR UTILITIES NOT
 SHOWN ON THE PLANS OR NOT IN THE LOCATION
 SHOWN ON THE PLANS.

**CONTRACT
 DRAWING**
 MAY 10 1974

CITY OF LAS VEGAS NEVADA DEPARTMENT OF PUBLIC WORKS SERVICES DIVISION			
"COVE" SWIMMING POOL BATH HOUSE VENTILATION SYSTEM			
W.O. NO. 9228	F.B.K. NO.	DATE	DRAWING NO.
SC. (H)	SC. (V)		674-17
DES. C.A. / C.V.			FILE NO.
DR. D. V. VEIGANG			
APPROVED BY DIRECTOR OF PUBLIC WORKS		13 NOV 73	
			SHEET 8 OF 10



THIS PLAN IS PREPARED BY ME OR UNDER MY CLOSE PERSONAL SUPERVISION AND TO THE BEST OF MY KNOWLEDGE AND BELIEF IT COMplies WITH ALL CITY, STATE AND FEDERAL REQUIREMENTS AND REGULATIONS.

CONTRACT NUMBER
DATE 1958

CITY OF LAS VEGAS DESIGN	
DEPARTMENT OF PUBLIC WORKS	
PROJECT NUMBER	
"CIVIL" SWIMMING POOL	
BATH HOUSE VENTILATION SYSTEM	
DATE	1958
BY	W. J. ...
CHECKED BY	...
APPROVED BY	...