




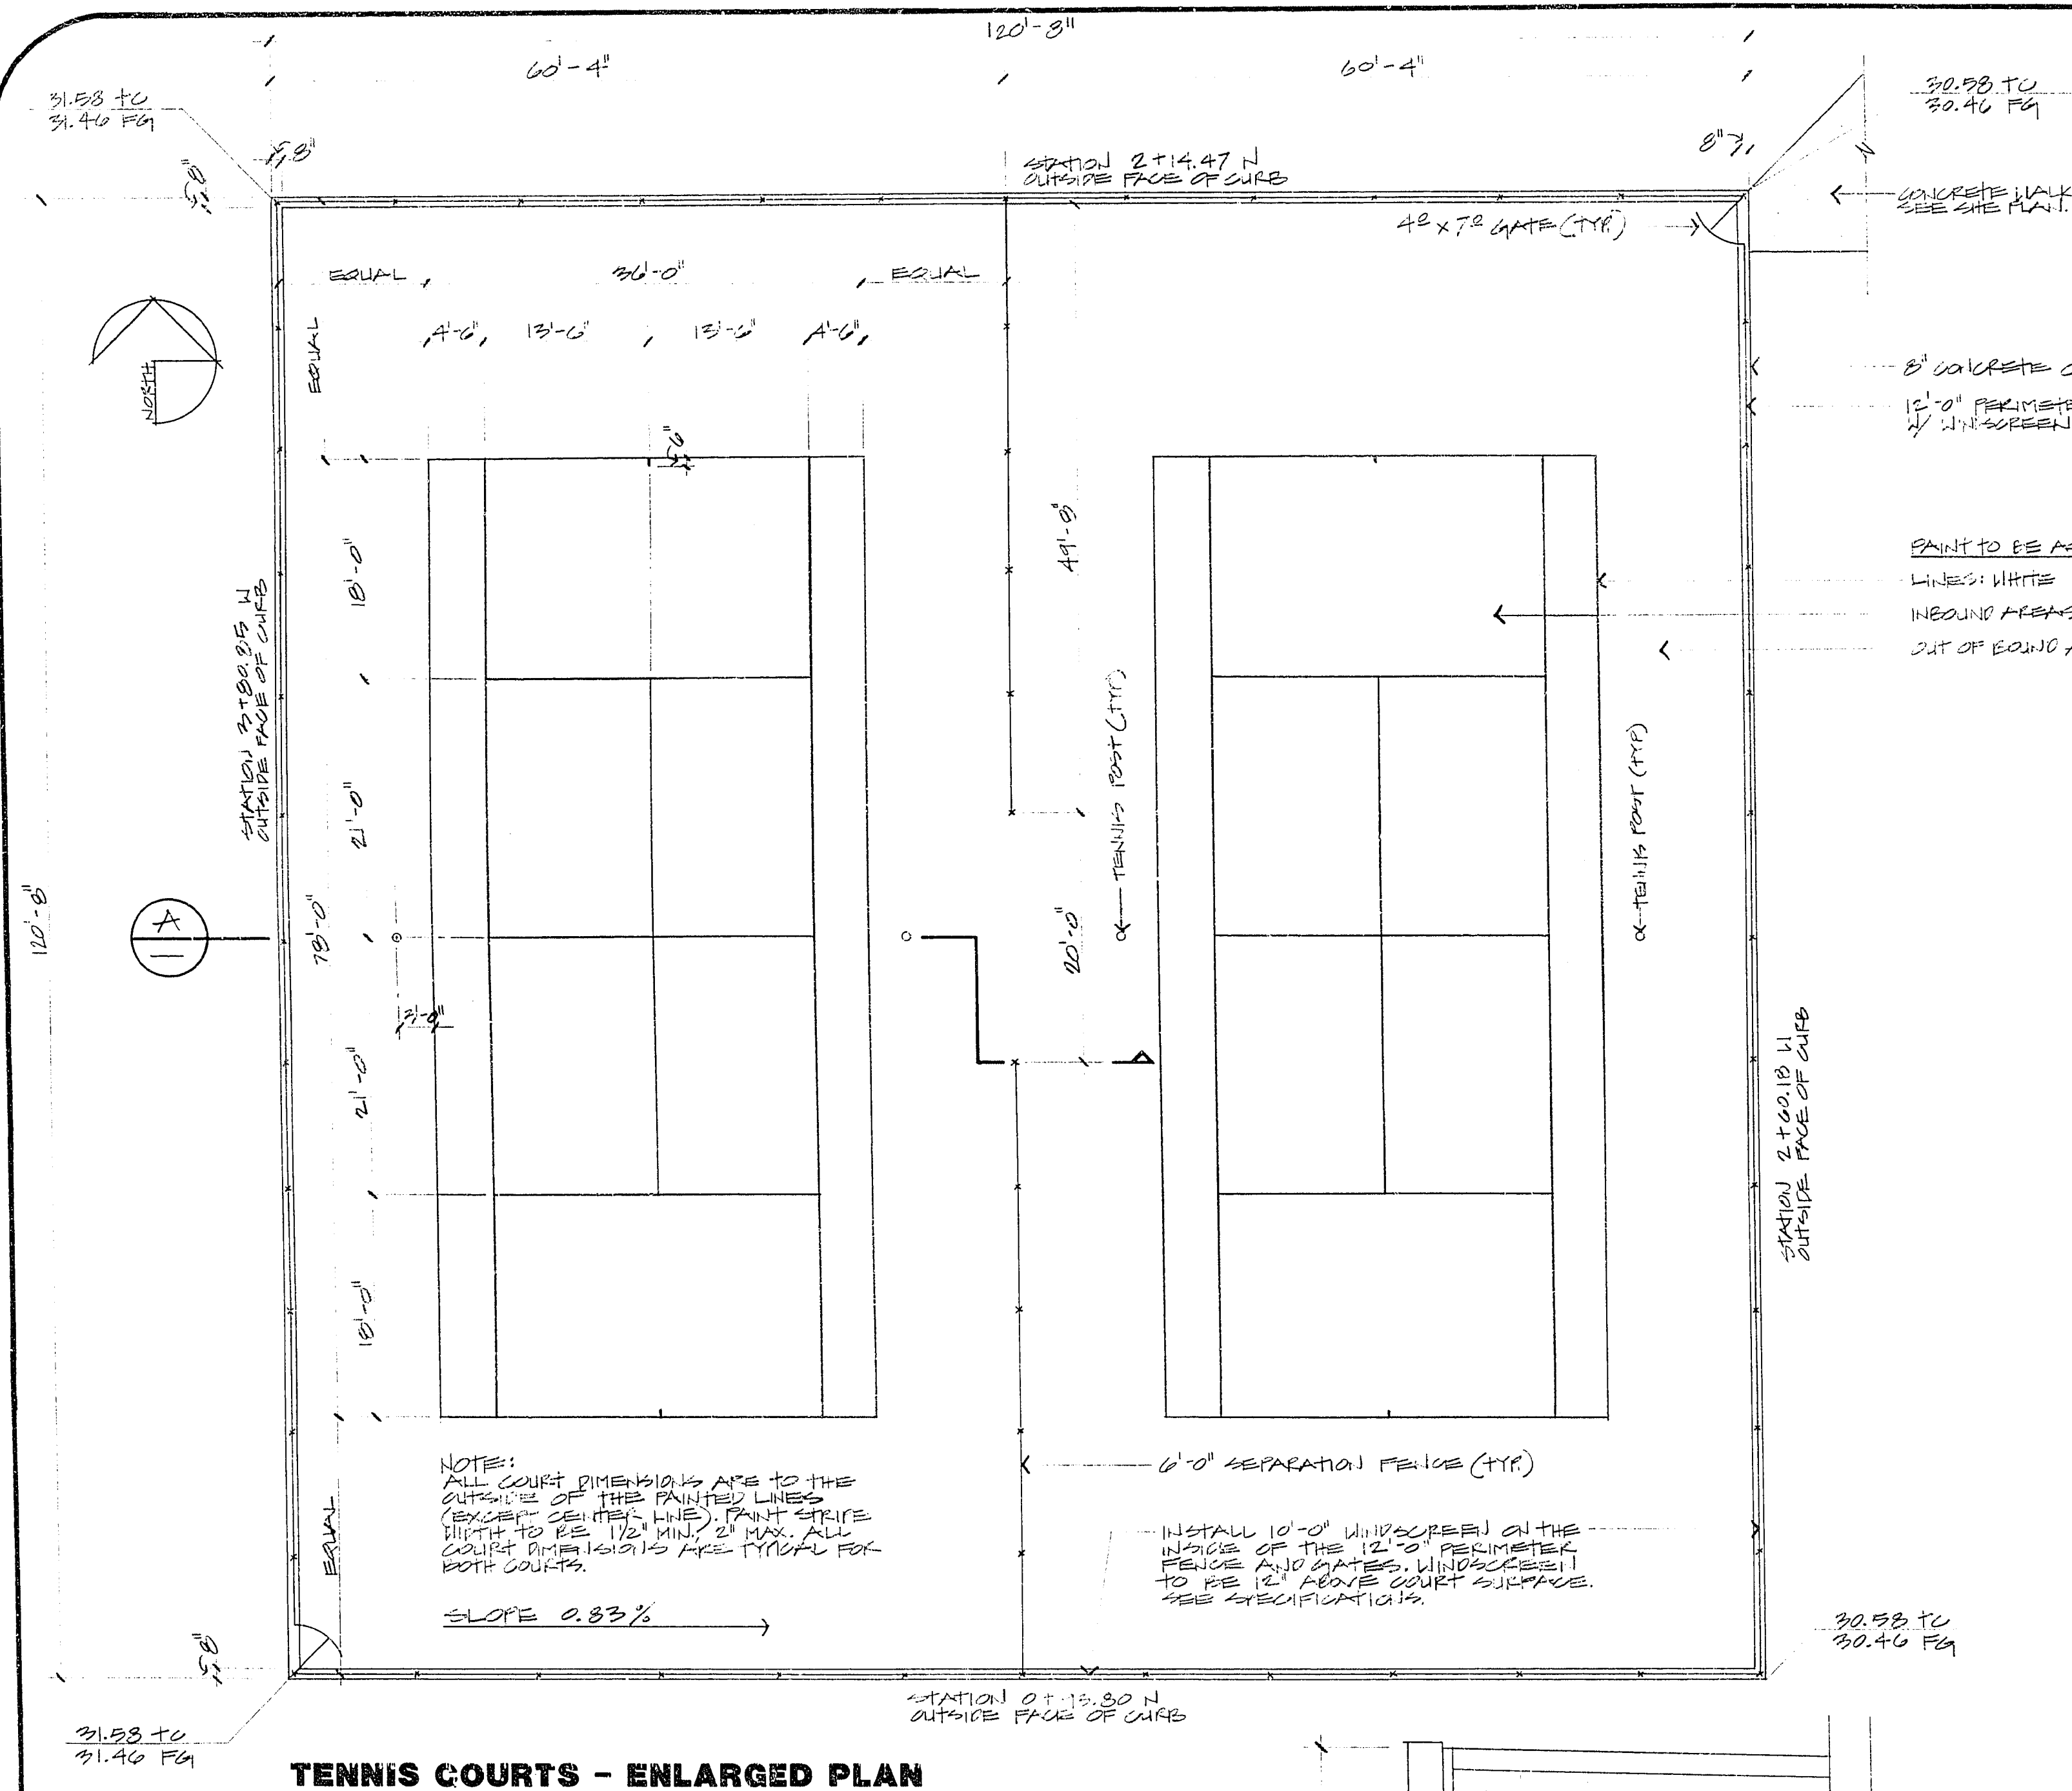


TENNIS COURTS - ENLARGED PLAN

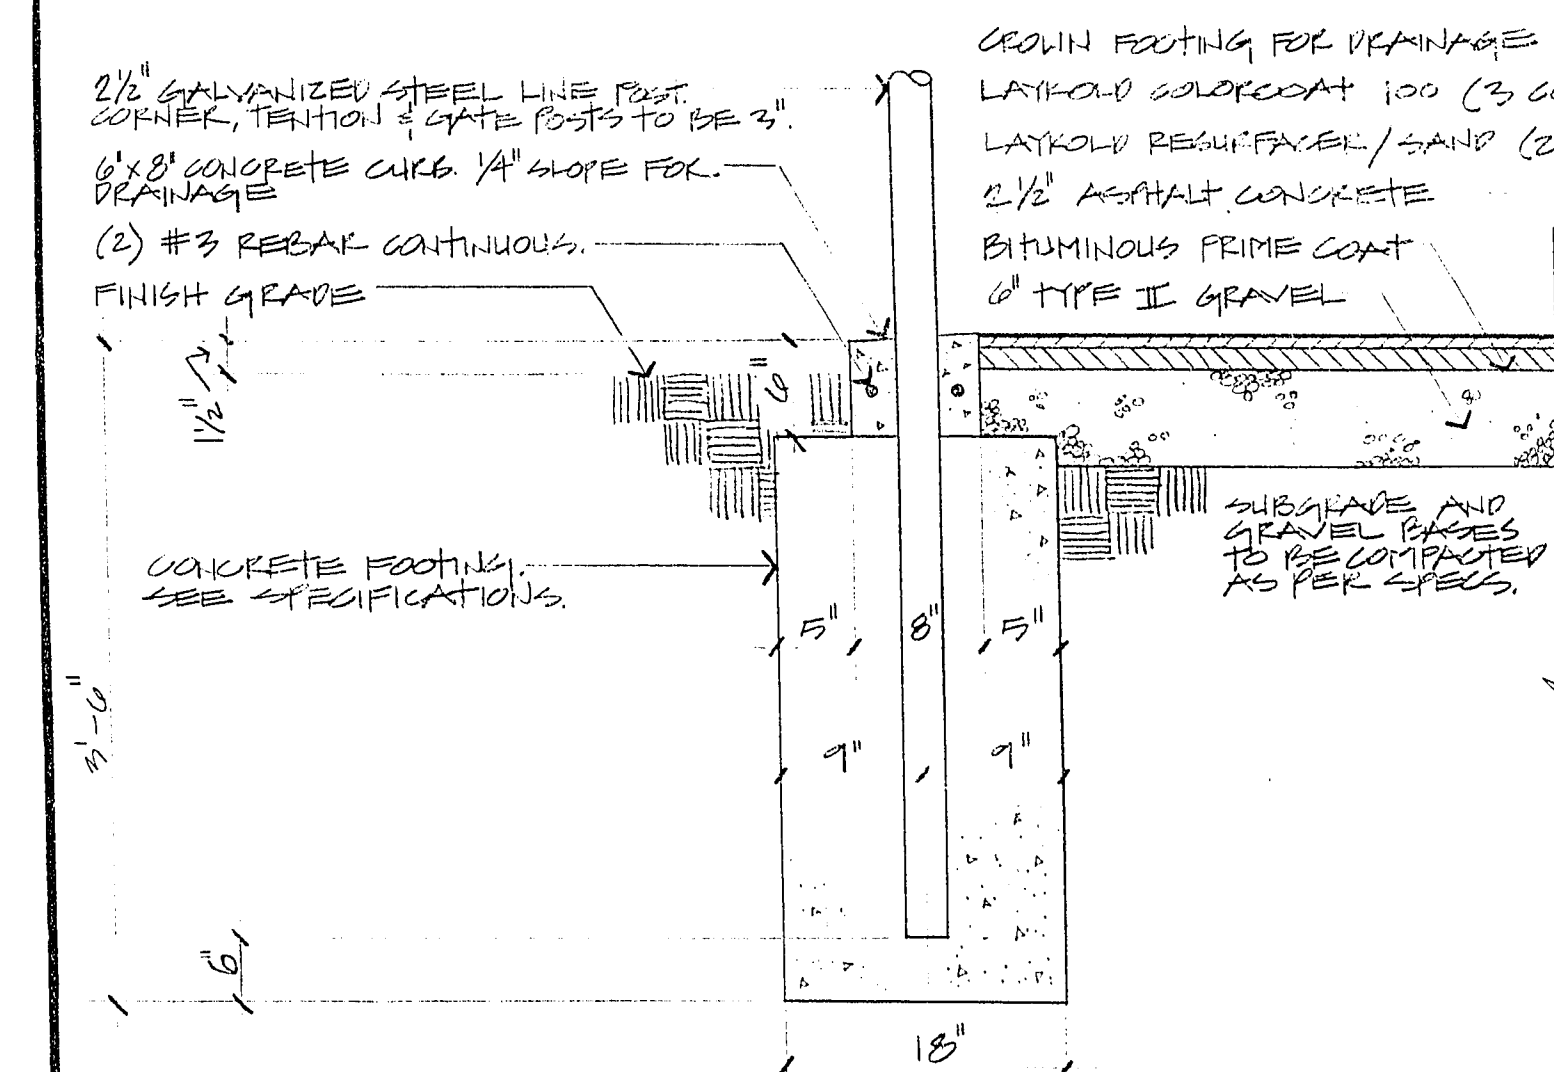


CROSS SECTION THRU 12' PERIMETER FENCE

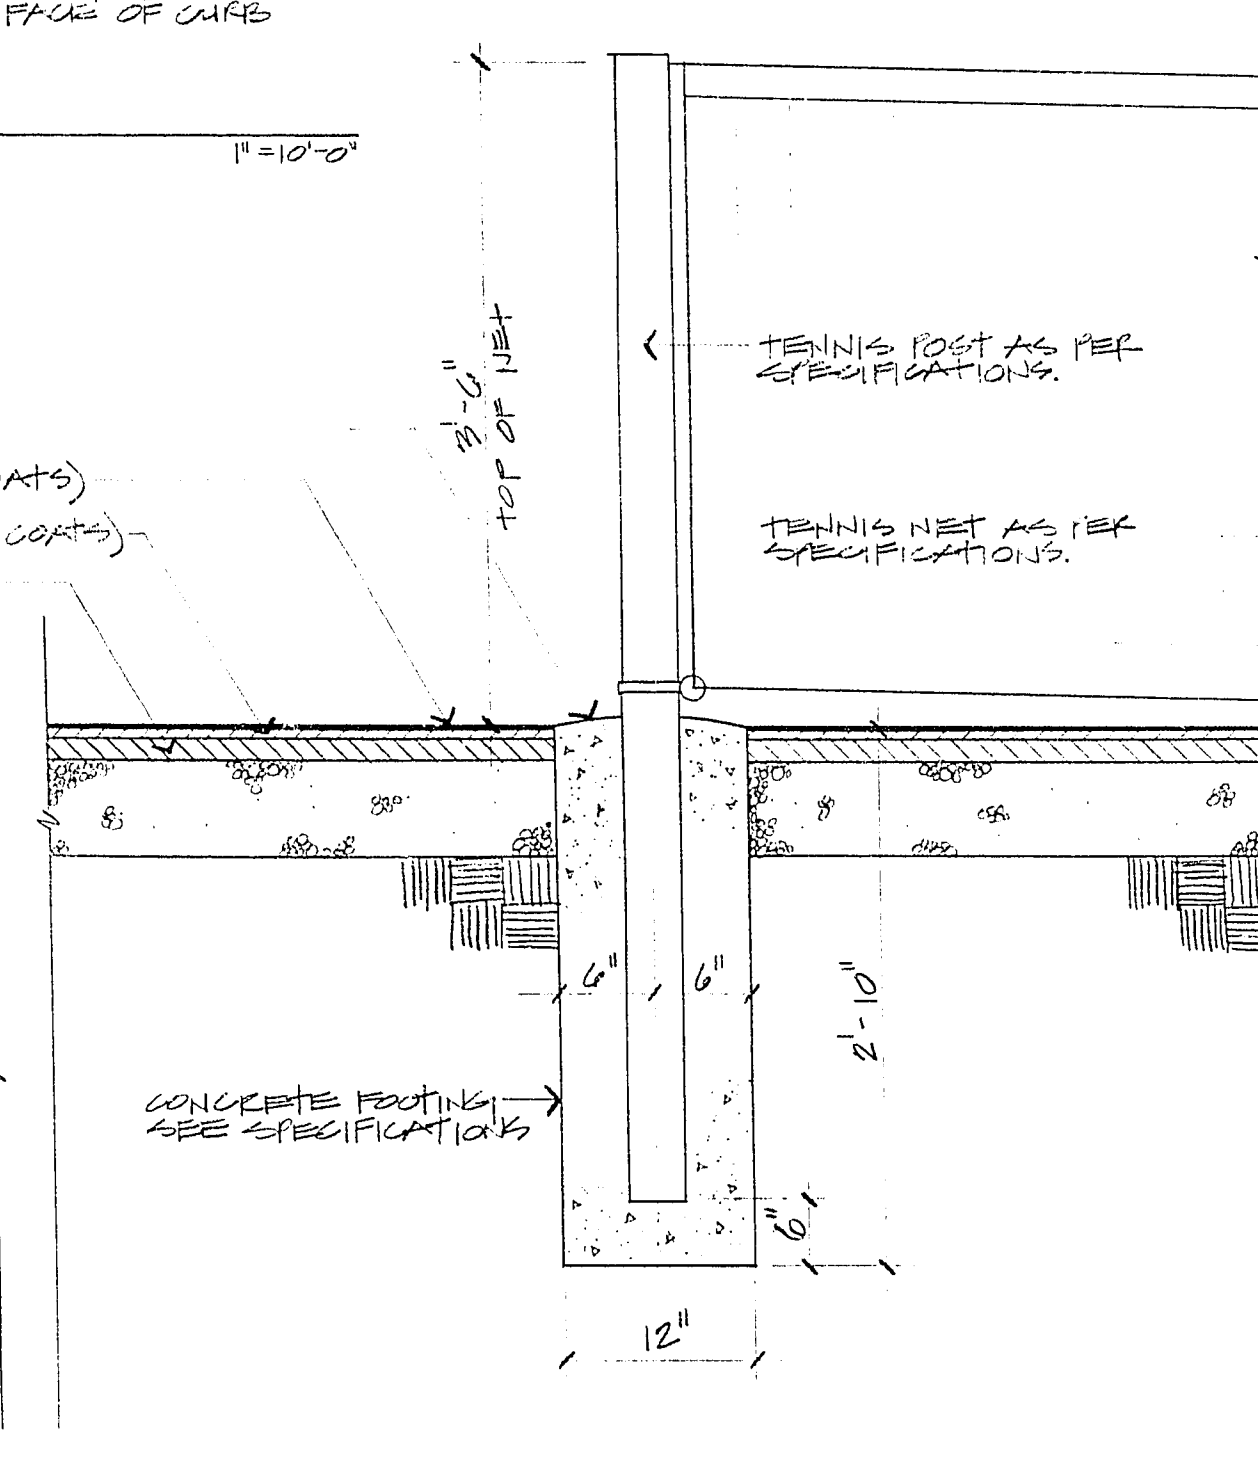


THRU RATCHET POST

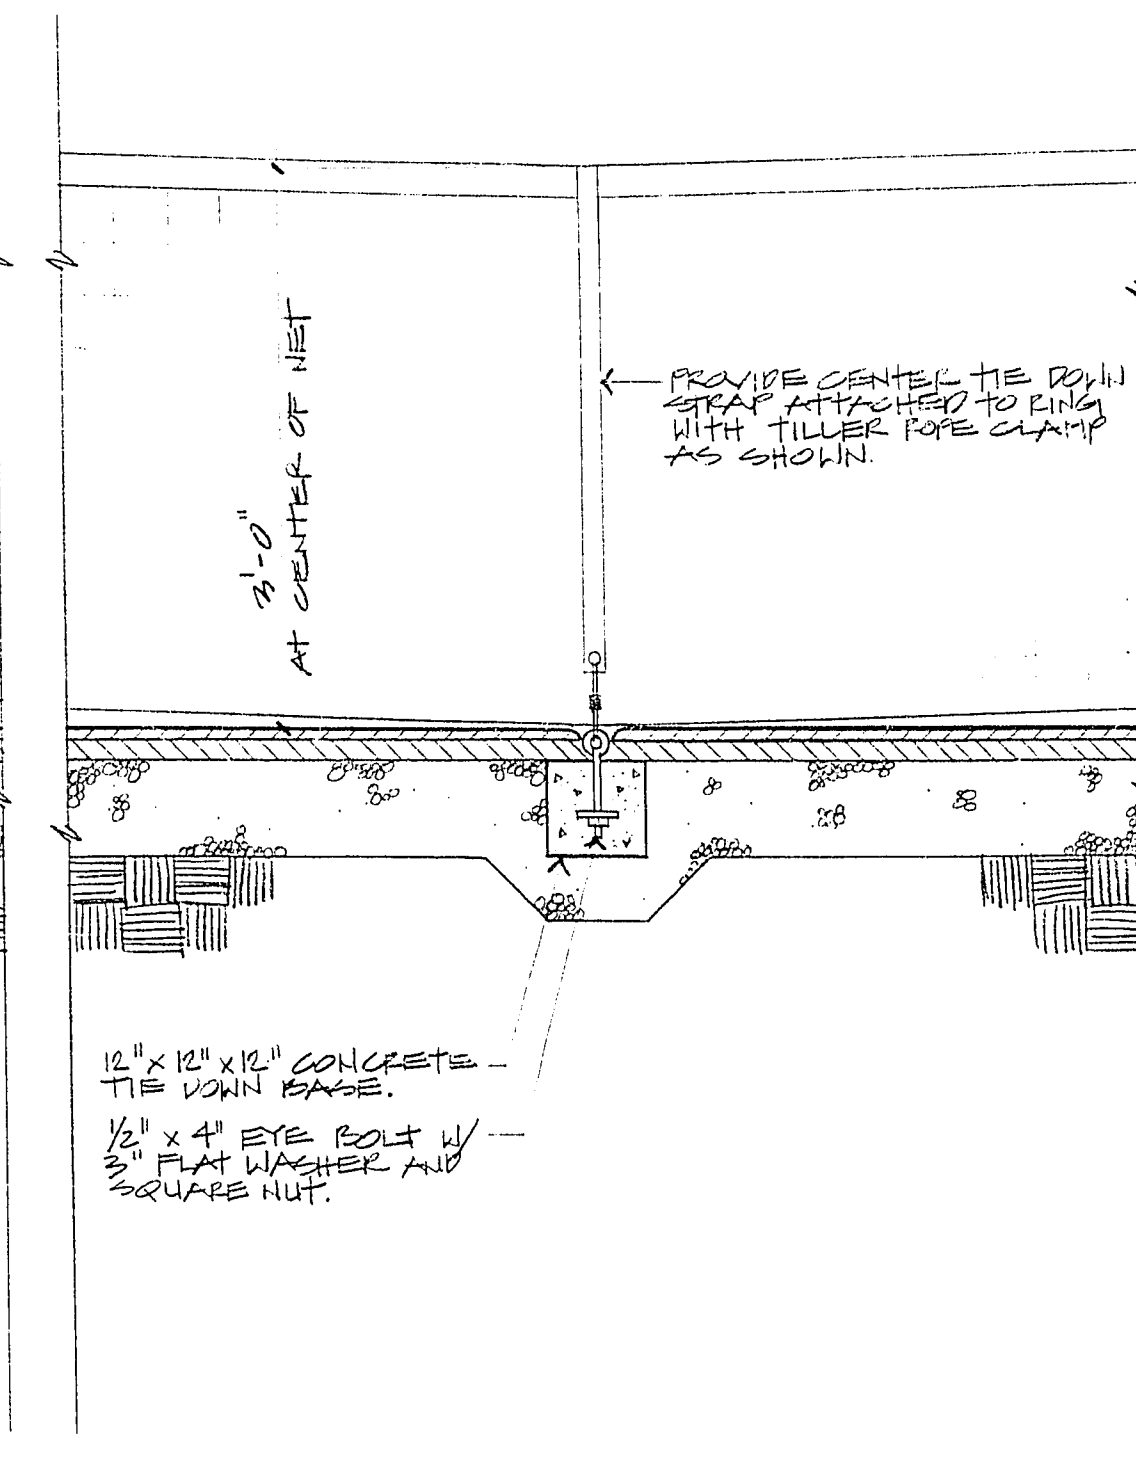


THRU CENTER TIE DOWN

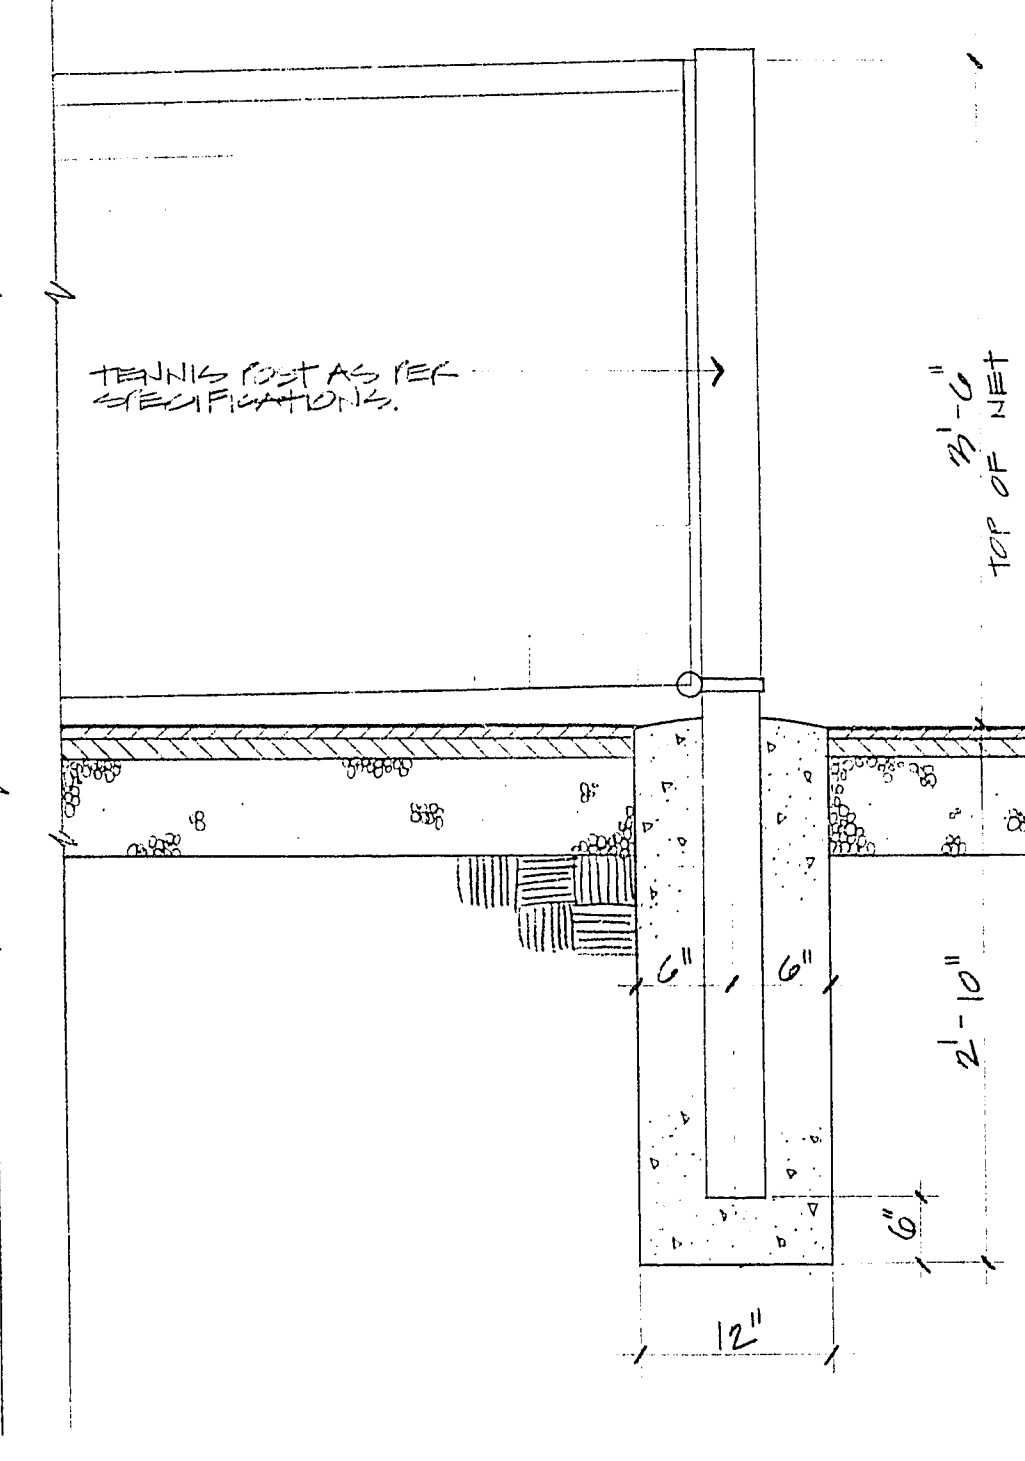

THRU HOOK POST

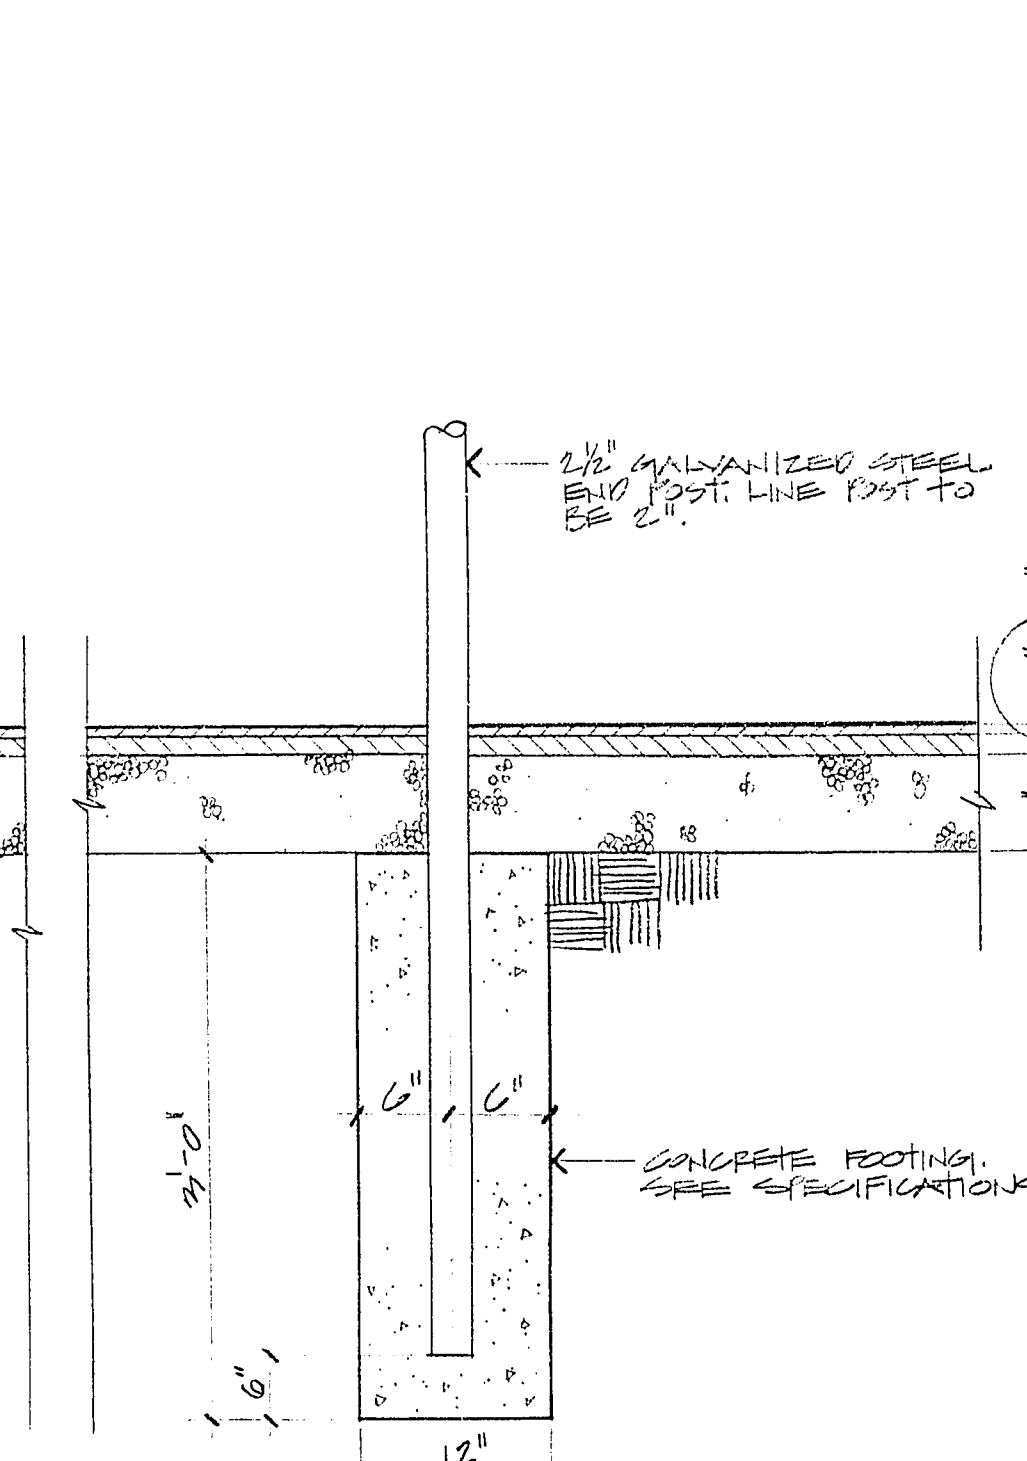

THRU 6' SEPARATION FENCE

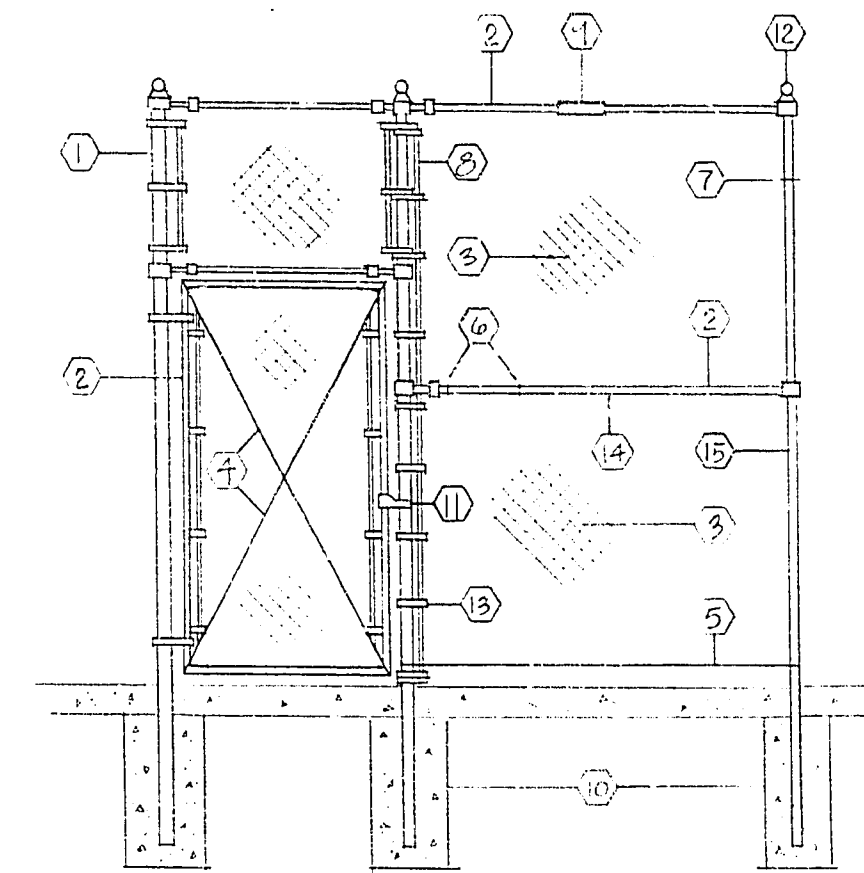

12' PERIMETER FENCE CONSTRUCTION


1. CORNER, TENSION & GATE POSTS TO BE 2" PIPE, SCH. 40
2. TOP RAIL, CENTER RAIL & GATE FRAMES TO BE 1/2" PIPE, SCH. 40
3. CHAIN LINK FENCING TO BE 9 GAUGE, 2" MESH WIRE. FABRIC TO BE INSTALLED ON OUTSIDE OF ALL POSTS.
4. DIAGONAL TIE RODS TO BE 3/8" SOLID ROD, 0.376 LBS/FT
5. TENSION WIRE 7 GAUGE, COLL-SPRING WIRE WITH FABRIC TIE WIRE 2 1/2" O.C.
6. FABRIC BANDS ON HORIZONTAL RAILS @ 18" O.C.
7. FABRIC BANDS ON VERTICAL POSTS @ 18" O.C.
8. STRETCHER BARS TO BE 1/4" x 3/4" FLAT, 0.633 LBS/FT
9. OUTSIDE SLEEVE-TYPE COUPLING TO BE 7" MINIMUM LENGTH @ 20' O.C. ONE COUPLING IN EVERY FIVE FEET TO BE A STINK-LOADED EXPANSION-TYPE COUPLING.
10. CONCRETE FOOTINGS SEE CROSS SECTIONS THIS SHEET AND SPECIFICATIONS.
11. PERIMETER GATES TO HAVE A FORK-TYPE LATCH WITH PROVISION FOR PADLOCK.
12. ALL POSTS TO BE FITTED WITH ORNAMENTAL TOPS.
13. STRETCHER BAR CLAMPS @ 18" O.C. MAXIMUM SPACING BETWEEN STRETCHER BARS TO BE 30'-0". BARS TO BE 1/2" x 3/4".
14. CENTER RAIL REQUIRED FOR ENTIRE LENGTH OF 12'-0" PERIMETER FENCE.
15. LINE POSTS TO BE 2 1/2" PIPE, SCH. 40

6' SEPARATION FENCE CONSTRUCTION

1. END POST TO BE 2 1/2" PIPE, SCH. 40
2. TOP RAIL TO BE 1/2" PIPE, SCH. 40
3. CHAIN LINK FENCING TO BE 9 GAUGE, 2" MESH WIRE.
4. N/A
5. TENSION WIRE 7 GAUGE, COLL-SPRING WIRE WITH FABRIC TIE WIRE 2 1/2" O.C.
6. N/A
7. FABRIC BANDS ON VERTICAL POSTS @ 18" O.C.
8. STRETCHER BARS TO BE 1/4" x 3/4" FLAT, 0.633 LBS/FT
9. OUTSIDE SLEEVE-TYPE COUPLING TO BE 7" MINIMUM LENGTH @ 20' O.C. ONE COUPLING IN EVERY 50'-0" OF FENCE TO BE A STINK-LOADED EXPANSION-TYPE COUPLING.
10. CONCRETE FOOTINGS SEE CROSS SECTIONS THIS SHEET AND SPECIFICATIONS.
11. N/A
12. ALL POSTS TO BE FITTED WITH ORNAMENTAL TOPS.
13. STRETCHER BAR CLAMPS @ 18" O.C. MAXIMUM SPACING BETWEEN STRETCHER BARS TO BE 30'-0". BARS TO BE 1/2" x 3/4".
14. N/A
15. LINE POSTS TO BE 2 1/2" PIPE, SCH. 40


GENERAL NOTES

ALL FENCING, GATES, POSTS, HARDWARE ETC. TO BE GALVANIZED. SEE SPECIFICATIONS.
10'-0" MAXIMUM SPACING ON ALL FENCE POSTS.
INSTALL 10'-0" WINDSCREENS ON THE INSIDE OF THE 12'-0" PERIMETER FENCE AND GATES. WINDSCREENS TO BE 12" ABOVE COURT SURFACE. SEE SPECIFICATIONS.

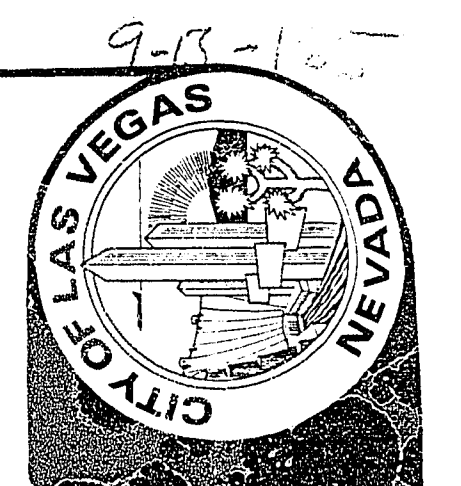

City of Las Vegas, Nevada
Department of Design and Development
Thomas B. Graham, AICP, RLA, Director
DESIGN BY: E. ALVARADO
DRAWN BY: E. ALVARADO
SCALE: AS SHOWN
DATE: 4-20-00

REVISIONS	DATE

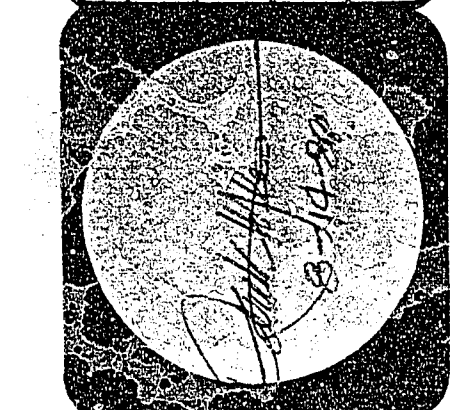

ANGEL PARK PHASE IIB
TENNIS COURTS - PLAN AND DETAILS

PROJECT NO.
WU6292
DRAWING NO.
650.14-V10
SHEET OF 36
C-5