18-3-19

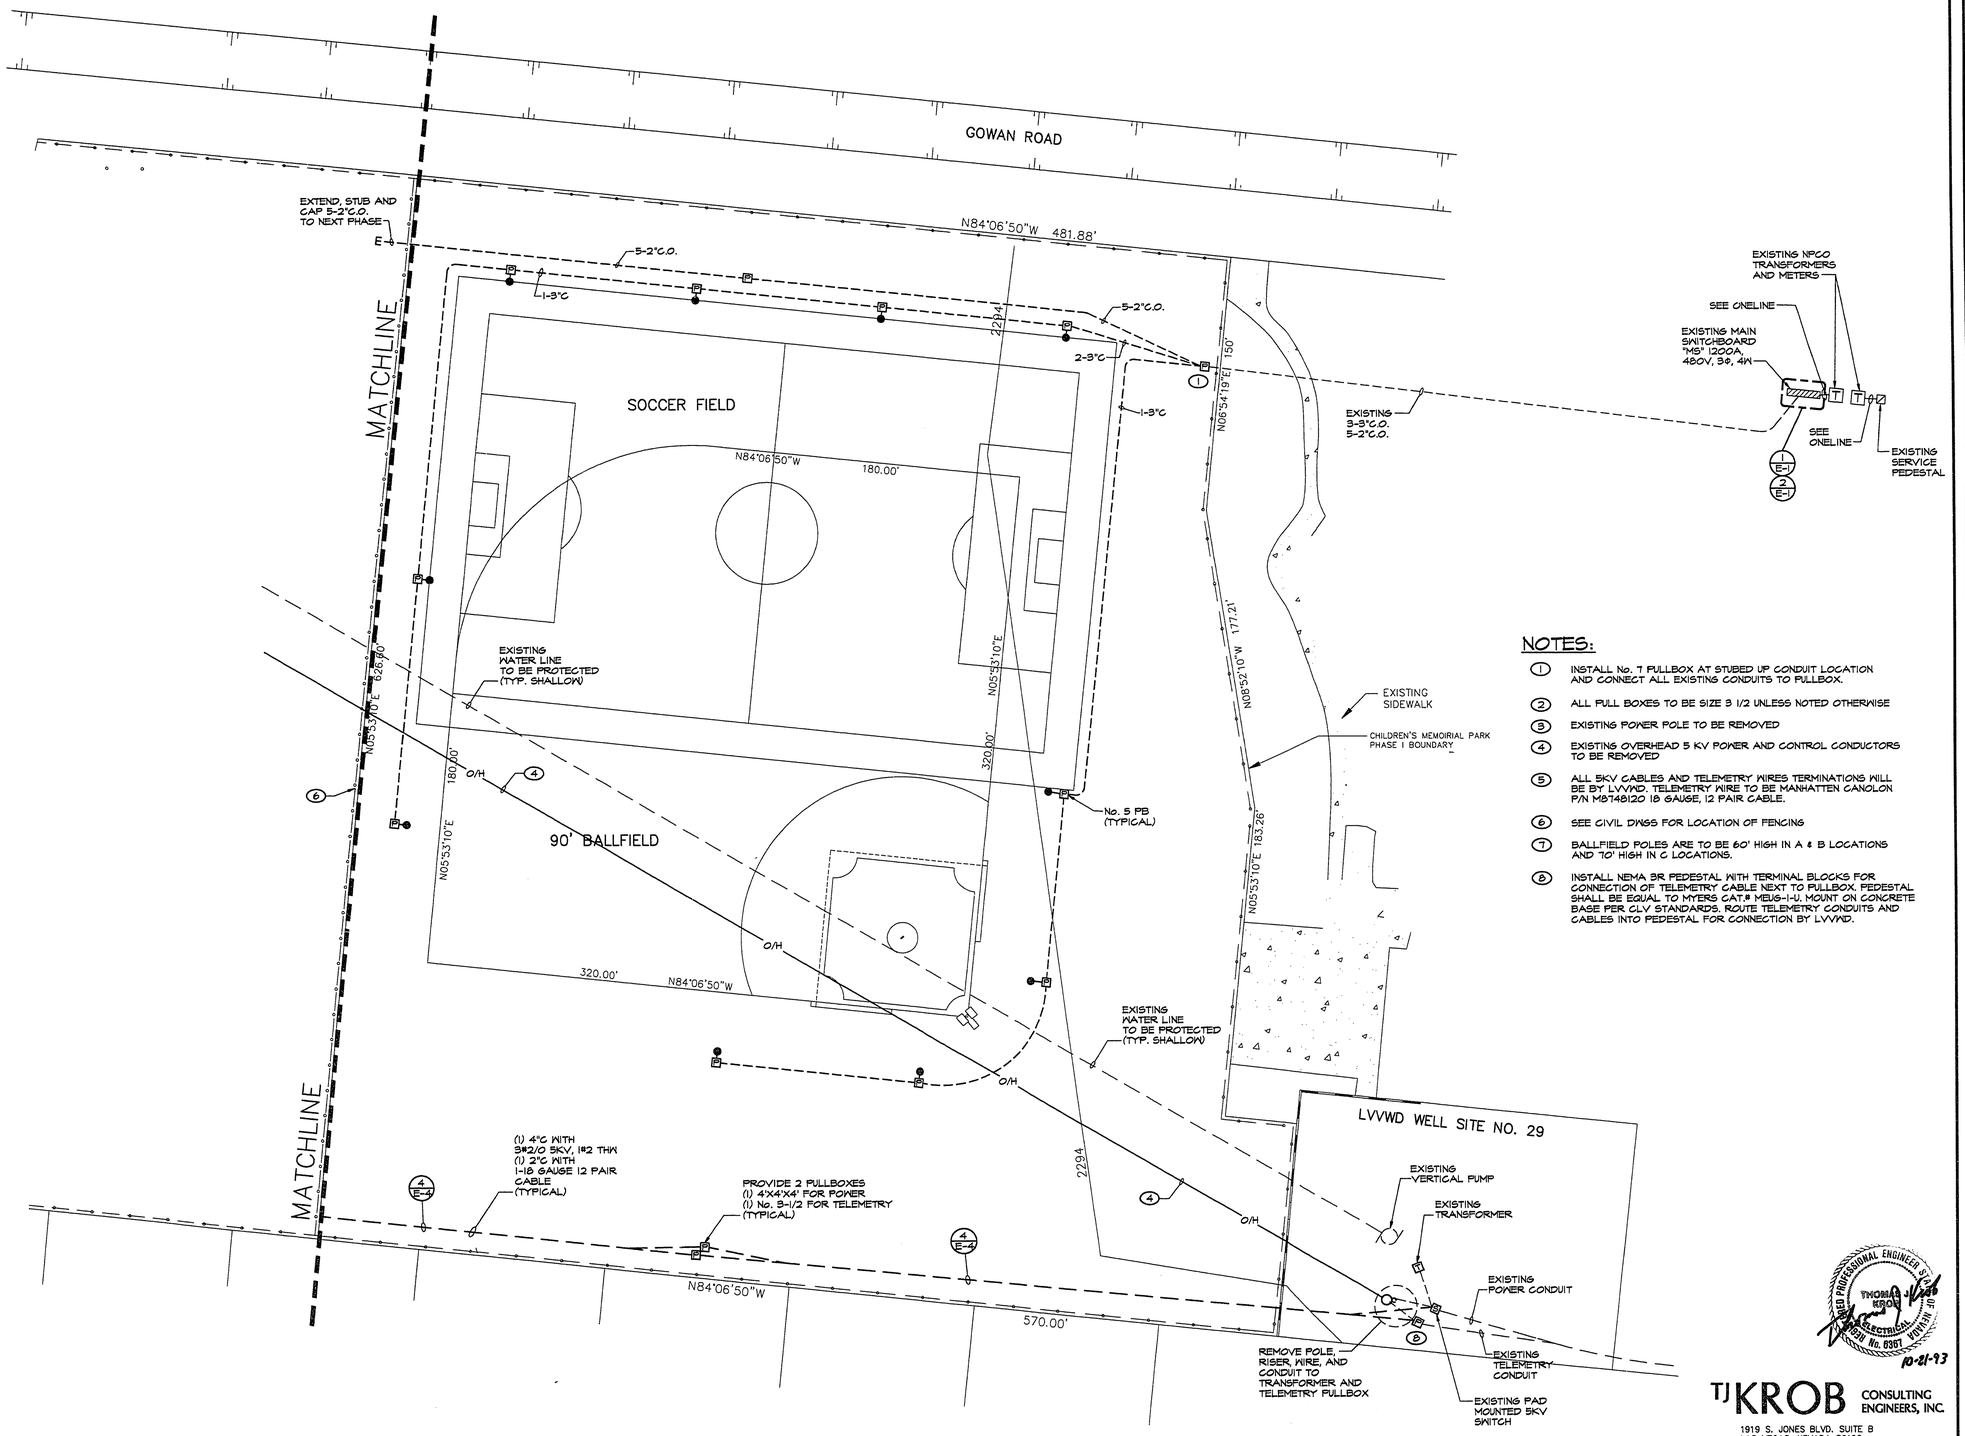

NOTES:

1. INSTALL No. 7 PULLBOX AT STUBED UP CONDUIT LOCATION AND CONNECT ALL EXISTING CONDUITS TO PULLBOX.
2. ALL PULL BOXES TO BE SIZE 3 1/2 UNLESS NOTED OTHERWISE
3. EXISTING POWER POLE TO BE REMOVED
4. EXISTING OVERHEAD 5 KV POWER AND CONTROL CONDUCTORS TO BE REMOVED
5. ALL 5KV CABLES AND TELEMETRY WIRES TERMINATIONS WILL BE BY LVVWD. TELEMETRY WIRE TO BE MANHATTEN CANOLON P/N MB748120 18 GAUGE, 12 PAIR CABLE.
6. SEE CIVIL DWGS FOR LOCATION OF FENCING
7. BALLFIELD POLES ARE TO BE 60' HIGH IN A & B LOCATIONS AND 70' HIGH IN C LOCATIONS.
8. INSTALL NEMA 3R PEDESTAL WITH TERMINAL BLOCKS FOR CONNECTION OF TELEMETRY CABLE NEXT TO PULLBOX. PEDESTAL SHALL BE EQUAL TO MYERS CAT.# MEUS-1-U. MOUNT ON CONCRETE BASE PER CLV STANDARDS. ROUTE TELEMETRY CONDUITS AND CABLES INTO PEDESTAL FOR CONNECTION BY LVVWD.

TJ KROB CONSULTING ENGINEERS, INC.
1919 S. JONES BLVD. SUITE B
LAS VEGAS, NEVADA 89102
(702) 871-3621
ELECTRICAL ENGINEERING

REV.	DATE	BY	REVISION

THE MARK GROUP ENGINEER & CONSULTS, INC.
2975 SO. RAINBOW BLVD., SUITE G
LAS VEGAS, NEVADA 89102
PHONE (702) 364-1066

DRAWN BY: JI
DESIGNED BY: TK
APPROVED BY:

CITY OF LAS VEGAS PARKS & LEISURE ACTIVITIES

TITLE: ELECTRICAL SITE POWER PLAN

PROJECT: CHILDREN'S MEMORIAL PARK 90 FOOT BALLFIELD, PHASE II

PROJECT NO. 91-2443
DATE: 10-13-93
SCALE: HORIZ. 1"=40'

SHEET 4
E-2
OF 6 SHEETS

650.35-V2