



5+00
4+00
3+00
2+00
1+00
0+00

CAKEY BLVD.

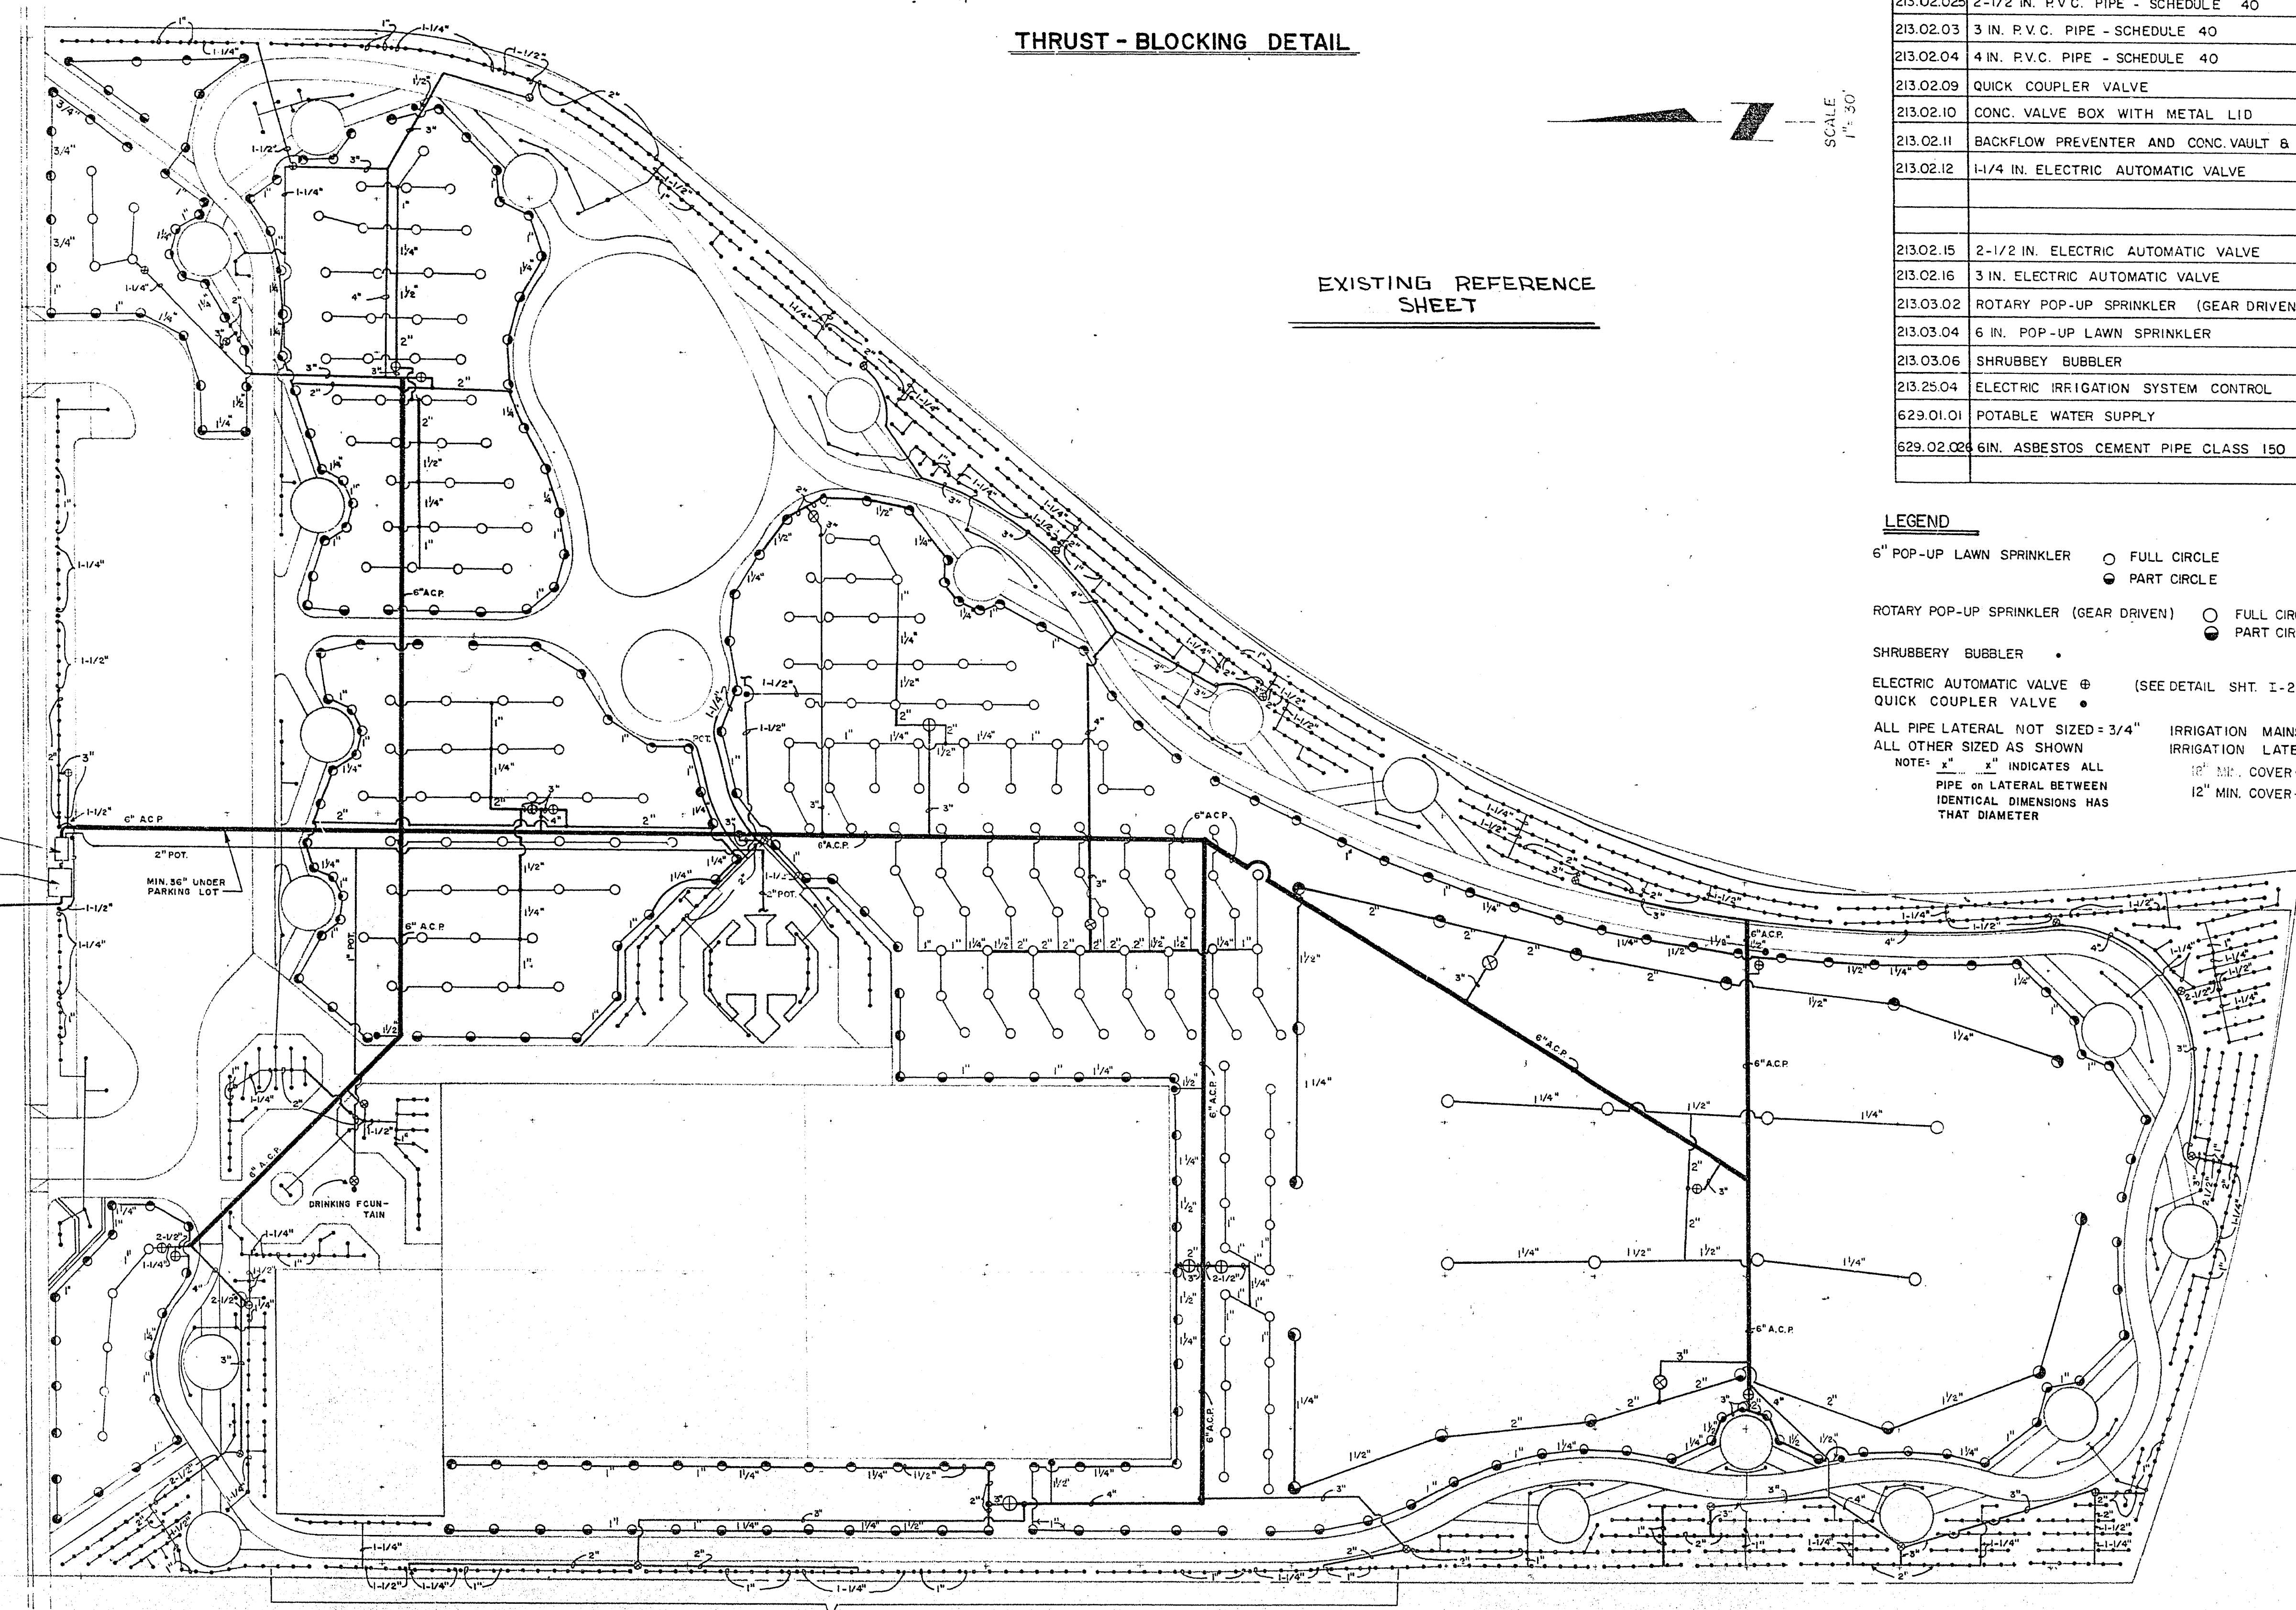

NOTE:
THRUST BLOCKS SHALL
BE CLASS B 3000 PSI
CONCRETE AND OF
ADEQUATE SIZE AND
STRENGTH TO PREVENT
MOTION OF FITTINGS
UNDER MAXIMUM PRESSURES.

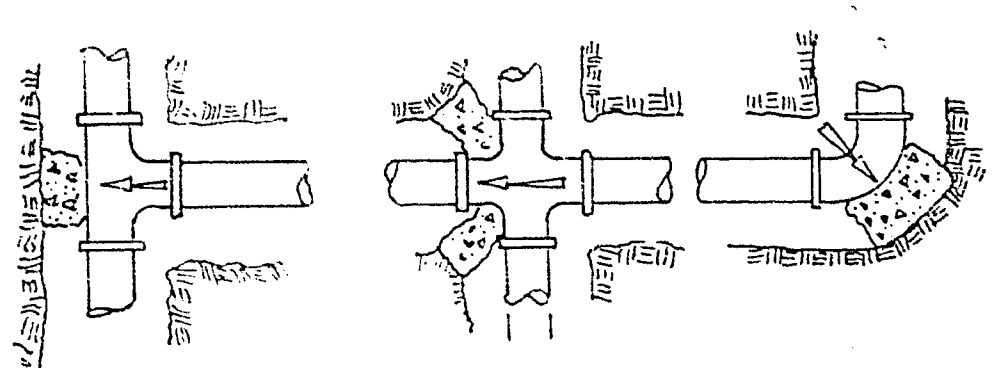

THRUST - BLOCKING DETAIL

EXISTING REFERENCE
SHEET

SCALE
1" = 30'

APPROXIMATE QUANTITIES - THIS SHEET			
ITEM NO.	DESCRIPTION	UNIT	QUANTITY
213.02.07	3/4 IN. PVC PIPE - SCHEDULE 40	L.F.	6960
213.02.01	1 IN. PVC PIPE - SCHEDULE 40	L.F.	1420
213.02.04	1-1/4 IN. P.V.C. PIPE - SCHEDULE 40	L.F.	2085
213.02.05	1-1/2 IN. P.V.C. PIPE - SCHEDULE 40	L.F.	1120
213.02.02	2 IN. P.V.C. PIPE - SCHEDULE 40	L.F.	1255
213.02.025	2-1/2 IN. P.V.C. PIPE - SCHEDULE 40	L.F.	80
213.02.03	3 IN. P.V.C. PIPE - SCHEDULE 40	L.F.	1260
213.02.04	4 IN. P.V.C. PIPE - SCHEDULE 40	L.F.	435
213.02.09	QUICK COUPLER VALVE	E.A.	7
213.02.10	CONC. VALVE BOX WITH METAL LID	E.A.	38
213.02.11	BACKFLOW PREVENTER AND CONC. VAULT & PLUMBING	L.S.	L.S.
213.02.12	1-1/4 IN. ELECTRIC AUTOMATIC VALVE	E.A.	2
213.02.15	2-1/2 IN. ELECTRIC AUTOMATIC VALVE	E.A.	4
213.02.16	3 IN. ELECTRIC AUTOMATIC VALVE	E.A.	32
213.03.02	ROTARY POP-UP SPRINKLER (GEAR DRIVEN)	E.A.	24
213.03.04	6 IN. POP-UP LAWN SPRINKLER	E.A.	542
213.03.06	SHRUBBERY BUBBLER	E.A.	1091
213.25.04	ELECTRIC IRRIGATION SYSTEM CONTROL	E.A.	4
629.01.01	POTABLE WATER SUPPLY	L.S.	L.S.
629.02.02	6 IN. ASBESTOS CEMENT PIPE CLASS 150	L.F.	1340

LEGEND

- 6" POP-UP LAWN SPRINKLER ○ FULL CIRCLE
● PART CIRCLE
- ROTARY POP-UP SPRINKLER (GEAR DRIVEN) ○ FULL CIRCLE
● PART CIRCLE (PATTERN ADJUSTABLE)
- SHRUBBERY BUBBLER ●
- ELECTRIC AUTOMATIC VALVE & QUICK COUPLER VALVE (SEE DETAIL SHT. 1-2 FOR SIZING SCHEDULE)
- ALL PIPE LATERAL NOT SIZED = 3/4" IRRIGATION MAINS REQUIRE 36" MIN. COVER
ALL OTHER SIZED AS SHOWN IRRIGATION LATERALS REQUIRE:
NOTE: "x" INDICATES ALL 12" MIN. COVER - ROTARY CIRCUITS
PIPE OR LATERAL BETWEEN 12" MIN. COVER - LAWN SPRINKLER and
IDENTICAL DIMENSIONS HAS SHRUBBERY BUBBLER
THAT DIAMETER CIRCUITS

BENCH MARK
C.L.V. B.M. # 1615A2
N.E. CORNER OAKLEY & CAHLAN
ELEV. - 2087.90

CONTRACT
DRAWING
OCT 30 1981

W.O. no. 3477
Scale (ft) 1" = 30'
Fid. bk. no. 78-3X
Design by D. McSOGGLE
Approved by the Director of Public Services
Date
Drawn by JOHN PAYNE

Engineering Design Division
IRRIGATION & POTABLE
WATER SUPPLY

Department of Public Services
BOB BASKIN PARK

