


2/13/61

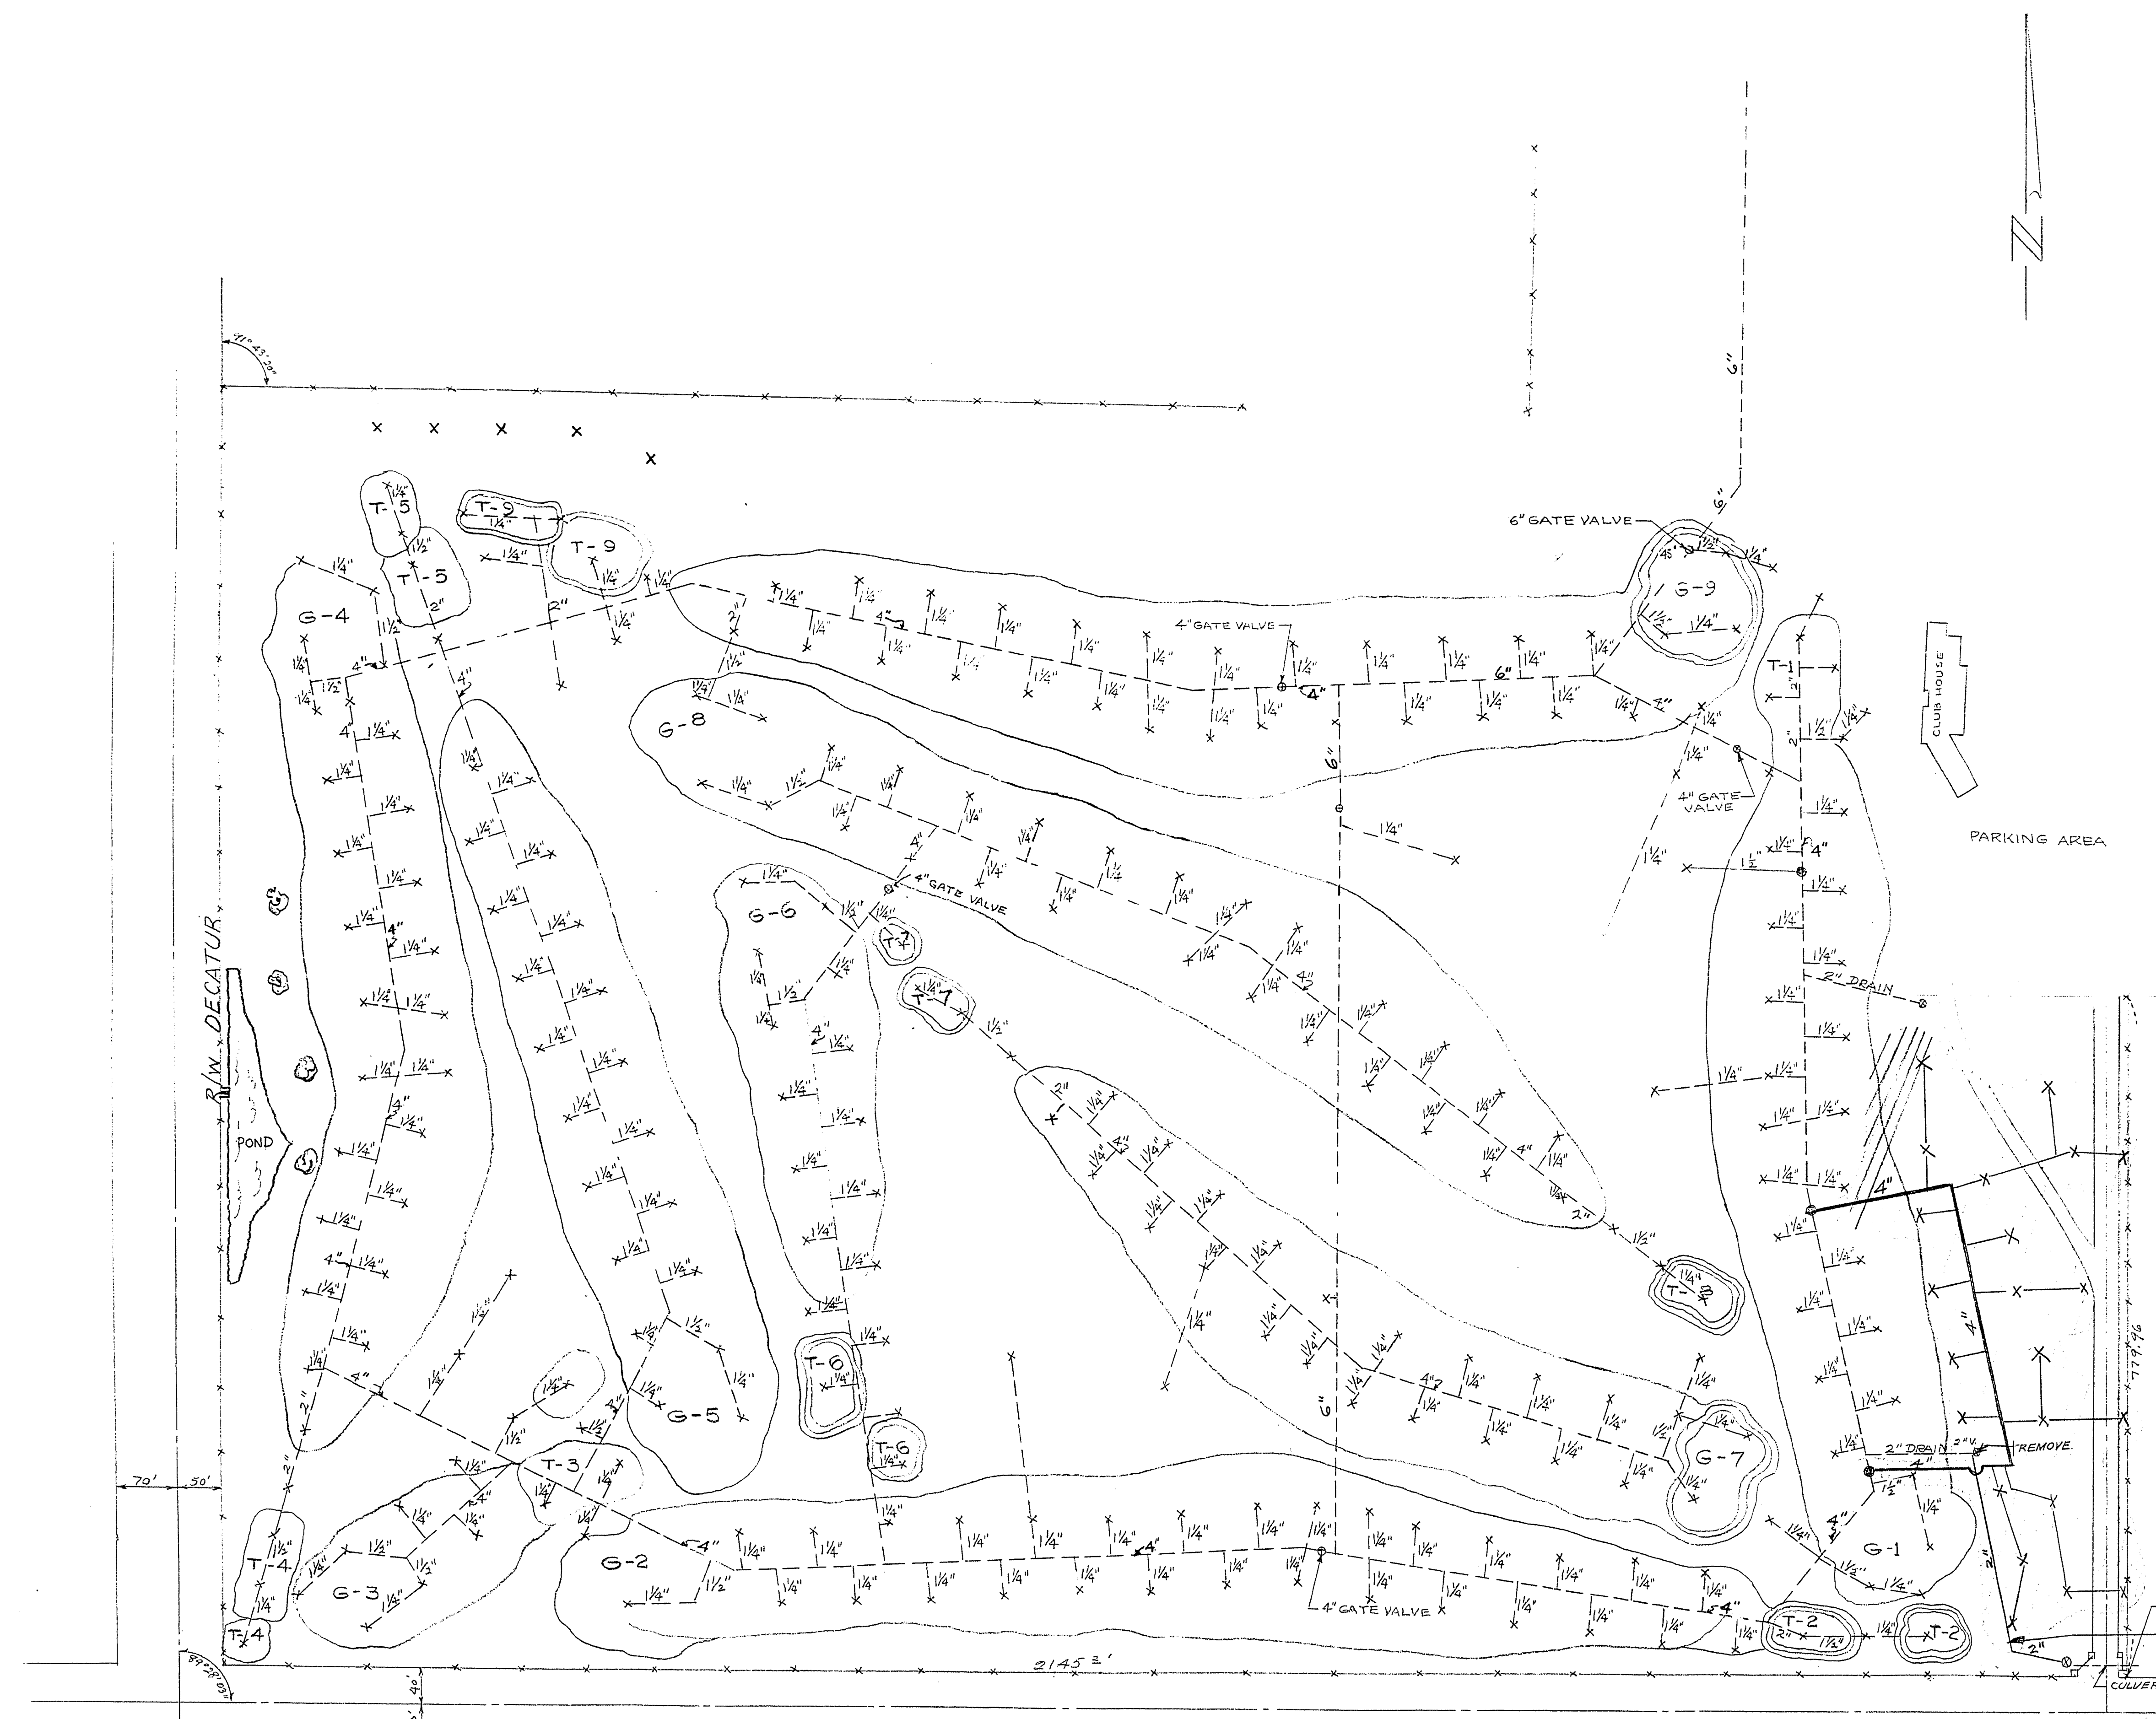

LEGEND: CONSTRUCTION 1968 (PROPOSED)

- CONNECTION TO EXISTING MAIN
- NEW WATER MAINS & LATERALS
- NEW QUICK COUPLERS
- NEW CONSTRUCTION ZONES

NOTE ① WHERE SIZE IS NOT INDICATED
1 1/2" PIPE WILL BE USED

○ CONSTRUCTION COMPLETED

LEGEND:
(FROM ORIG. DWG. NO. 660-V22)

- - GATE VALVES
- X - BUCKNER 15E VALVES (OR EQUAL)

FOR 1 VALVE USE 1 1/4" PIPE
FOR 2 VALVE USE 1 1/2" PIPE
FOR 3 VALVE OR MORE USE 2" PIPE
EXCEPT WHERE OTHERWISE NOTED

SCHOOL PROPERTY COR.
REMOVE EXISTING DRAIN VALVE, EXTEND 2" LINE TO CULVERT
AND INSTALL DRAIN VALVE ON END OF LINE

CITY OF LAS VEGAS NEVADA ENGINEERING DEPT.			
ADDITIONS TO SPRINKLING SYSTEM MUNICIPAL GOLF COURSE HOLES #1 THRU #9			
DESIGNED BY	WM. R. BELL & SON	DATE	3-4-58
DRAWN BY	L. H.	SCALE	1" = 100' & NOTED
CHECKED BY		FIELD BOOK NO.	
APPROVED		WORK ORDER NO.	
CITY ENGR.		DRAWING NO.	660-V54