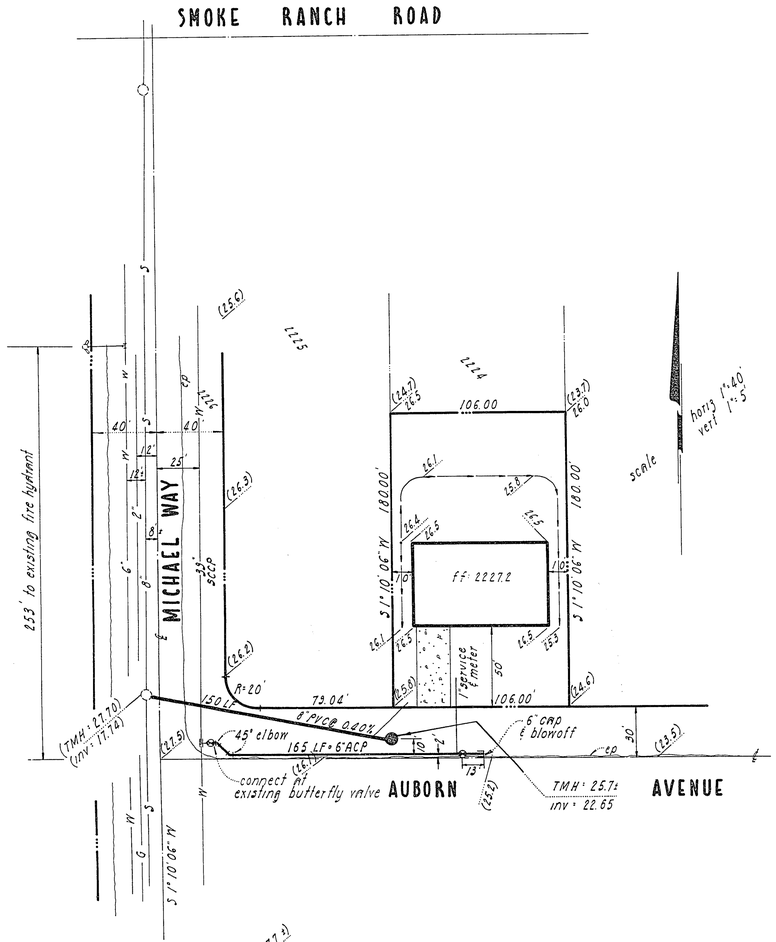

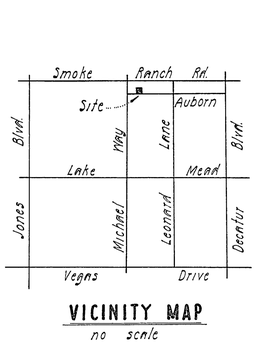

VICINITY MAP
no scale

GENERAL NOTES

1. All construction and materials shall be in accordance with the "Uniform Standards and Specifications for Public Works Construction Off-Site improvements. Clark County Area Nevada", , issued 1978; the "Uniform Standard Drawings for Public Works Construction, City of Las Vegas, any other applicable approved standards issued by the controlling agency; the Uniform Building Codes and all Local City Codes and Ordinances applicable.
2. The existence and location of any underground utility pipes or structures shown on these plans are obtained by a search of the available records. To the best of our knowledge there are no existing utilities except as shown on these drawings.
3. All construction shall be as shown on these plans, and any alterations shall have the prior approval of the City Engineer.
4. Contractor shall provide all necessary horizontal and vertical transitions for proper drainage. Extent of transitions shall be as shown or as determined by City Engineer or Inspector.

APPROVALS

CLV CITY ENGINEER	10-10-83 DATE	CLV QUALITY CONTROL ENGINEER	10/11/83 DATE
CLV SANITATION ENGINEER	10-10-83 DATE	CHIEF OF LAND DEVEL. & FLOOD CONTROL	N/A DATE
CLV FIRE MARSHALL	10-10-83 DATE	LAS VEGAS VALLEY WATER DISTRICT	10/6/83 DATE
NEVADA POWER CO.	10/6/83 DATE	SOUTHWEST GAS CORP.	10/6/83 DATE
CENTRAL TELEPHONE CO.	10/6/83 DATE		

LAS VEGAS VALLEY WATER DISTRICT

1. All work shall conform to LVWD Standard Plates.
2. All work, except as modified hereon or by note 1, shall be done in accordance with "Uniform Standard Specifications for Public Works Construction, Clark County Area, Nevada," Latest Edition.
3. Notice shall be given to Engineering Department of LVWD 48 hours prior to actual construction.
4. Service saddles or tapped collars will be required on all services; double tapped collars are not permitted.
5. All lines shall be pressure tested to 200 psi.
6.
7. Deflection angle shall not exceed 2½° per 13 foot section of pipe for pipe sizes smaller than 14 inches, and shall not exceed 2° for pipe sizes between 14 and 16 inches.
8. All meters shall be located outside of driveways.
9. Detector tape shall be required in accordance with Std. Plate No. 27 over all mains not installed at 6 feet from back of curb and over all service laterals not installed at right angles to main.
10. Call before you dig. 1-800-227-2600

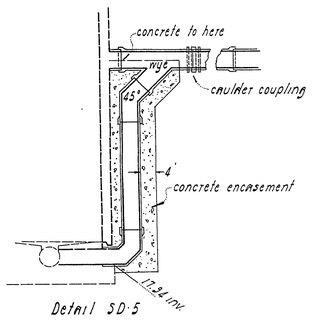

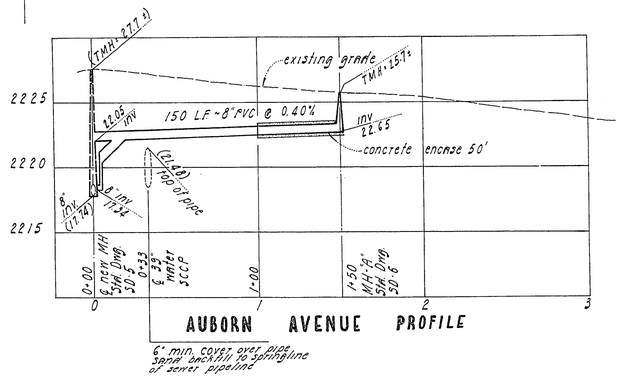

GRADING
SEWER AND WATER PLAN

PARCEL 1 · FILE 36, PAGE 3 OF PARCEL MAPS
IN SECTION 24 · TOWNSHIP 20 SOUTH · RANGE 62 EAST · MDM
CITY OF LAS VEGAS STATE OF NEVADA

SEWER QUANTITIES		WATER QUANTITIES	
Drop manhole	1 each	6" A.C.P.	165 LF
Shallow manhole	1 each	6" G.V.	1 each
8" PVC	150 L.F.	1" meter & service	1 each
service 4"	30 L.F.		

1) Rev. per CLV smh 9-29-83
2) Rev. per CLV smh 10-5-83

JUN 27 1995

22-1-75 307-V565