



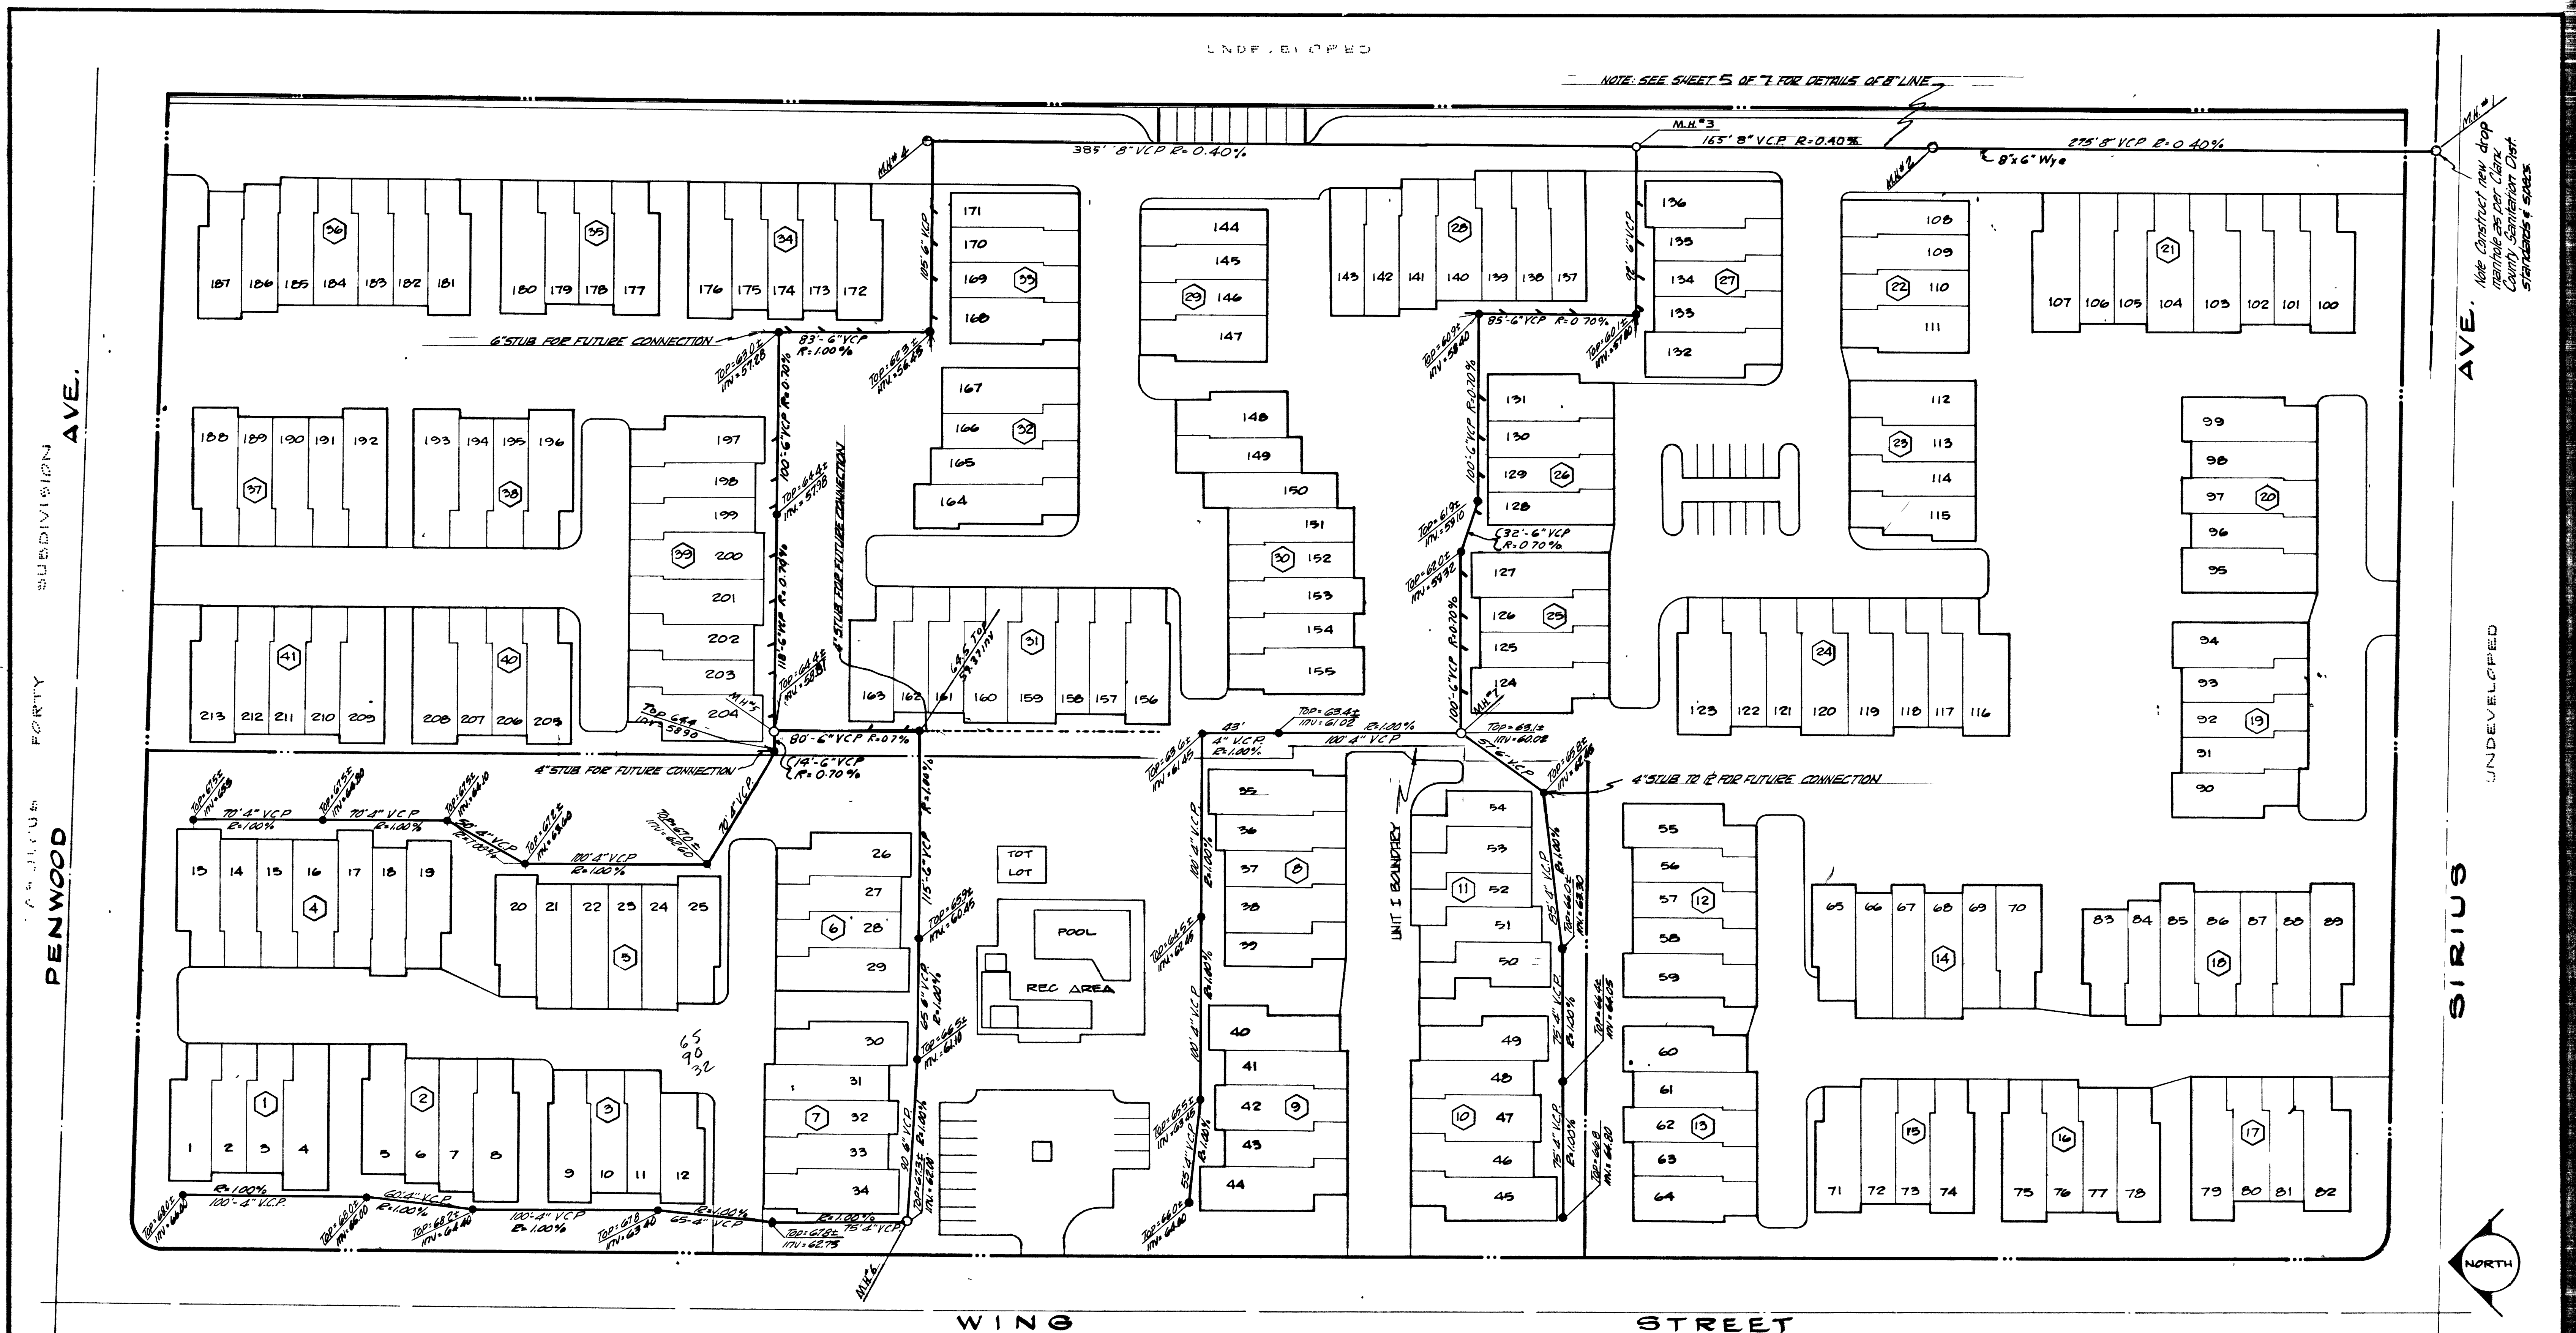

NOTE: SEE SHEET 5 OF 7 FOR DETAILS OF 8" LINE.

Note Construct new drop manhole as per Clark County Sanitation Dist. standards & S&P's

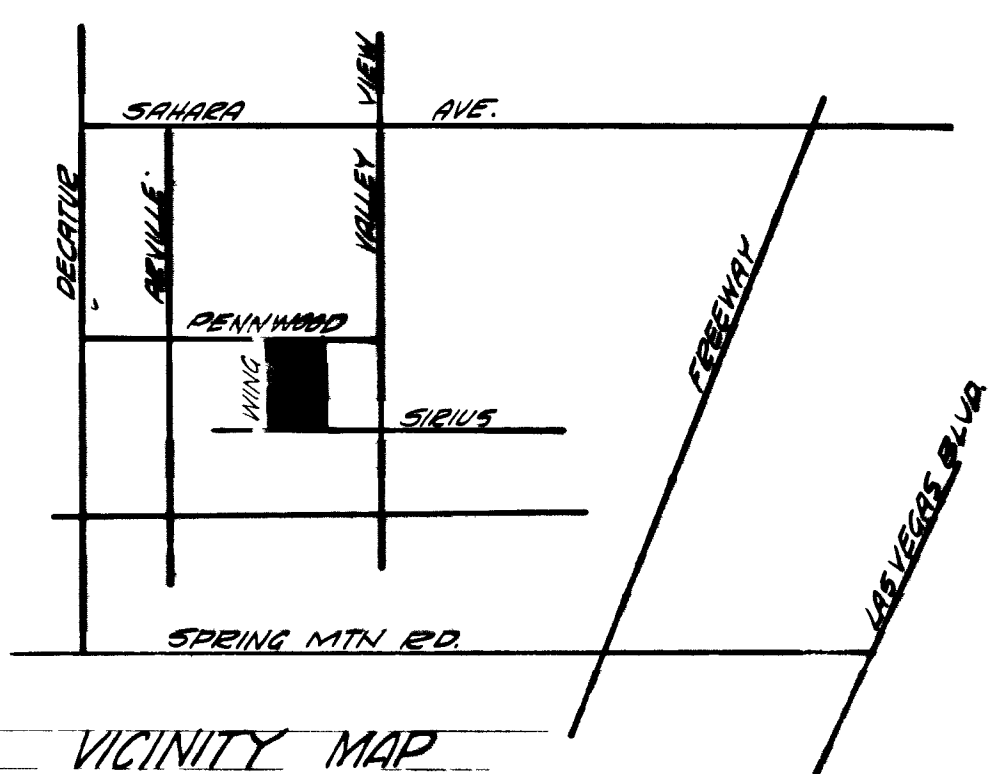

GENERAL NOTES

- 1) Water mains & sewer mains shall have a 10' min separation
- 2) Sewer only to be laid in sewer trench.
- 3) All 4" house laterals to be laid at min grade.
- 4) It shall be the contractors responsibility to perform construction as per plans. Any changes shall first meet with the approval of the City Engineer.
- 5) House services shall comply with the Western Plumbing Code as to separation distance.
- 6) All houses to be served individually as per Sec. 313 of the Uniform Plumbing Code.
7. Construct Wyes for future connections to center of future unit. See Calc Sheet for location

LEGEND & ESTIMATE OF QUANTITIES

8" V.C.P. Sewer main (C.C.S.D.) 825 L.F.

- Standard manholes, (C.C.S.D) = 6 each
- drop manholes, (C.C.S.D) = 1 each
- 6" V.C.P. Sewer main (Private) = 1222 LF.

4" V.C.P. Sewer main (Private) 1393 LF

- *Standard cleanouts* 30 each

2 Wyes for fut. Connection

BENCH MARK 8"x6" Wye 1 E

Rivet & plate at N.E. Cor. of Pennwood &
Wing Sts. Elev. = 2167.93

SUBMITTED BY:

APPROVED BY:

James H. Marshall
Clark County Sanitation District

7/27/71

	CONSULTING ENGINEERS • PLANNERS								
	2209 PARADISE ROAD, LAS VEGAS, NEVADA 89106								
	(702) 734-0227								
<u>BRADFORD PLACE UNIT N21</u>									
<i>MASTER SEWER PLAN</i>									
SCALE	1" = 40'	WO NO	1029	DATE	6-4-71	SHEET		OF	
HORIZ		DES.		REV	8-24-71	4			
VERT		CHK		REV					7

3264

2016-71 3074-965-1

