

CITY OF LAS VEGAS ENGINEERING DEPT.


City of Las Vegas, Nevada
Office of the City Engineer
Approved by: B. J. [Signature]
Date: 11/27/57

APPROVED AS TO DESIGN ONLY
Contractor will be responsible for all
details, dimensions and conformity to
the approved drawings.
By: [Signature]
Date: 11/27/57

Approval of this plan by the City of Las Vegas, Nevada,
does not relieve the City of responsibility for errors
in calculation, design, or planning by the Subdivider's
Engineer or Surveyor.

BONANZA TERRACE

POR. S 1/2 S 1/2 SW 1/4 NE 1/4 SEC. 28
T 20 S, R. 61 E, M. D. B. & M.

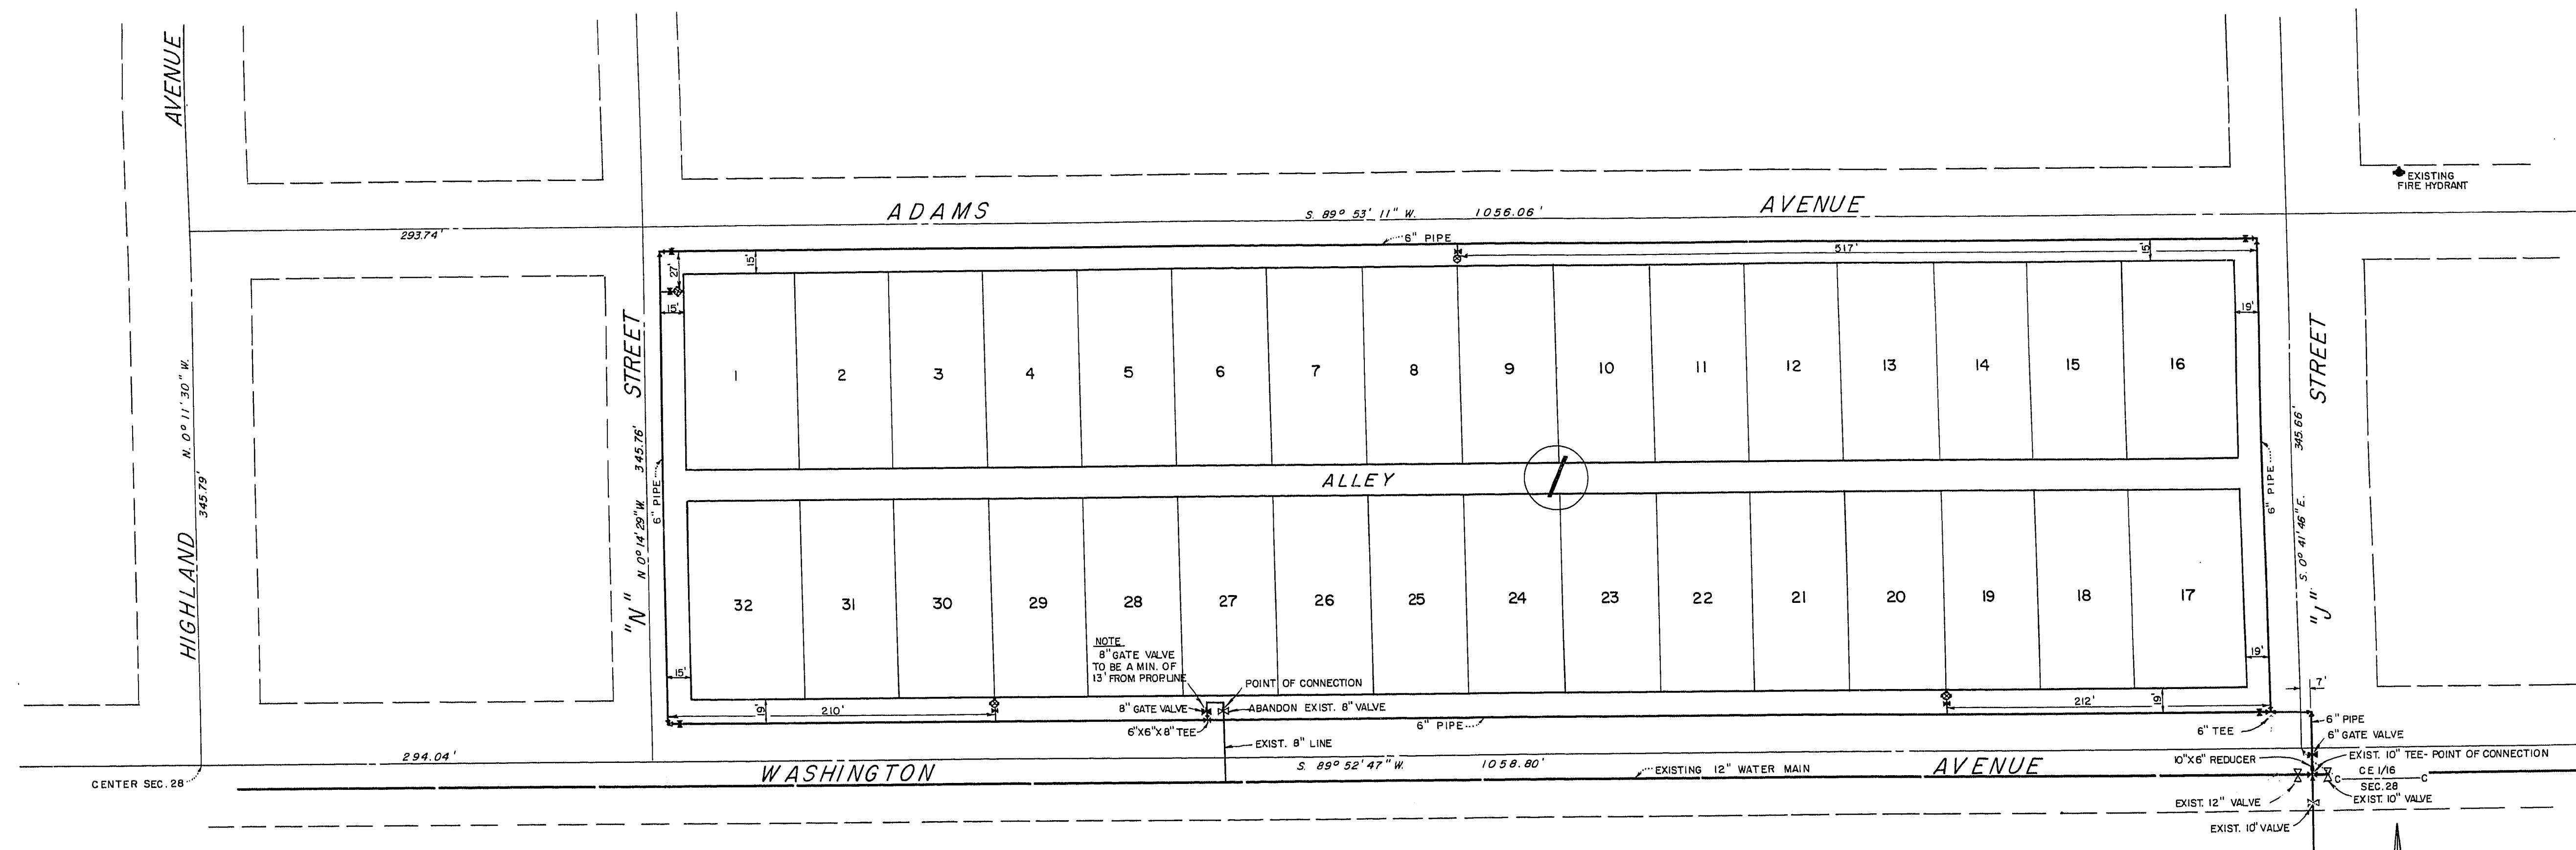

LEGEND
— 6" PIPE
— 6" GATE VALVE
— FIRE HYDRANT

ESTIMATE OF QUANTITIES
6" PIPE..... 2743 LIN. FT.
6" GATE VALVE..... 5 EACH
FIRE HYDRANT..... 4 EACH
FIRE HYDRANT VALVE BOX W/6" GATE VALVE-4-EACH
6"X6"X6" TEE..... 1 EACH
6"X6"X6" TEE..... 1 EACH
6"-90° ELBOW..... 4 EACH
HOUSE SERVICES..... 32 EACH
8" GATE VALVE..... 1 EACH
10"X6" REDUCER..... 1 EACH

NOTE: ALL LABOR AND MATERIALS MUST MEET STANDARDS AND
SPECIFICATIONS OF THE LAS VEGAS VALLEY WATER
DISTRICT AND THE CITY OF LAS VEGAS.

APPROVALS

[Signature] 11/27/57
CITY ENGINEER DATE
[Signature] DATE
FIRE CHIEF
[Signature] 7/1/57
LAS VEGAS VALLEY WATER DISTRICT DATE

BONANZA TERRACE WATER DISTRIBUTION PLAN

DESIGNED BY C.R.M. SCALE: 1"=60'
DRAWN BY C.R.M. **TYSON ENGINEERING COMPANY** SHEET 1
CHECKED BY E.T. CONSULTING ENGINEERS
211 E. CHARLESTON BLVD. LAS VEGAS, NEV. OF 1 SHEETS

REVISED - JAN. 3, 1957
BY C.R.M. TYSON ENGR. CO.