

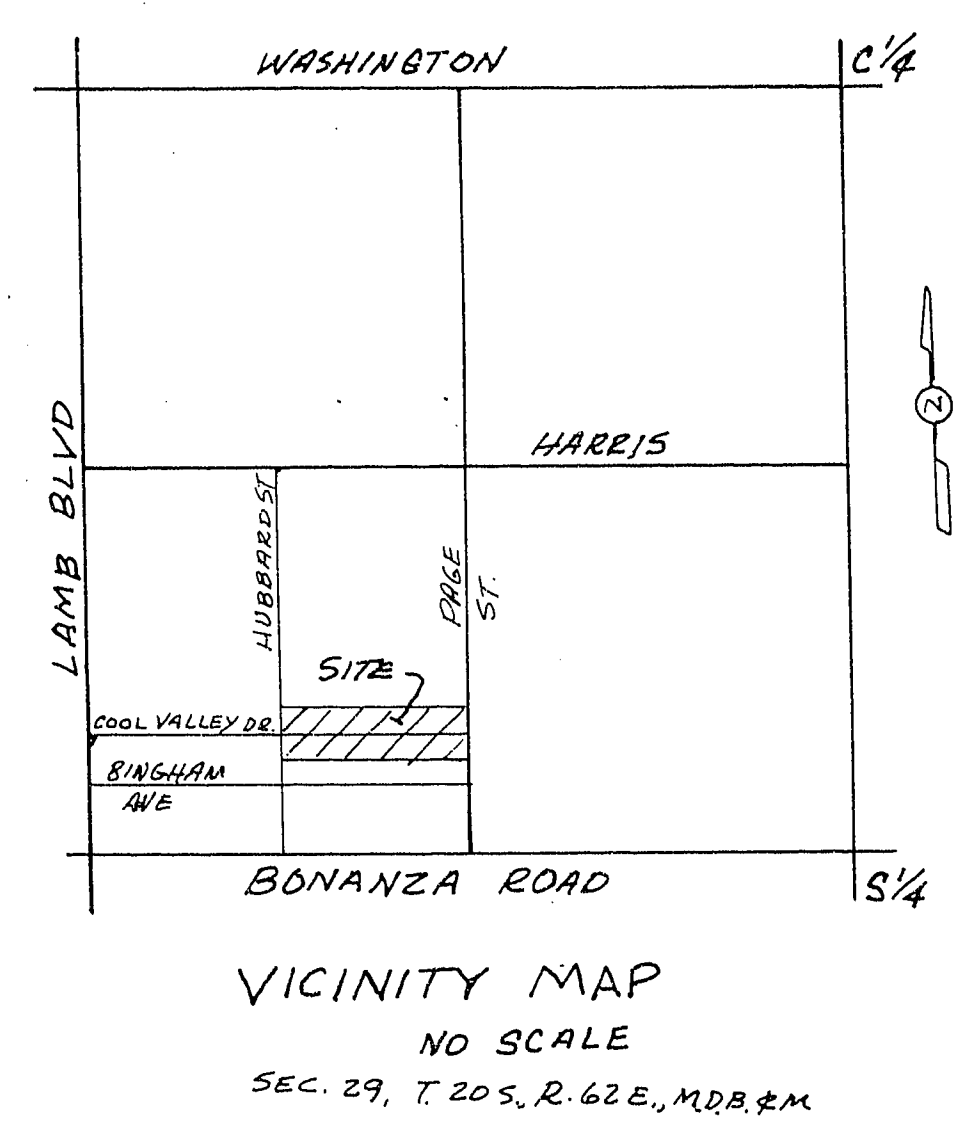


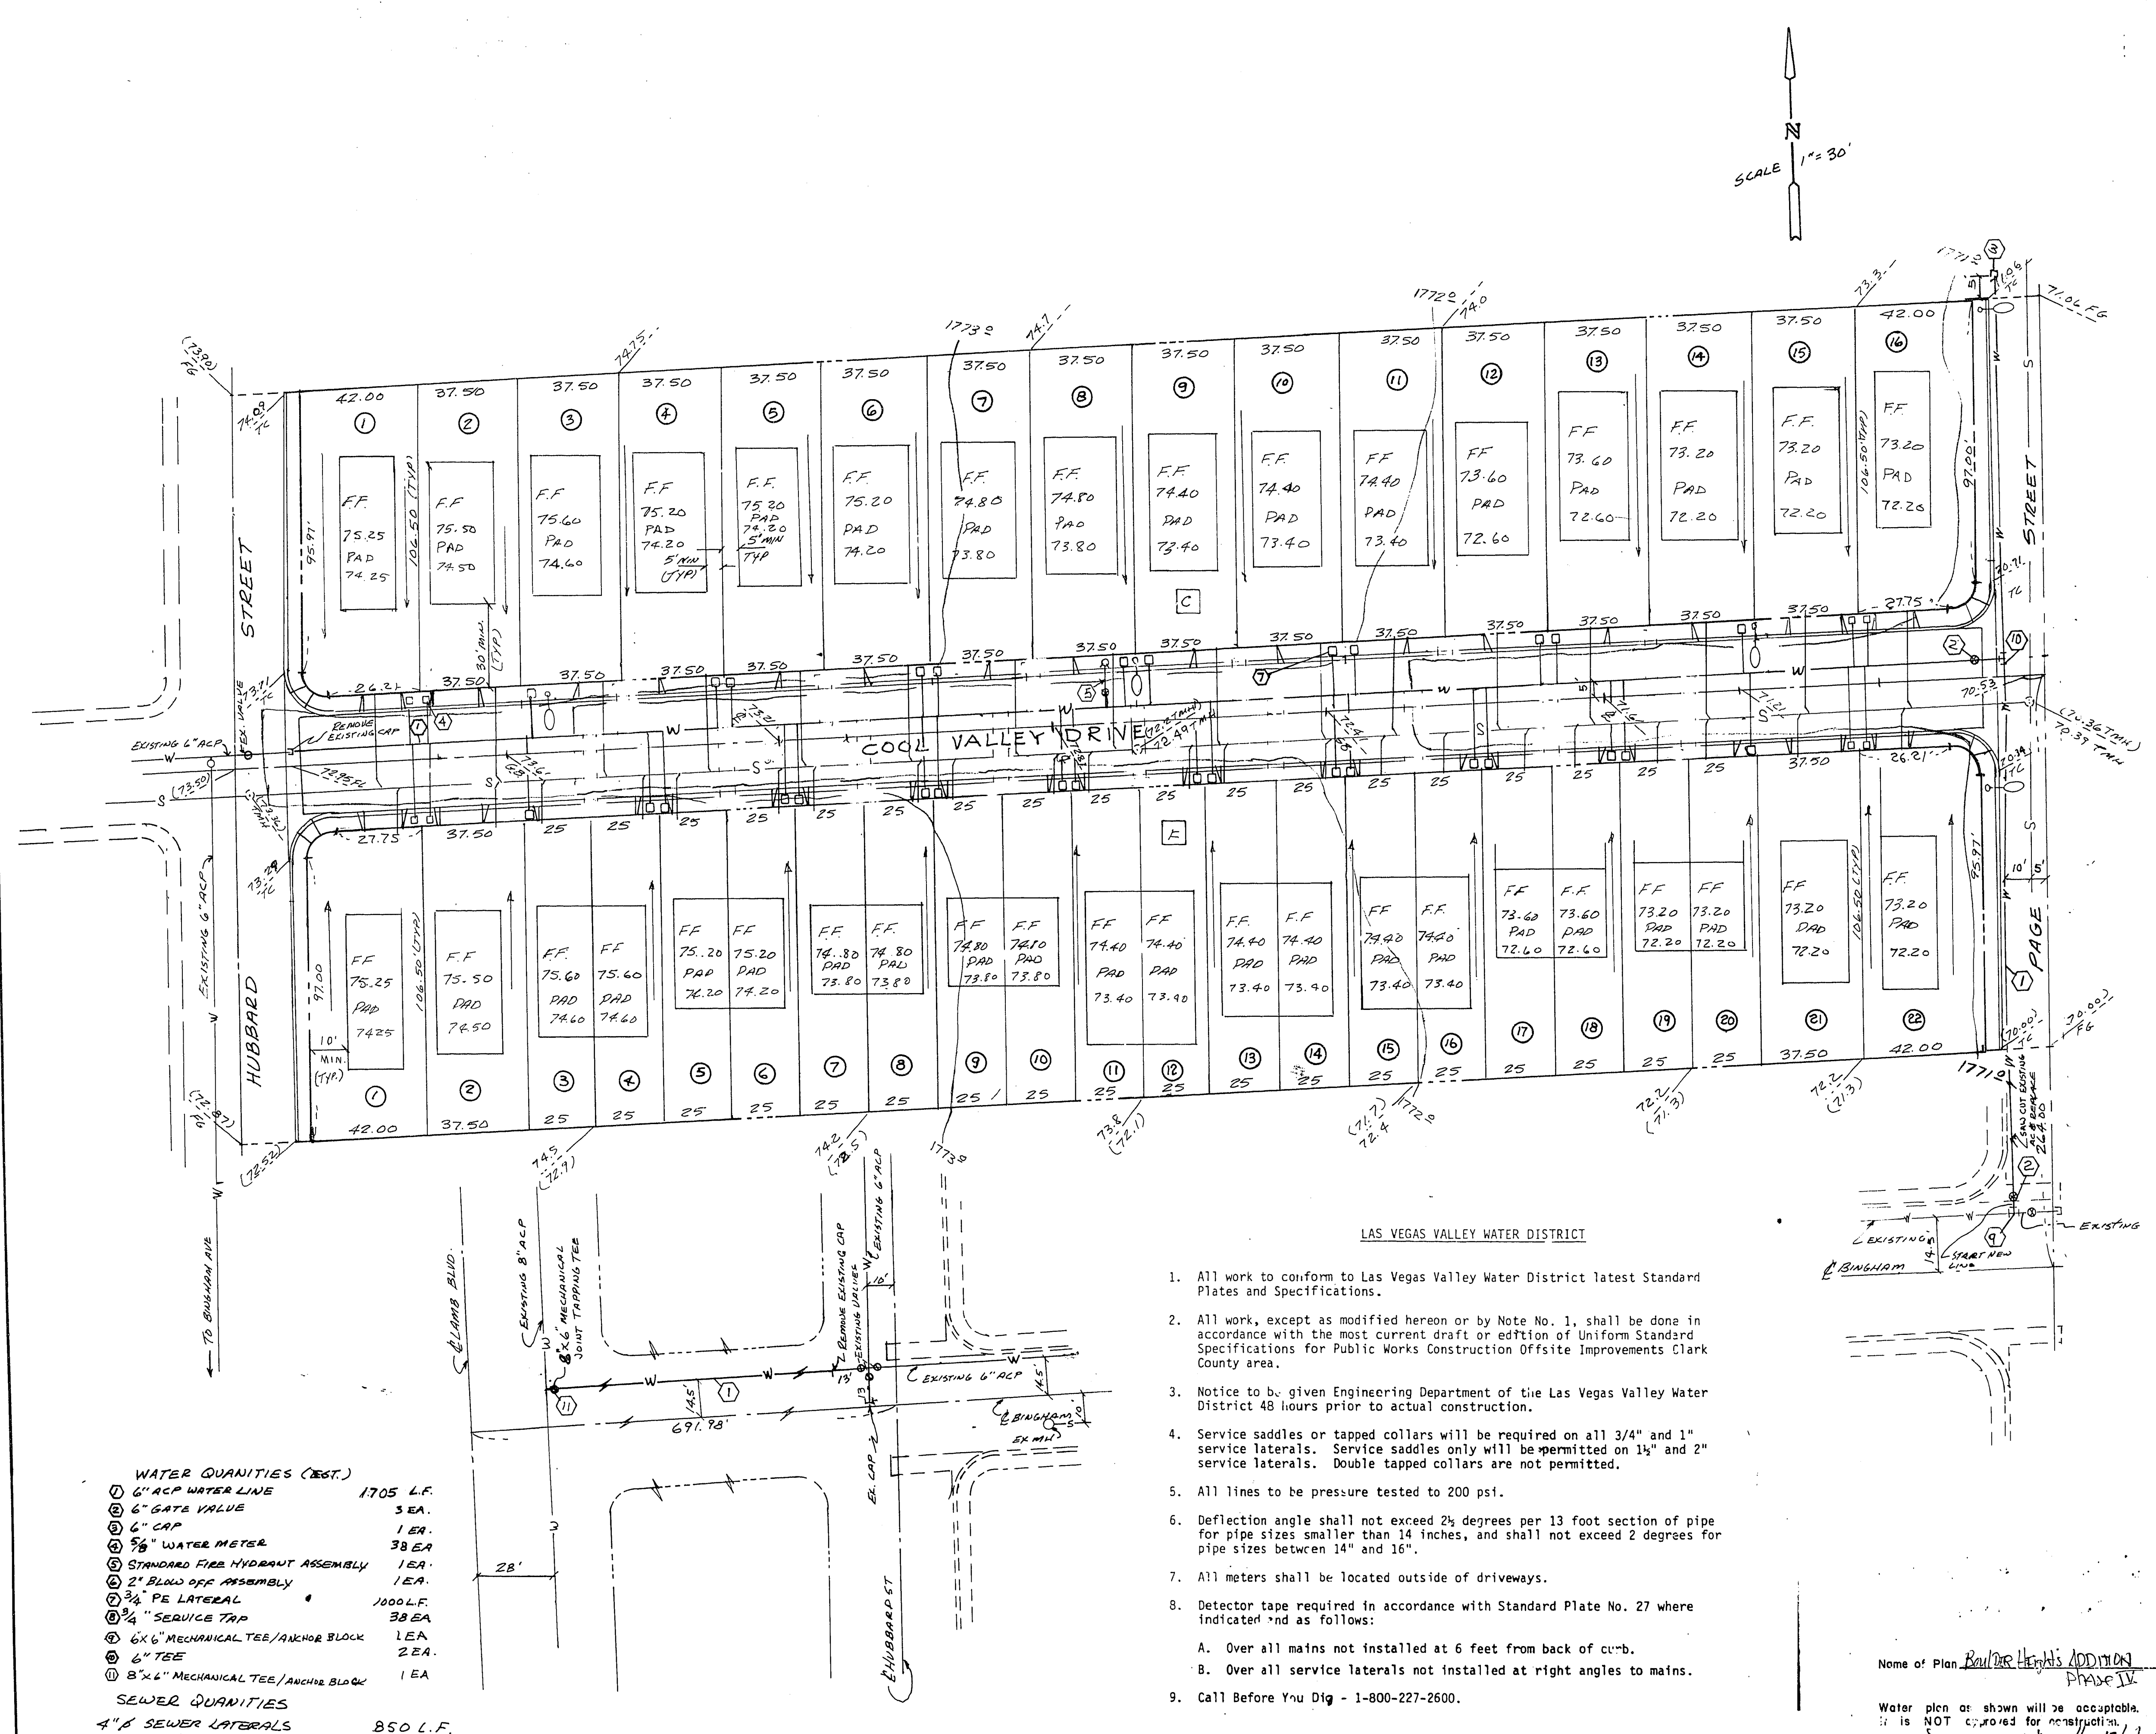

BENCH MARK
CITY OF LAS VEGAS DATUM
ELEV. 1773.31
BM # 06230D1

- LEGEND
- ① LOT NUMBER
 - FF FINISHED FLOOR
 - (72.0) EXISTING ELEV.
 - 72.0 DESIGN ELEV.
 - F.H. FIRE HYDRANT
 - G.B. GRADE BREAK
 - BLOCK NUMBER

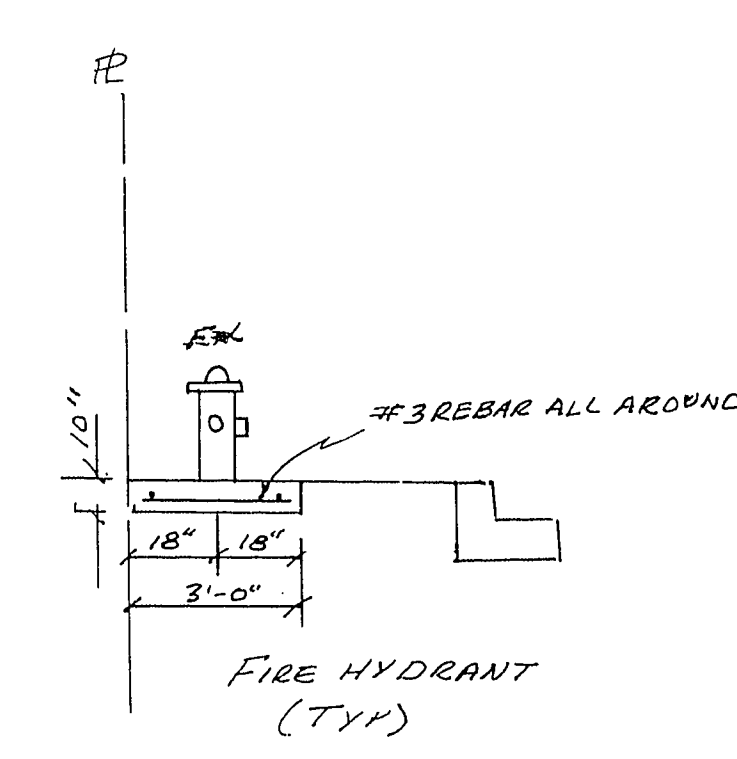

- LAS VEGAS VALLEY WATER DISTRICT
- All work to conform to Las Vegas Valley Water District latest Standard Plates and Specifications.
 - All work, except as modified hereon or by Note No. 1, shall be done in accordance with the most current draft or edition of Uniform Standard Specifications for Public Works Construction Offsite Improvements Clark County area.
 - Notice to be given Engineering Department of the Las Vegas Valley Water District 48 hours prior to actual construction.
 - Service saddles or tapped collars will be required on all 3/4" and 1" service laterals. Service saddles only will be permitted on 1 1/2" and 2" service laterals. Double tapped collars are not permitted.
 - All lines to be pressure tested to 200 psi.
 - Deflection angle shall not exceed 2 1/2 degrees per 13 foot section of pipe for pipe sizes smaller than 14 inches, and shall not exceed 2 degrees for pipe sizes between 14" and 16".
 - All meters shall be located outside of driveways.
 - Detector tape required in accordance with Standard Plate No. 27 where indicated and as follows:
 - A. Over all mains not installed at 6 feet from back of curb.
 - B. Over all service laterals not installed at right angles to mains.
 - Call Before You Dig - 1-800-227-2600.

- WATER QUANTITIES (EST.)
- ① 6" ACP WATER LINE 1705 L.F.
 - ② 6" GATE VALVE 3 EA.
 - ③ 6" CAP 1 EA.
 - ④ 5/8" WATER METER 38 EA.
 - ⑤ STANDARD FIRE HYDRANT ASSEMBLY 1 EA.
 - ⑥ 2" BLOW OFF ASSEMBLY 1 EA.
 - ⑦ 3/4" PE LATERAL 1000 L.F.
 - ⑧ 3/4" SERVICE TAP 38 EA.
 - ⑨ 6"x6" MECHANICAL TEE/ANCHOR BLOCK 1 EA.
 - ⑩ 6" TEE 2 EA.
 - ⑪ 8"x6" MECHANICAL TEE/ANCHOR BLOCK 1 EA.
- SEWER QUANTITIES
- 4" S SEWER LATERALS 850 L.F.

NOTE: MAIN SEWER LINE IS EXISTING
THE LATERALS TO HOUSES NEED
TO BE INSTALLED.

LOOPED WATER LINE

APPROVALS

Name of Plan <u>Boulder Heights Addition</u>	DATE <u>12/14/85</u>
<u>David A. Donnelly</u> LAS VEGAS VALLEY WATER DIST.	DATE
<u>[Signature]</u> CLV. CHIEF, LAND DEVELOPMENT	DATE <u>12-26-85</u>
<u>David A. Donnelly</u> CLV. FIRE MARSHALL	DATE <u>12/18/85</u>

Water plan as shown will be acceptable.
It is NOT approved for construction.

PREPARED FOR
GERALD LEAVITT

KENNETH D. FARRIMOND
REGISTERED ENGINEER
#4134
LAS VEGAS, NEVADA

BOULDER HEIGHTS ADDITION
TRACT #1, PHASE III
PLOT # GRADING PLAN AND SEWER & WATER PLAN
SECTION 29, TOWNSHIP 20 SOUTH, RANGE 62 EAST, M.D.B. 14M
CLARK COUNTY NEVADA

SHEET
2
OF
4