


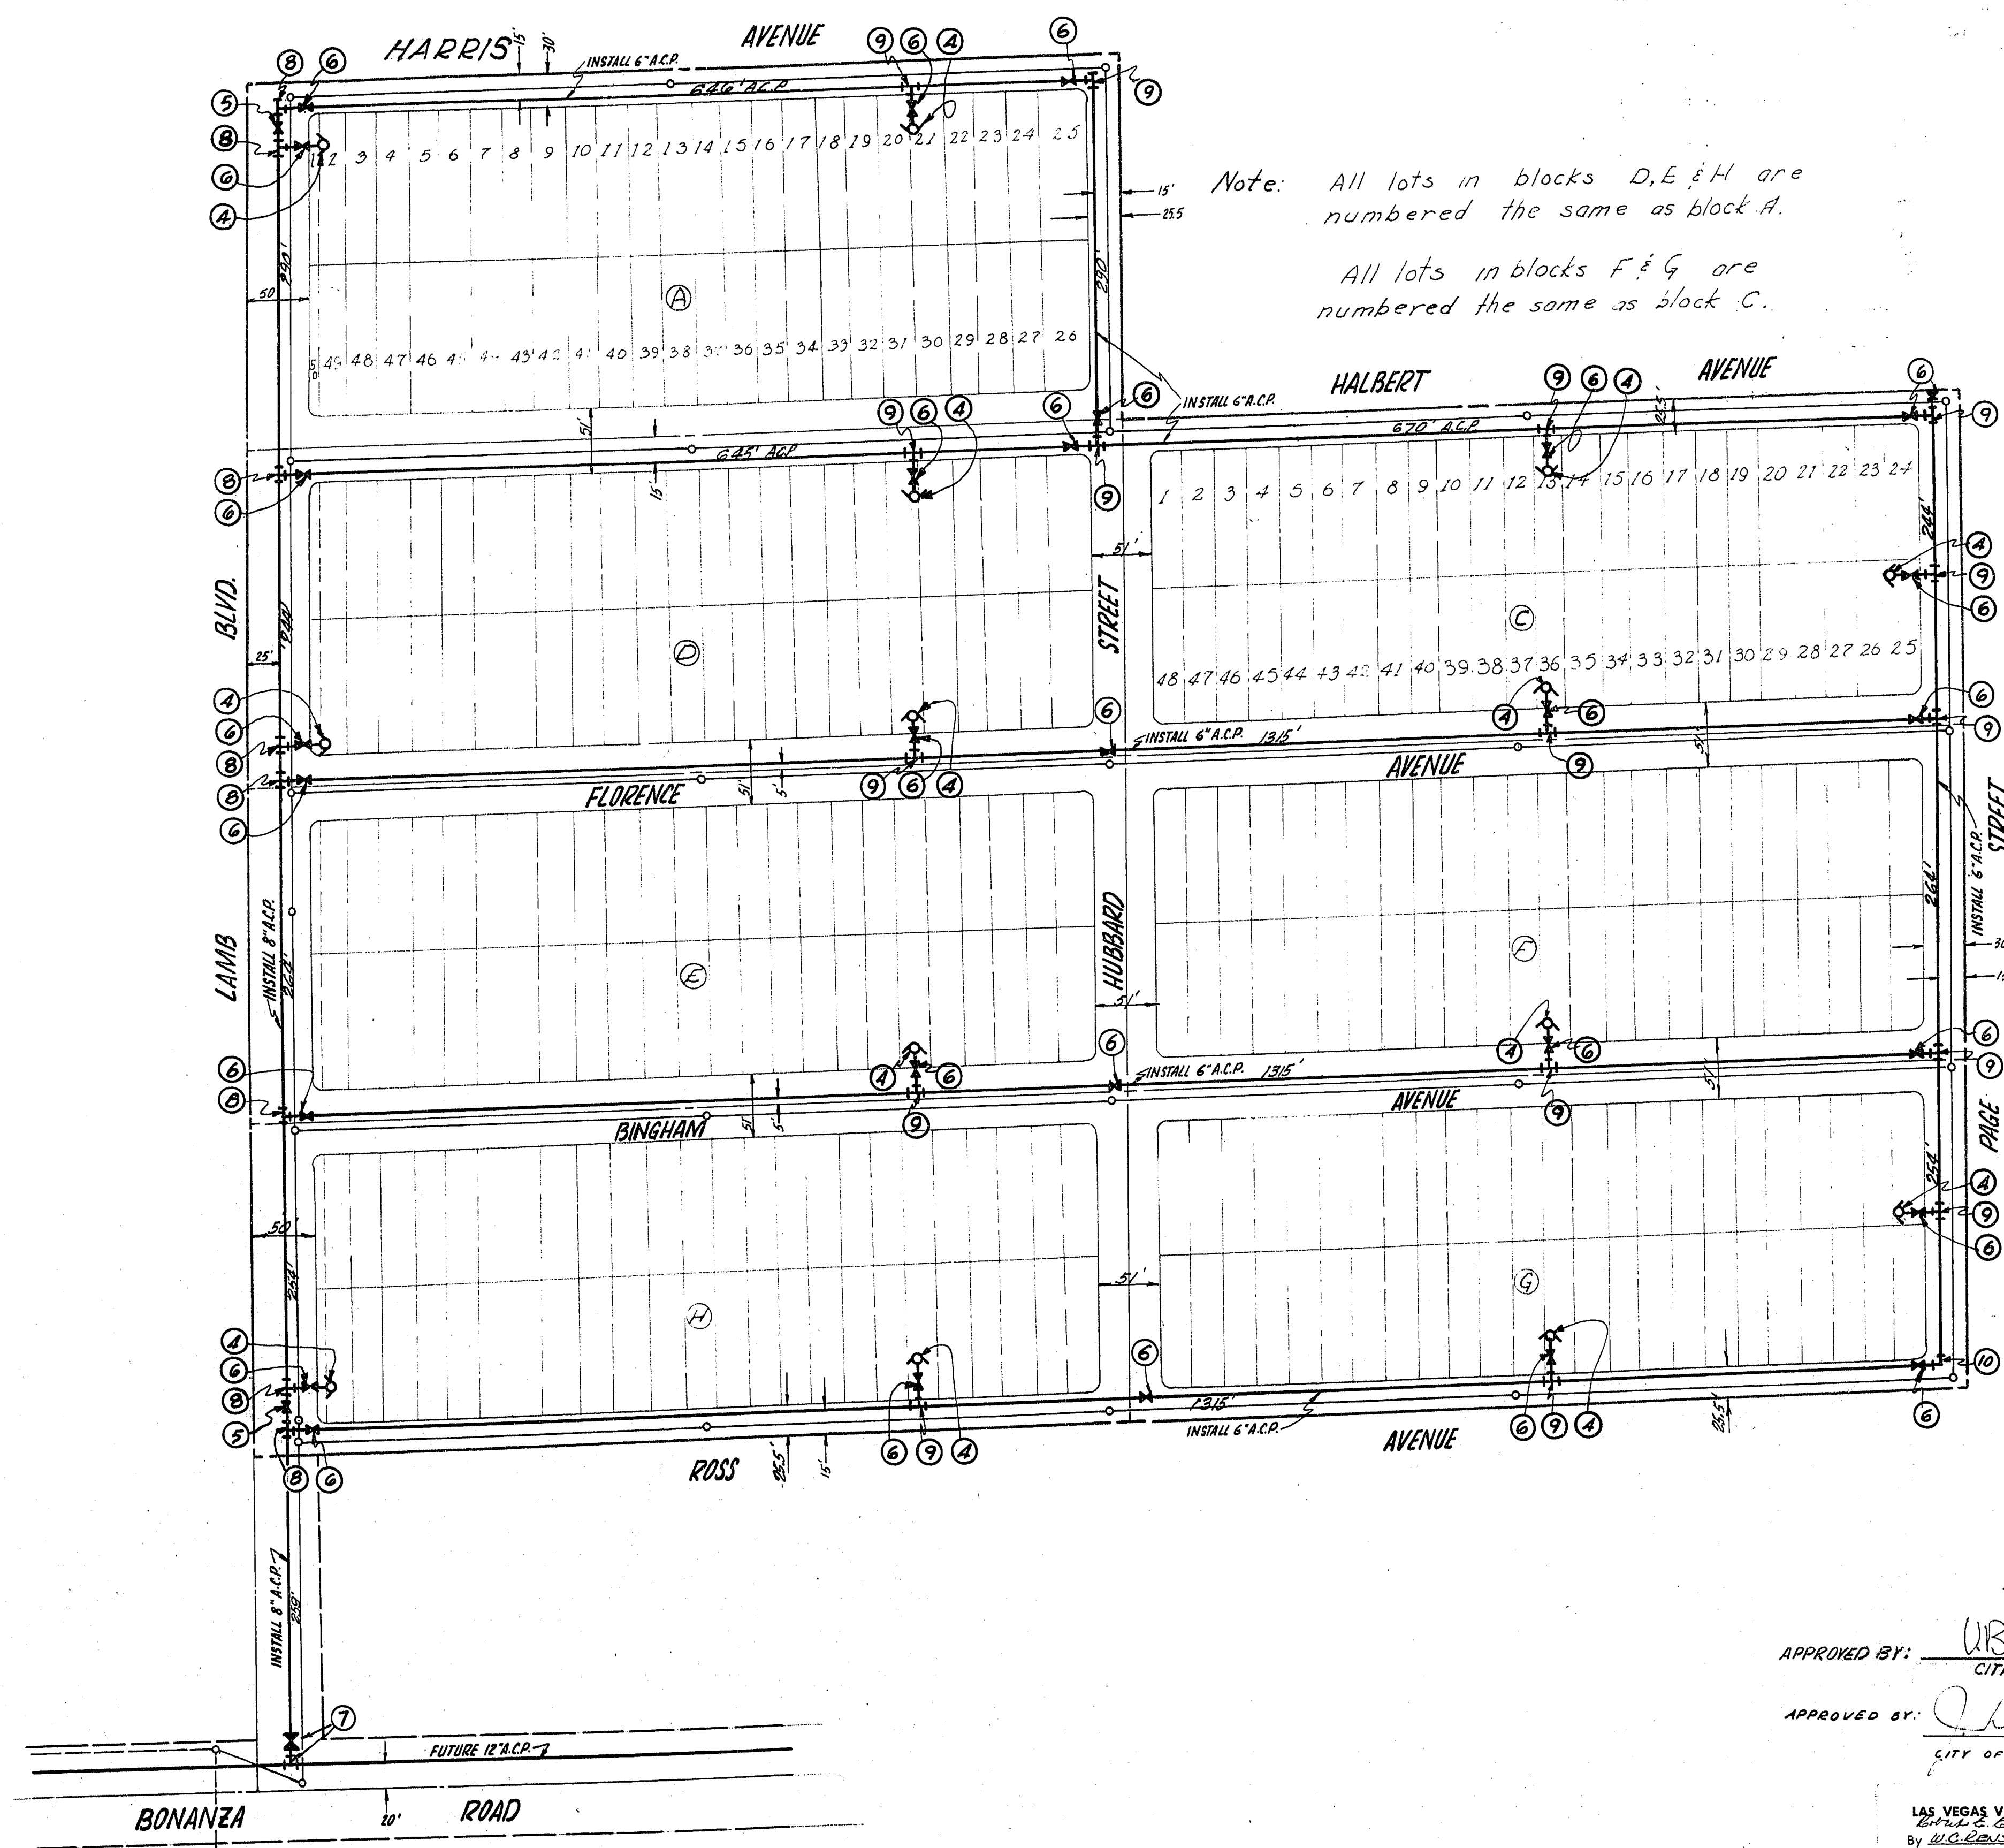

CONET. ALL WATER LINES & SERVICE CONNECTIONS IN ACCORDANCE WITH THE LAS VEGAS VALLEY WATER DIST. STDS.

HYDRANTS INST. ON 100' $\frac{9}{16}$ " SFS. TO BE LOC. 18" BACK OF CURB

HYDRANTS INST. ON 51' $\frac{9}{16}$ " SFS. TO BE LOC. 12" BACK OF PL. WITHIN 3' UTIL. EASEMENT. A 3' x 5' CONC. SLAB TO BE PLACED AROUND HYDRANT

QUANTITIES		
N ^o	ITEM	AMOUNT
1	8" WATER MAIN	1056 LF.
2	6" "	7191 LF.
3	3/4" HOUSE SERVICES	192 EA.
4	STD. FIRE HYDRANT	14 EA.
5	8" GATE VALVE	2 EA.
6	6" "	29 EA.
8	8" x 8" x 6" TEE	8 EA.
9	6" x 6" x 6" "	14 EA.
10	6" x 6" ELL	1 EA.
OFF SITE		
1	8" WATER MAIN	259 LF.
7	12" x 8" TAPPING TEE & 8" TAPPING VALVE	1 EA.

APPROVED BY: W.B. Whiting 10-29-63
CITY ENGINEER

APPROVED BY: C.W. Miller 9-25-63
CITY OF LAS VEGAS FIRE CHIEF

LAS VEGAS VALLEY WATER DISTRICT
By W.C. Rasmussen Date 10/1/63
THIS SIGNATURE IS NOT AN OFFICIAL APPROVAL. IT INDICATES ONLY THAT THE TRACING WAS IN ACCORDANCE WITH THE APPROVED PRINT AT TIME OF SIGNATURE.

R.P. Jones
12-9-63

Submitted By: Victor G. Kramphauer
Victor G. Kramphauer
Nevada Cert. RCE 1511

Boulder Heights Addition
Water Layout

Drawn By: P. H. H. H. Checked By: P. H. H. H. Scale: 1"=80' Sheet: 15 of 22

21-6-64 562g-980-1