
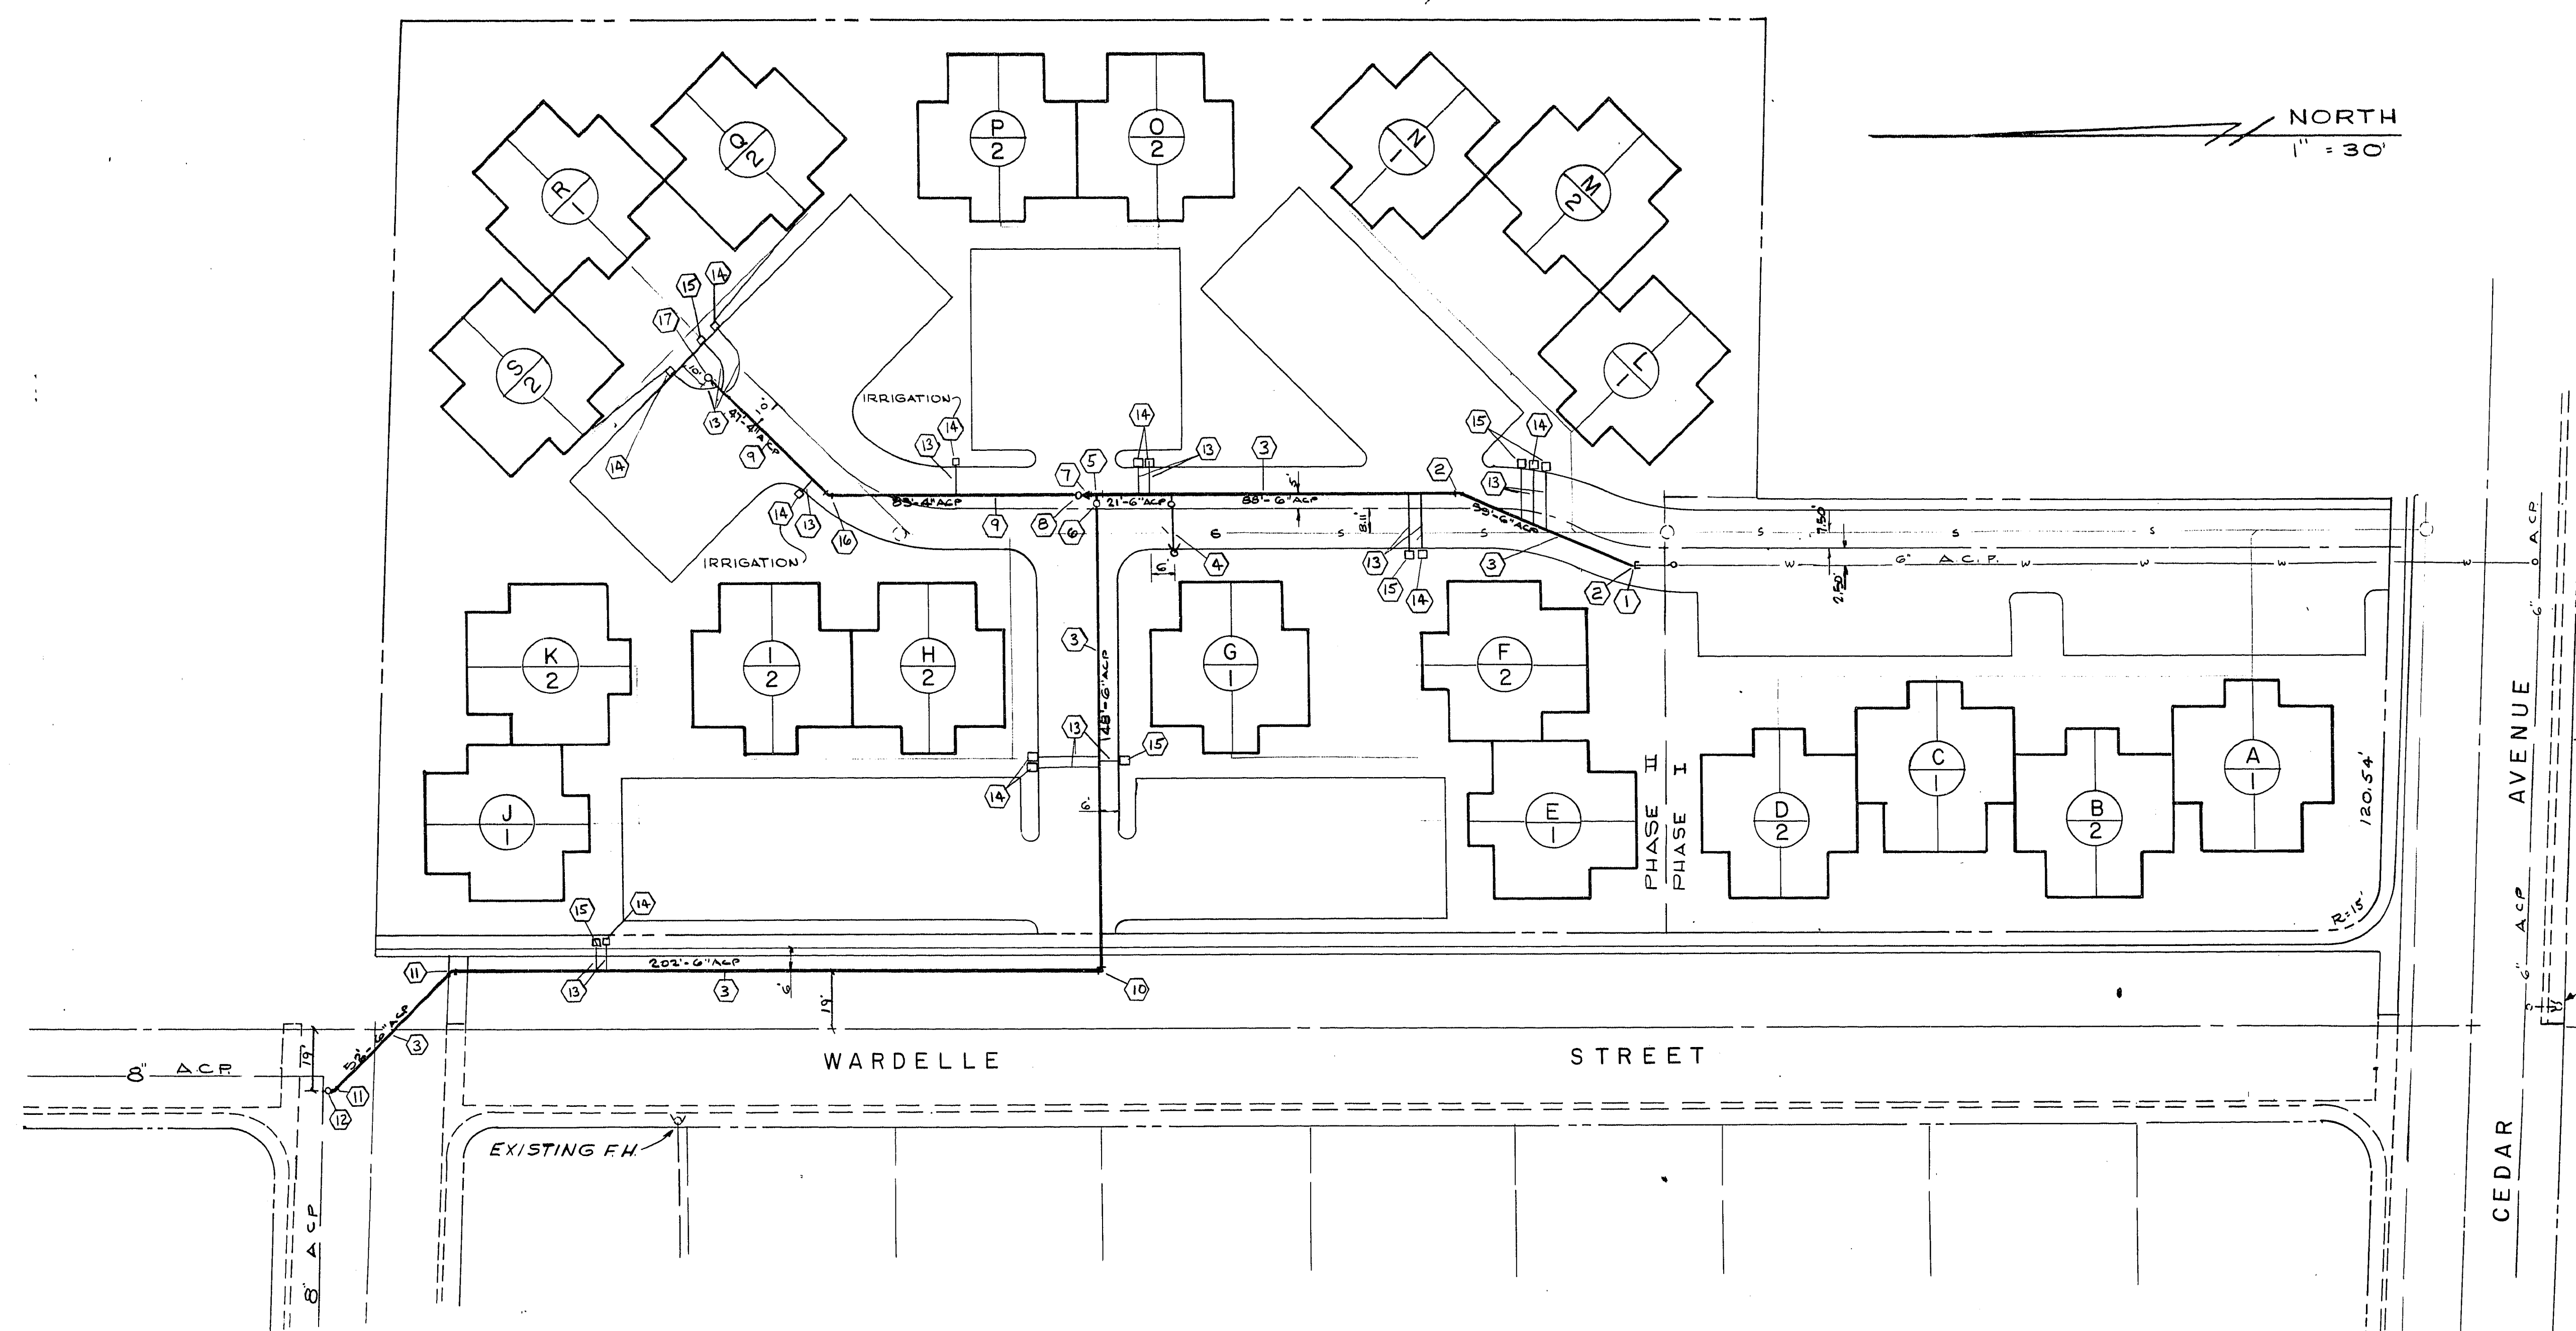


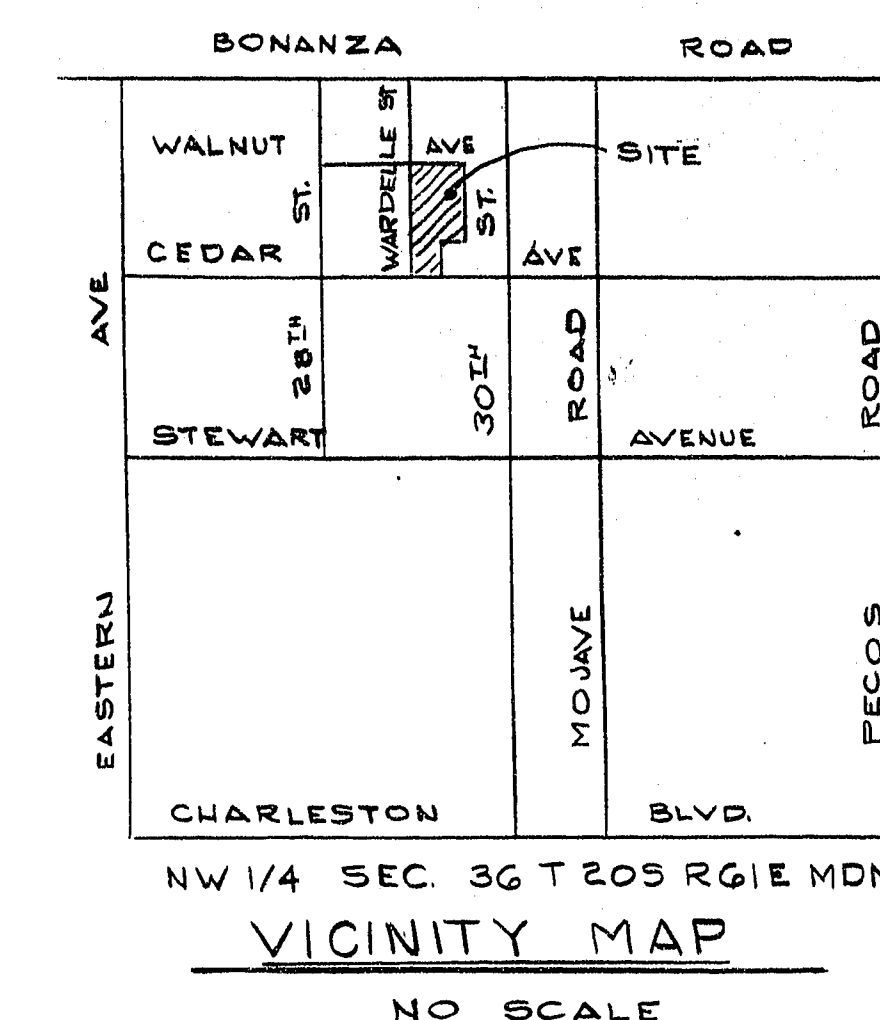

LAS VEGAS VALLEY WATER DISTRICT

- All work to conform to Las Vegas Valley Water District Standard Plates.
- All work, except as modified hereon or by Note No. 1, shall be done in accordance with the most current draft or edition of Uniform Standard Specifications for Public Works Construction Offsite Improvements Clark County area.
- Notice to be given Engineering Department of the Las Vegas Valley Water District 48 hours prior to actual construction.
- Service saddles or tapped collars will be required on all services; double tap collars are not permitted.
- All lines to be pressure tested to 200 psi.
- All valve boxes shall have concrete collars PER LATEST CLV STD. DWG
- Deflection angle shall not exceed 2 1/2 degrees per 13 foot section of pipe for pipe sizes smaller than 14 inches, and shall not exceed 2 degrees for pipe sizes between 14" and 16".
- All meters shall be located outside of driveways.
- Detector tape required in accordance with Standard Plate No. 27 where indicated and as follows:
 - Over all mains not installed at 6 feet from back of curb.
 - Over all service laterals not installed at right angles to mains.
- Call Before You Dig - 800-227-2600
- FIRE HYDRANTS SHALL BE INSTALLED AND IN OPERATION WITHIN 300 FT OF NEW BUILDING CONSTRUCTION PRIOR TO THAT CONSTRUCTION (L.V.F.D.)

ESTIMATED QUANTITIES

①	REMOVE 6" CAP & 2" BLOWOFF	1 EA
②	6"-22 1/2" ELL	2 EA
③	6" A.C.P.	570 LF
④	FIREHYDRANT ASSEMBLY (COMPLETE)	1 EA
⑤	6" x 6" TEE	1 EA
⑥	6" VALVE W/ VALVE BOX	1 EA
⑦	6" x 4" REDUCER	1 EA
⑧	4" VALVE W/ VALVE BOX	1 EA
⑨	4" A.C.P.	130 LF
⑩	6" 90° ELL	1 EA
⑪	6" 45° ELL	2 EA
⑫	8" x 6" TAPPING TEE & VALVE W/ VALVE BOX	1 EA
⑬	3/4" RE SERVICE LATERAL	300 LF
⑭	3/4" WATER METER BY L.V.W.D	11 EA
⑮	5/8" WATER METER BY L.V.W.D	6 EA
⑯	4" 45° ELL	1 EA
⑰	4" CAP W/ 2" BLOW-OFF	1 EA

APPROVALS:

William J. Harris 4/28/82
 CITY ENGINEER DATE
John Ford 4/27/82
 CLV - FIRE MARSHALL DATE
[Signature] 4/24/82
 CLV - QUALITY CONTROL ENGINEER DATE
[Signature] 5-10-82
 CLV - FIELD OPERATIONS ENGINEER DATE
 LAS VEGAS VALLEY WATER DISTRICT

SUBMITTED BY:

DAVID B. PECKHAM
 No. 3340
 RPE 3340

GENERAL NOTES

- All trenching to be done by hand where danger to existing utilities is imminent.
- Existing utilities are located on plans for the convenience of the contractor only. The contractor shall bear full responsibility for the protection of utilities and the engineer bears no responsibility for utilities not shown on plans or not in the location shown on the plans. Contractor to verify the exact location of utilities prior to construction.
- Contractor shall provide access to private property at all times during construction.
- All work shall be contained within the right-of-way or easements shown on plans.

Peckham Engineering
 CONSULTING CIVIL ENGINEERS

3017 W. Charleston Blvd.
 Tempe Plaza, Suite 54
 Las Vegas, Nev. 89102
 (702) 870-4887/870-9925

CEDAR PARK II

WATER PLAN

SCALE	DATE	W.O. NO.	SHEET
1" = 30'	JAN '82	1-1007	5 of 5

22-b-44 567g-1025-I-II