



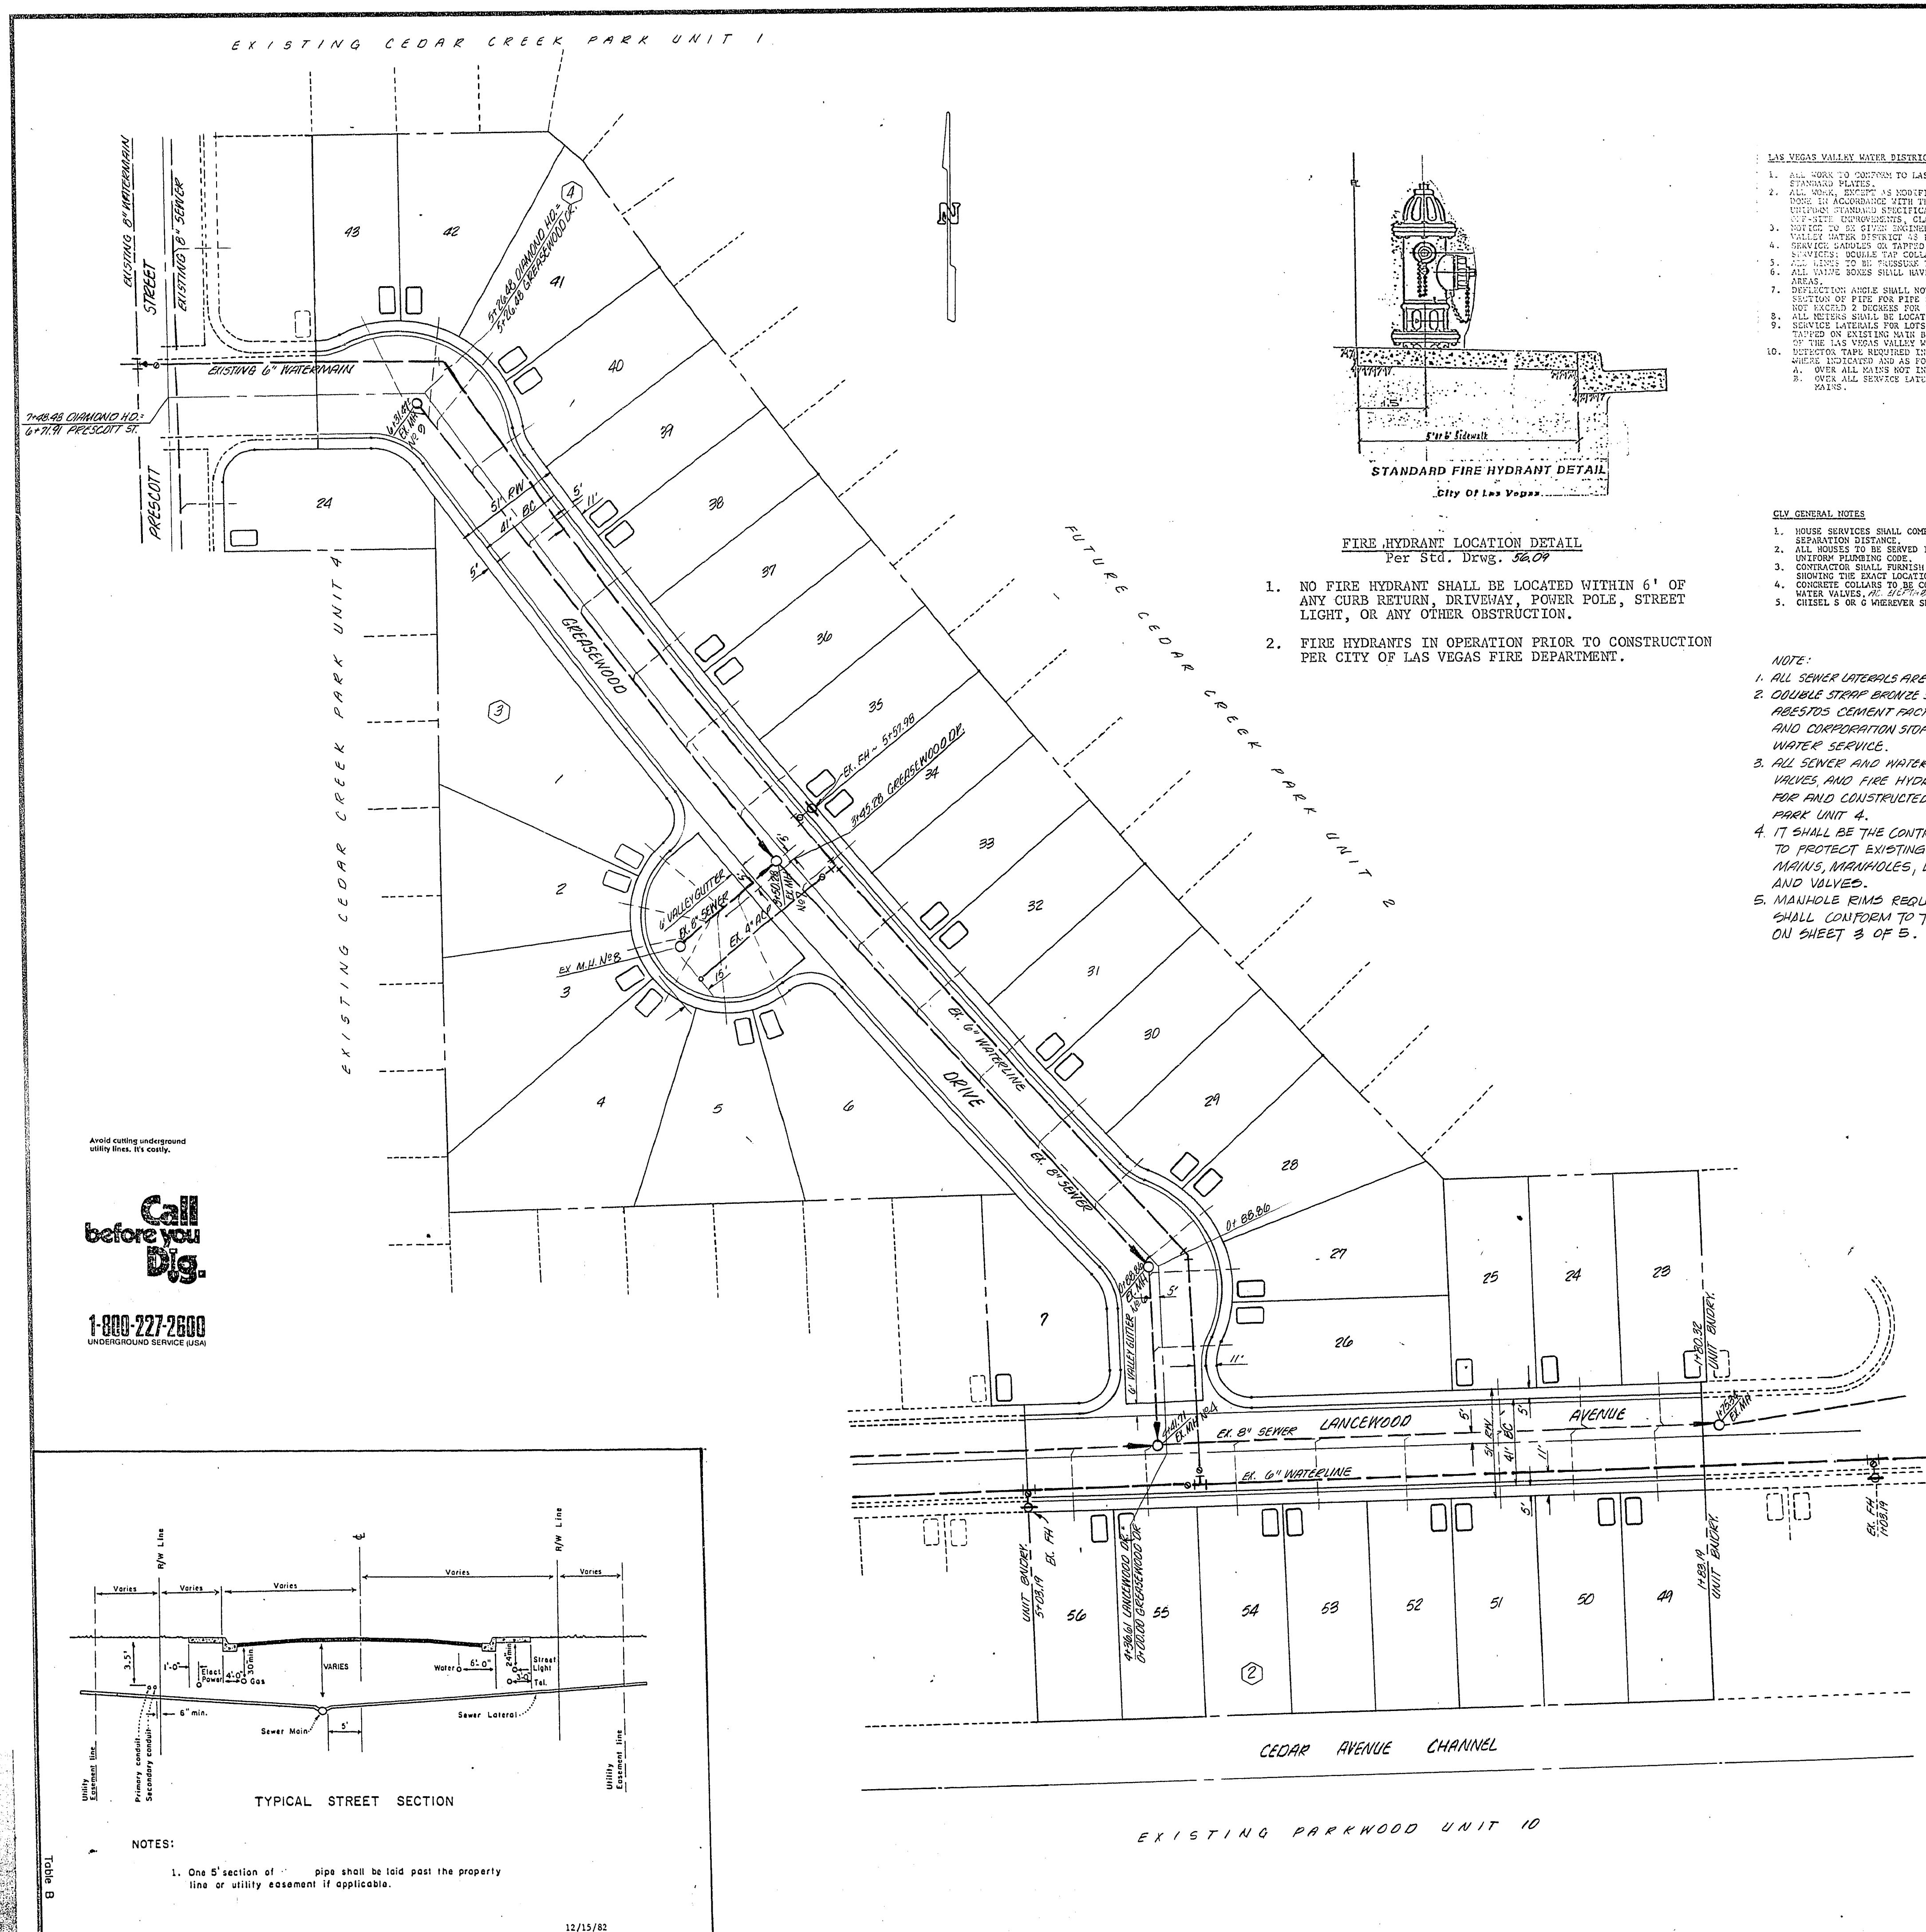

- LAS VEGAS VALLEY WATER DISTRICT NOTES**
1. ALL WORK TO CONFORM TO LAS VEGAS VALLEY WATER DISTRICT STANDARD SPECIFICATIONS.
 2. ALL WORK, EXCEPT AS NOTED HEREON OR BY NOTE NO. 1, SHALL BE DONE IN ACCORDANCE WITH THE MOST CURRENT EDITION OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, CITY OF LAS VEGAS, CLARK COUNTY AREA.
 3. EXCEPT TO THE EXTENT OTHERWISE NOTED, THE LAS VEGAS VALLEY WATER DISTRICT IS NOT RESPONSIBLE FOR THE DESIGN OF ANY SERVICE LATERALS OR TAPPED COLLARS WILL BE SUBMITTED ON ALL SERVICE LATERALS FOR APPROVAL.
 4. ALL SERVICE LATERALS SHALL BE CONCRETE COLLARS AT SURFACE OF PAVED AREAS.
 5. DEFLECTION SHALL NOT EXCEED 1/4 INCH PER 10 FEET SECTION OF PIPE FOR PIPE SIZES SMALLER THAN 14", AND SHALL NOT EXCEED 2 DEGREES FOR PIPE SIZES BETWEEN 14" AND 16".
 6. ALL SERVICE LATERALS SHALL BE LOCATED OUTSIDE OF DRIVEWAYS.
 7. SERVICE LATERALS FOR LOTS WILL BE TAPPED ON EXISTING MAIN BY OWNER'S CONTRACTOR UNDER DIRECTION OF THE LAS VEGAS VALLEY WATER DISTRICT.
 8. INSPECTION TAP REQUIRED IN ACCORDANCE WITH STANDARD PLATE NO. 27 WHERE INDICATED AND AS FOLLOWS:
A. OVER ALL MAINS NOT INSTALLED AT 6 FEET FROM BACK OF CURB.
B. OVER ALL SERVICE LATERALS NOT INSTALLED AT 6 FEET FROM BACK OF CURB.

- CITY GENERAL NOTES**
1. HOUSE SERVICES SHALL COMPLY WITH WESTERN PLUMBING CODE AS THE SEPARATION DISTANCE.
 2. ALL HOUSES TO BE SERVED INDIVIDUALLY AS PER SECTION 313 OF THE UNIFORM PLUMBING CODE.
 3. CONTRACTOR SHALL FURNISH THE ENGINEER WITH AS-BUILT DRAWINGS SHOWING THE EXACT LOCATIONS OF ALL HOUSE CONNECTIONS.
 4. CONCRETE COLLARS TO BE CONSTRUCTED AROUND ALL MANHOLES AND WATER VALVES, AND 24" MIN. IN DIAMETER.
 5. CHISEL S OR C WHEREVER SEWER OR GAS LINES PASS UNDER CURB.

- NOTE:**
1. ALL SEWER LATERALS ARE EXISTING.
 2. DOUBLE STRAP BRONZE SERVICE SADDLE OR ARBESTOS CEMENT FACTORY TAPPED COLLAR, AND CORPORATION STOP, EXIST FOR EACH WATER SERVICE.
 3. ALL SEWER AND WATER MAINS, MANHOLES, VALVES, AND FIRE HYDRANTS, WERE BONDED FOR AND CONSTRUCTED WITH CEDAR CREEK PARK UNIT 4.
 4. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO PROTECT EXISTING SEWER AND WATER MAINS, MANHOLES, LATERALS, HYDRANTS, AND VALVES.
 5. MANHOLE RIMS REQUIRING ADJUSTMENT SHALL CONFORM TO THE ELEVATIONS SHOWN ON SHEET 3 OF 5.

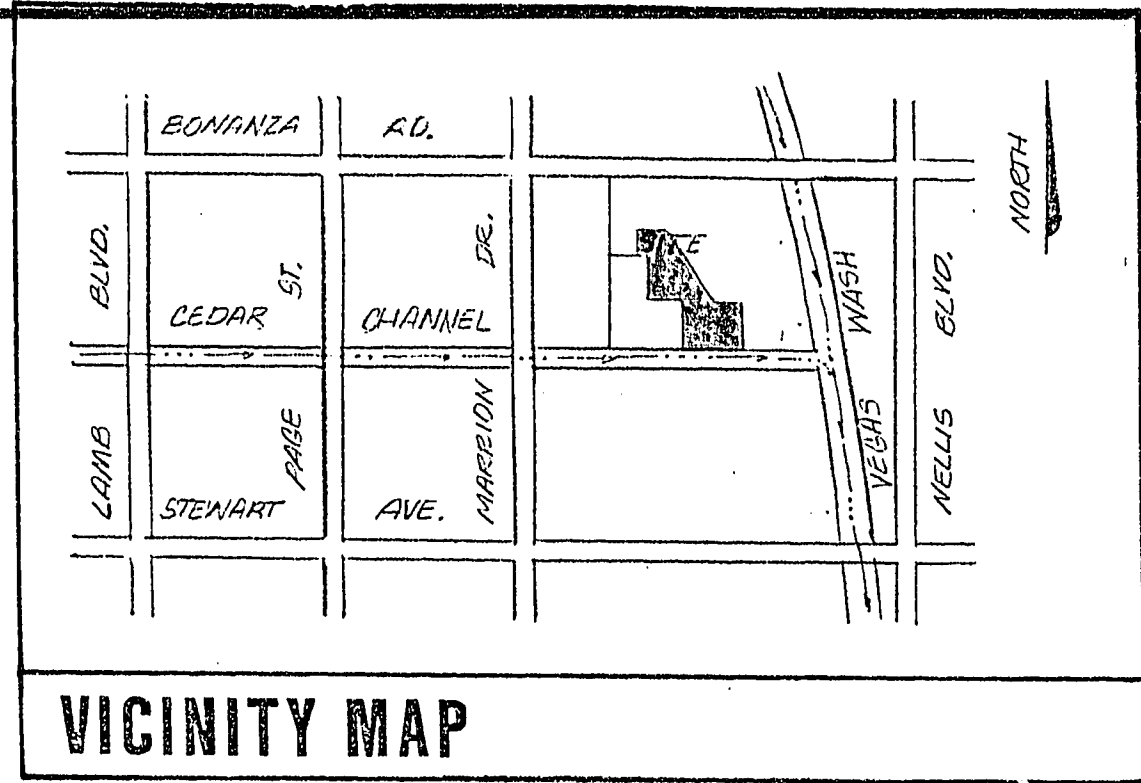

LEGEND AND QUANTITIES ESTIMATE

5/8" WATER LATERALS 1 METERS	37 EA.
EXISTING MANHOLE	
EXISTING SEWER LATERAL	
EXISTING FIRE HYDRANT	
DRIVEWAY LOCATION	
EXISTING DRIVEWAY LOCATION	

APPROVALS

[Signature] 7-13-83
CITY OF LAS VEGAS, CITY ENGINEER DATE


[Signature] 7/83
CITY OF LAS VEGAS, QUALITY CONTROL DATE

[Signature] 8-9-83
CITY OF LAS VEGAS, FIRE MARSHAL DATE

[Signature] 7-5-83
CITY OF LAS VEGAS, SANITARY ENGINEER DATE

CONSULTING ENGINEERS • PLANNERS 2800 WEST SAHARA AVENUE LAS VEGAS, NEVADA 89102 PHONE (702) 873-7550	
neveda	
PROJECT MASTER SEWER AND WATER PLAN CEDAR CREEK PARK UNIT 3	
SHEET 4 OF 5 SHEETS	
WO NO.	2032-3
BY	VEB
DATE	JUNE, 1983
SCALE	1"=40'

Call before you Dig.
1-800-227-2800
UNDERGROUND SERVICE JAPAN

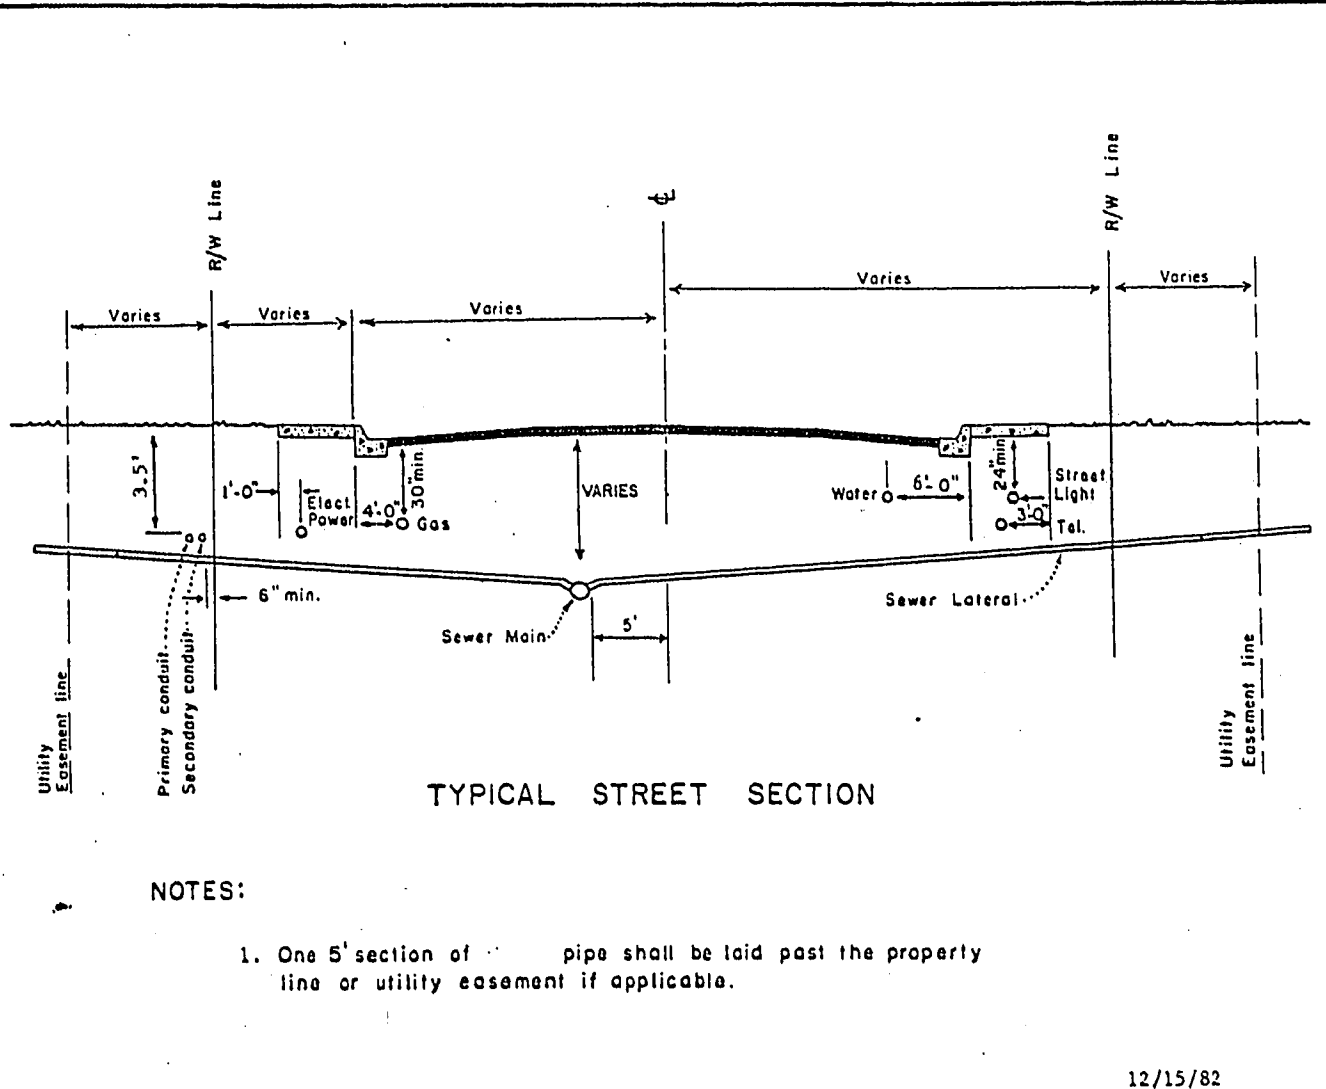

NOTES:

1. One 5' section of pipe shall be laid past the property line or utility easement if applicable.

12/15/82

33-6-61 3074-1020-3