


EXISTING "ANCHOR VILLAGE" APARTMENTS

CITY OF LAS VEGAS FIRE DEPARTMENT NOTES

1. NO FIRE HYDRANT SHALL BE LOCATED WITHIN 6' OF ANY CURB RETURN, DRIVEWAY, POWER POLE, STREET LIGHT, OR ANY OTHER OBSTRUCTION.
2. ON ANY NEW HOME OR BUILDING CONSTRUCTION ACCESSIBLE HYDRANTS SHALL BE INSTALLED BEFORE ACTUAL CONSTRUCTION COMMENCES, AND SAID HYDRANTS SHALL BE IN GOOD WORKING ORDER WITH AN ADEQUATE WATER SUPPLY.
3. SEE THE "HYDRANT SPECIFICATIONS" AND "HYDRANT INSTALLATION SPECIFICATION" SHEETS FOR DETAILED REQUIREMENTS. FOR WALL, FENCE OR PLANTER LOCATIONS SEE "HYDRANT INSTALLATION SPECIFICATIONS", ITEMS 1 - 4, PAGE 13, CLV ORDINANCE NO. 2077.
4. FIRE HYDRANT SPACING
RESIDENTIAL 500 FT. MAXIMUM
COMMERCIAL 300 FT. MAXIMUM
5. APPROVED FIRE HYDRANTS FOR THIS PROJECT ARE:
KELLEY CARRISON OF
MUELLER 2-423 CENTRAL.

FUTURE "BAYSIDE UNIT NO. 4"

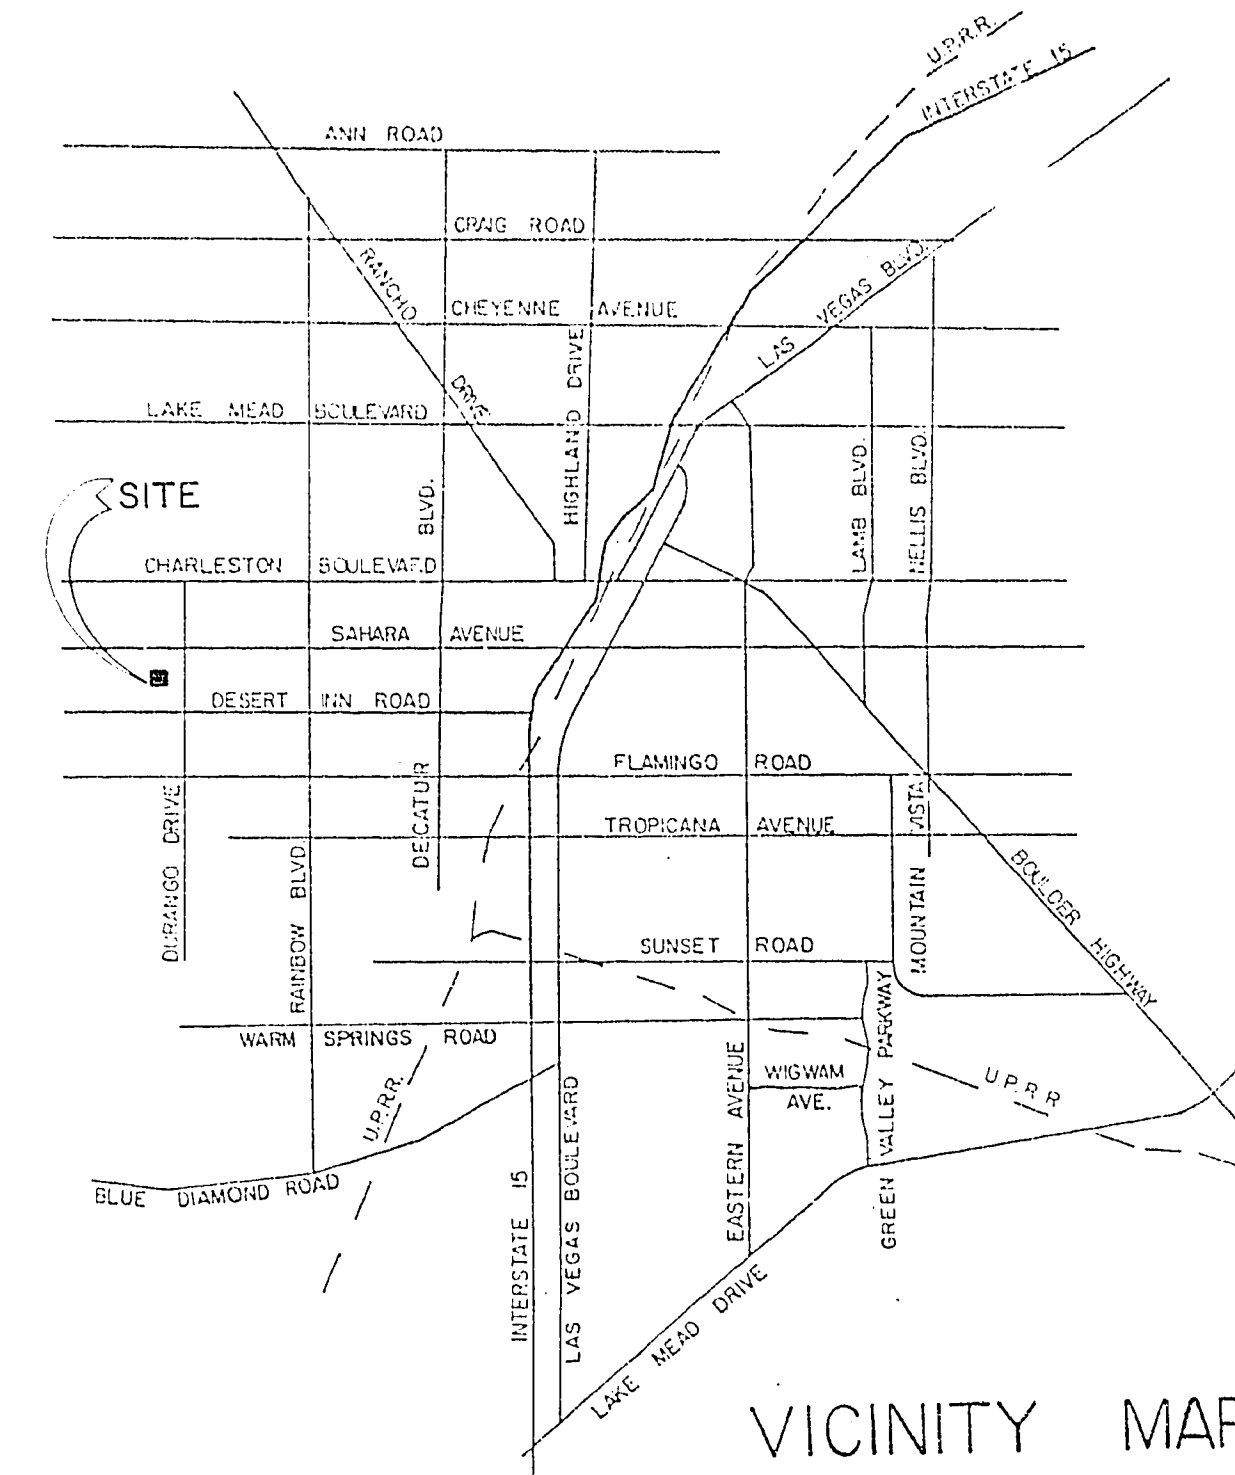

VICINITY MAP

LAS VEGAS VALLEY WATER DISTRICT NOTES

1. ALL WORK TO CONFORM TO LAS VEGAS VALLEY WATER DISTRICT LATEST STANDARD PLATES AND SPECIFICATIONS.
2. ALL WORK, EXCEPT AS MODIFIED HEREON OR BY NOTE NO. 1, SHALL BE DONE IN ACCORDANCE WITH THE MOST CURRENT DRAFT OR EDITION OF UNIFORM STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION OFF-SITE IMPROVEMENTS CLARK COUNTY AREA.
3. NOTICE TO BE GIVEN ENGINEERING DEPARTMENT OF THE LAS VEGAS VALLEY WATER DISTRICT 48 HOURS PRIOR TO ACTUAL CONSTRUCTION.
4. SERVICE SADDLES OR TAPPED COLLARS WILL BE REQUIRED ON ALL 3/4" AND 1" SERVICE LATERALS. SERVICE SADDLES ONLY WILL BE PERMITTED ON 1 1/2" AND 2" SERVICE LATERALS. DOUBLE TAPPED COLLARS ARE NOT PERMITTED.
5. ALL LINES TO BE PRESSURE TESTED TO 200 PSI.
6. DEFLECTION ANGLE SHALL NOT EXCEED 2 1/2 DEGREES PER 13 FOOT SECTION OF PIPE FOR PIPE SIZES SMALLER THAN 14 INCHES, AND SHALL NOT EXCEED 2 DEGREES FOR PIPE SIZES BETWEEN 14" AND 16".
7. ALL METERS SHALL BE LOCATED OUTSIDE OF DRIVEWAYS.
8. DETECTOR TAPE REQUIRED IN ACCORDANCE WITH STANDARD PLATE NO. 27 WHERE INDICATED AND AS FOLLOWS:
A. OVER ALL MAINS NOT INSTALLED AT 6 FEET FROM BACK OF CURB.
B. OVER ALL SERVICE LATERALS NOT INSTALLED AT RIGHT ANGLES TO MAINS.
9. CALL BEFORE YOU DIG - 1-800-227-2600.

ESTIMATE OF QUANTITIES

8" WATERLINE	2115 LF
① 8" X 8" X 8" TEE	3 EA
② 8" GATE VALVE	4 EA
③ 45° ELL	2 EA
④ 8" CAP	3 EA
⑤ HYDRANT ASSEMBLY	6 EA
3/4" METER & SERVICE	63 EA.

Avoid cutting underground utility lines. It's costly.

Call before you Dig.

1-800-227-2600
UNDERGROUND SERVICE (USA)

Remond R. Peoples 4/11/86
C.L.V. FIRE MARSHALL DATE
David J. Dennis 3/18/86
LAS VEGAS VALLEY WATER DISTRICT DATE

ENGINEERS & SURVEYORS INCORPORATED	7022 W. CHARLESTON BLVD. LAS VEGAS, NEVADA 89117 PHONE: 702/363-6415
SUBMITTED BY <i>Paul J. Dennis</i> 1/22/86	

TITLE	MASTER WATER PLAN
PROJECT	BAYSIDE UNIT NO. 3

WO NO.	850302-3
BY	P.E.V.
DATE	11-85
SCALE	1" = 60'

SHEET	14
OF 15 SHEETS	

116-6-30 567Y-844-3