


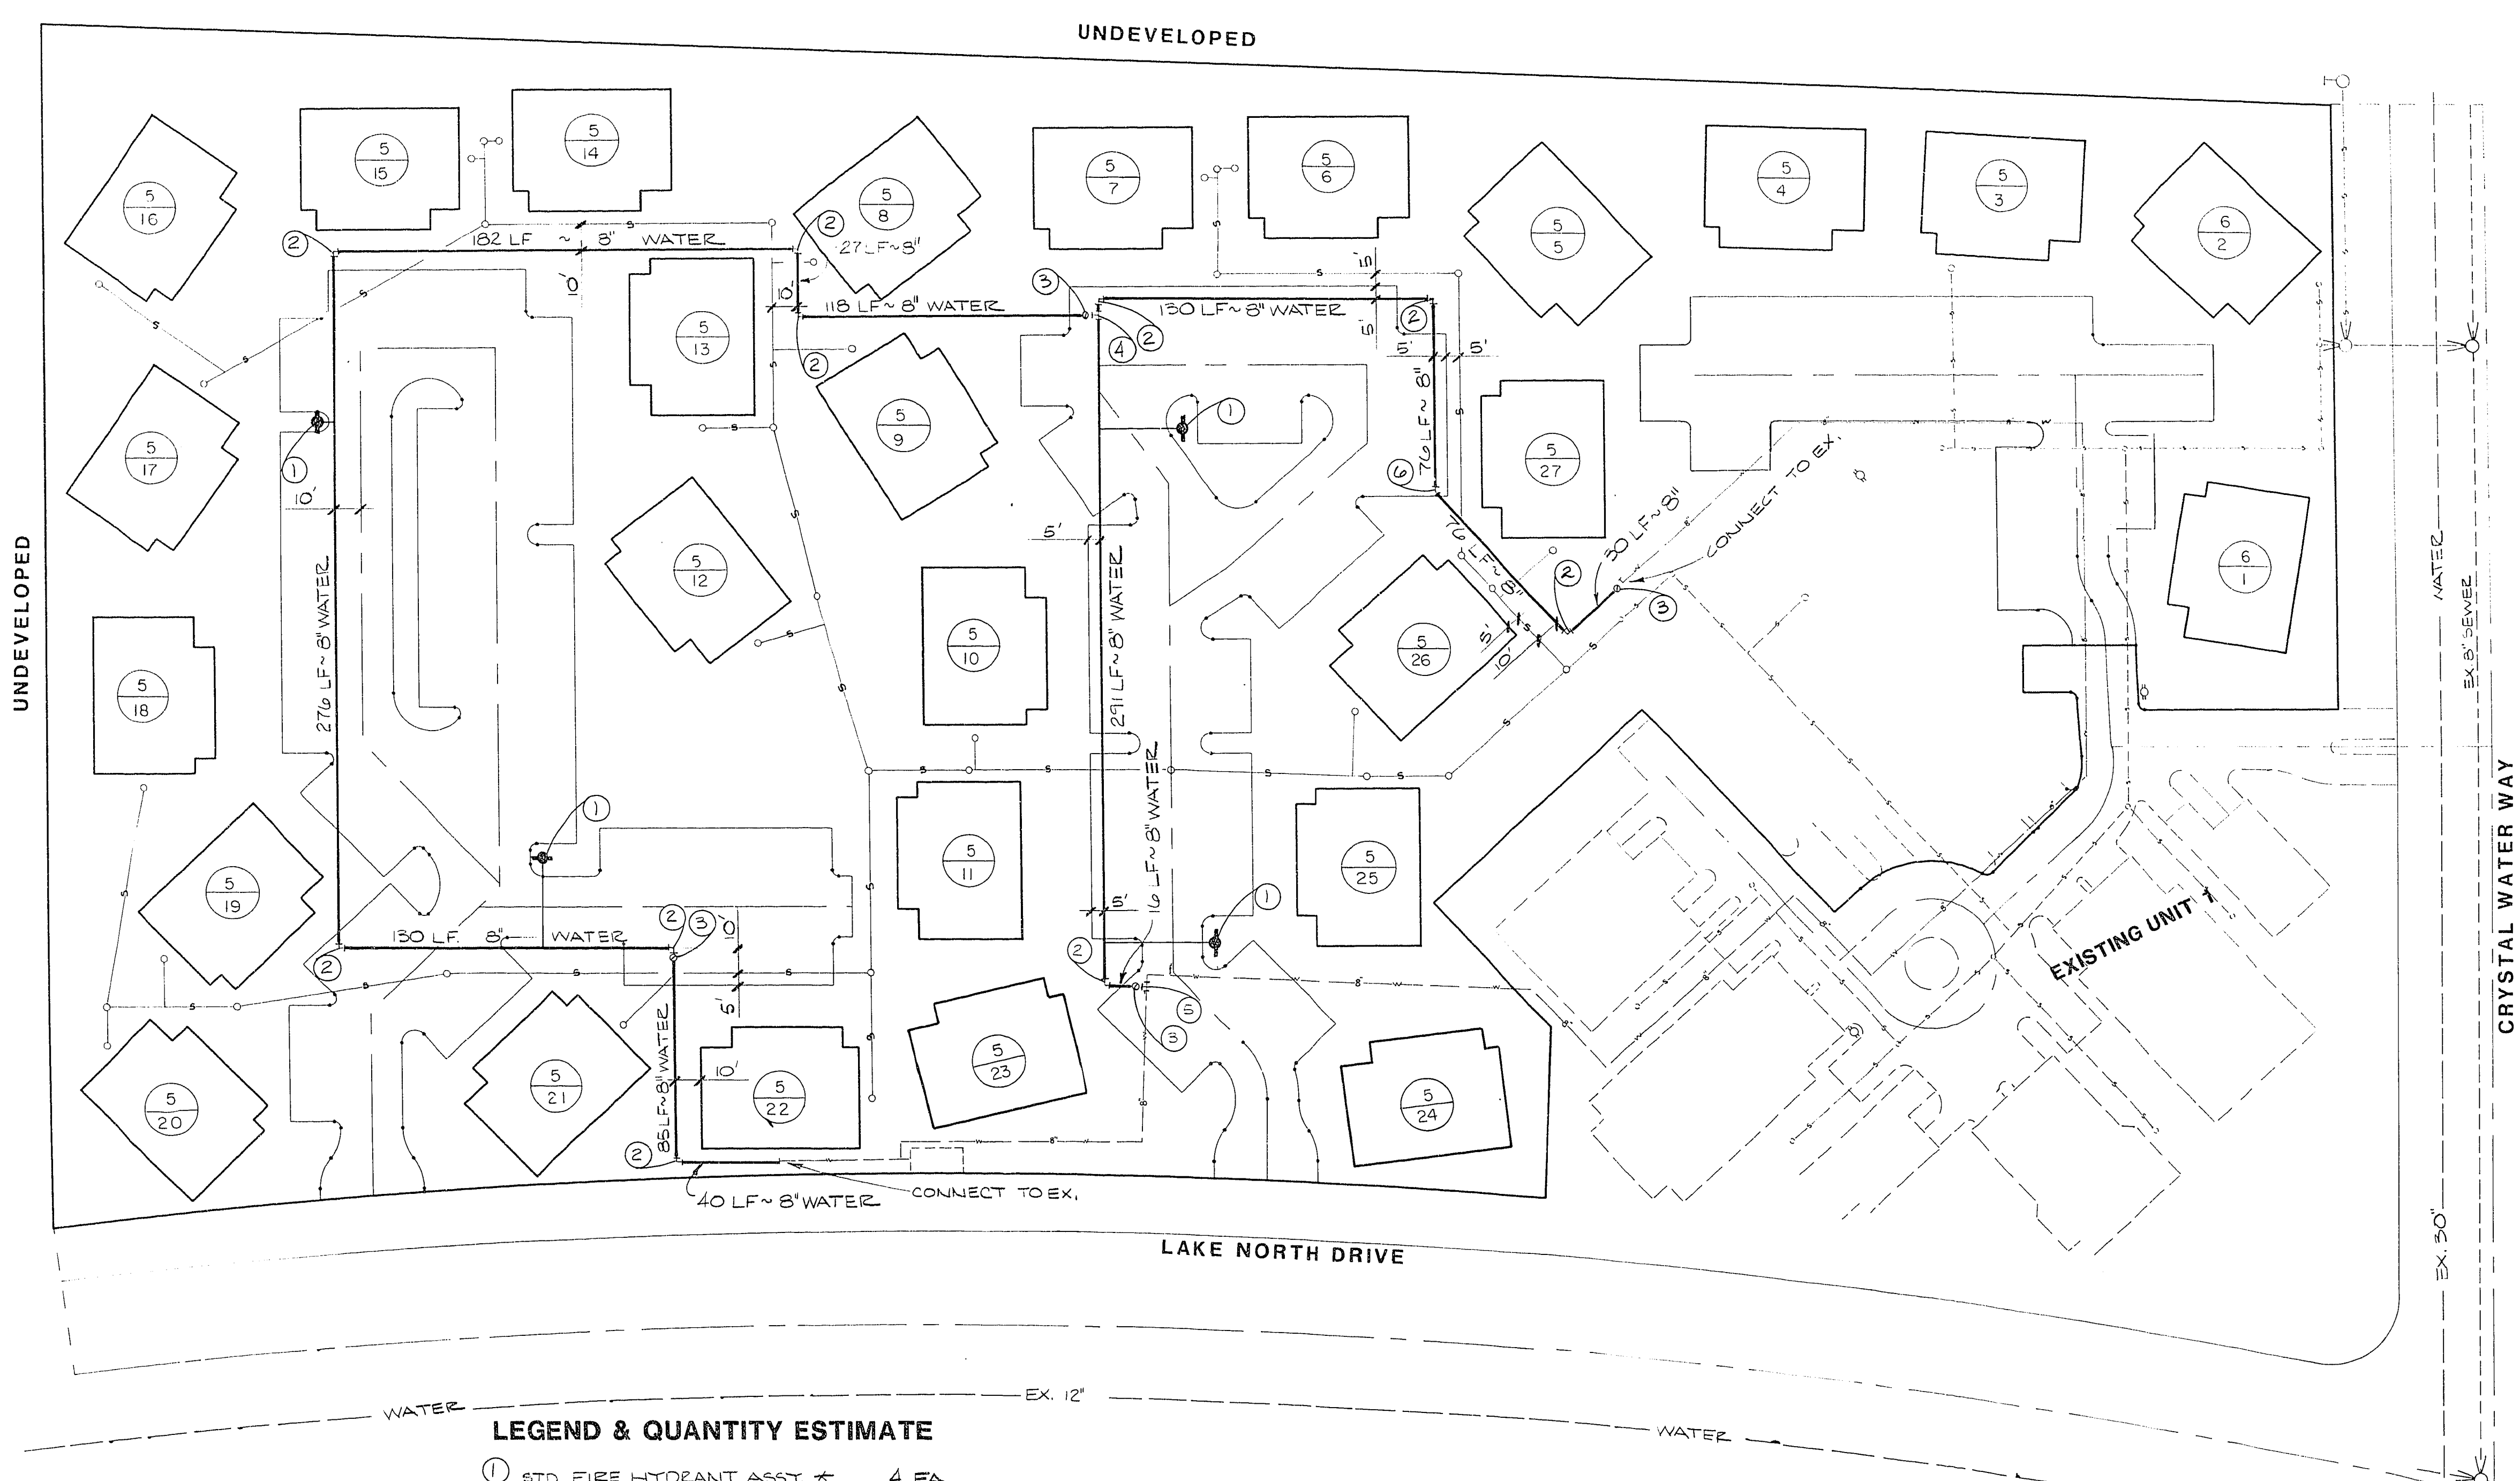

- GENERAL NOTES**
1. ALL WORK TO CONFORM TO LAS VEGAS VALLEY WATER DISTRICT STANDARD PRACTICE.
 2. ALL WORK, EXCEPT AS MODIFIED HEREIN OR BY NOTE NO. 1, SHALL BE DONE IN ACCORDANCE WITH THE MOST CURRENT DRAFT OR EDITION OF UNIFORM STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION OFF-SITE IMPROVEMENTS, CLARK COUNTY AREA.
 3. REFERENCE TO BE GIVEN TO THE DIVISION OF THE LAS VEGAS VALLEY WATER DISTRICT AS BEING PRIOR TO ACTUAL CONSTRUCTION.
 4. SERVICE SAMPLES WILL BE REQUIRED ON ALL SERVICES 15" AND LARGER. TAPPED COLLARS ARE PERMITTED ON 1" AND SMALLER. BOTTOM TAP COLLARS ARE NOT PERMITTED.
 5. ALL LINES TO BE PRESSURE TESTED TO 200 PSI.
 6. DEFLECTION ANGLE SHALL NOT EXCEED 25 DEGREES PER 13 FOOT SECTION OF PIPE FOR PIPE SIZES SMALLER THAN 14" AND SHALL NOT EXCEED 5 DEGREES FOR PIPE SIZES 14" AND 16".
 7. ~~ALL WORK SHALL BE DONE IN ACCORDANCE WITH STANDARD PRACTICE NO. 2, WHICH IS INCORPORATED AS A REFERENCE.~~
 8. SERVICE LATERALS FOR LOTS WILL BE TAPPED ON EXISTING MAIN BY OWNER'S CONTRACTOR UNDER DIRECTION OF THE LAS VEGAS VALLEY WATER DISTRICT.
 9. ~~INTERFERENCES SHALL BE NOTED IN ACCORDANCE WITH STANDARD PRACTICE NO. 2, WHICH IS INCORPORATED AS A REFERENCE.~~
 10. CALL BEFORE YOU DIG - 1-800-227-2600.

LEGEND & QUANTITY ESTIMATE		
①	STD. FIRE HYDRANT ASST. *	4 EA.
②	8" 90° BEND	10 EA.
③	8" GATE VALVE	4 EA.
④	8" TEE	1 EA.
⑤	8" WET TAP TEE	1 EA.
⑥	8" 45° BEND	1 EA.
8" PVC WATER MAIN		1477 LF.
* INCLUDES TEE, VALVE, 6" LATERAL, THRUST BLOCK, RISES, AND ALL ASSOCIATED HARDWARE.		


Raymond R. Keight
C.L.V. FIRE MARSHALL
10/2/87
DATE

M. J. Wells
6/10/87

NO. NO.	3370
BY	SCD
DATE	
SCALE	1" = 40'

SHEET	4
OF 4 SHEETS	

567Y-843-2

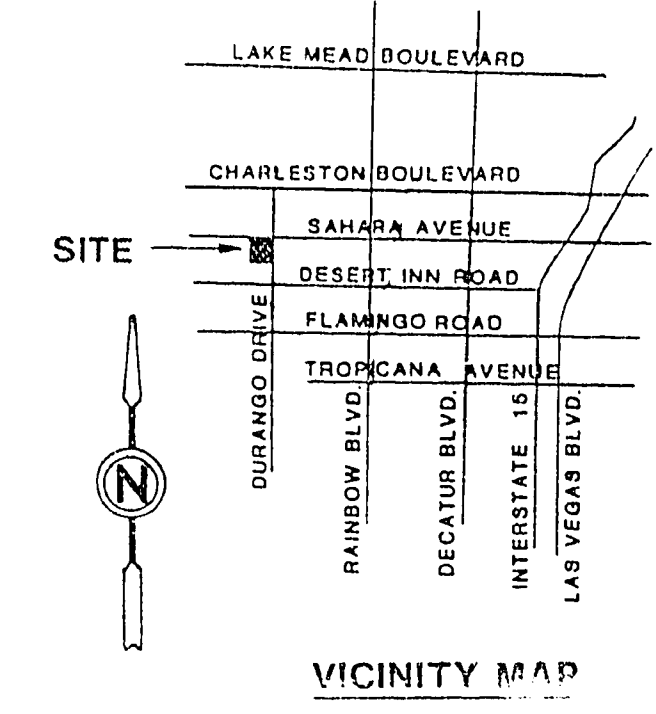

DIVERSIFIED DEVELOPMENT
CITY OF LAS VEGAS

vtm nevada

CONSULTING ENGINEERS - PLANNERS
2300 PASAD DEL PRADO BUILDING A SUITE 100
LAS VEGAS, NEVADA 89102 PHONE (702) 873-7550

MASTER WATER PLAN

BAYCLIFF CREEKS
UNIT 2