


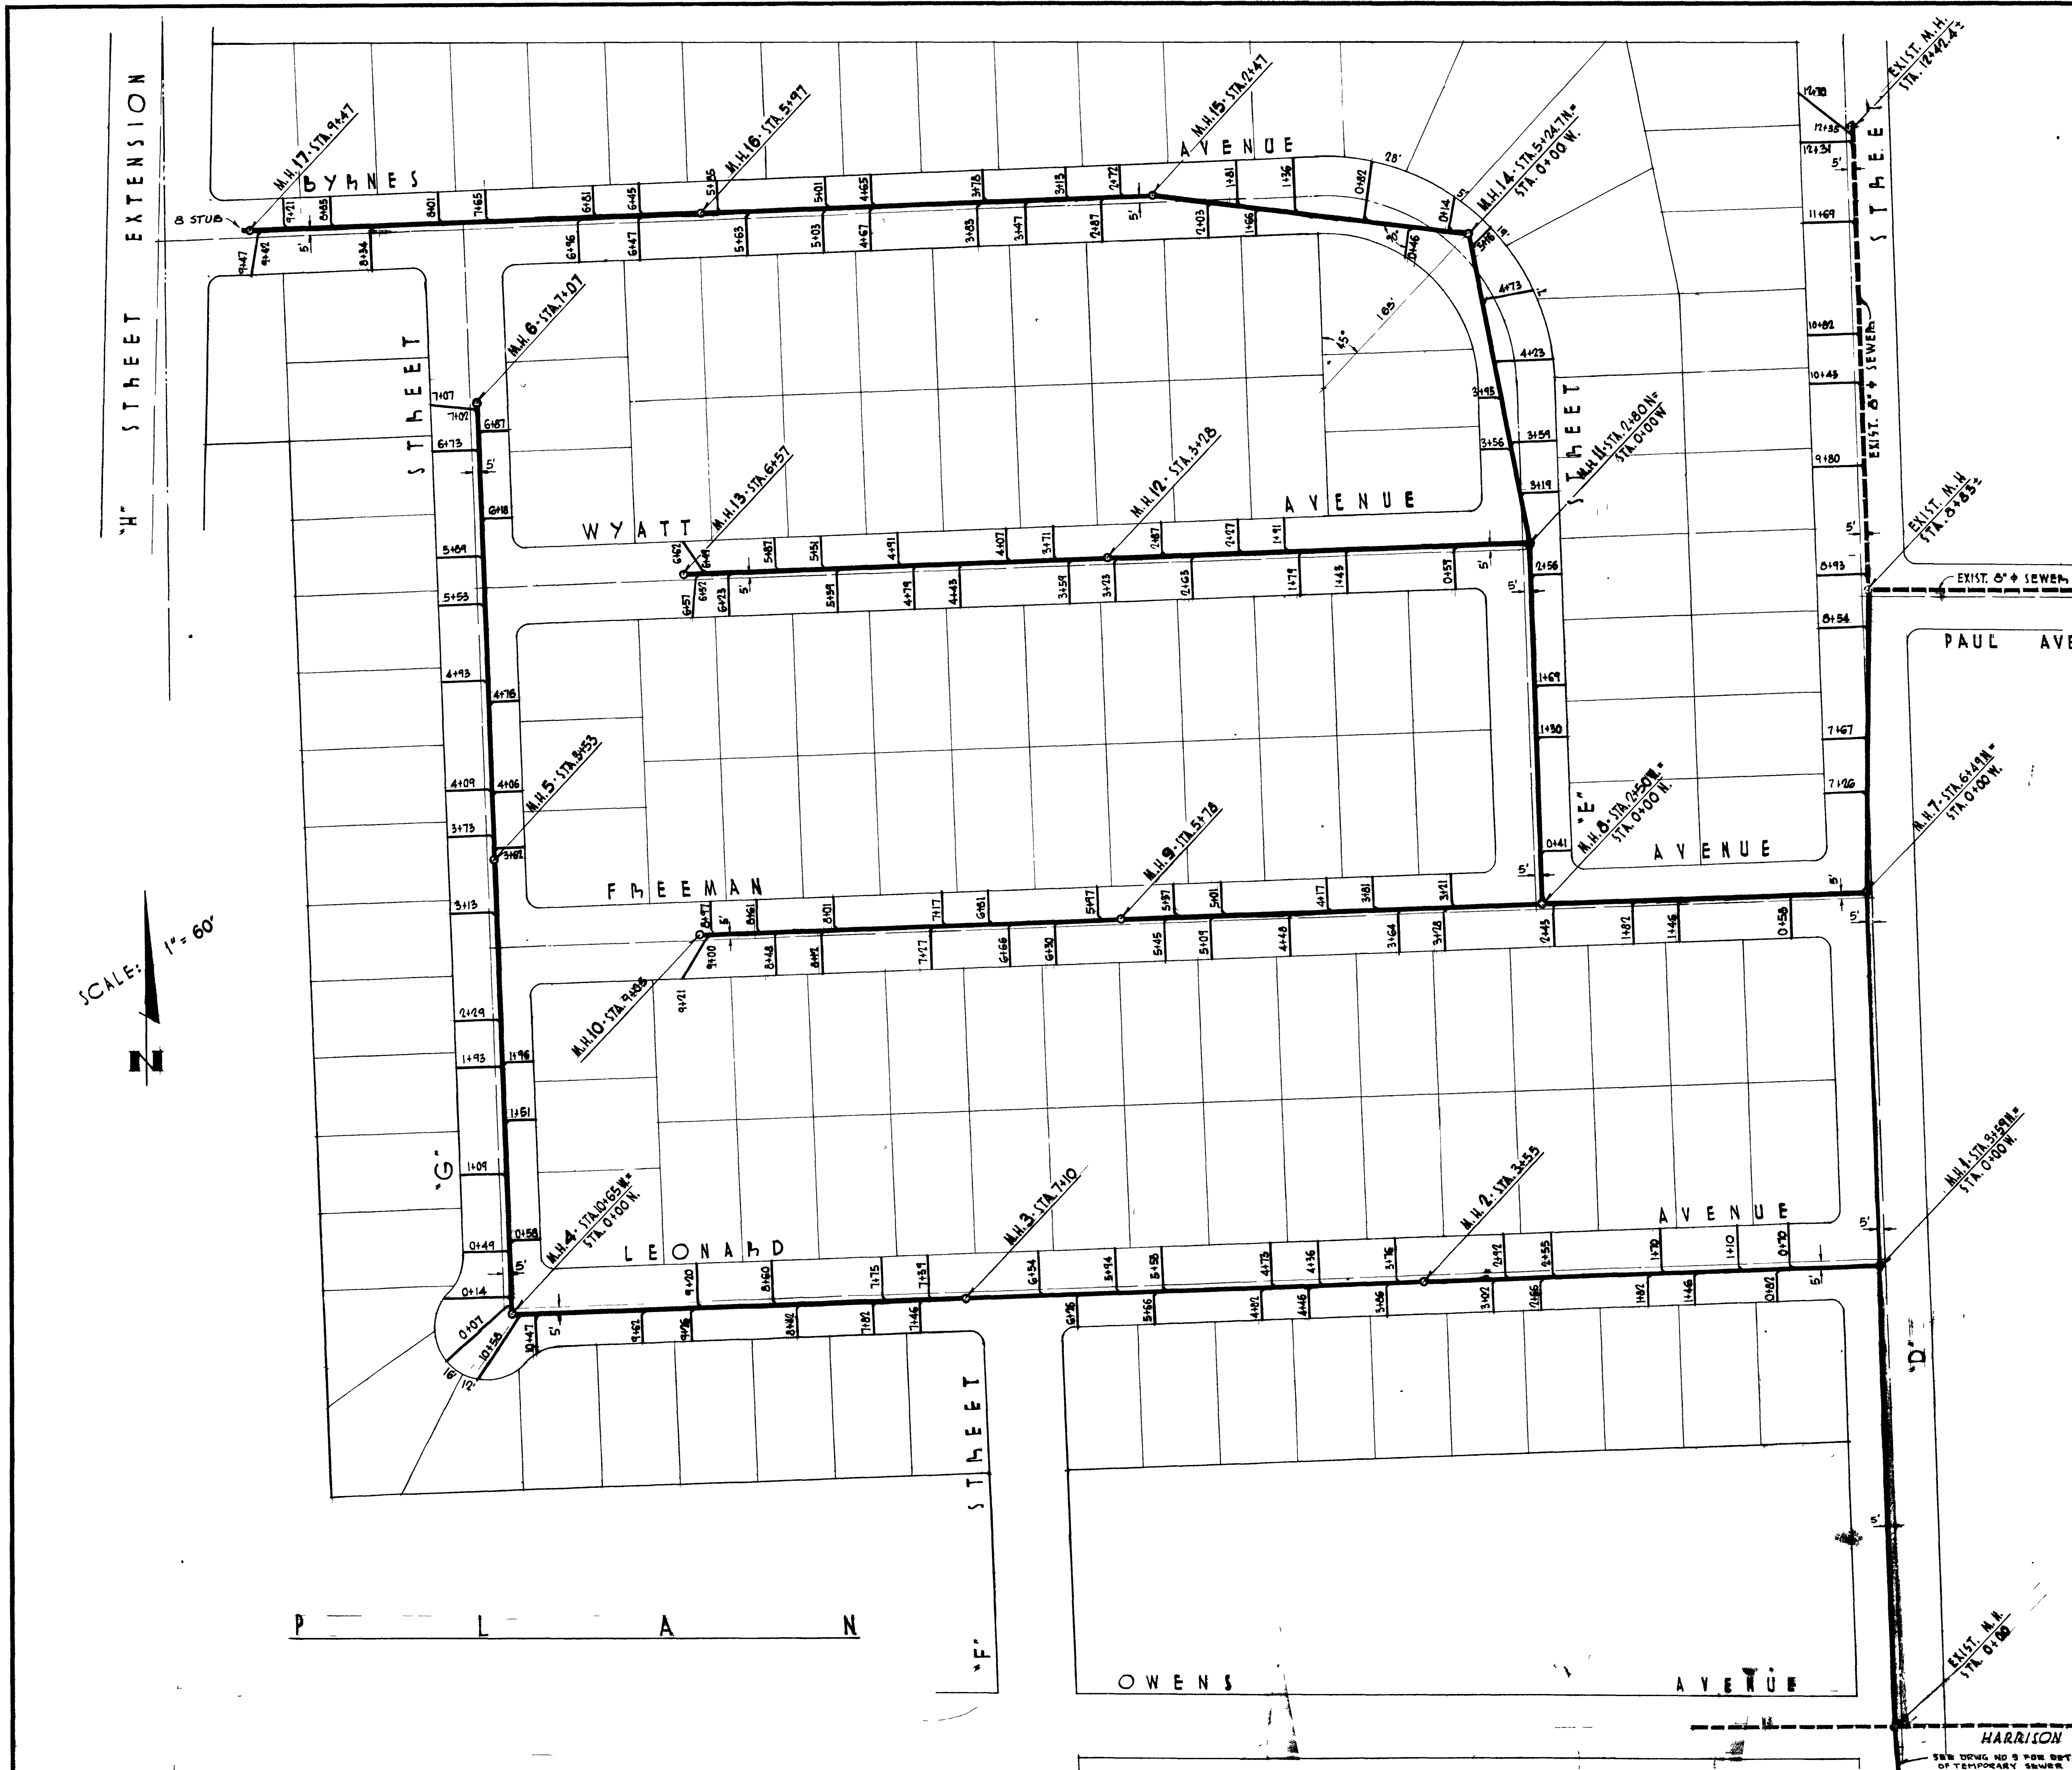

GENERAL NOTES

- 1. ALL SEWERS SHALL BE 8" VITRIFIED CLAY PIPE.
- 2. ALL HOUSE CONNECTIONS SHALL BE 4" VITRIFIED CLAY PIPE. CONNECTIONS SHALL BE EXTENDED TO PROPERTY LINES.
- 3. STATIONING OF HOUSE CONNECTIONS MAY BE ADJUSTED 2' TO FIT JOINTS IN SEWER PIPE.

ESTIMATE OF QUANTITIES

8" VITRIFIED CLAY PIPE	5689 LIN. FT.
4" VITRIFIED CLAY PIPE	4750 LIN. FT.
MANHOLES	17 EACH
DROP MANHOLES	0 EACH
8" STUDS	1 EACH

BENCH MARK ELEV. 2035.51
USGS TRIANG. STA. AT COR.
H STREET & OWENS AVE.

C-3-1

6/26/54 ADDED NOTE REF. TO TEMPORARY SEWER ON D ST.
5/26/54 RELOCATE SEWER ON D ST. 0+00 TO 3+59

PLAN OF SEWERS		
SEWERAGE SYSTEM		
FOR		
BERKLEY SQUARE		
CITY OF LAS VEGAS - NEVADA		
SCALE	PERLITER & SOMING	DATE
1" = 60'	ENGINEER	1
MAY 1954	448 SQ HILL LOS ANGELES	OF 3

3236

16-4-54 3074-890-1

