
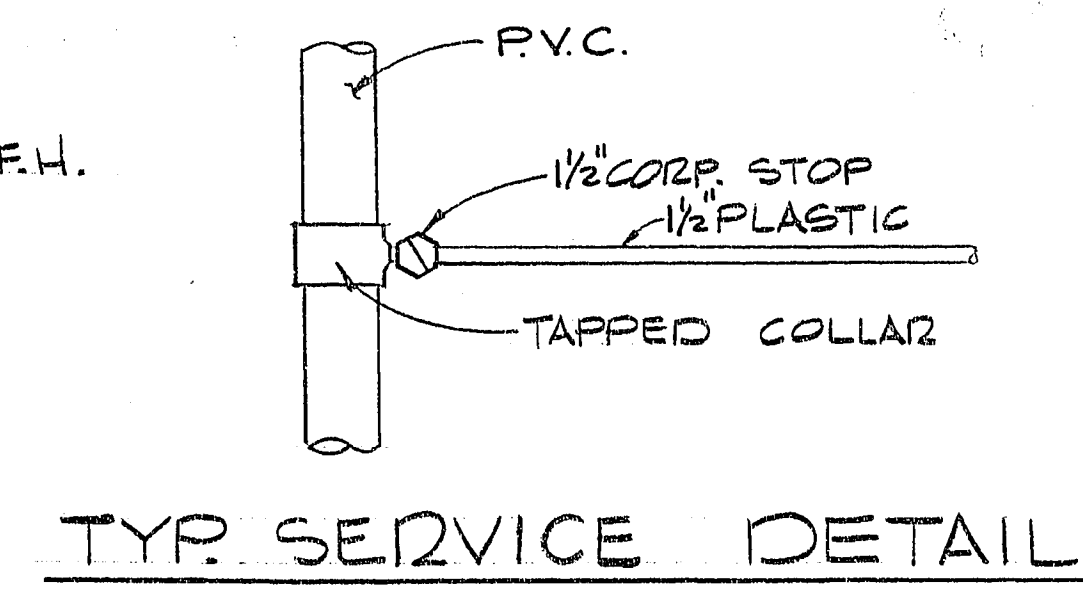
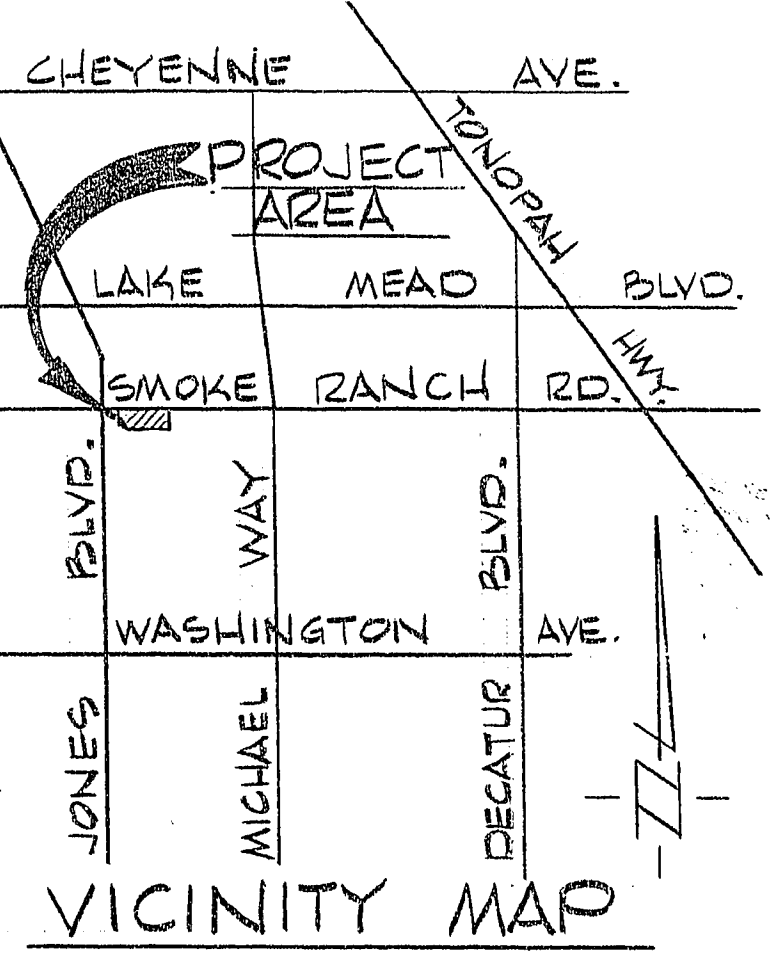


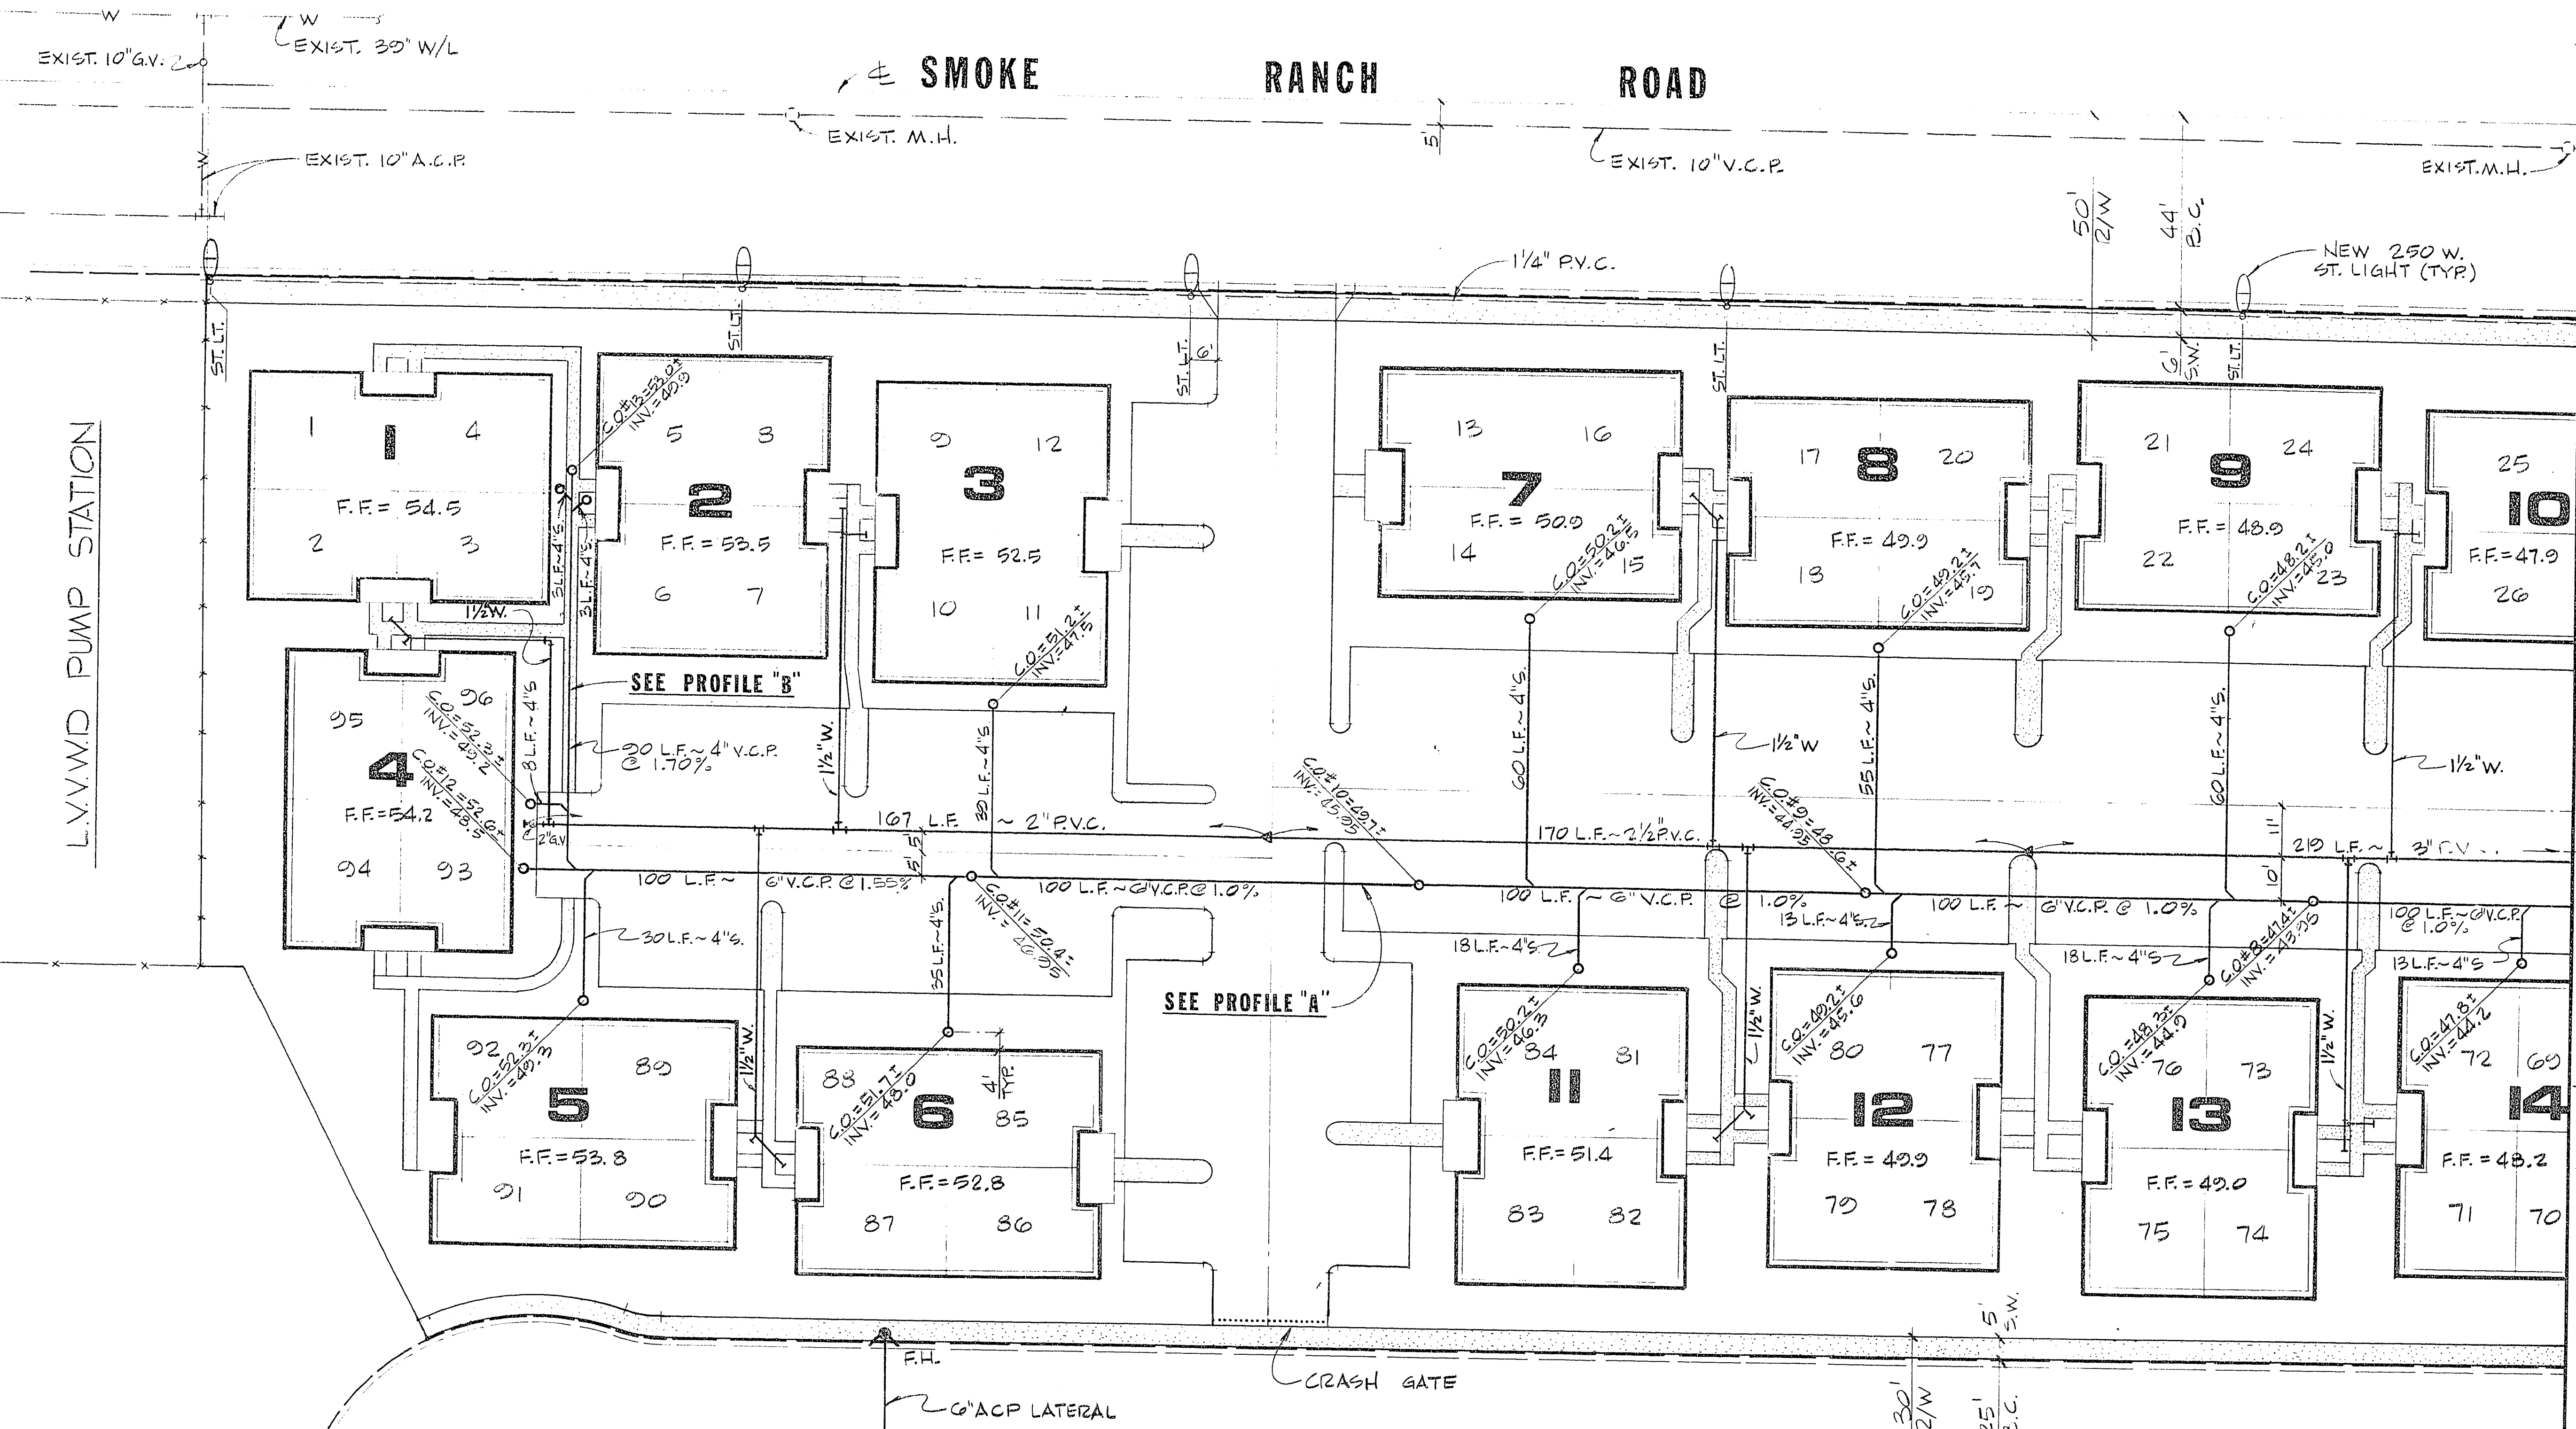

NOTES:

- 1. ST. LIGHT SERVICE WIRE TO BE 2-#2s @ 1-#4.
- 2. ALL FIELD WIRE TO BE 2-#4s, THW.
- 3. FOR ADDITIONAL IRRIGATION PIPING SEE LANDSCAPE DWGS.

APPROVALS:

<i>[Signature]</i> C.L.V. ENGINEER	7-26-78 DATE	<i>[Signature]</i> C.L.V. FIELD OPERATIONS ENGR.	7-26-78 DATE
<i>[Signature]</i> C.L.V. ELECTRICAL COORD.	7-27-78 DATE	<i>[Signature]</i> NEVADA POWER CO.	7-26-78 DATE
<i>[Signature]</i> C.L.V. ELECTRICAL SUPERVISOR	7-27-78 DATE	<i>[Signature]</i> LAS VEGAS VALLEY WATER DISTRICT	7-26-78 DATE
<i>[Signature]</i> C.L.V. SANITATION SUP'T.	7-24-78 DATE		

Nevada Power Company approves the point of service to the street light system. This shall not be deemed to constitute the placement of the light poles which may be in conflict with Nevada Power Company's prior rights and/or facilities.

(Date)
7-13-78
[Signature]
NEVADA POWER COMPANY

REVISIONS

REV.	DATE	DESCRIPTION
1	7/27/78	REVISED GENERAL SIZE & GRADE

RECOMMENDED

BY: <i>[Signature]</i>	DATE: 7/27/78
CHECKED: <i>[Signature]</i>	DATE: 7/27/78

PROJECT INFORMATION

PROJECT NO.	50-D-4
TRACT NO.	50-E-3
UTILITY PLAN	I

CONSULTING ENGINEER

NAME	G.C. WALLACE
COMPANY	Consulting Engineers, Inc.
ADDRESS	1100 East Sahara Ave. • Las Vegas, Nevada 89104 • 732-3330

301.017