


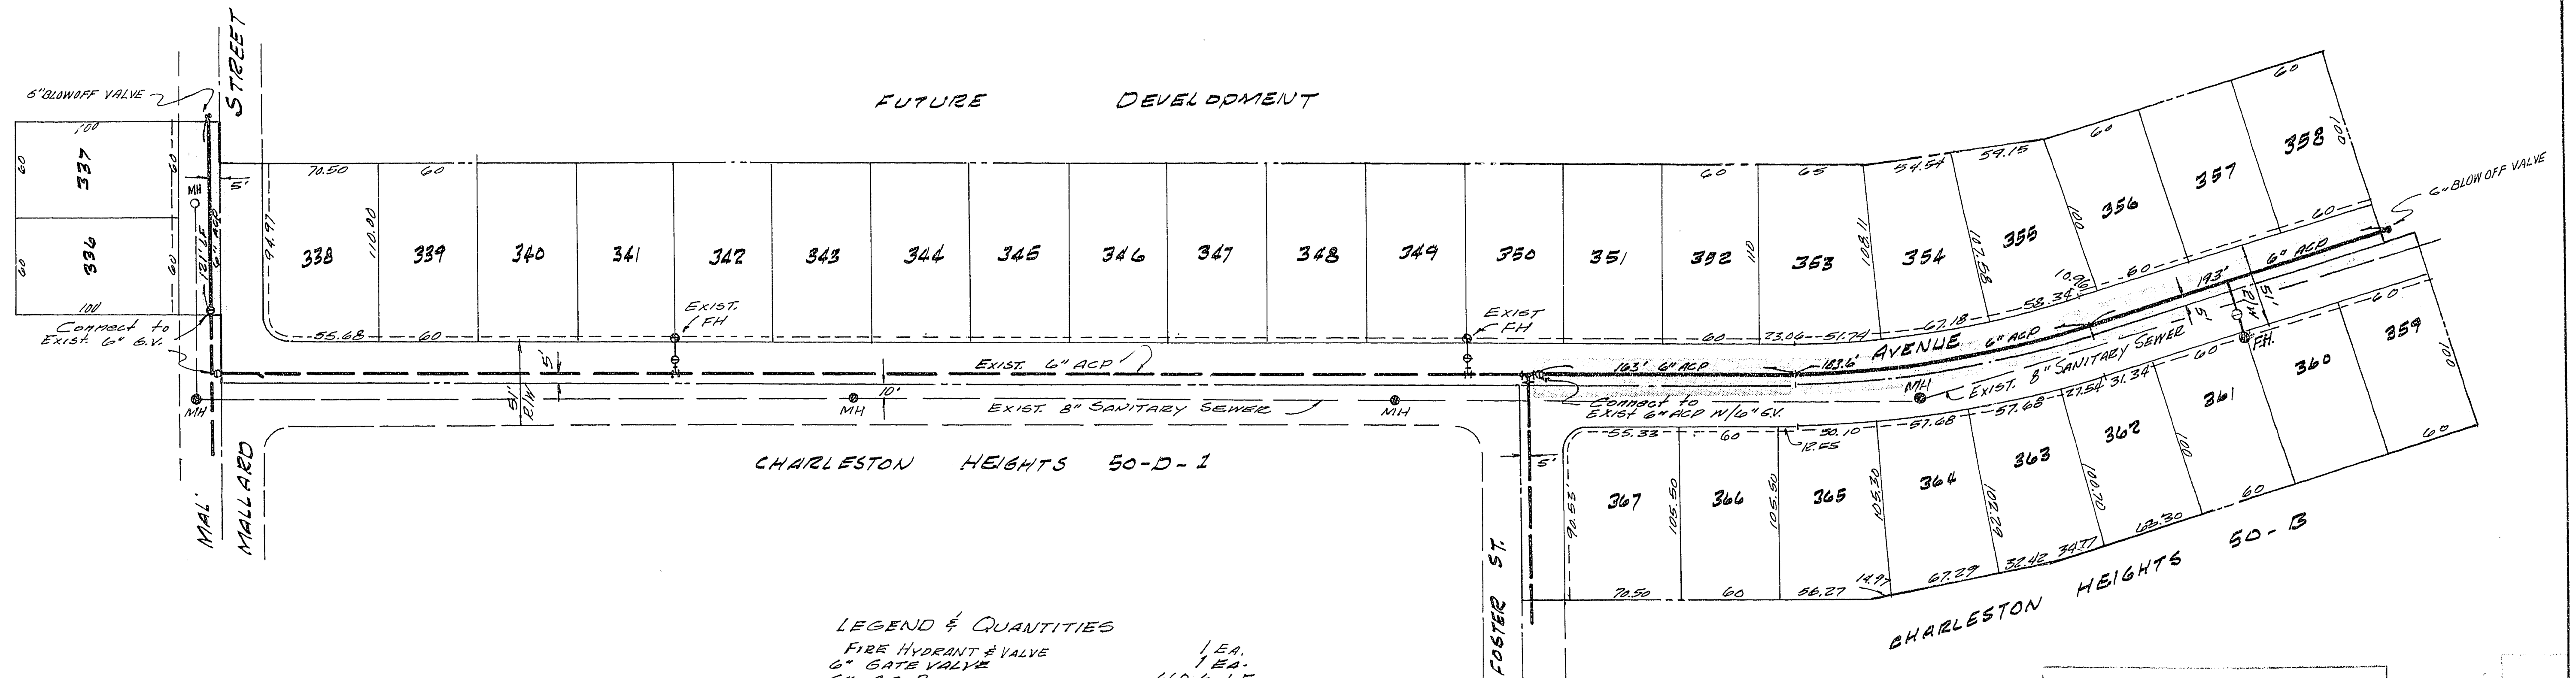

LEGEND & QUANTITIES

FIRE HYDRANT & VALVE	1 EA.
6" GATE VALVE	1 EA.
6" A.C.P.	660.6 L.F.
3/4" HOUSE SERVICES	32 EA.
3/4" x 5/8" METERS	32 EA.
20' WATER LINE EASEMENT	↑ 20'
6" BLOWOFF VALVE	2 EA.

LAS VEGAS VALLEY WATER DISTRICT
PLAN CHECK
DATE 8-28-68

1. CONFORMANCE - GENERAL
2. PLANNING
3. VALVE LOCATIONS
4. METER SIZE
5. EASEMENT REQUIREMENTS
6. FEE COMPUTATIONS
7. OTHER

ABOVE CHECKED BY B.E. Adams

LAS VEGAS VALLEY WATER DISTRICT
RECOMMENDED D. L. F. Adams DATE 8/28/68
APPROVED Frank Head DATE 8/28/68
GENERAL MANAGER

APPROVALS:
R. J. Seiler 10-14-68
CITY ENGINEER DATE
J. D. Mills 10-11-68
CITY FIRE DEPT DATE

SUBMITTED:
James H. Russell 10/11/68
TROYAN ENGINEERING, INC. DATE

CHARLESTON HEIGHTS
TR. 50-D UNIT 2
WATER PLAN

NO.	DATE	DESCRIPTION	BY
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			