




WATER NOTES:

1. ALL WORK TO CONFORM TO LAS VEGAS VALLEY WATER DISTRICT STANDARD PLATES.
2. ALL WORK, EXCEPT AS MODIFIED HEREON OR BY NOTE NO. 1 SHALL BE DONE IN ACCORDANCE WITH THE MOST CURRENT DRAFT OR EDITION OF UNIFORM STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION OFFSITE IMPROVEMENTS CLARK COUNTY AREA.
3. NOTICE TO BE GIVEN ENGINEERING DEPARTMENT OF THE LAS VEGAS VALLEY WATER DISTRICT 48 HOURS PRIOR TO ACTUAL CONSTRUCTION.
4. SERVICE SADDLES OR TAPPED COLLARS WILL BE REQUIRED ON ALL SERVICES. DOUBLE TAP COLLARS ARE NOT PERMITTED.
5. ALL LINES TO BE PRESSURE TESTED TO 200 PSI.
6. ALL VALVE BOXES SHALL HAVE CONCRETE COLLARS AT SURFACE OF PAVED AREAS.
7. DEFLECTION ANGLE SHALL NOT EXCEED 2 1/2 DEGREES PER 13 FOOT SECTION OF PIPE FOR PIPE SIZES SMALLER THAN 14 INCHES AND SHALL NOT EXCEED 2 DEGREES FOR PIPE SIZES BETWEEN 14 INCHES AND 16 INCHES.
8. ALL METERS SHALL BE LOCATED OUTSIDE OF DRIVEWAYS.
9. DETECTOR TAP REQUIRED IN ACCORDANCE WITH STANDARD PLATE NO. 27 WHERE INDICATED AND AS FOLLOWS:
 - A. OVER ALL MAINS NOT INSTALLED AT 6 FEET FROM BACK OF CURB
 - B. OVER ALL SERVICE LATERALS NOT INSTALLED AT RIGHT ANGLES TO MAINS.

STD. F.H. W/ 6" G.V. & 6" A.C.P. LATERAL	7	EA.
10" GATE VALVE W/ VALVE BOX & COVER	6	EA.
10" A.C.P.	2000	L.F.
6" GATE VALVE W/ VALVE BOX & COVER	5	EA.
6" A.C.P.	1,273	L.F.
4" A.C.P.	642	L.F.
METER BOX	22	EA.
3/4" SERVICE	22	EA.
5/8" METER (BY L.V.V.W.D.)	22	EA.
2" BLOW OFF ASSEMBLY	1	EA.
6" BLOW OFF ASSEMBLY	5	EA.
20" BUTTERFLY VALVE W/ VALVE BOX & COVER	1	EA.
20" A.C.P. (OVERSIZED ONSITE FM. 10")	503	L.F.

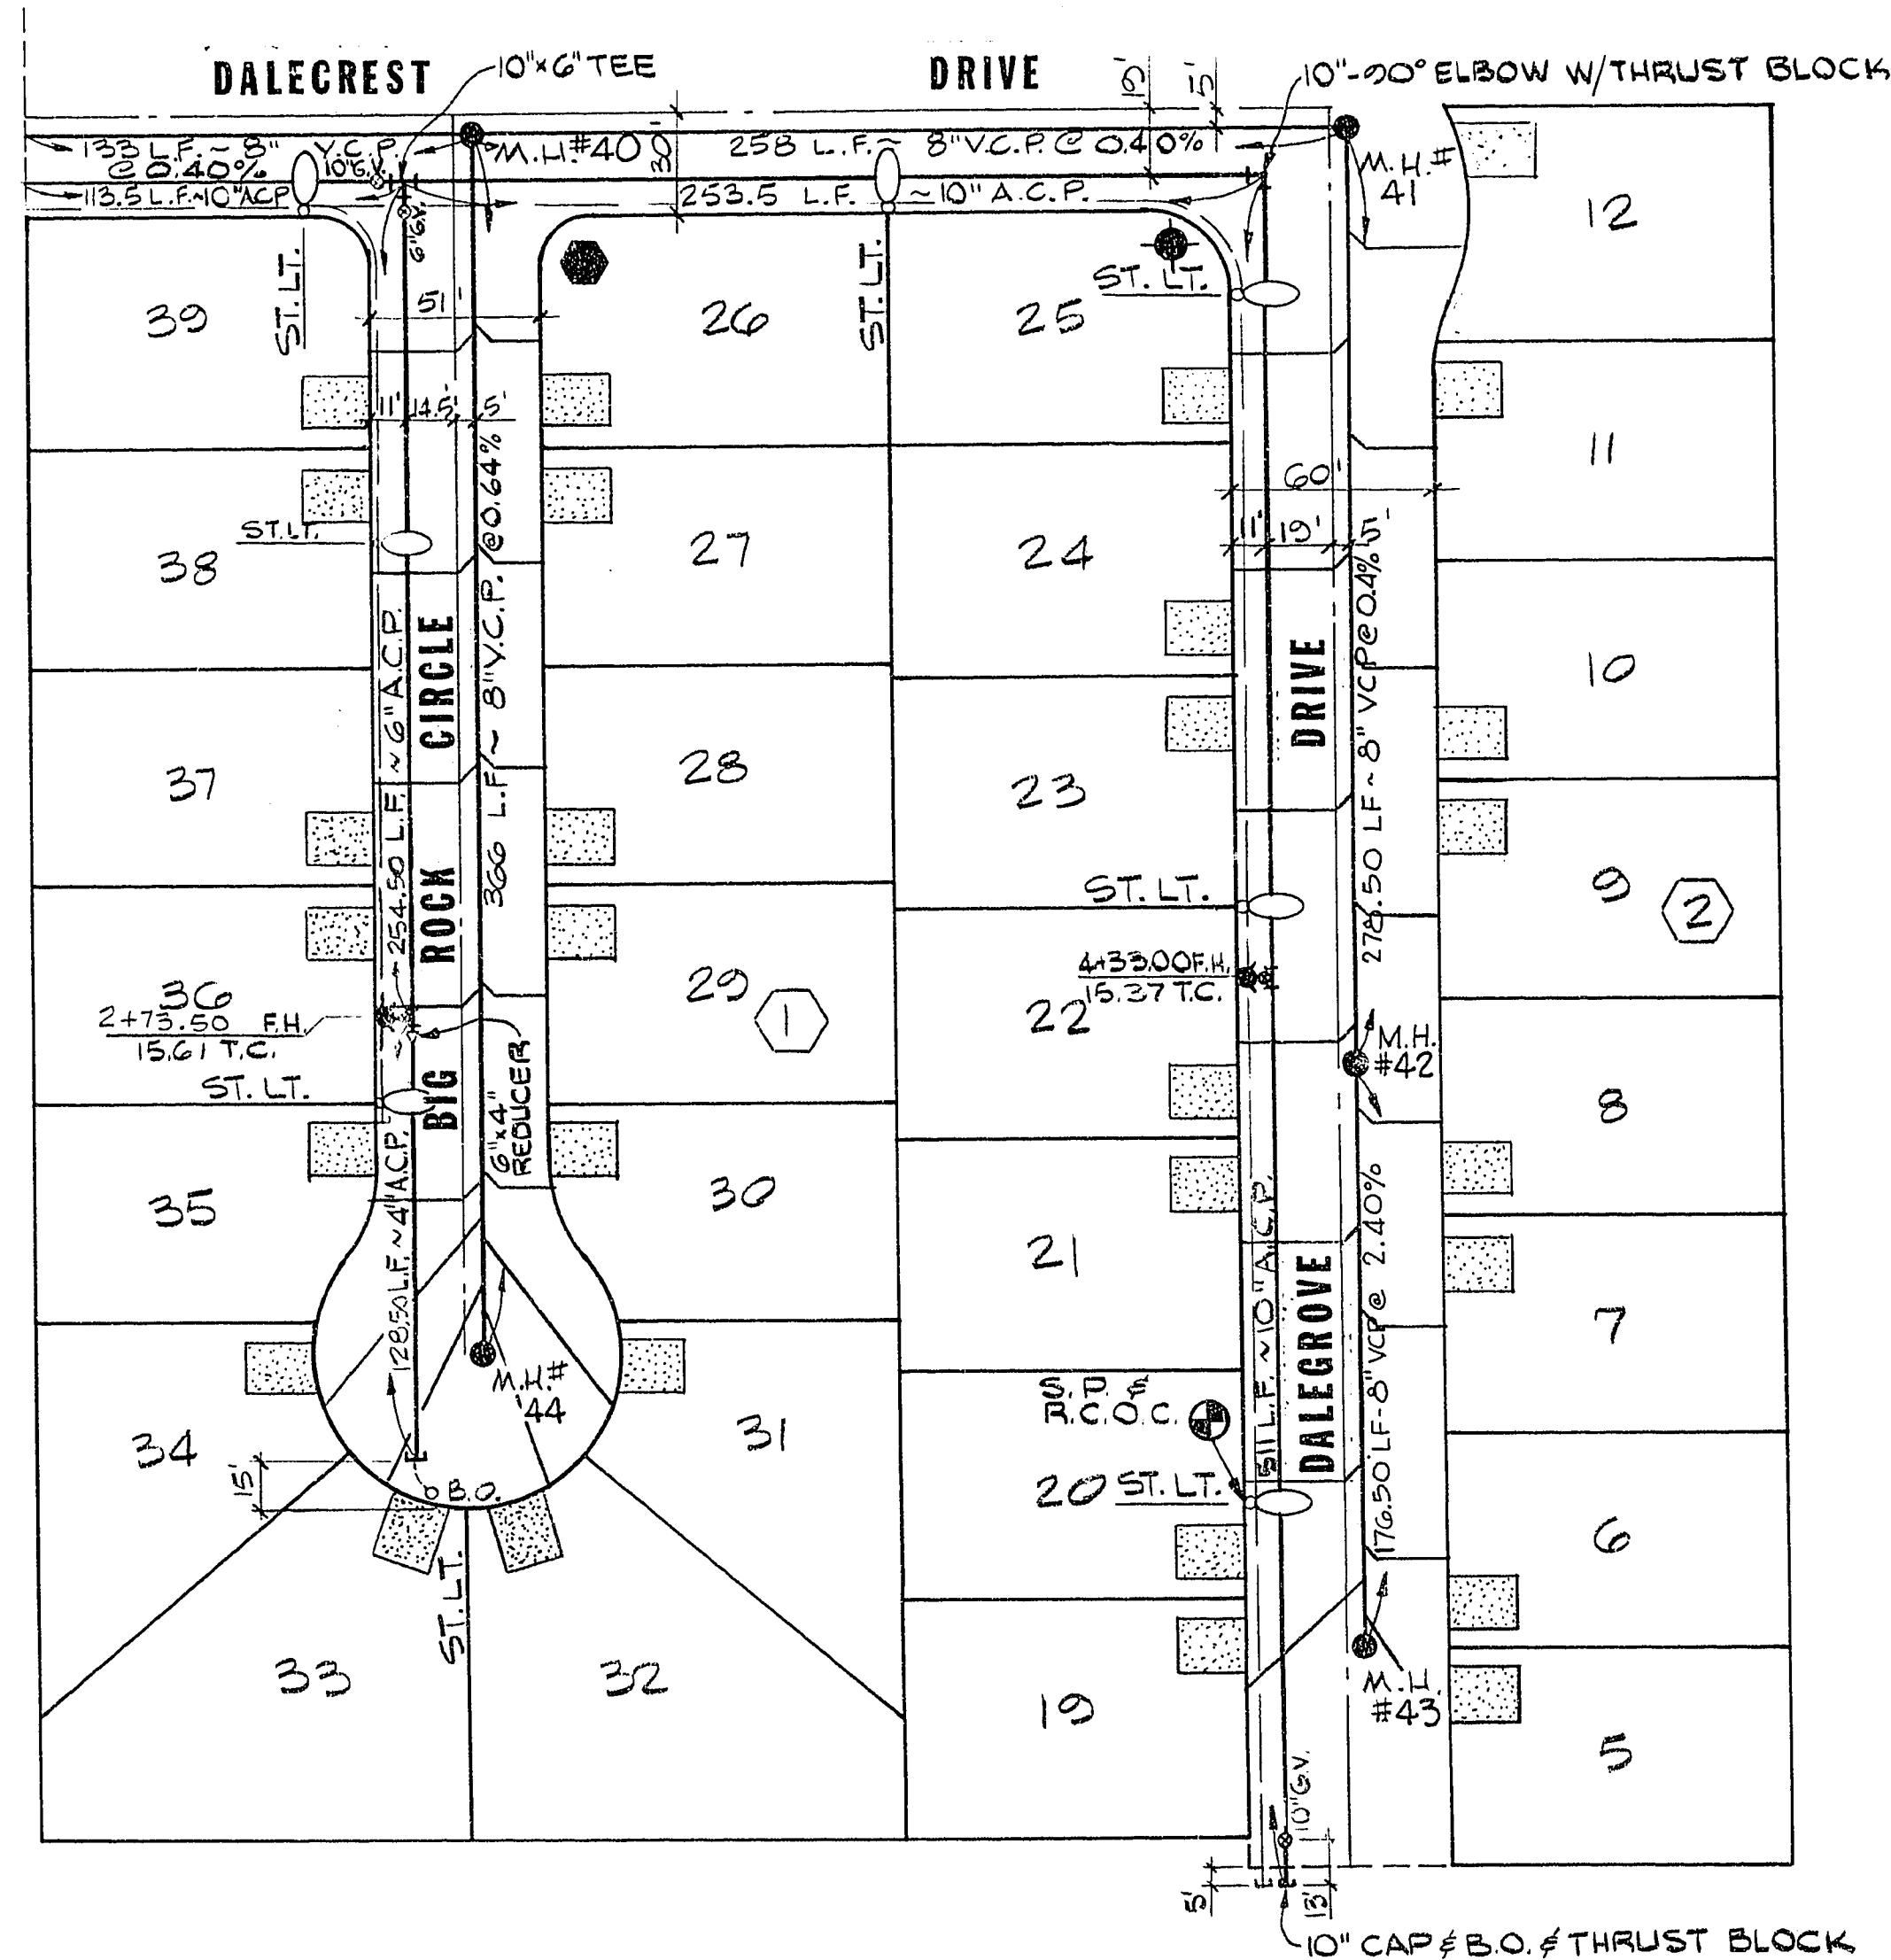

 C.L.V. ENGINEER	DATE 5/4/74
 C.L.V. FIELD OPERATIONS ENG'N.	DATE 5/4/74
 C.L.V. ELECTRICAL SUPERVISOR	DATE 4-28-79
 C.L.V. ELECTRICAL COORDINATOR	DATE 4/23/79
 C.L.V. SANITATION SUPT.	DATE 4-24-79
 NEVADA POWER CO.	DATE 2-15-79
 LAS VEGAS VALLEY WATER DISTRICT	DATE 5-21-79
 C.L.V. FIRE DEPT.	DATE 4-25-79
 C.L.V. QUALITY CONTROL ENG'N.	DATE 5-4-79

 STD. F.H. W/C G.V. & G" A.C.P. LATERAL
 SEWER MANHOLE
 NEW 100 W. LUMINAIRE W/11 GA. POLE
 1/4" R.V.C. (ST. LIGHT CONDUIT).
 GATE VALVE
 WATER LINE
 SEWER LINE
 #3 1/2 CONC. PULL BOX W/METAL COVER.
 STOP & ST. NAME SIGN.
 ST. NAME SIGN
 CONC. DRIVEWAY
 SERVICE POINT
 NEW 250 W. LUMINAIRE W/11 GA. POLE

- 1) ALL FIELD WIRE TO BE 2-#4_s THW. 1-#8 GREEN
- 2) CHISEL S, W, & G. WHERE THESE LATERALS PASS UNDER THE CURB.
- 3) SERVICE POINT - LINESIDE 2-#2_s & 1-#6.

G.C. WALLACE
Consulting Engineers, Inc.
100 East Sahara Ave. • Las Vegas, Nevada 89104 • 732-3330

BECKER & SONS
HEIGHTS — TRACT NO. 57A
UTILITY PLAN I

SHEET
5
OF 23 SHEETS