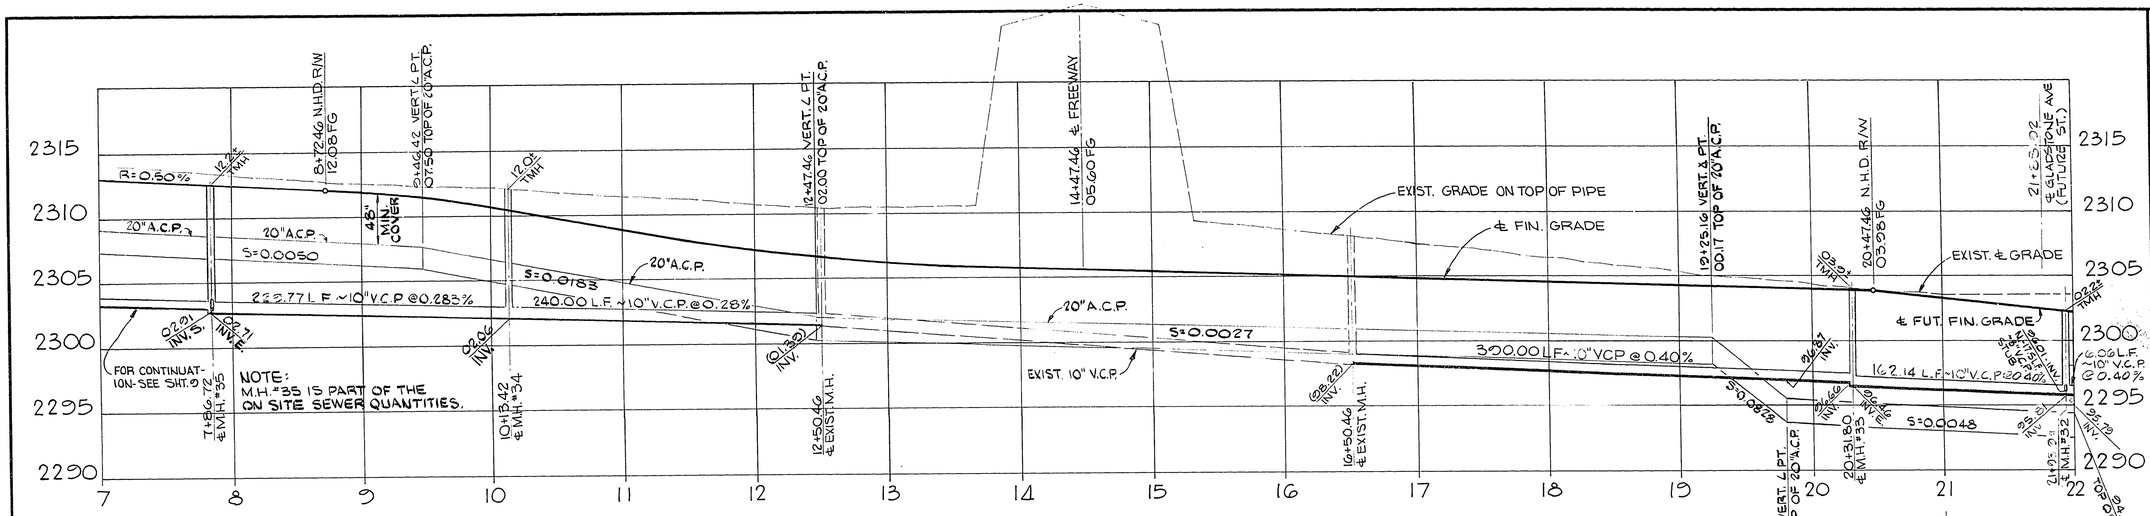

PROFILE

SCALE: VERT. 1" = 5'
HORIZ. 1" = 50'

ESTIMATE OF OFFSITE WATER QUANTITIES

10" A.C.P.	75 L.F.
12" A.C.P.	26 L.F.
20" A.C.P. (OVERSIZED FM. 14")	2123 L.F.
24" A.C.P. (OVERSIZED FM. 14")	1041 L.F.
10" GATE VALVE W/VALVE BOX & COVER	5 EA.
12" GATE VALVE W/VALVE BOX & COVER	2 EA.
20" BUTTERFLY VALVE W/VALVE BOX & COVER	2 EA.
24" BUTTERFLY VALVE W/VAULT STRUCTURE	1 EA.

NORTH
SCALE: 1" = 50'

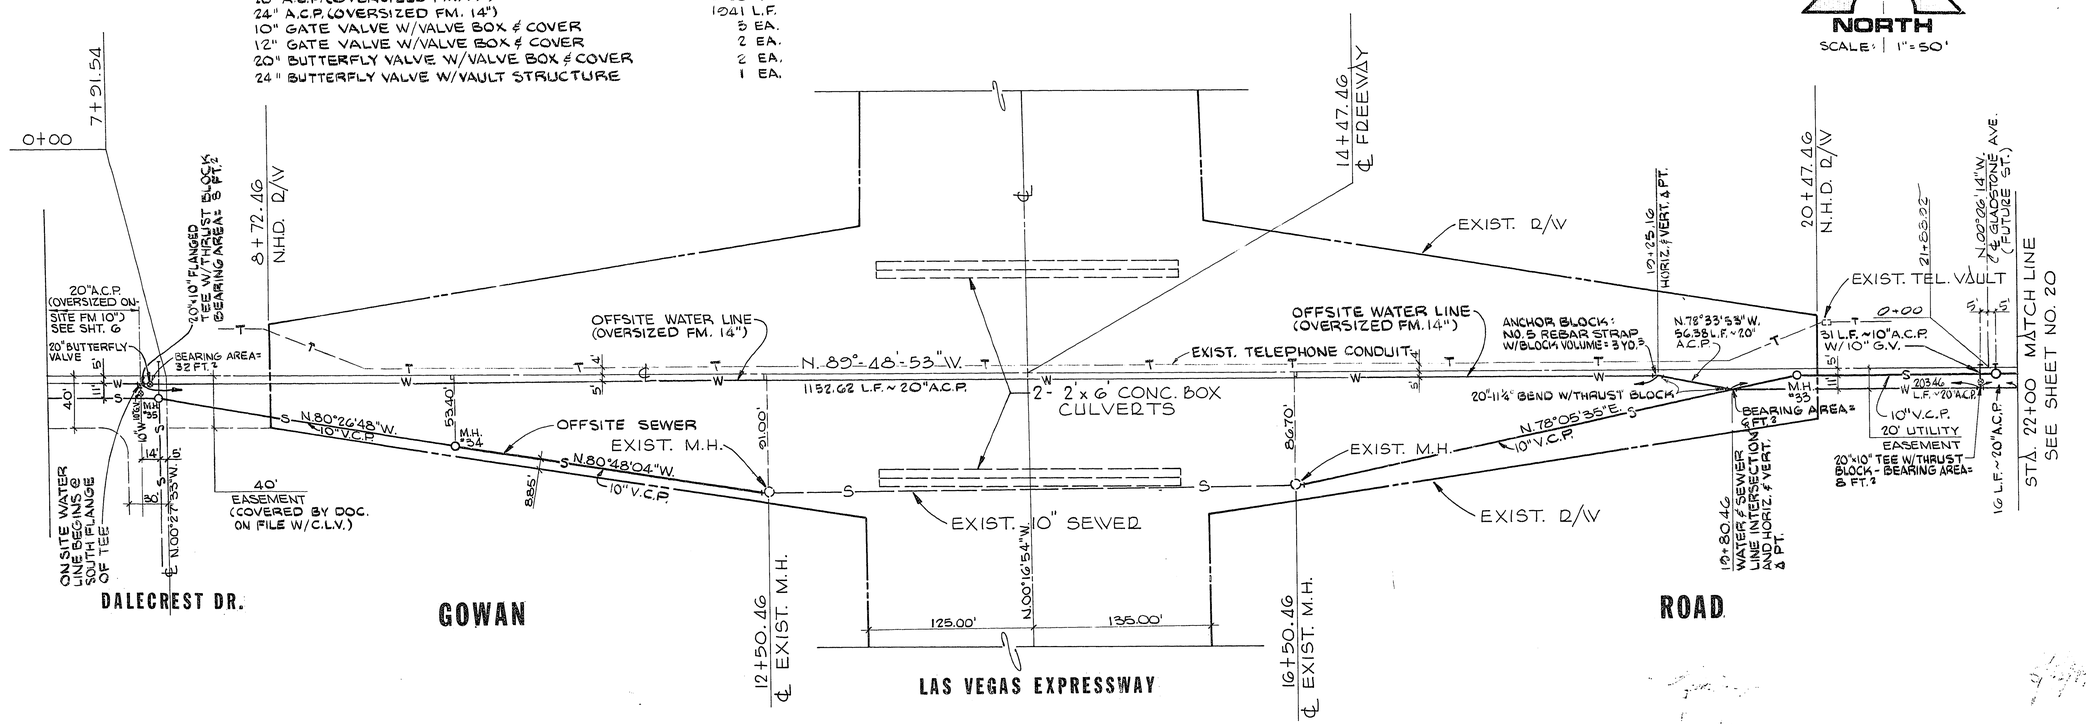

APPROVALS:

C.L.V. ENGINEER	5/22/79 DATE	LAS VEGAS VALLEY WATER DISTRICT	5-21-79 DATE
C.L.V. FIELD OPERATIONS ENG'R.	DATE	C.L.V. SANITATION SUPERINTENDENT	5-24-79 DATE
		C.L.V. QUALITY CONTROL ENG'R.	5-22-79 DATE

REV	DATE	DESCRIPTION
1	8/6/79	MOVED WATERLINE TO 5' FM. ℄ PER N.H.D.

RECOMMENDED: G. C. WALLACE
R.E. NO. 3194 2/6/79 DATE

G. C. WALLACE
Consulting Engineers, Inc.
1100 East Sahara Ave. • Las Vegas, Nevada 89104 • 732-3330

CHARLESTON HEIGHTS DEVELOPMENT CO.
CHARLESTON HEIGHTS — TRACT NO. 57A
OFFSITE SEWER & WATER

SHEET 21 OF 23 SHEETS

433.012

9/78 DIETERICH-POST 65320

307y-1040-57A