
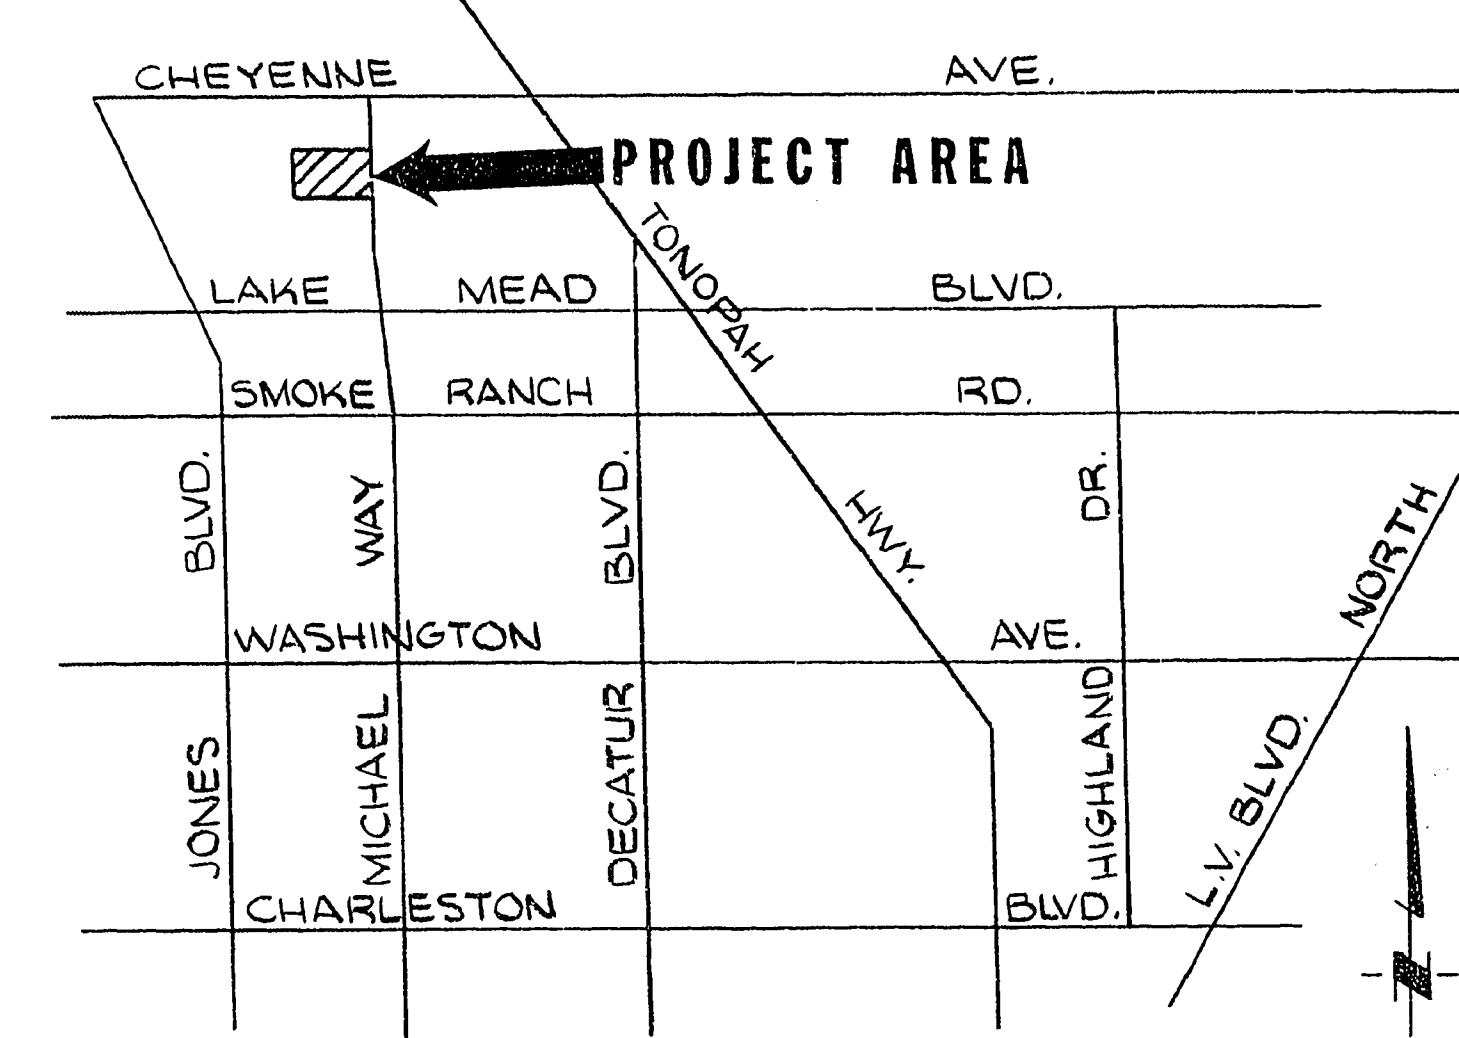


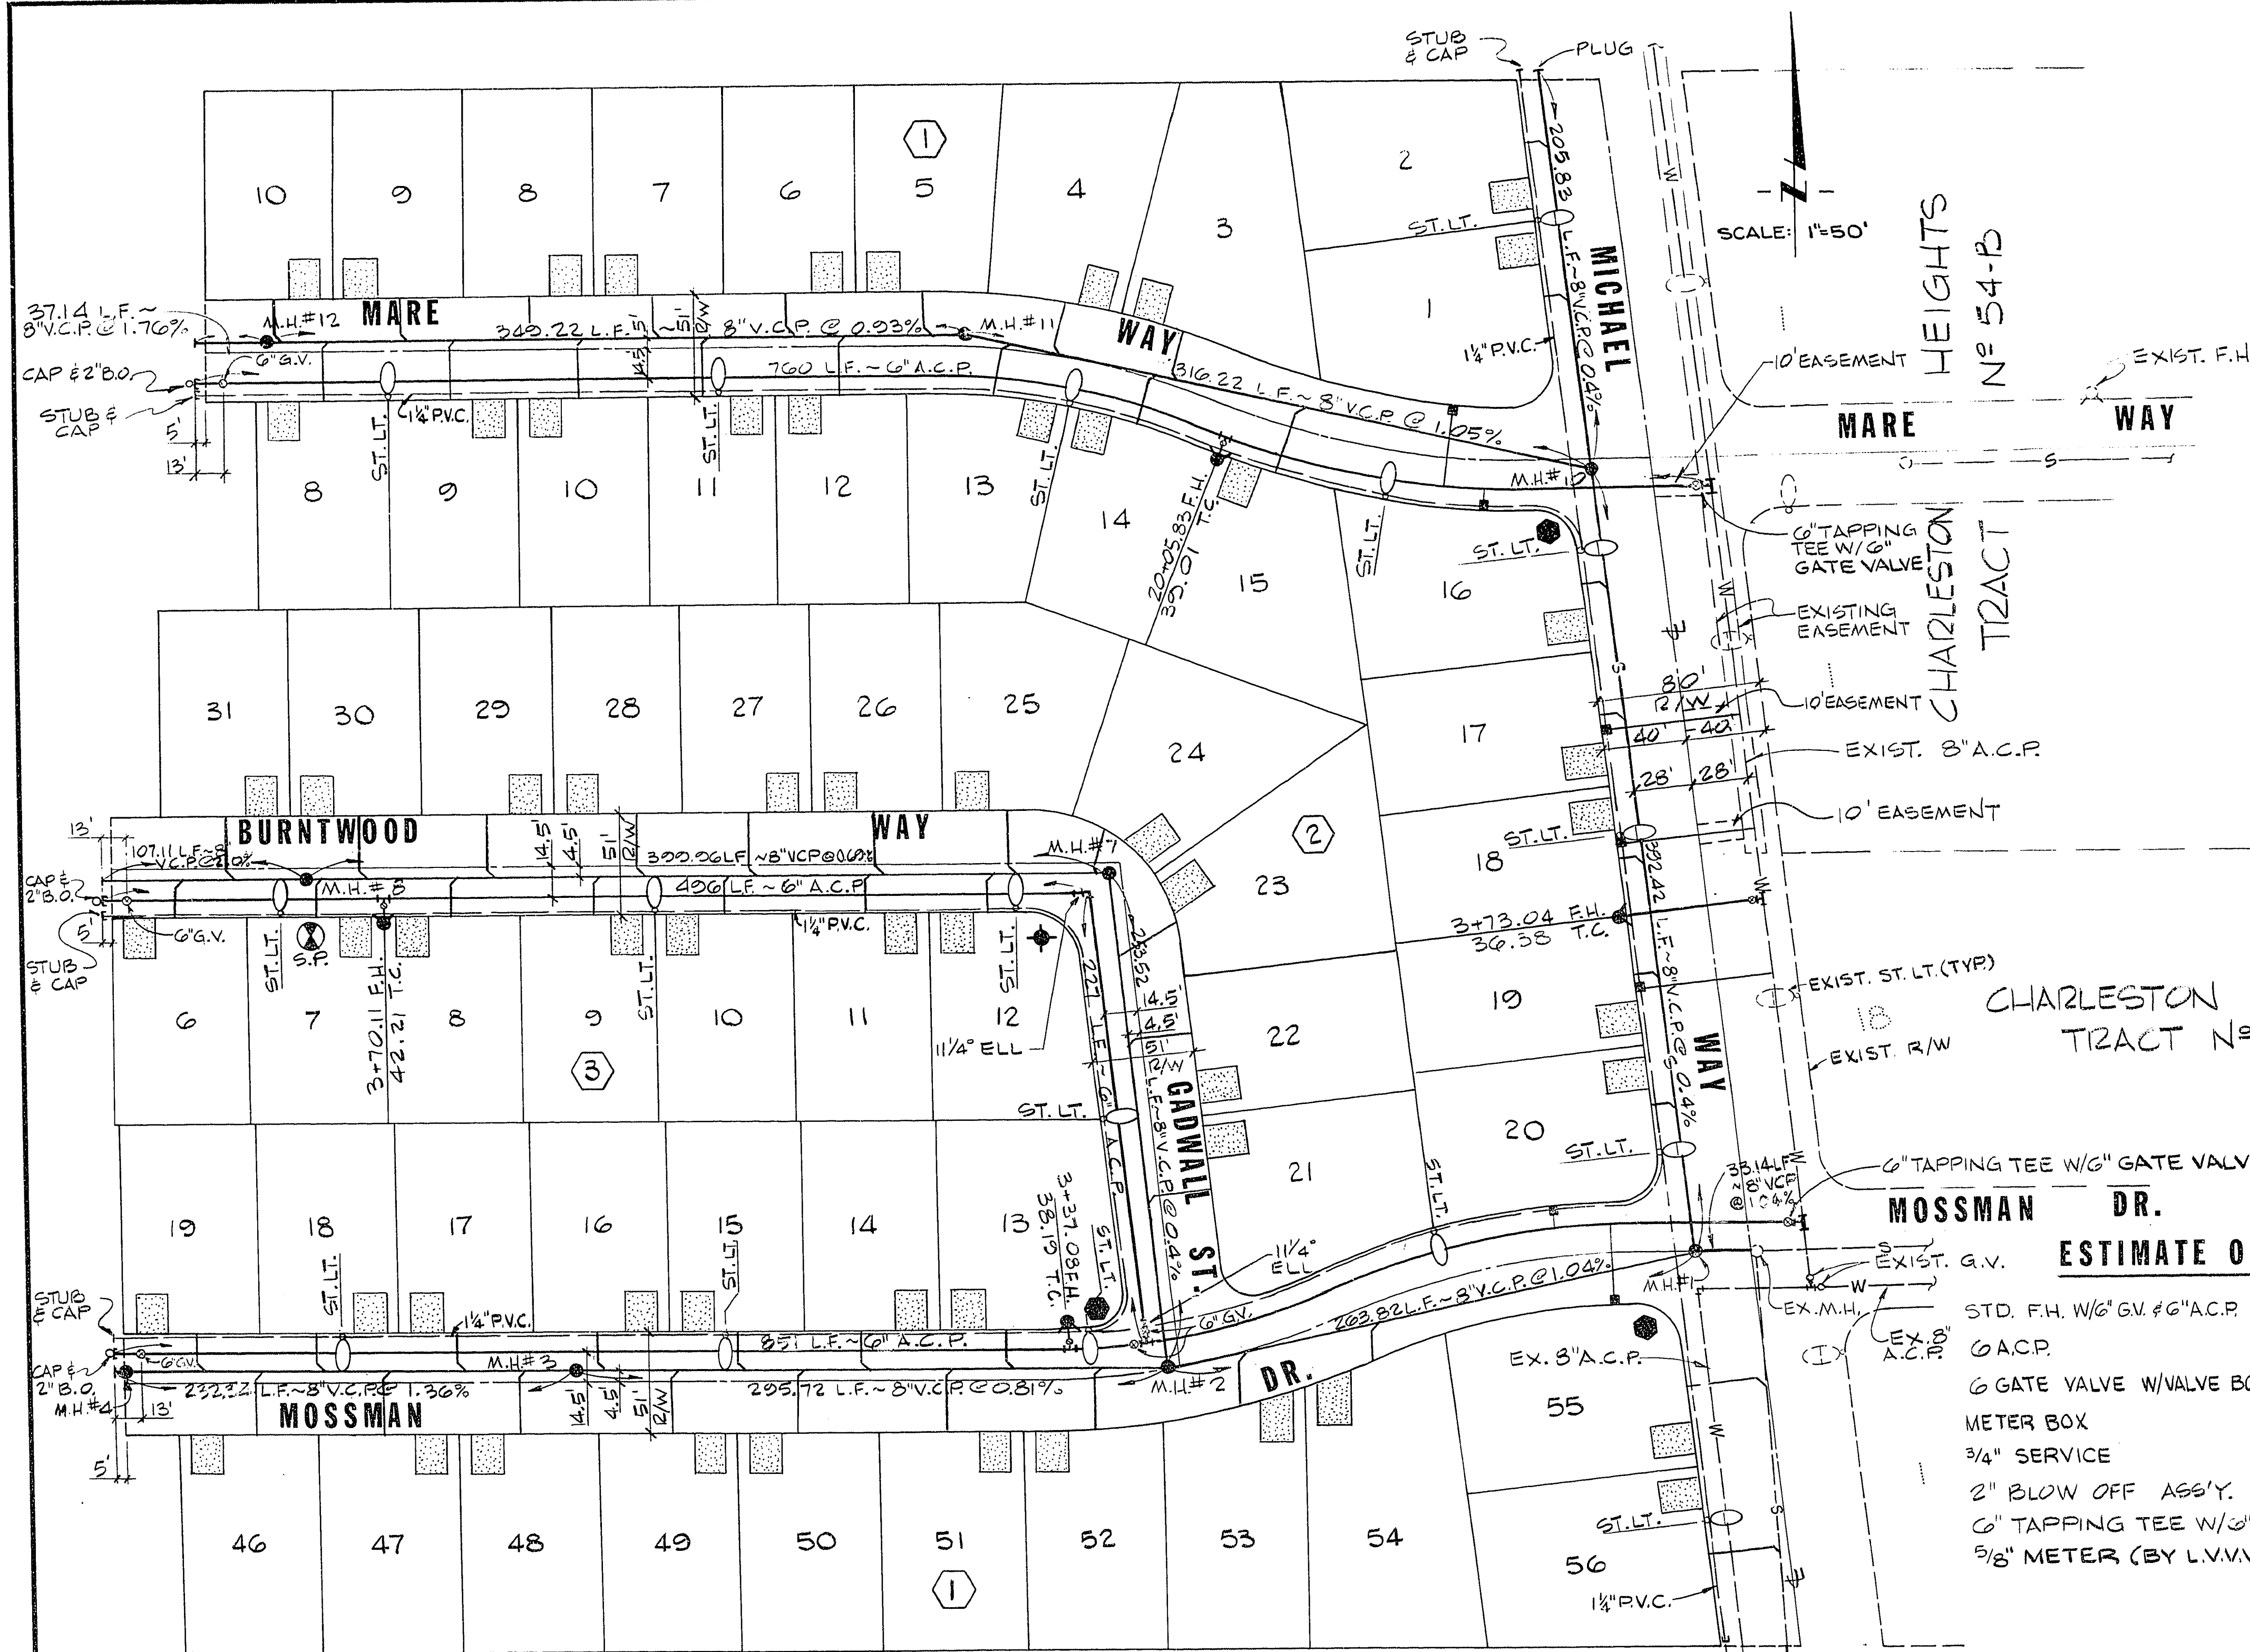

VICINITY MAP

LEGEND

- STD. F.H. W/6" G.V. & 6" A.C.P. LATERAL
- SEWER MANHOLE
- NEW 100 W. LUM., H.P.S. W/11 GA. POLE
- NEW 250 W. LUM., H.P.S. W/11 GA. POLE
- EXIST. LUMANAIRE
- 1 1/2" P.V.C. ST. LIGHT CONDUIT
- GATE VALVE
- SEWER LINE
- WATER LINE
- STOP SIGN & ST. NAME SIGN
- SERVICE POINT
- STREET SIGN
- CONCRETE DRIVEWAY

NOTE: SERVICE WIRE TO BE 2-#2's & 1-#6 THW
ALL FIELD WIRE TO BE 2-#4's THW.

APPROVALS:

[Signature] 10/4/78
C.L.V. ENGINEER DATE

[Signature] 10-4-78
C.L.V. FIELD OPERATIONS ENGINEER DATE

[Signature] 9/18/78
C.L.V. ELECTRICAL SUPERVISOR DATE

[Signature] 9/18/78
C.L.V. ELECTRICAL COORDINATOR DATE

[Signature] 9-15-78
C.L.V. SANITATION SUP'T. DATE

[Signature] 9-19-78
C.L.V. FIRE MARSHALL DATE

[Signature] 10-9-78
C.L.V. QUALITY CONTROL ENGINEER DATE

[Signature] 10-19-78
NEVADA POWER CO. DATE


[Signature] 1-25-79
LAS VEGAS VALLEY WATER DISTRICT DATE

ESTIMATE OF QUANTITIES


STD. F.H. W/6" G.V. & 6" A.C.P. LATERAL	4	EA.
6" A.C.P.	2,334	L.F.
6" GATE VALVE W/VALVE BOX & COVER	5	EA.
METER BOX	50	EA.
3/4" SERVICE	50	EA.
2" BLOW OFF ASS'Y.	3	EA.
6" TAPPING TEE W/3" GATE VALVE	2	EA.
5/8" METER (BY L.V.V.W.D.)	50	EA.

WATER NOTES

- ALL WORK TO CONFORM TO LAS VEGAS VALLEY WATER DISTRICT STANDARD PLATES.
- ALL WORK, EXCEPT AS MODIFIED HEREON OR BY NOTE NO. 1, SHALL BE DONE IN ACCORDANCE WITH THE MOST CURRENT DRAFT OR EDITION OF UNIFORM STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION OFFSITE IMPROVEMENTS CLARK COUNTY AREA, 1978.
- NOTICE TO BE GIVEN ENGINEERING DEPARTMENT OF THE LAS VEGAS VALLEY WATER DISTRICT 48 HOURS PRIOR TO ACTUAL CONSTRUCTION.
- SERVICE SADDLES OR TAPPED COLLARS WILL BE REQUIRED ON ALL SERVICES, DOUBLE TAP COLLARS ARE NOT PERMITTED.
- ALL LINES TO BE PRESSURE TESTED TO 200 PSI.
- ALL VALVE BOXES SHALL HAVE CONCRETE COLLARS AT SURFACE OF PAVED AREAS.
- DEFLECTION ANGLE SHALL NOT EXCEED 2-1/2 DEGREES PER 13 FOOT SECTION PIPE FOR PIPE SIZES SMALLER THAN 24 INCHES AND SHALL NOT EXCEED 2 DEGREES FOR PIPE SIZES BETWEEN 24 INCHES AND 36 INCHES.
- ALL METERS SHALL BE LOCATED OUTSIDE OF DRIVEWAYS.
- SERVICE LATERALS FOR LOTS 2, 6, 56, BLOCK 1 & LOTS 17, 18 & 19, BLOCK 2 WILL BE TAPPED ON EXISTING 8" ACP MAIN BY OWNER'S CONTRACTOR UNDER DIRECTION OF THE LAS VEGAS VALLEY WATER DISTRICT.
- DETECTOR TAPE REQUIRED IN ACCORDANCE WITH STANDARD PLATE NO. 27 WHERE INDICATED AND AS FOLLOWS:
A. OVER ALL MAINS NOT INSTALLED AT 6 FEET FROM BACK OF CURB.
B. OVER ALL SERVICE LATERALS NOT INSTALLED AT RIGHT ANGLES TO MAINS.

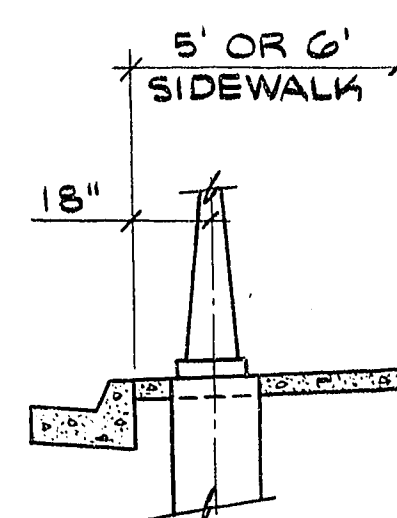


STREET LIGHT

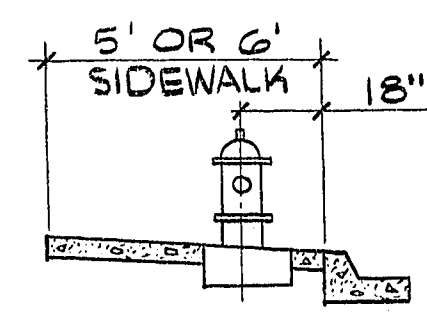

FIRE HYDRANT

ST. LIGHT & FIRE HYDRANT LOCATION DETAIL

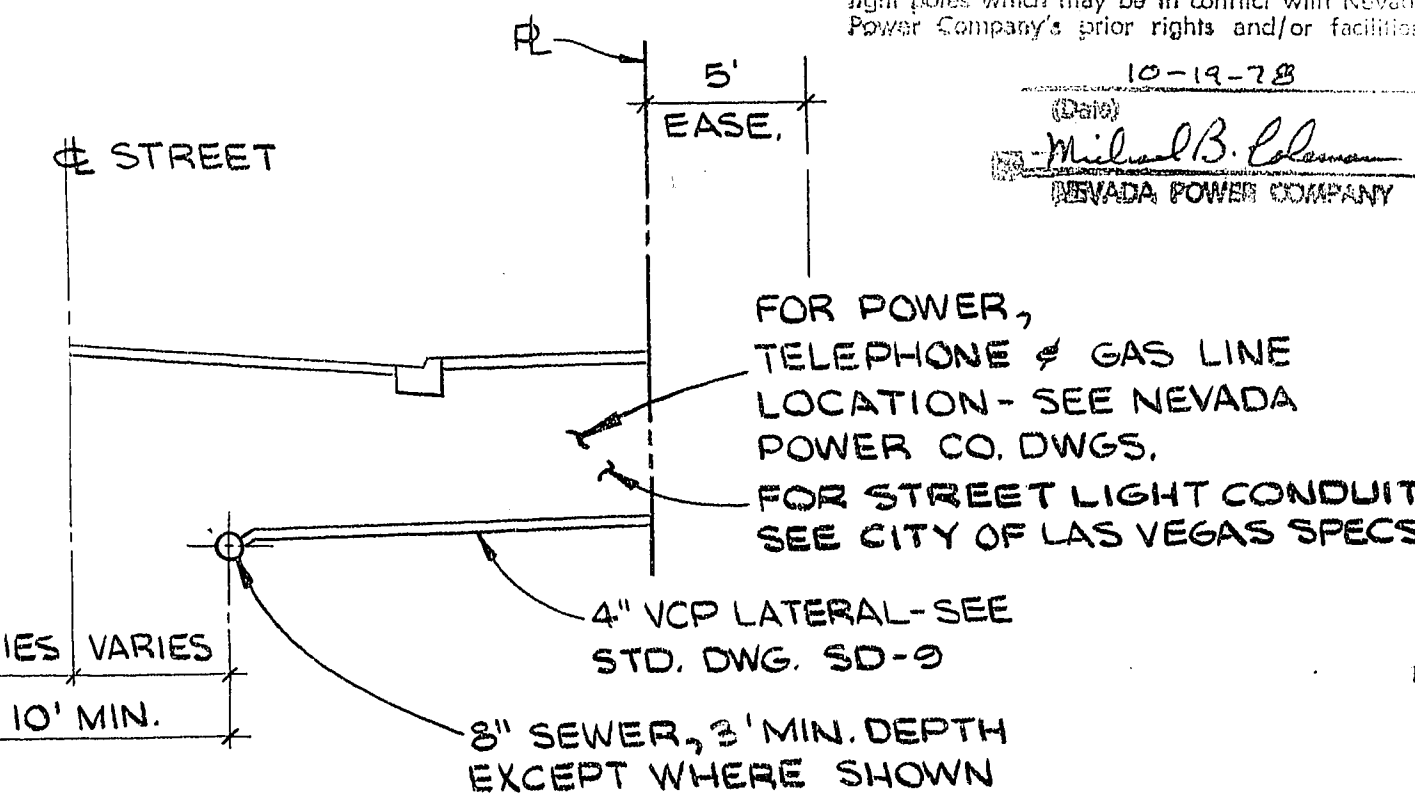

TYP. STREET SECTION

Nevada Power Company approves the placement of service to the street light system. This approval is deemed to consent to the placement of light poles which may be in conflict with Nevada Power Company's prior rights and/or facilities.

10-19-78
[Signature]
NEVADA POWER COMPANY

FOR POWER, TELEPHONE & GAS LINE LOCATION - SEE NEVADA POWER CO. DWGS.
FOR STREET LIGHT CONDUIT SEE CITY OF LAS VEGAS SPECS.

DESCRIPTION

REV. DATE

RECOMMENDED BY

3774 3/1/79
G.C. WALLACE

G.C. WALLACE
Consulting Engineers, Inc.
1100 East Sahara Ave. • Las Vegas, Nevada 89104 • 732-3330

BECKER & SONS

CHARLESTON HEIGHTS — TRACT NO. 55-A

UTILITY PLAN

SHEET

5

OF 11 SHEETS

3078-1040-55A