



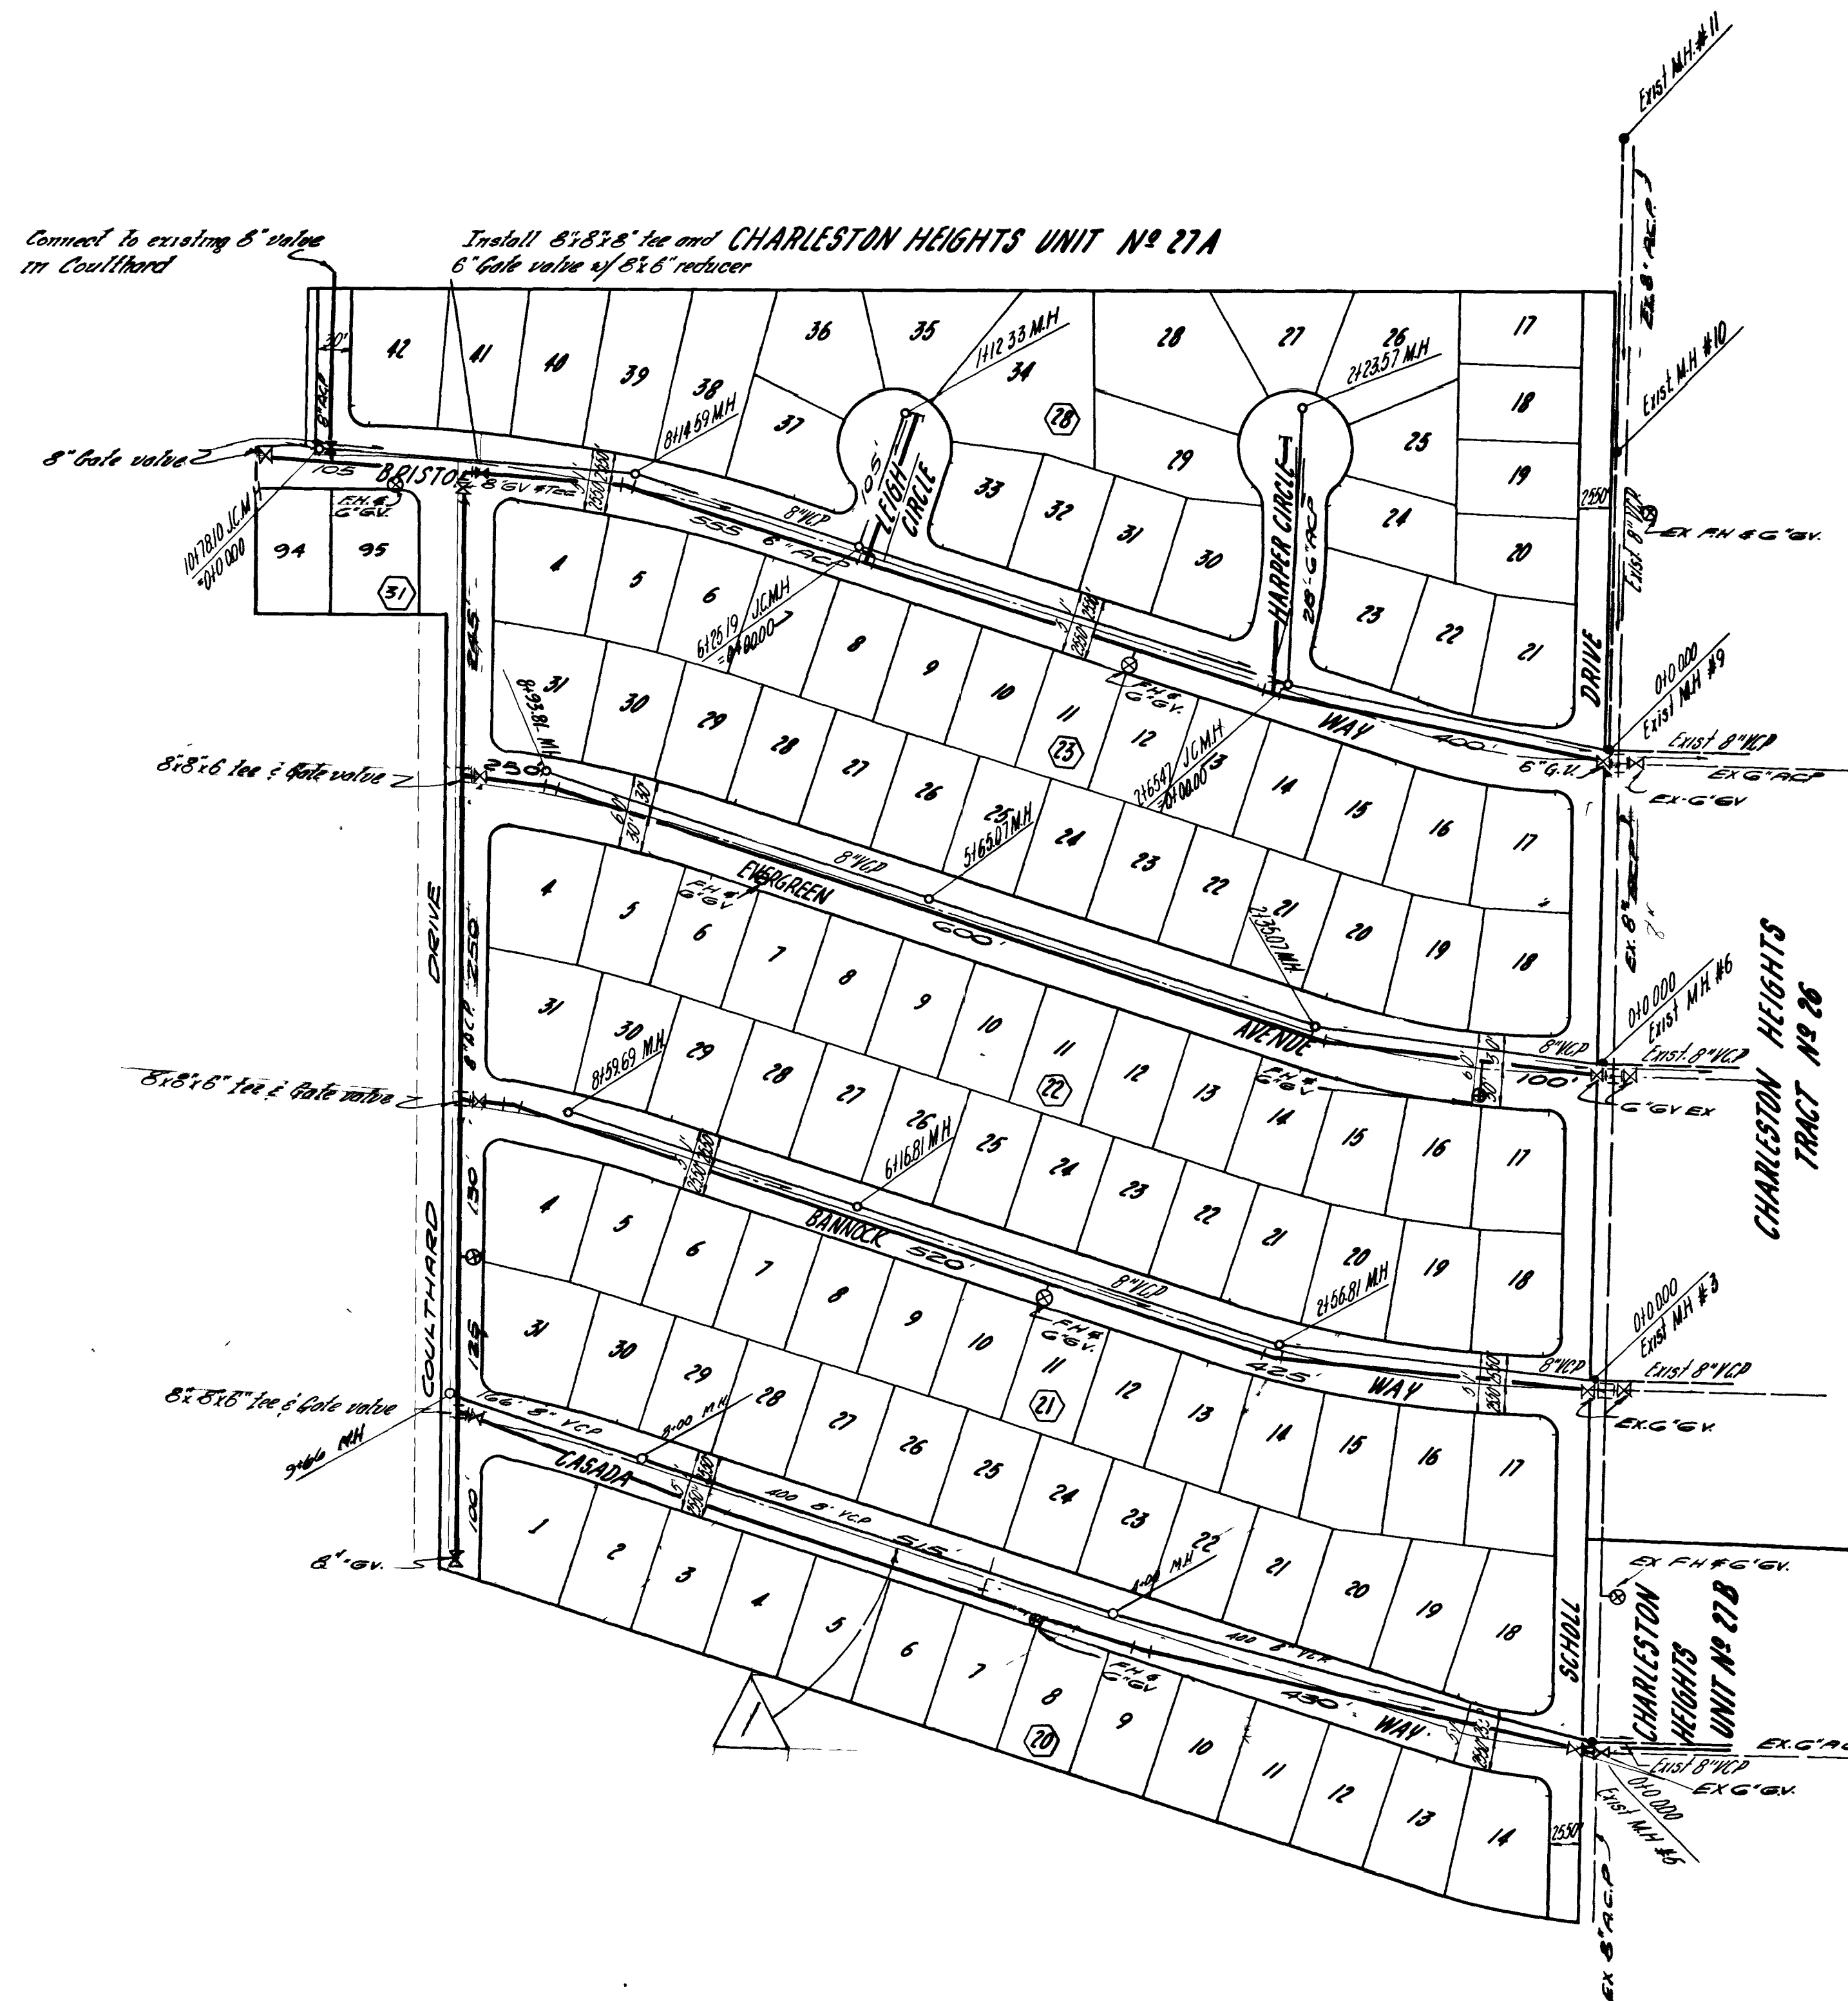

ESTIMATE OF QUANTITIES
 G.A.C.P. 511600' L.N. P.
 3/4" COPPER SERVICES 126 LB.
 FIRE HYDRANTS 7 EA.

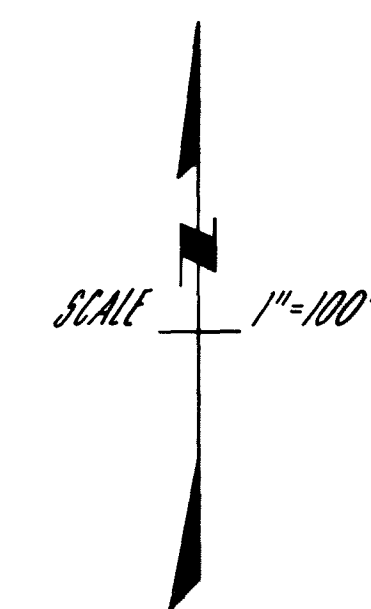

APPROVALS
[Signature] 7-15-63
 City Engineer Date
[Signature] 4/23/63
 Fire Chief Date
 L.V.V.W.D. Date

NOTE - FOR FIRE HYDRANT PLACEMENT, REFER TO CITY OF LAS VEGAS STANDARD DRAWINGS NUMBER 303 AND 303A.

LAS VEGAS VALLEY WATER DISTRICT
 By *[Signature]* Date 7/16/63
 THIS SIGNATURE IS NOT AN OFFICIAL APPROVAL. IT INDICATES ONLY THAT THE TRACING WAS IN ACCORDANCE WITH THE APPROVED PRINT AT TIME OF SIGNATURE.

REV	DATE	DESCRIPTION	BY	APPD
1	6-24-63	RELOCATED CROSODA SS.	R.I.	
CHARLESTON HEIGHTS				
UNIT NO. 27C				
WATER PLAN				
DESIGNED	WESTERN ENGINEERS, INC.			SHEET 1
DRAWN	LAS VEGAS NEVADA			OF 1
CHECKED	APPROVED	DATE 7/16/63		

3472

37-6-106

5674-1040-27c

