


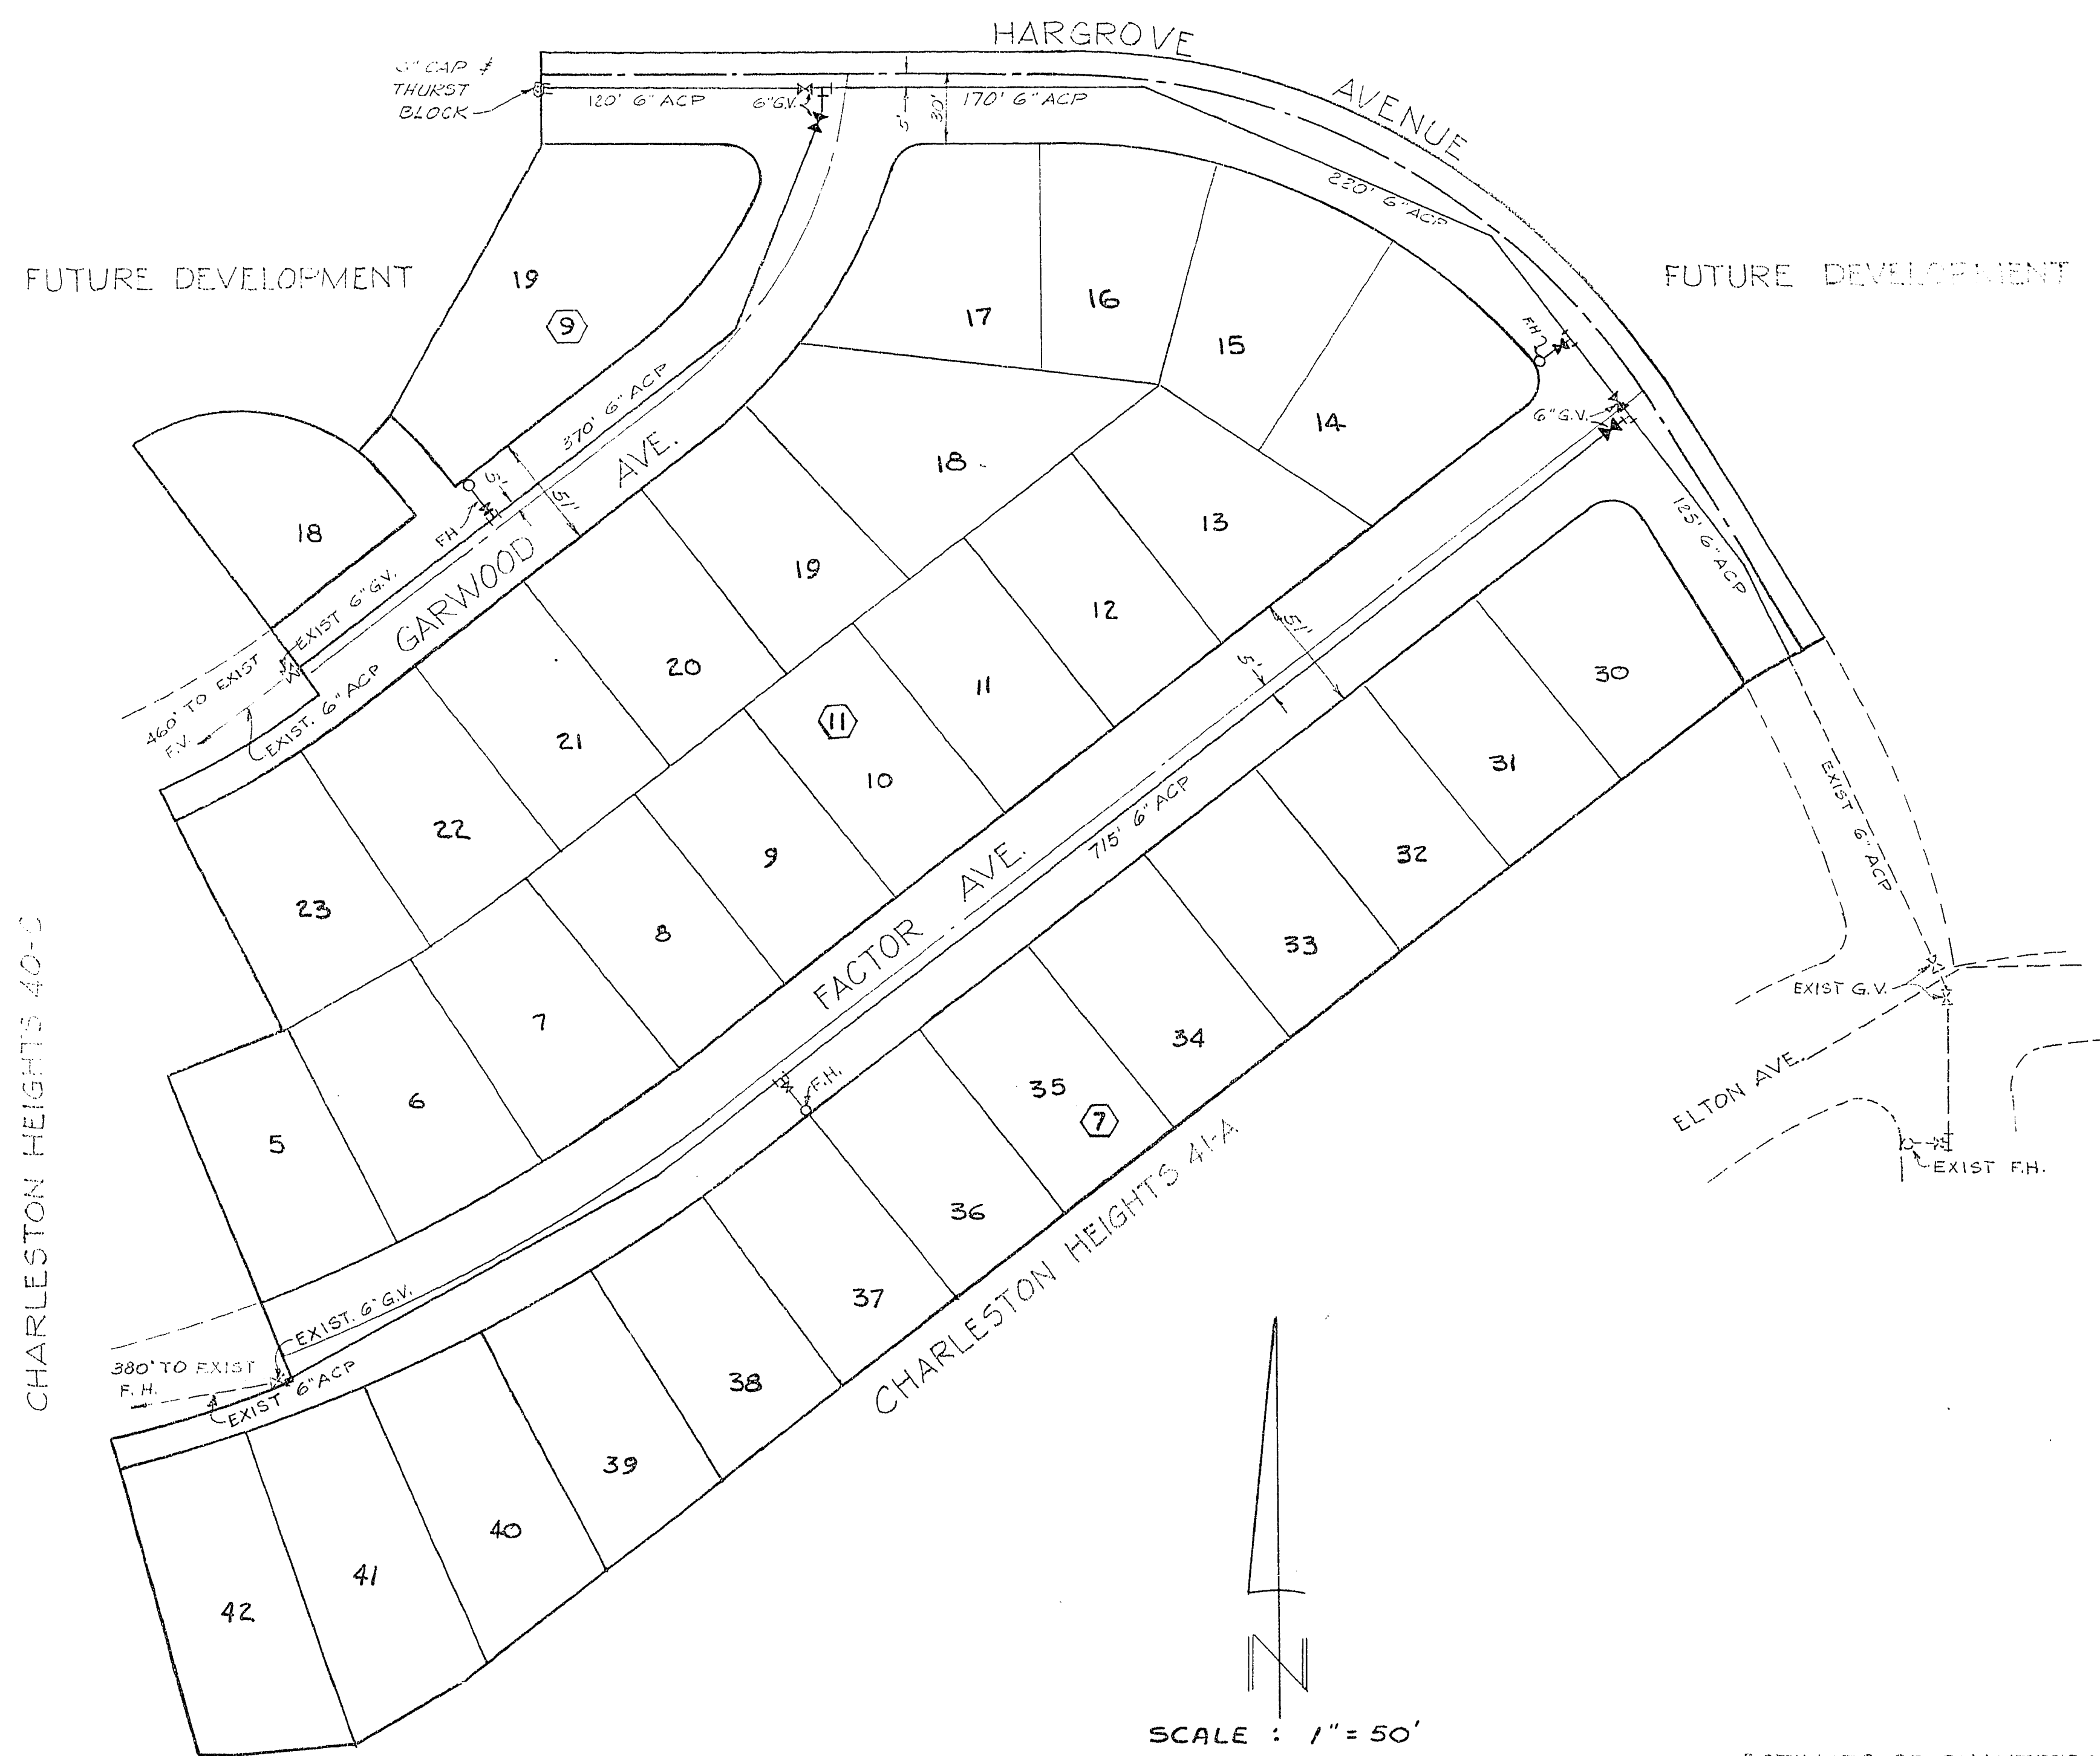

SCALE : 1" = 50'

ESTIMATE OF QUANTITIES
 6" GATE VALVES 4 REQ.
 6" ACP 1720 L.F.
 COPPER SERVICE 34 EA.
 FIRE HYDRANT 3 EA.

LAS VEGAS VALLEY WATER DISTRICT
 By *[Signature]* Date *8/15/62*
 THIS SIGNATURE IS NOT AN OFFICIAL
 APPROVAL. IT INDICATES ONLY THAT
 THE TRACING WAS IN ACCORDANCE
 WITH THE APPROVED PRINT AT TIME OF
 SIGNATURE.


APPROVALS

[Signature] 11-25-62
 CITY ENGINEER DATE
[Signature] Aug 15-62
 FIRE CHIEF DATE
[Signature] Aug 15, 62
 BOULDERADO WATER CO DATE

CHARLESTON HEIGHTS
 TRACT No. 41-C
 WATER PLAN

DESIGNED ☒	WESTERN ENGINEERS, INC. LAS VEGAS NEVADA	SHEET 1 OF 1
DRAWN ☒		
CHECKED ☒		

APPROVED *[Signature]* DATE *8/15/62*
 567Y-1040-41C



SCALE 1" = 50'

EXTENTS OF QUANTITIES
 OF WATER SUPPLY
 OF WATER SUPPLY
 OF WATER SUPPLY

APPROVED
 [Signature]
 [Signature]
 [Signature]

APPROVED
 [Signature]
 [Signature]
 [Signature]

CHARLESTON HEIGHTS
 TRACT No. 60-C
 WATER PLAN
 [Signature]
 [Signature]
 [Signature]