
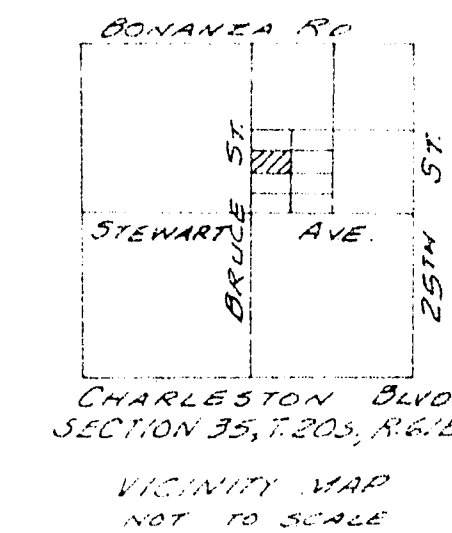


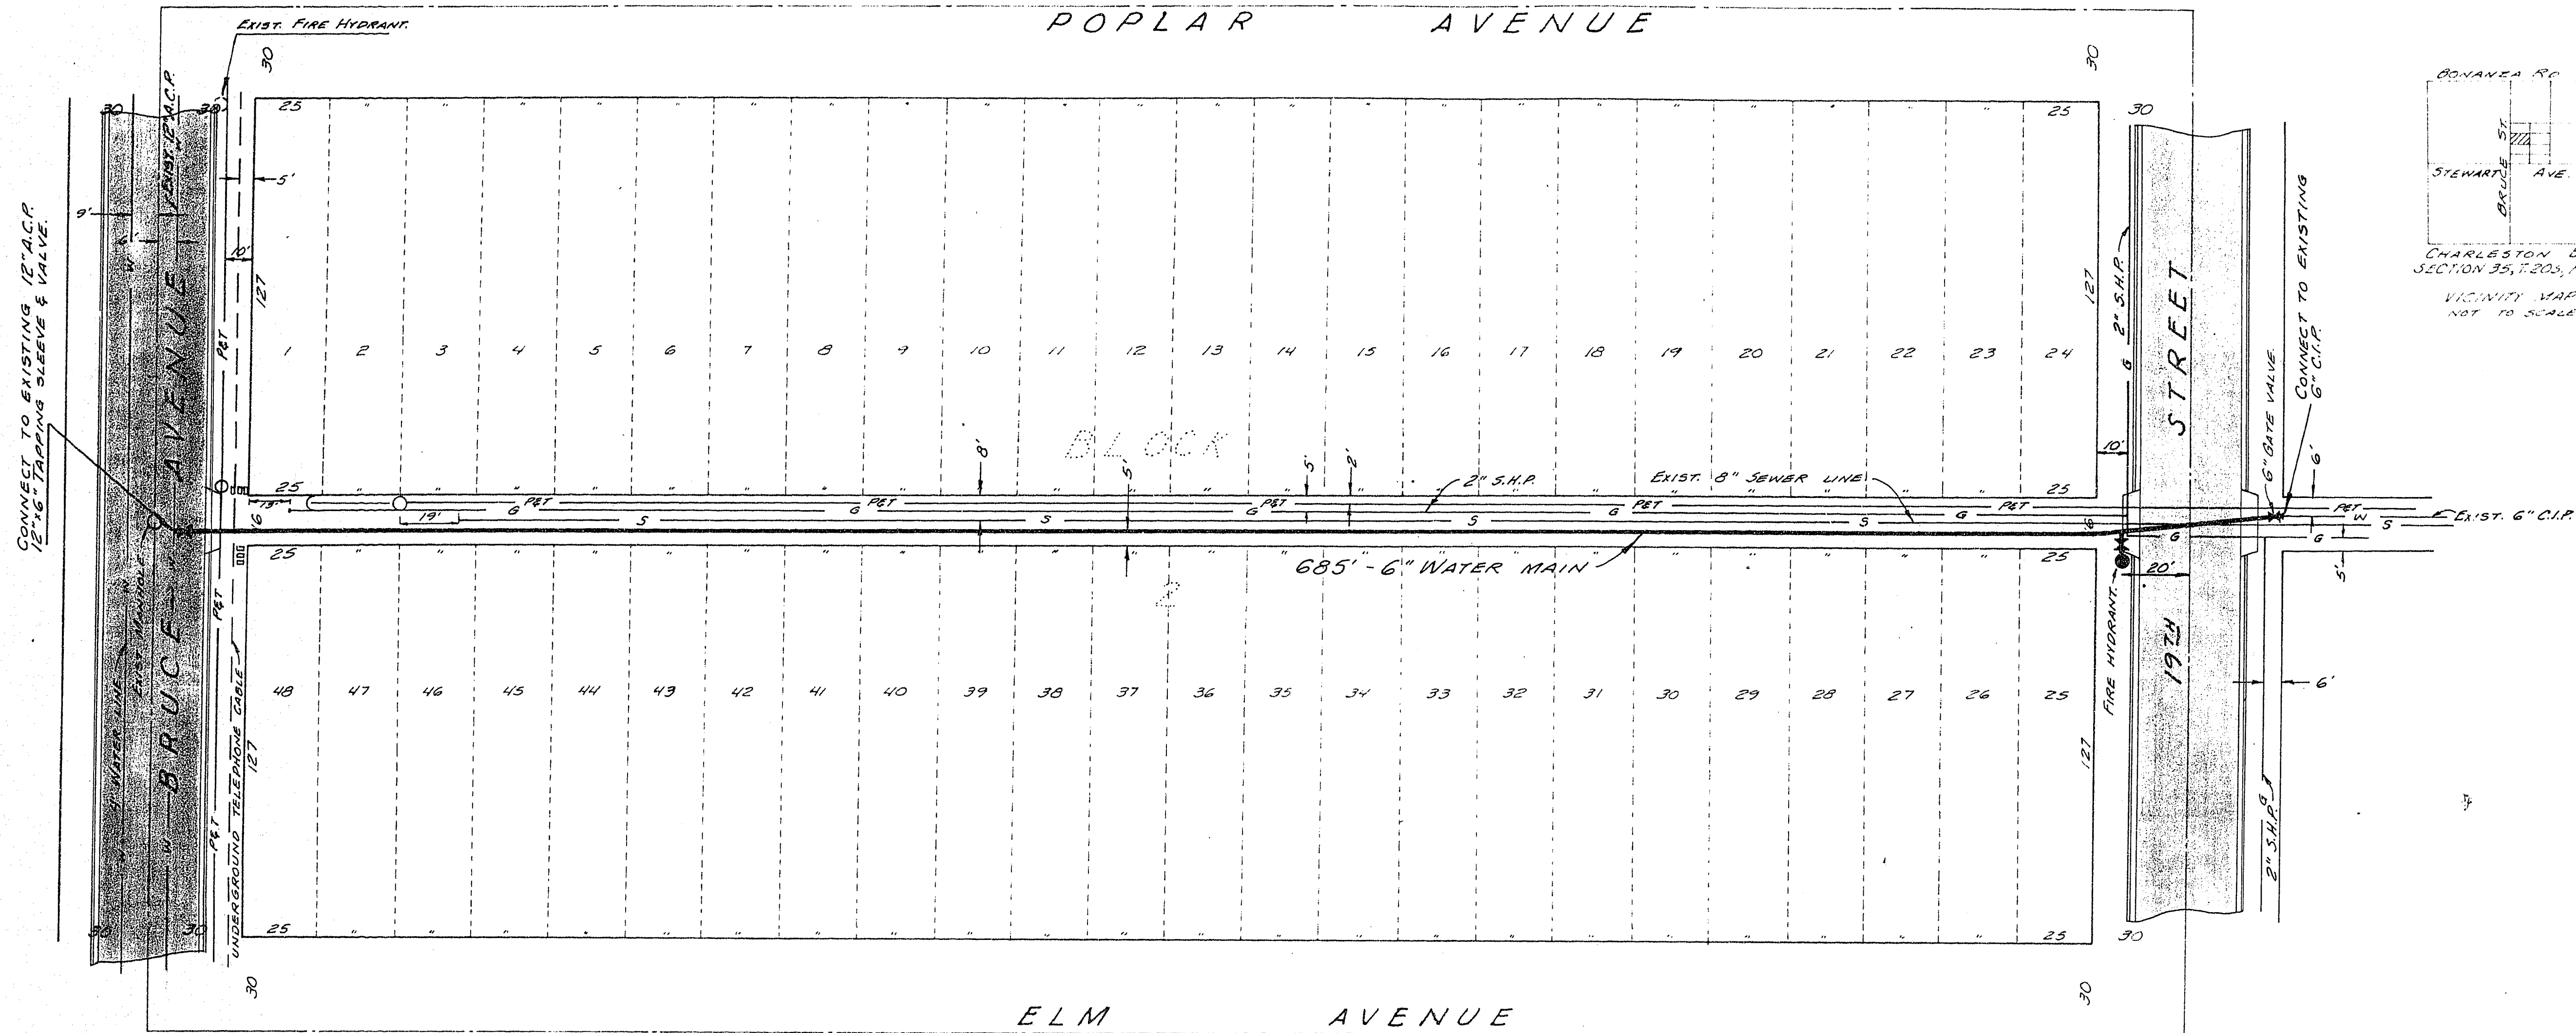

NORTH

APPROXIMATE QUANTITIES
 6" WATER LINE - A.C.P. CLASS 150 685 LIN. FT.
 FIRE HYDRANT W/NECESSARY FITTINGS TO INSTALL. 1 EACH

APPROVALS:
 WILLIAM C. RENSHAW, LAS VEGAS VALLEY WATER DISTRICT.
 LAS VEGAS CITY ENGINEER
 LAS VEGAS FIRE DEPARTMENT.

SHEET 1 OF 1

LAS VEGAS VALLEY WATER DISTRICT
 ASSESSMENT DISTRICT No. UNIT
 WILLIAM C. RENSHAW
 CHIEF ENGINEER & GEN. MGR.

BLOCK 2
 BOULDER DAM HOMESITE
 ADDITION TRACT No. 2

APPROVED: [Signature] DATE: 4-3-64 SCALE: 1" = 30'
 TEVPA TURQUIN CONSULTING ENGINEER
 LAS VEGAS, NEVADA JOB No. 15-14

REV 4-20-9-1

567 Y-950-2