


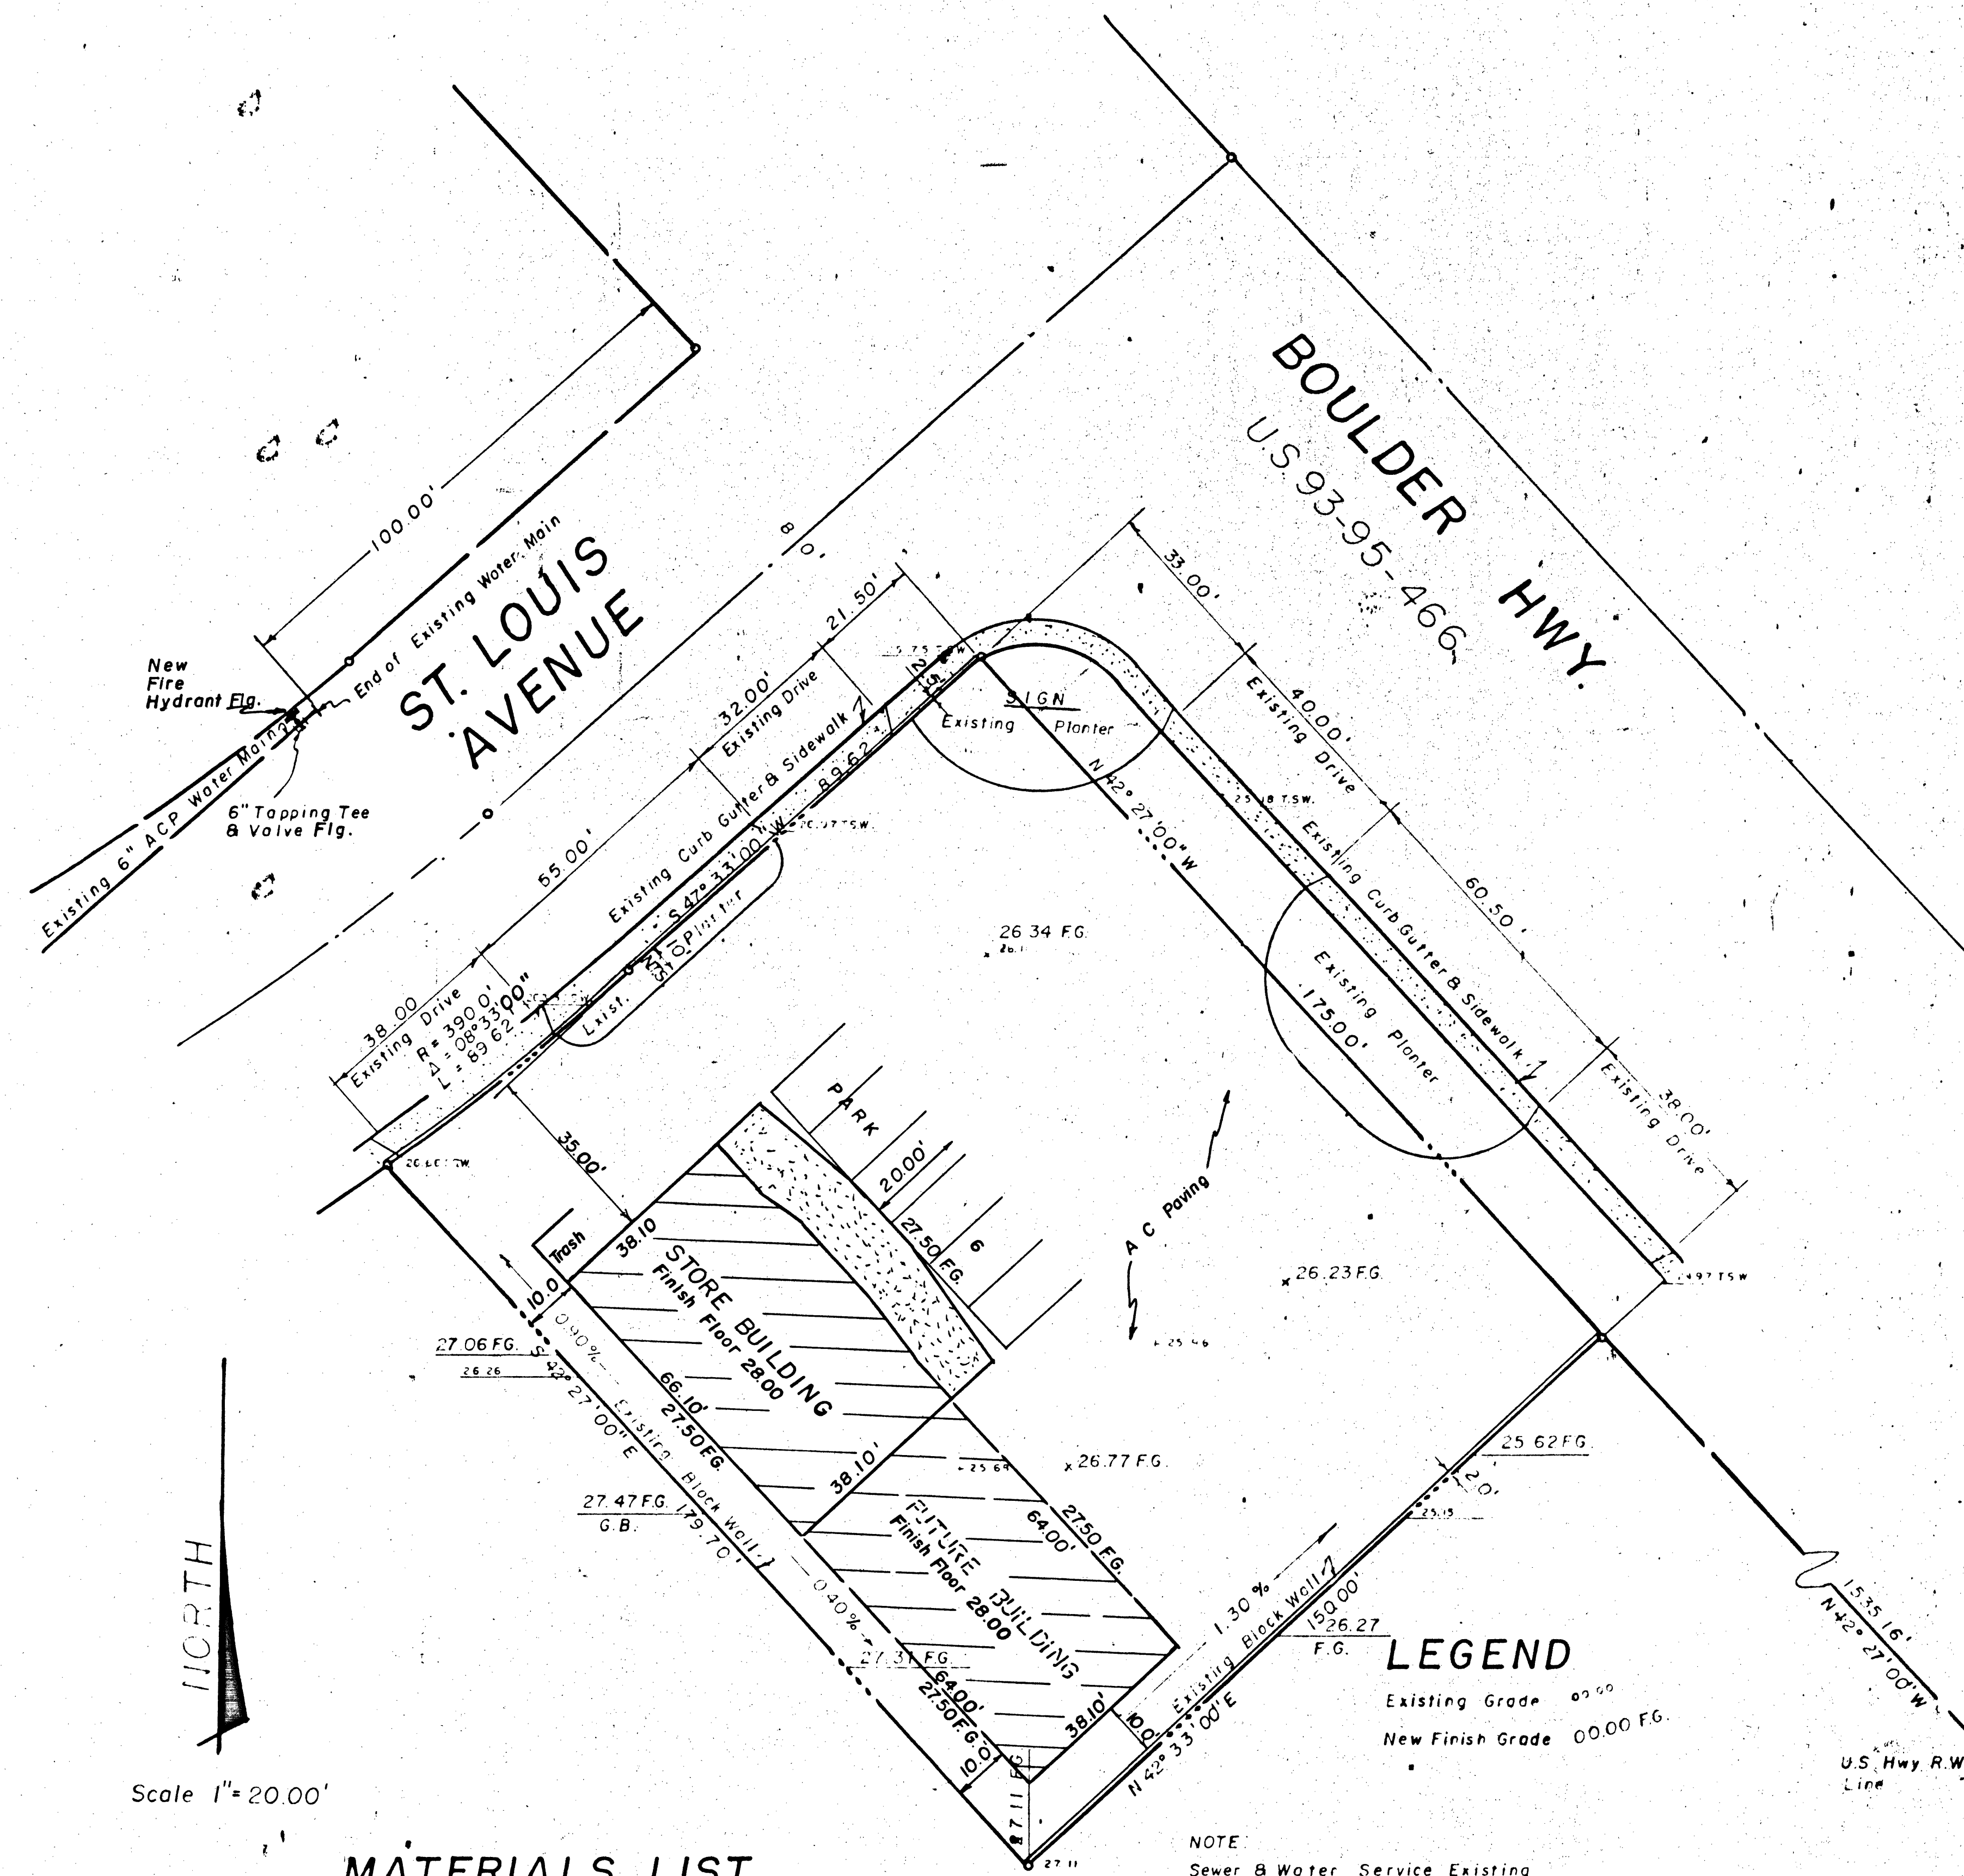

BENCH MARK

U.S.G.S. J-365
South P.C. St. Louis and Boulder Hwy.
Elevation 1826.35


PAVING DETAIL

2\" A.C. Paving Bit. Fog Seal
6\" Type II Gravel

APPROVALS

Consulting Engineer Date 10/25/78
County Engineer Date 10/25/78
County Fire Department Date 10/25/78

LOCATION MAP

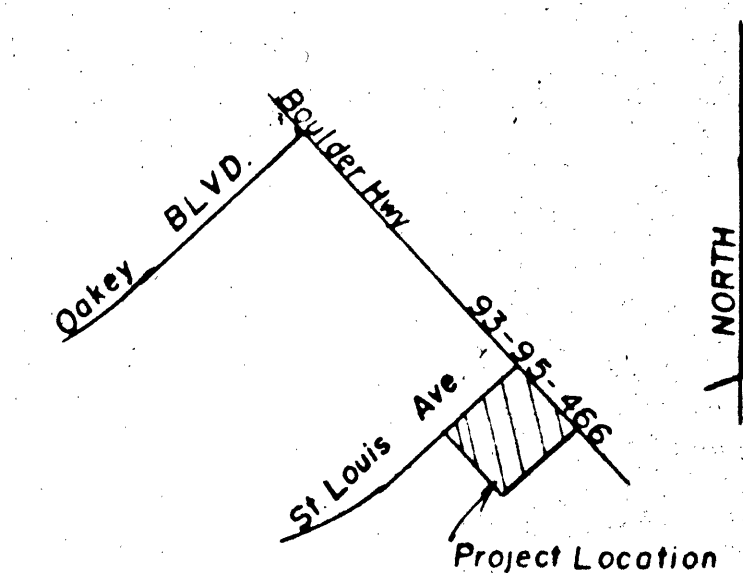

FIRE HYDRANT NOTES

- All work shall be done in strict accordance with Clark County Specifications.
- All work shall be done in strict accordance with Clark County Fire Department "Hydrant Specifications", "Hydrant Installation Specifications" and "Water Resolutions and Requirements".
- On any new home or building construction, accessible fire hydrants are to be installed before actual construction commences and said fire hydrants shall be in good working order with adequate water supply.
- Painting of curb or stripping of asphalt areas, and protection of hydrants from physical injury per Clark County Fire Department Hydrant Installations shall be completed before approval of the hydrants by the Clark County Fire Department.
- No fire hydrant shall be located within 15 feet of any driveway, power pole, light standard, or other obstructions, for wall, fence and planter locations. Drawings 44.0 "B" shall be used.

MATERIALS LIST

- 1 each 6\" Tapping Tee & Valve Flg.
- 790 L.F. 6\" ACP Water
- 1 each Fire Hydrant Flg.
- 2 each 6\" 45° Bends

LEGEND

Existing Grade 00.00
New Finish Grade 00.00 FG.

NOTE:
Sewer & Water Service Existing

KARSTEN T. BRONKEN
Consulting Engineers
1818 Industrial Road
LAS VEGAS, NEVADA 89102

PLOT AND GRADING PLAN CIRCLE K STORES

Revised - New Future Building, 12/19/78, RG
Revised - Fire Hydrant, 7/16/79, RG

JUN 27 1979

565-119

