


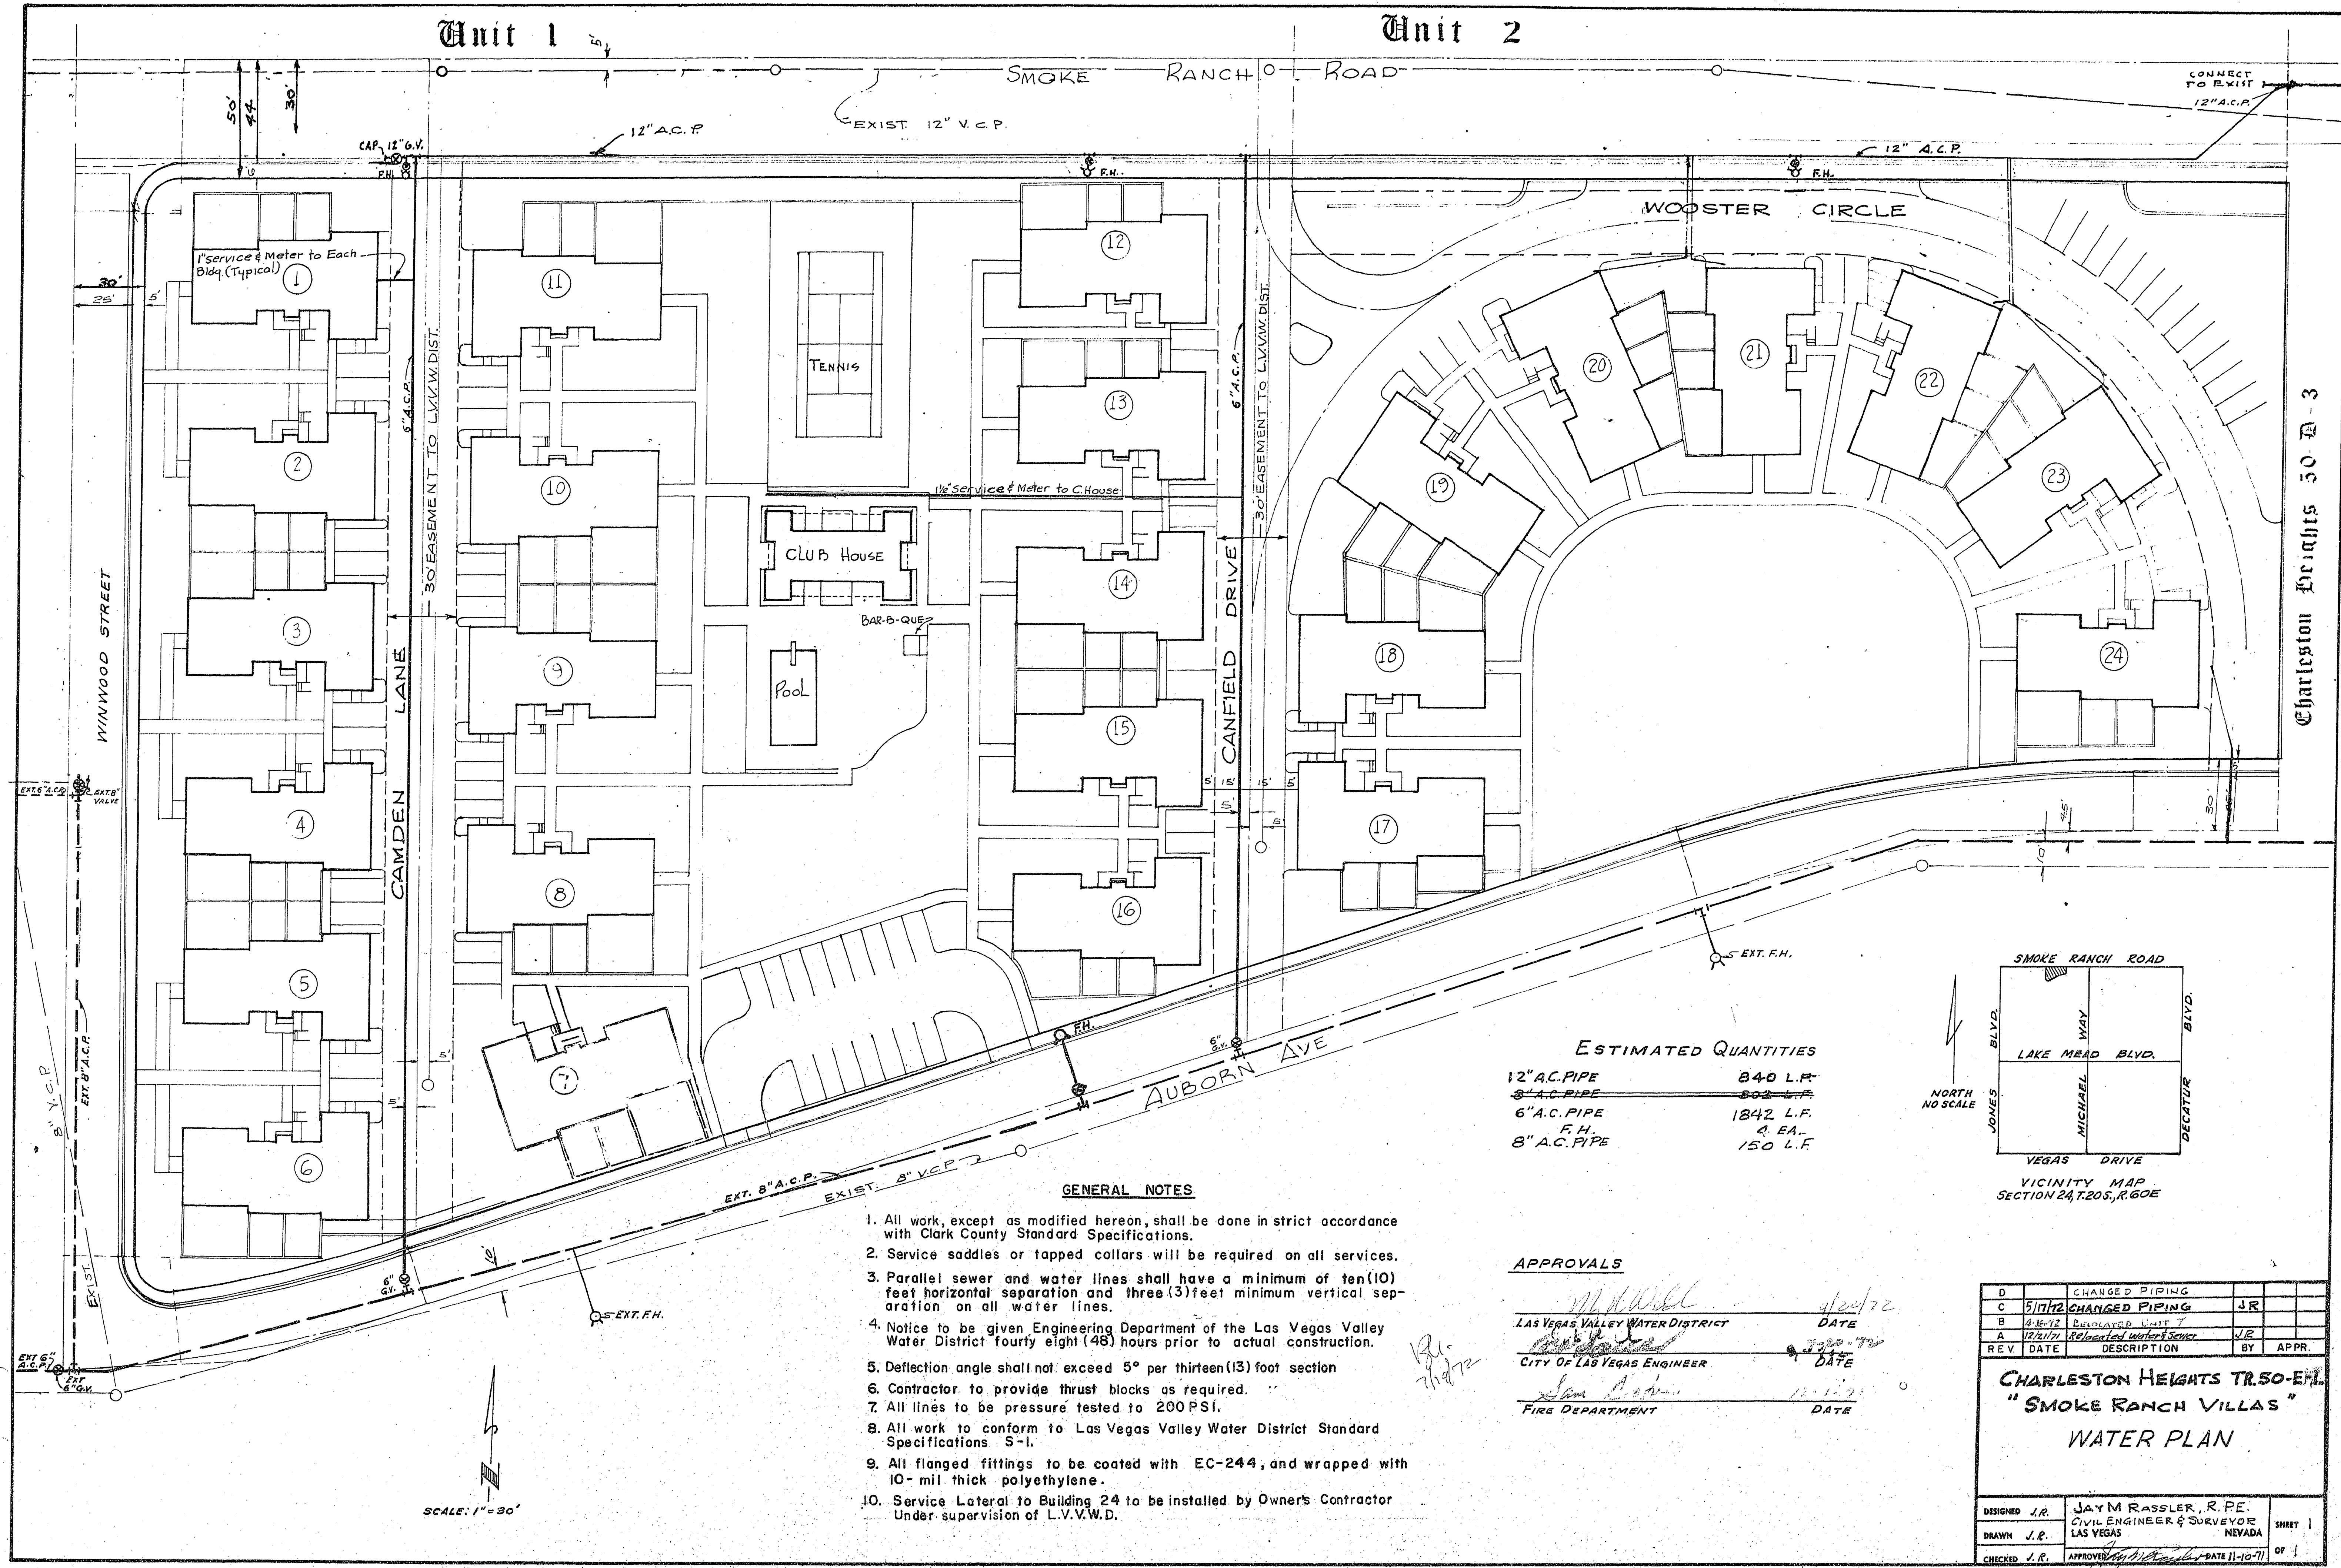

GENERAL NOTES

1. All work, except as modified hereon, shall be done in strict accordance with Clark County Standard Specifications.
2. Service saddles or tapped collars will be required on all services.
3. Parallel sewer and water lines shall have a minimum of ten(10) feet horizontal separation and three(3) feet minimum vertical separation on all water lines.
4. Notice to be given Engineering Department of the Las Vegas Valley Water District forty eight (48) hours prior to actual construction.
5. Deflection angle shall not exceed 5° per thirteen(13) foot section
6. Contractor to provide thrust blocks as required.
7. All lines to be pressure tested to 200 PSI.
8. All work to conform to Las Vegas Valley Water District Standard Specifications S-1.
9. All flanged fittings to be coated with EC-244, and wrapped with 10- mil thick polyethylene.
10. Service Lateral to Building 24 to be installed by Owner's Contractor Under supervision of L.V.V.W.D.


ESTIMATED QUANTITIES

12" A.C. PIPE	840 L.F.
8" A.C. PIPE	802 L.F.
6" A.C. PIPE	1842 L.F.
F.H.	2 EA.
8" A.C. PIPE	150 L.F.

APPROVALS

LAS VEGAS VALLEY WATER DISTRICT
CITY OF LAS VEGAS ENGINEER
FIRE DEPARTMENT

DATE
DATE
DATE

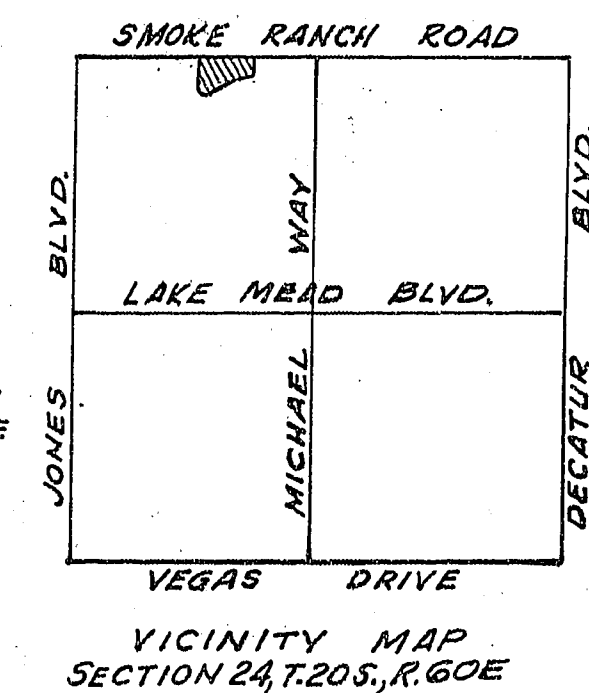

CHARLESTON HEIGHTS TR. 50-EM.
"SMOKE RANCH VILLAS"
WATER PLAN

DESIGNED J.R.	JAY M. RASSLER, R.P.E.	SHEET 1 OF 1
DRAWN J.R.	CIVIL ENGINEER & SURVEYOR LAS VEGAS NEVADA	
CHECKED J.R.	APPROVED J.R. DATE 11-10-71	

Unit 1

Unit 2

Charlotte Division 30-B-1

Estimated Quantity
 17' x 10' 0" 100.00
 17' x 10' 0" 100.00
 17' x 10' 0" 100.00

- NOTES:
1. All work to be done in accordance with the plans and specifications.
 2. All work to be done in accordance with the plans and specifications.
 3. All work to be done in accordance with the plans and specifications.
 4. All work to be done in accordance with the plans and specifications.
 5. All work to be done in accordance with the plans and specifications.
 6. All work to be done in accordance with the plans and specifications.
 7. All work to be done in accordance with the plans and specifications.
 8. All work to be done in accordance with the plans and specifications.
 9. All work to be done in accordance with the plans and specifications.
 10. All work to be done in accordance with the plans and specifications.

APPROVED
 [Signature]
 [Signature]
 [Signature]

Project No.	30-B-1
Division	Charlotte
Section	30-B-1
Sheet No.	1
Scale	1" = 10'
Drawn by	[Signature]
Checked by	[Signature]
Approved by	[Signature]
Date	10/1/50

Charlotte Division
 "Water Plan"