


VERIFY SCALE  
1/2" 0 1/2" 1"  
BAR REPRESENTS  
ONE AND ONE HALF  
INCHES ON ORIGINAL

CHEYENNE 2975 ZONE MOTOR OPERATED VALVES


VALVE VAULT DETAILS

SCALE  
AS SHOWN


DRAWN BY:	04/11/08
CHECKED BY:	04/11/08
RECOMMENDED BY:	DATE
RYAN PEARSON	DATE
ACCEPTED BY:	DATE
PETER J. JAUCH	DATE

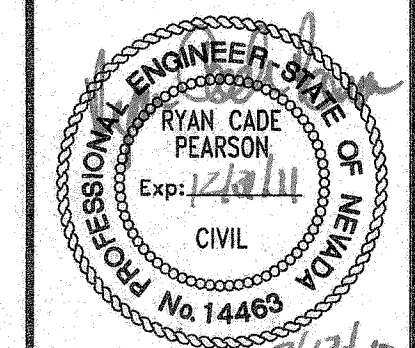


CONTRACT NUMBER  
**C1280**  
DRAWING NUMBER CD 1  
SHEET 9 OF 22

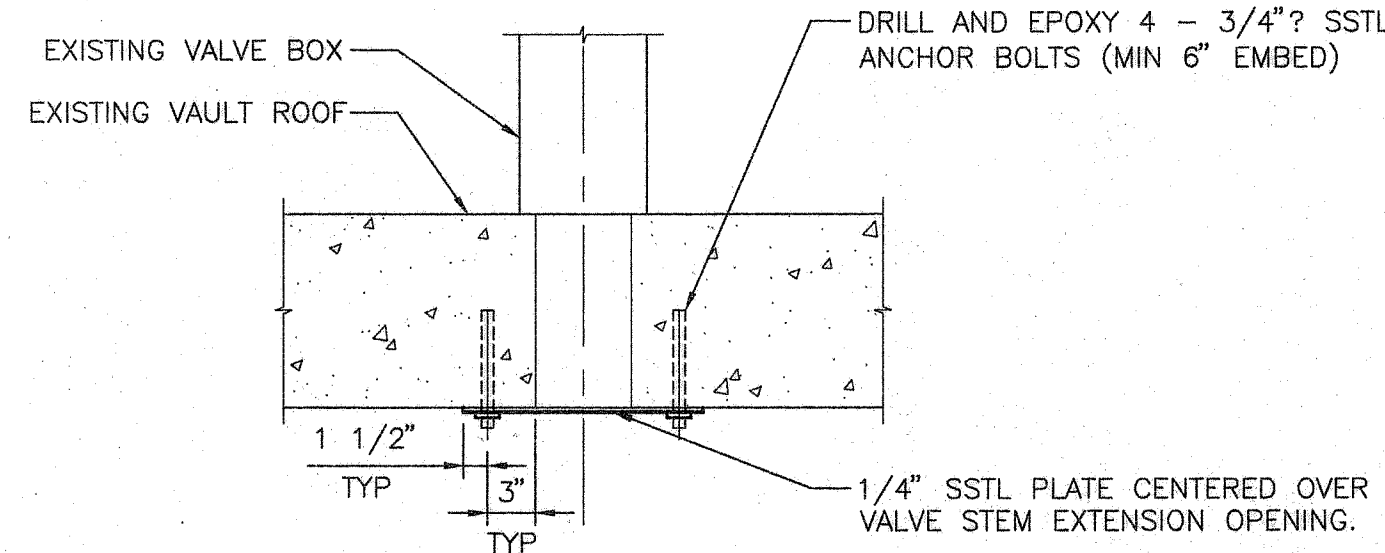

**SECTION A**  
SCALE: 1" = 1'-0"

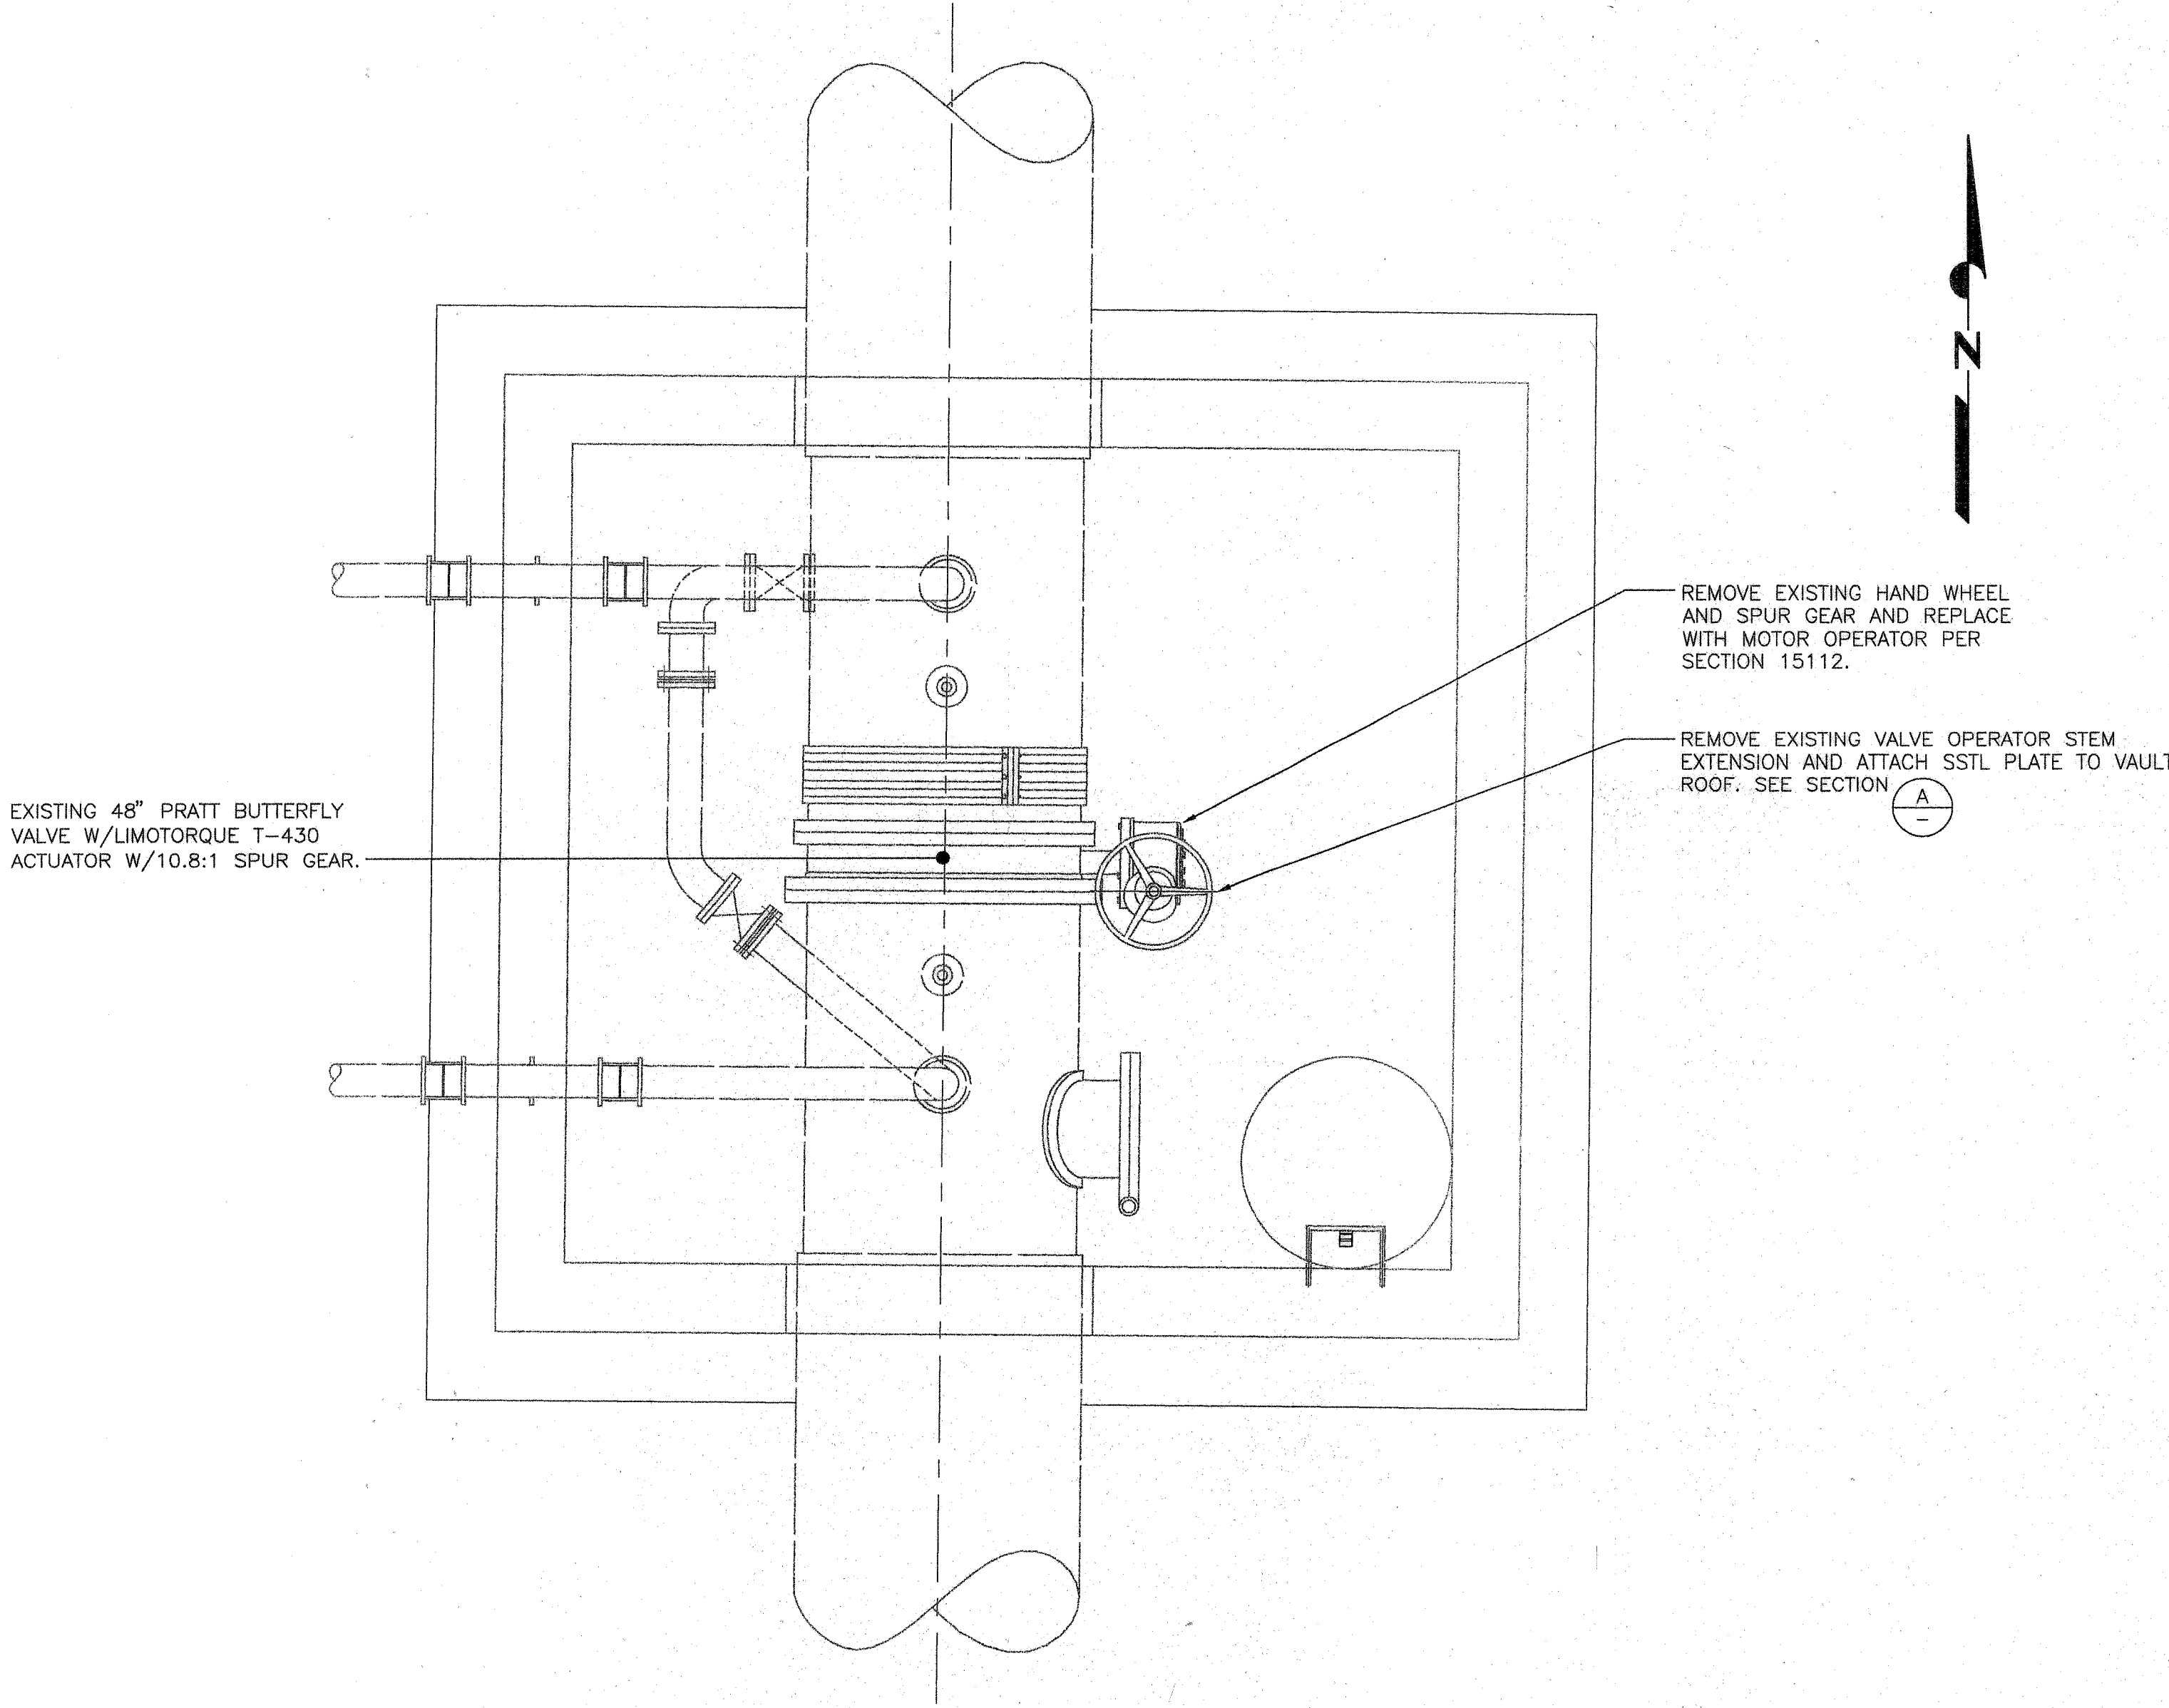

**48" VALVE VAULT**  
SCALE: 1/2" = 1'-0"  
NOTE:  
FOR EXISTING VALVE AND OPERATOR DATA SEE  
SPECIFICATION SECTION 15112 APPENDIX A.  
1 CD1  
C2

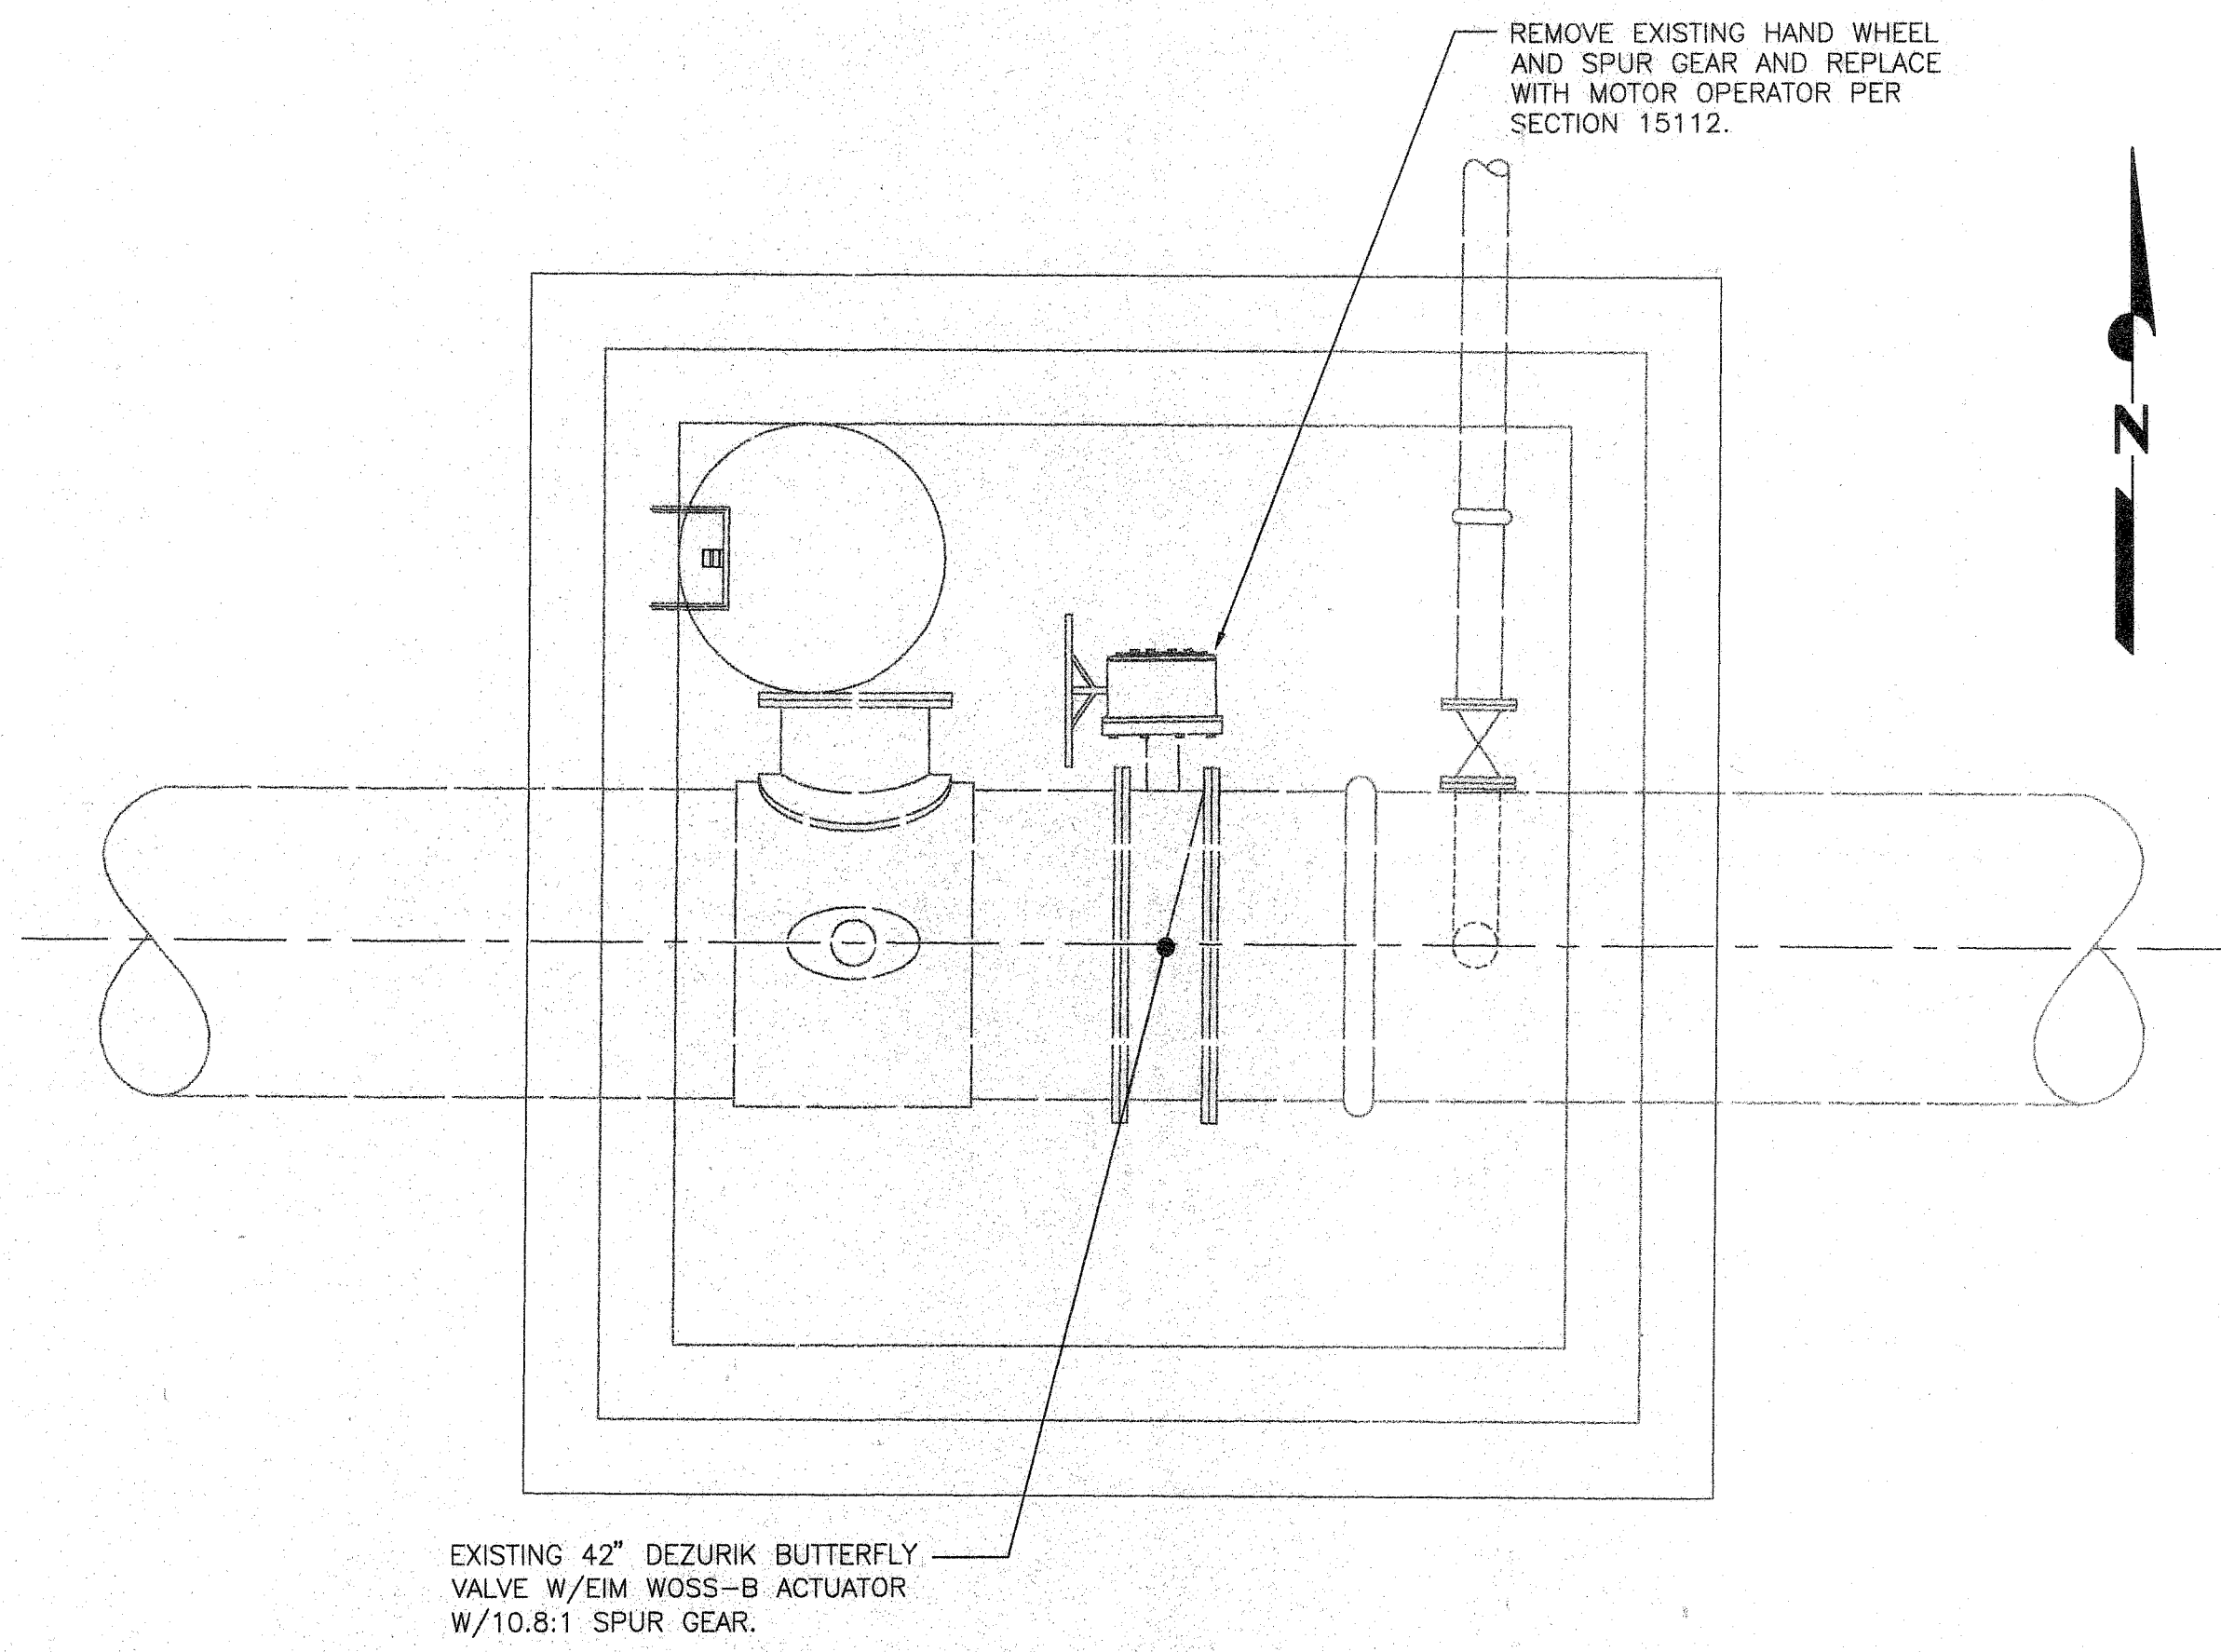

**42" VALVE VAULT**  
SCALE: 1/2" = 1'-0"  
NOTE:  
FOR EXISTING VALVE AND OPERATOR DATA SEE  
SPECIFICATION SECTION 15112 APPENDIX B.  
2 CD1  
C1



H#36700 CLV DWG # 565-476

175822