


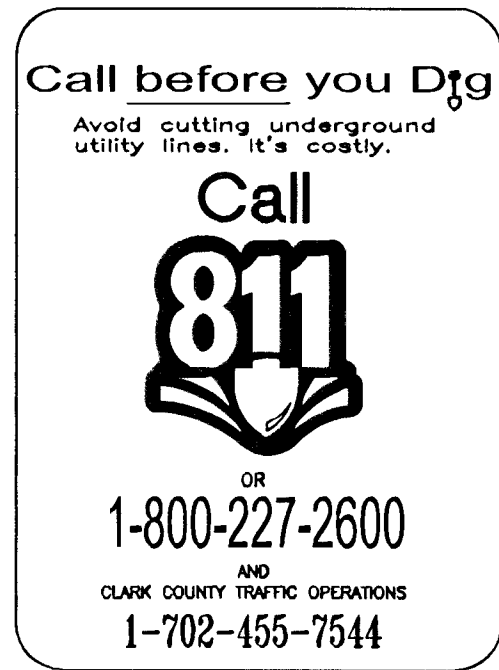


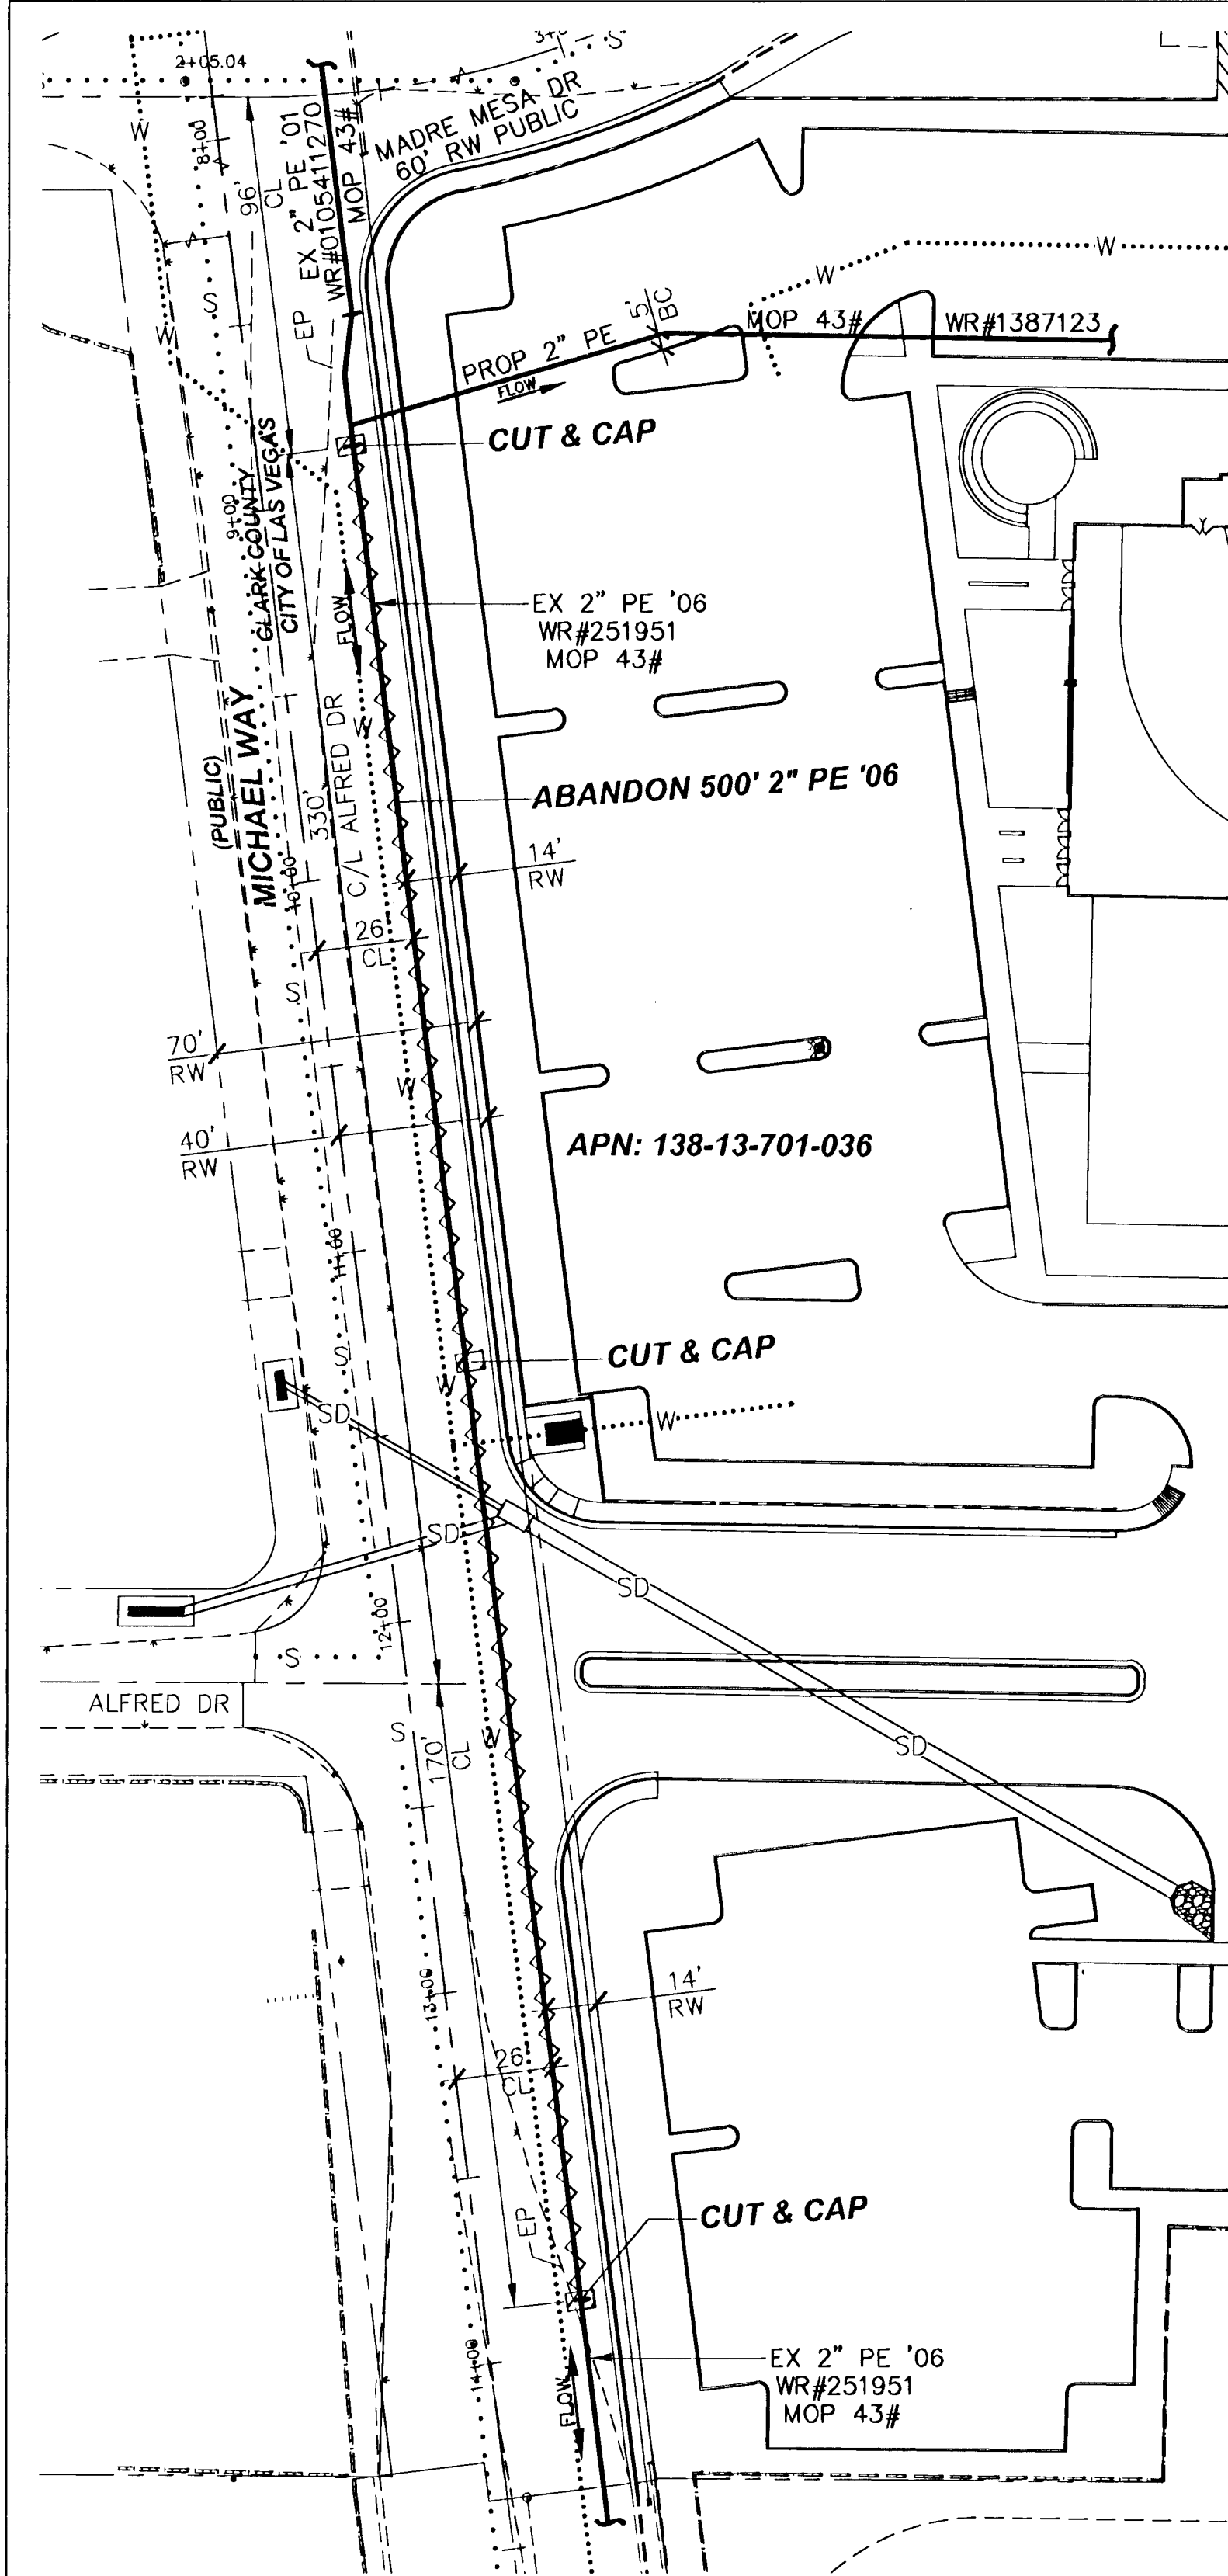


ABANDONMENT
(TEMP. F.O.S.)

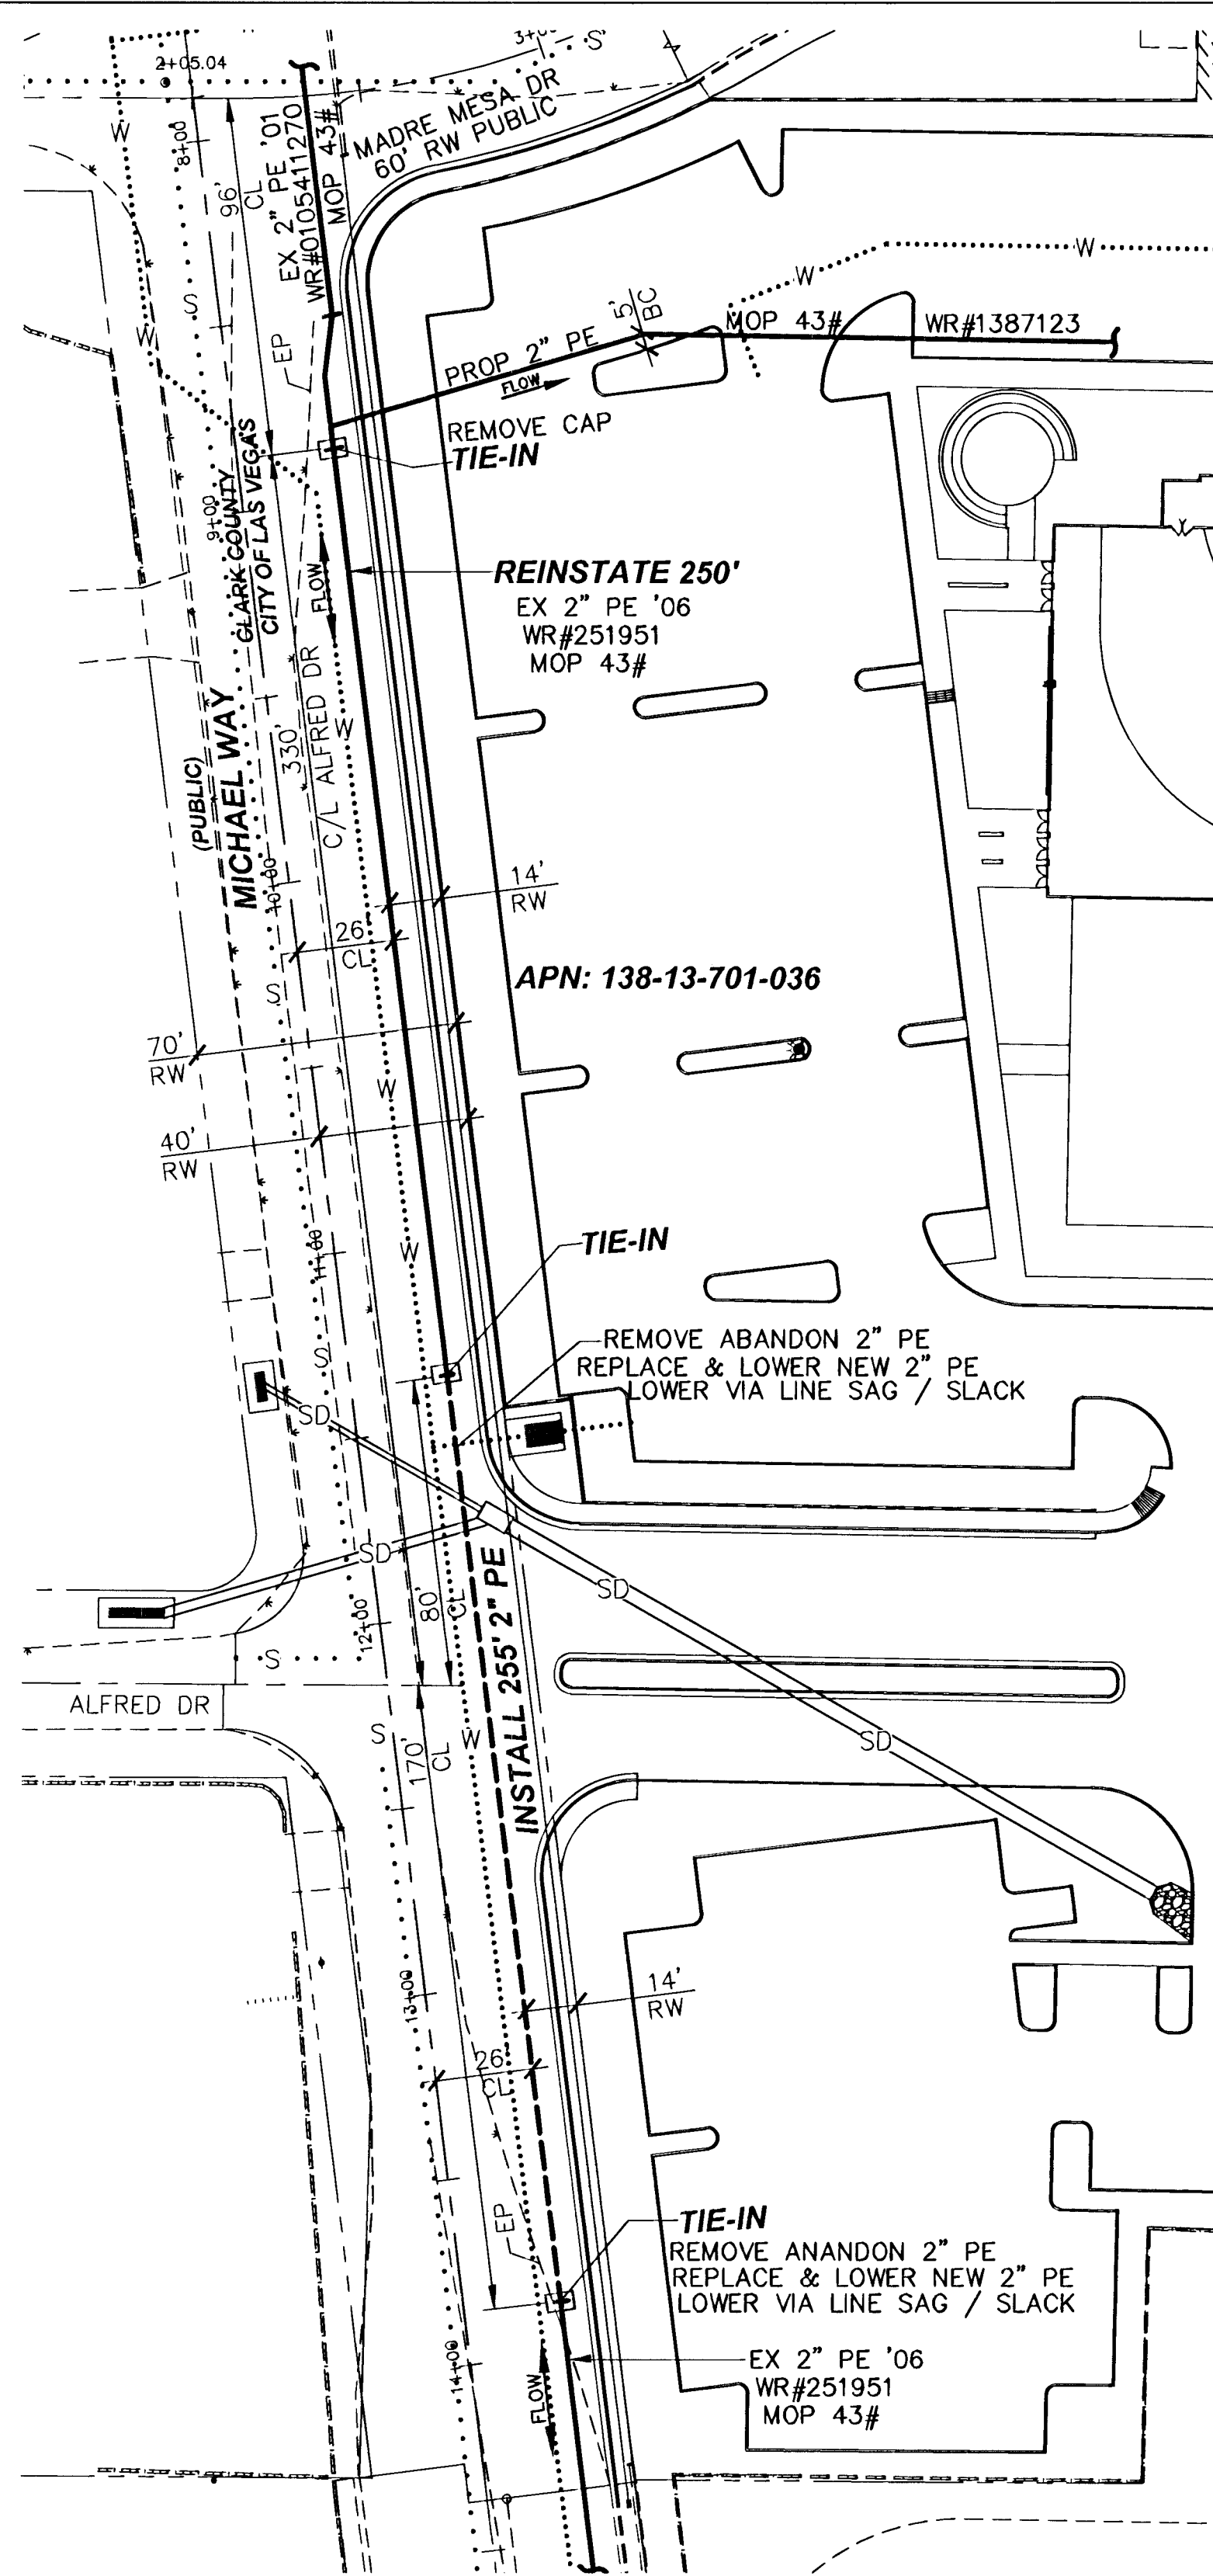

REINSTATEMENT
& LOWERING

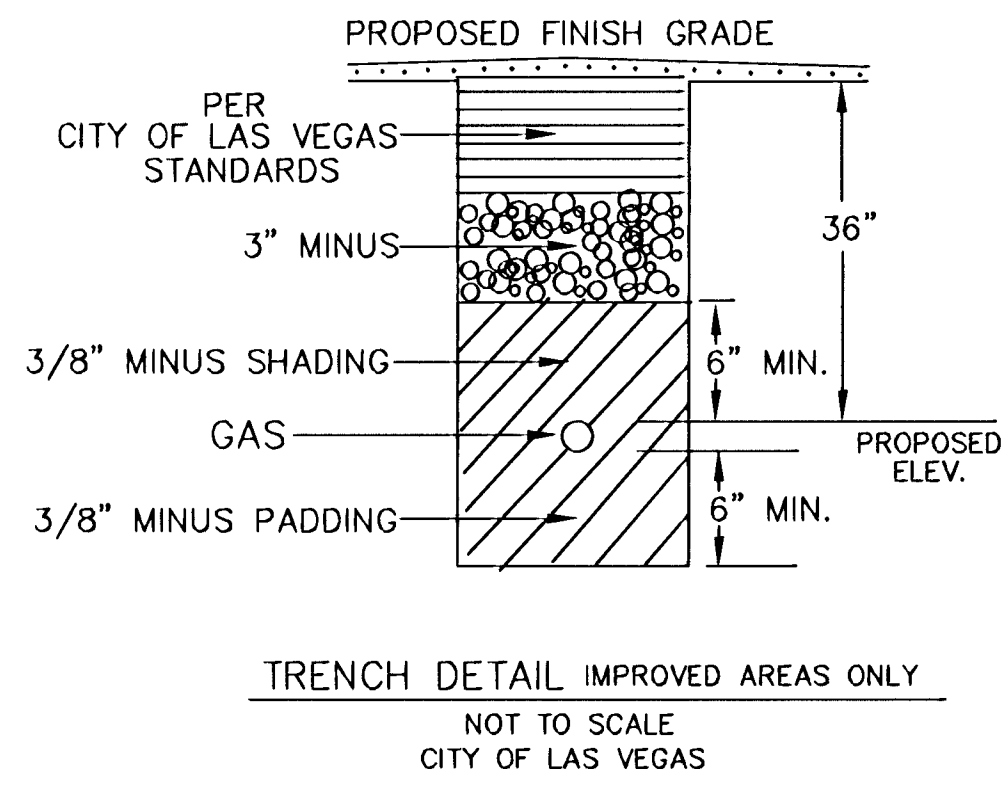

TRENCH DETAIL IMPROVED AREAS ONLY
NOT TO SCALE
CITY OF LAS VEGAS

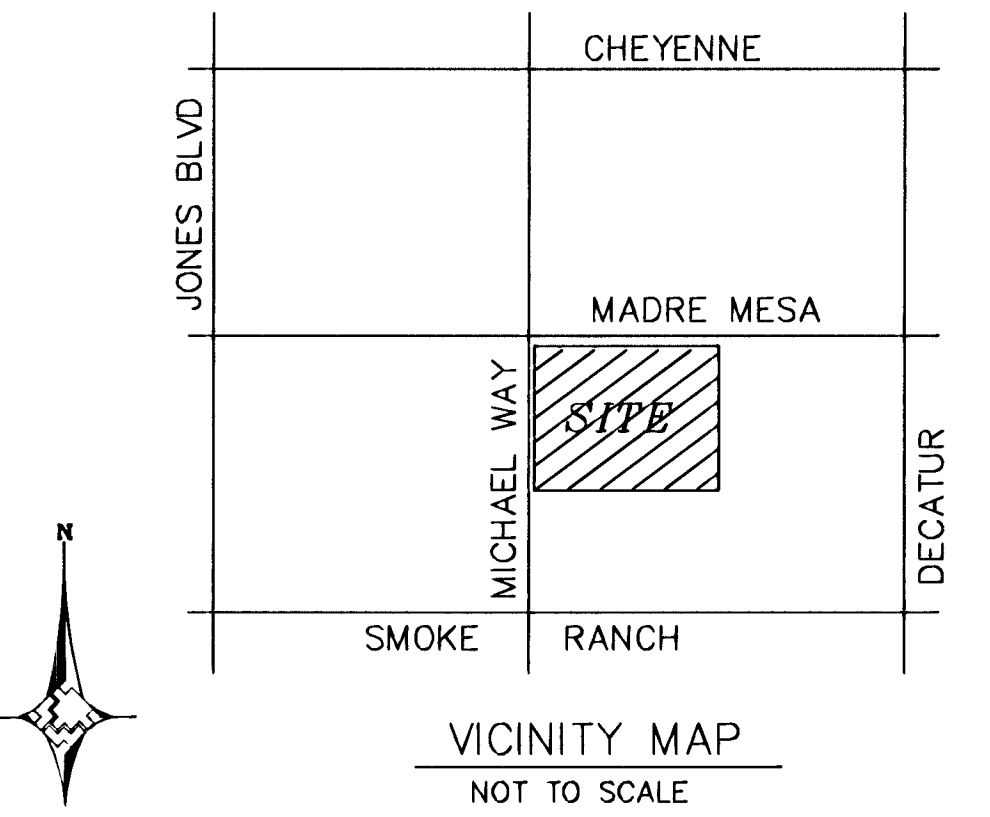

- CONSTRUCTION NOTES:
- SUGGESTED GAS LINE LOCATIONS ARE TO CLEAR SUBSTRUCTURES, LOCATE IN THE FIELD.
 - ALL PIPELINE CONSTRUCTION SHALL CONFORM TO APPLICABLE JURISDICTIONAL SPECIFICATIONS.
 - GAS MAINS SHALL BE PURGED PER OPERATIONS MANUAL.
 - DO NOT SCALE THIS DRAWING.
 - ANY CHANGES IN THE MAIN LOCATION MUST BE AUTHORIZED BY SWG INSPECTOR AND/OR ENGINEER.
 - SERVICE(S) TO BE N/A UNLESS OTHERWISE NOTED.
 - ALL MAIN TIE-INS REQUIRING TEES ARE TO BE FULL FLOW TEES UNLESS OTHERWISE STATED.
 - MICHAEL WAY IS PAVED, BACKFILL AND PAVEMENT RESTORATION TO COMPLY WITH RTC STANDARDS 503B, 500BT

- LEGEND
- PROPOSED GAS MAIN
 - PROPOSED GAS SERVICE
 - EXISTING GAS MAIN
 - UNIT BOUNDARY
 - RIGHT-OF-WAY
 - SEWER
 - WATER
 - SD STORM DRAIN
 - EDGE OF PAVEMENT
 - SAWCUT & PATCH
 - ABANDON GAS MAIN
 - CENTERLINE STATIONING

SYSTEM	D_VALLEY_WIDE
DR. NO.	X609Y522-2DR
SEGMENT M.A.O.P.	N/A
SYSTEM M.A.O.P.	43#
SYSTEM M.O.P.	43#

I REVIEWED THE PROCEDURES PERFORMED AND FOUND THEM, ADEQUATE () INADEQUATE ()**

** INADEQUATE COMMENTS _____

SIGNATURE: _____ DATE: _____

SIGNATURE: _____ DATE: _____

NOTE:
250' 2" PE IN PUBLIC ROW/EASEMENT

Purge Plan was completed in accordance with the Operations Manual Guidelines by:

Name _____ Date _____

APPROVED FOR CONSTRUCTION
THIS APPROVAL IS FOR WORK IN CLV R/W OR CLV EASEMENTS ONLY. OBTAINING PERMISSION OR EASEMENTS FOR WORK SHOWN ON PRIVATE PROPERTY IS THE RESPONSIBILITY OF THE UTILITY.

APPROVAL _____ DATE _____

NO.	DESCRIPTION	BY	DATE	APPROV.
REVISIONS				
MAIN				
3760104	4" P.E.			
3760102	2" P.E.		255'±	250'±
SERVICE				
3800102	2" P.E.			
3800101	1" P.E.			
UNIT NO.	UNIT TYPE	INSTL.	RET.	INSTL.
		PROPOSED	COMPLETED	
PROPERTY UNITS				

AS-BUILT DRAWING-PRESSURE TEST DATA			
PIPE DIA.	TEST MEDIUM	TEST METHOD	
PIPE LENGTH	☐ AIR	☐ GAUGE	
PIPE TYPE	☐ NITROGEN	☐ CHART	
MIN. DURATION	☐ WATER	☐ GAUGE/ PRESS REC SN#	
TEST PRES. (PSIG)	START	END	
TIME			
DATE			
PERFORMED BY			

VISUAL INSPECTION CERTIFICATION	
I HAVE VISUALLY INSPECTED ALL HEATED FUSIONS, SOLVENT CEMENT, MECHANICAL JOINTS, AND WELDS THAT I HAVE PERFORMED	
NAME	DATE
AS-BUILTS ACCEPTED BY	DATE
POSTED BY	DATE
POSTING QC'D BY	DATE

CONSTRUCTION	
INSPECTOR	
FOREMAN	
REVIEWED BY	
PERMIT INFORMATION	
CITY OF LAS VEGAS	
TAX CODE	
02-0200	

ISOLATION AREA	W. R. NO.
13	1391493
LOCATION	TILE NO.
MICHAEL WAY MADRE MESA DR	x606 y530
T=20S R=60E S=13	#4424

ENGINEER/TECHNICIAN		PHONE	
HECTOR INIGUEZ		595-3169	
ACCOUNT REP.		PHONE	
HECTOR INIGUEZ		595-3169	
SHEET NO.	1 OF 1	SCALE	1"=40'
DWN. BY	CARL CORBETT	CHKD. BY	TRC
TITLE			
RELO-CLV-MICHAEL WAY @ MADRE MESA MAIN LOWERING CITY OF LAS VEGAS			