



MATCHLINE - SEE SHEET 9

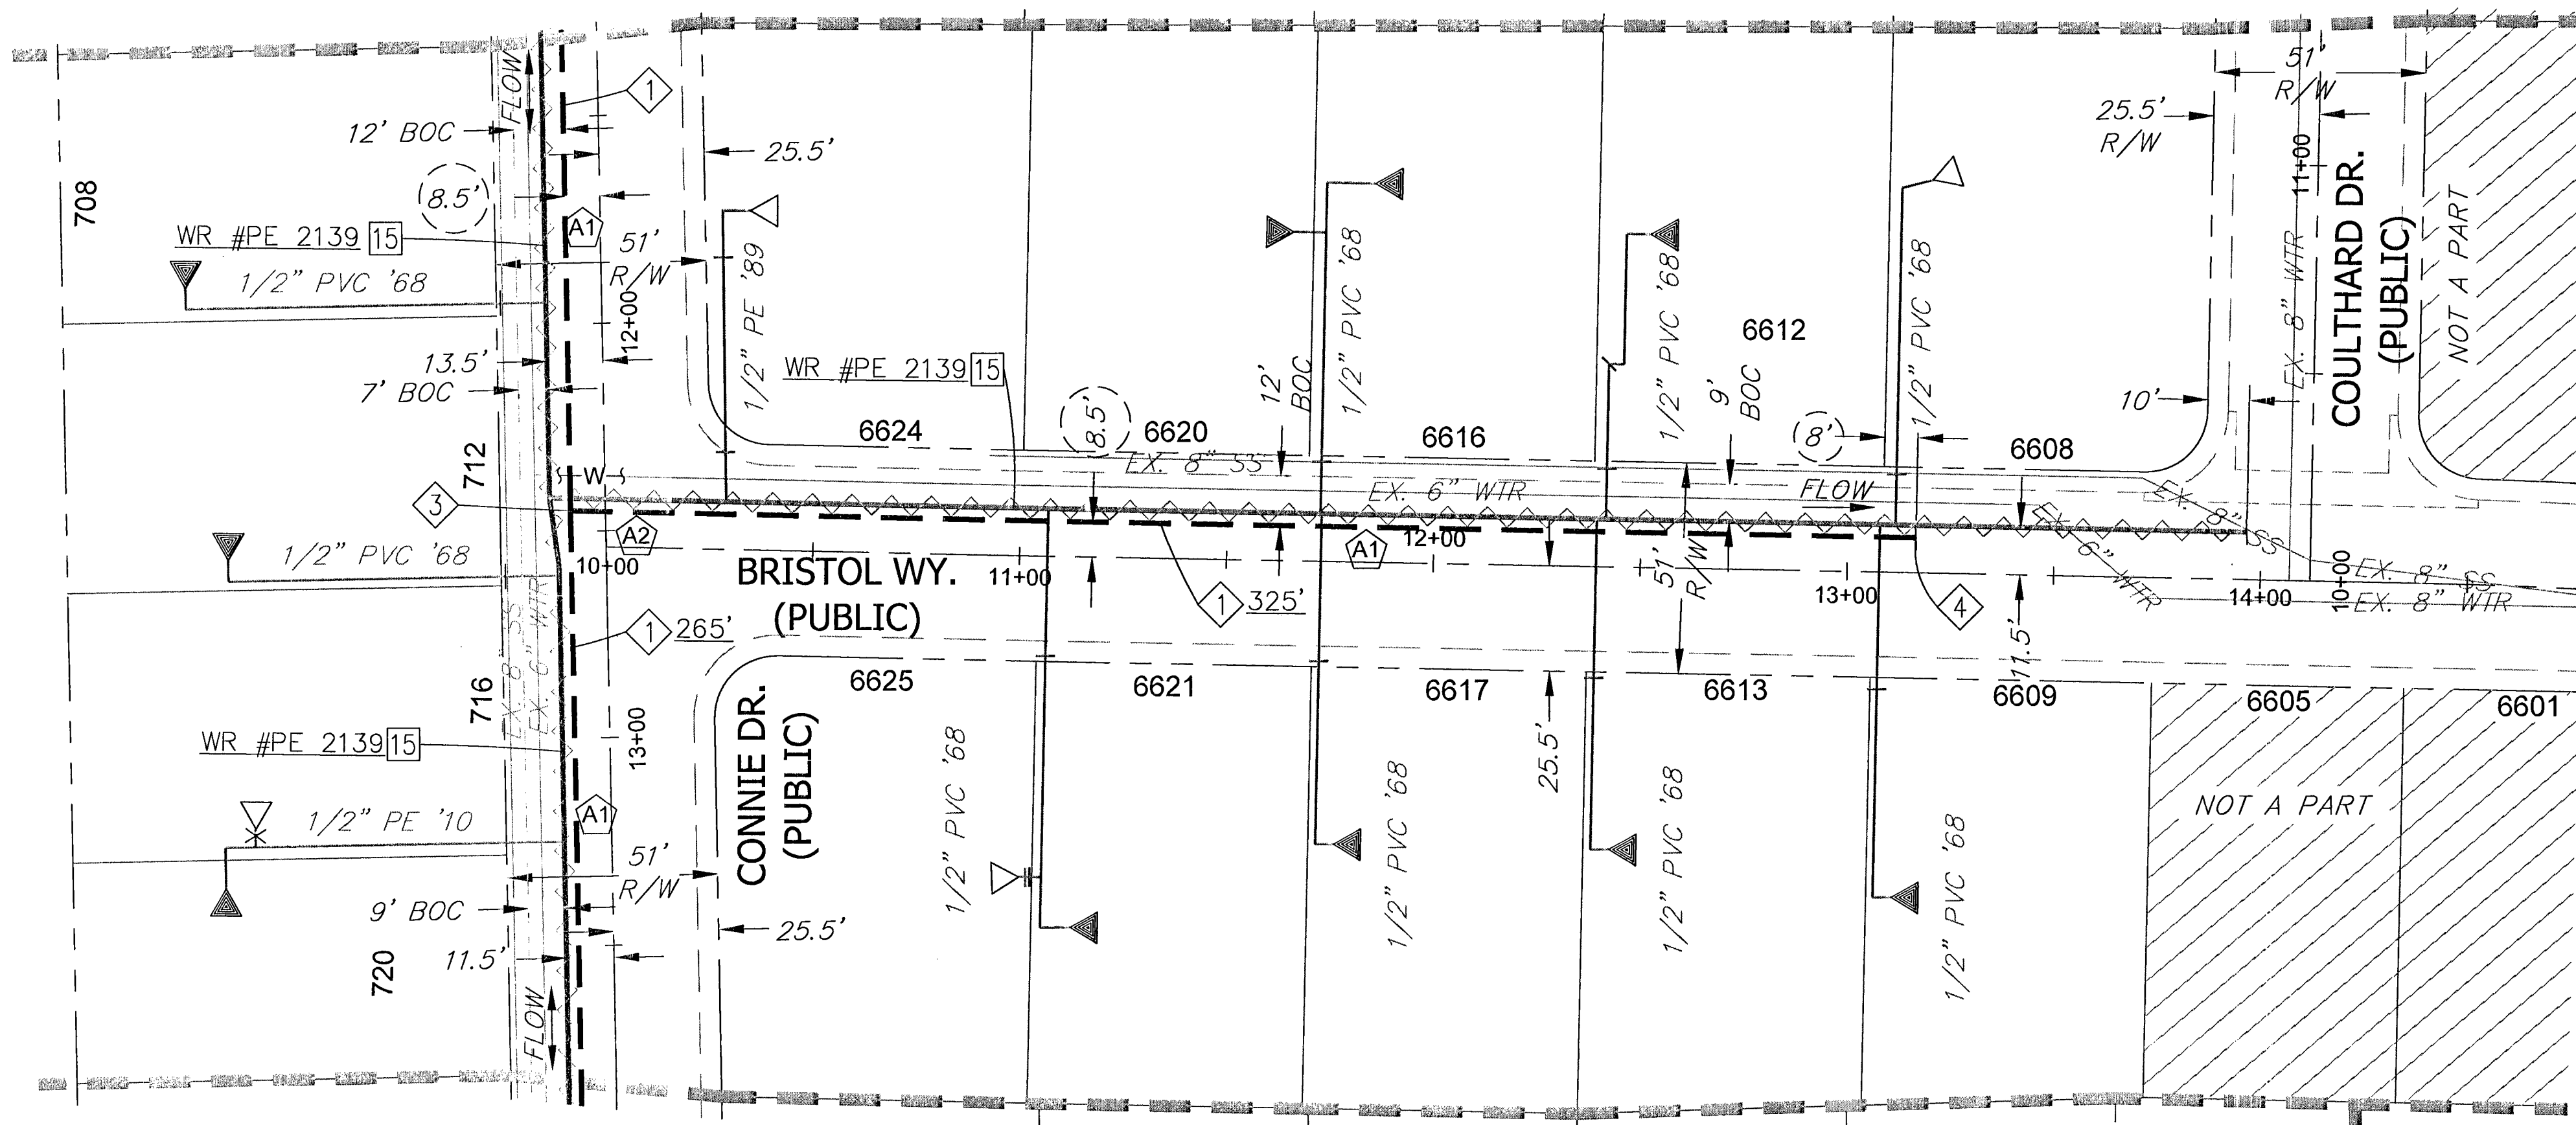

MATCHLINE - SEE SHEET 11

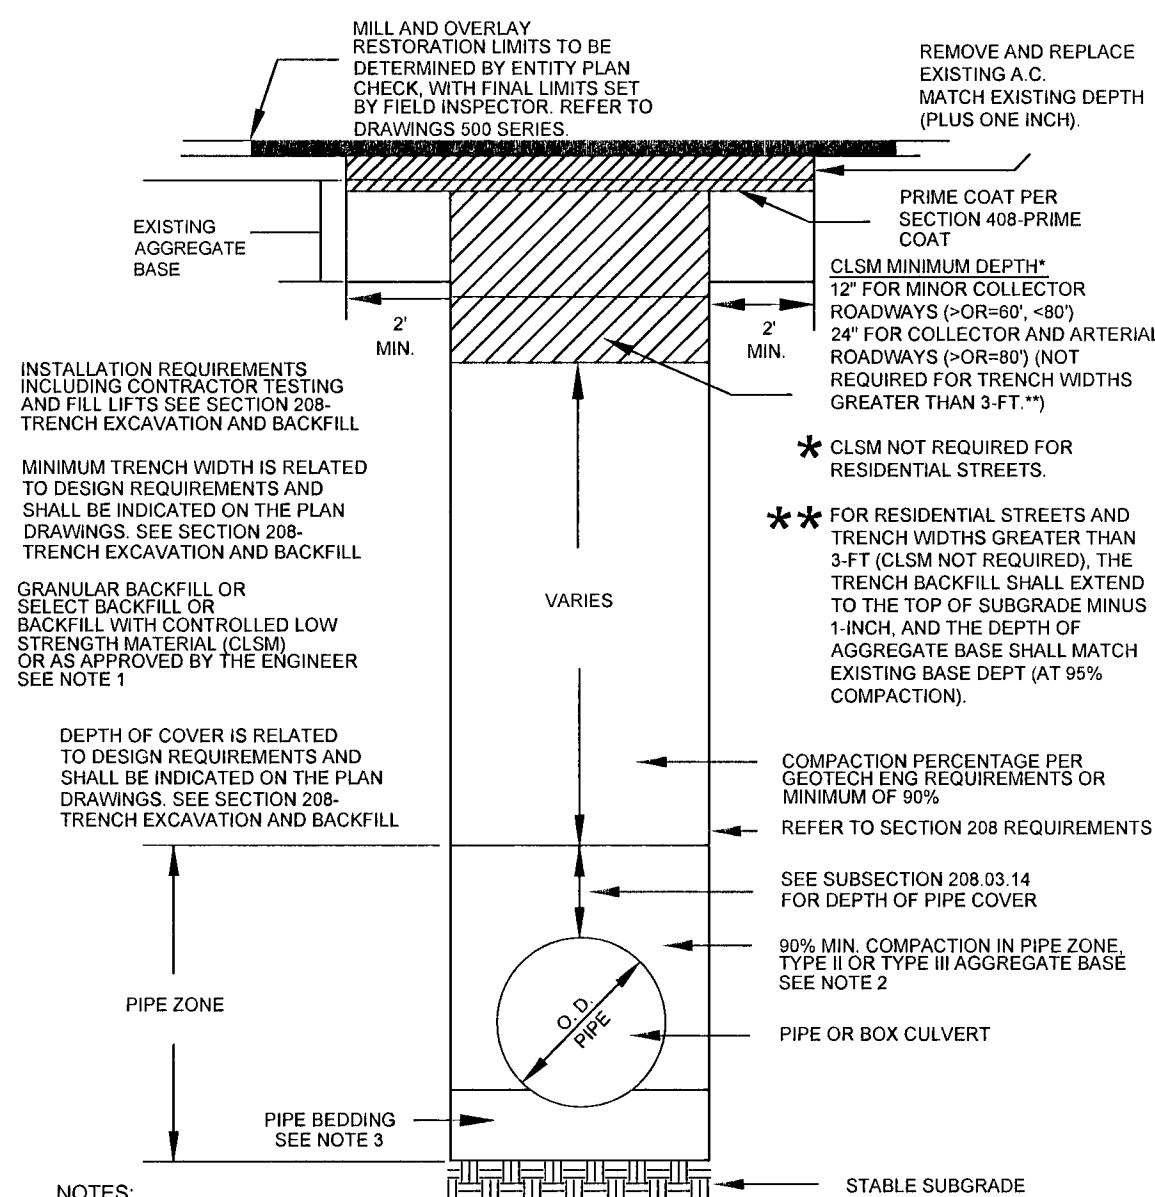

NOTES:

1. NO STONES OR LUMPS GREATER THAN 3" PERMITTED IN TRENCH 2' OR LESS IN WIDTH.
2. TRENCH WIDTH, BEDDING, SUBGRADE AND PIPE ZONE REQUIREMENTS FOR UTILITY INSTALLATIONS SHALL CONFORM TO THE RESPECTIVE ENTITY REQUIREMENTS.
3. CRUSHED ROCK MAY BE USED FOR PIPE BEDDING ONLY IF MATERIAL USE HAS BEEN SPECIFICALLY APPROVED BY THE GOVERNING AGENCY. SEE STANDARD DRAWING NO. 505 FOR PIPE BEDDING METHODS.
4. LAS VEGAS VALLEY WATER DISTRICT REQUIRES PIPE BEDDING AND BACKFILL WITHIN THE PIPE ZONE TO BE OF THE SAME MATERIAL.

RTC STD DWG 503



NO.	DESCRIPTION	BY	DATE	APPVD.
1.				
2.				
3.				
4.				

REVISIONS



TAX CODES	UNIT NO.	UNIT TYPE	INSTL. PROPOSED	RETIRED COMPLETED

PROPERTY UNITS

AS-BUILT DRAWING-PRESSURE TEST DATA

PIPE DIA.	TEST MEDIUM	TEST METHOD
PIPE LENGTH	☐ AIR ☐ GAUGE	☐ CHART
PIPE TYPE	☐ NITROGEN ☐ CHART	☐ GAUGE/
MIN. DURATION	☐ WATER ☐ SOAP	☐ PRESS REC SN#
TEST PRES. (PSI)	START	END
TIME		
DATE		
PERFORMED BY		

VISUAL INSPECTION CERTIFICATION

I HAVE VISUALLY INSPECTED ALL HEATED FUSIONS, SOLVENT CEMENT, MECHANICAL JOINTS, AND WELDS THAT HAVE BEEN PERFORMED	
NAME	DATE
INSPECTOR	
FOREMAN	
REVIEWED BY	
PERMIT INFORMATION	
CITY OF LAS VEGAS	
TAX CODE 02-0200	
AS-BUILTS ACCEPTED BY	DATE
POSTED BY	DATE
POSTING OC'D BY	DATE

CONSTRUCTION


INSPECTOR	
FOREMAN	
REVIEWED BY	
PERMIT INFORMATION	
CITY OF LAS VEGAS	
TAX CODE 02-0200	

ISOLATION AREA

46	W.R. NO. 1586704
LOCATION	
T20S R60E SEC 35 M.D.M.	ATLAS #/FILE # x600y514 x603y514

ENGINEER/TECH: NICOLE HUNT	PHONE: 702-365-2311
ACCOUNT REP:	PHONE:
PROJECT CONTACT: NICOLE HUNT	PHONE: 702-365-2311
SHEET NO: 10 OF 20	SCALE: 1" = 30'
DWN. BY: ZONE ENG	CHKD. BY:
DATE: 06/13/2013	APPVD. BY:

SI-CLV-CHARLESTON RAINBOW
UNIT 27A

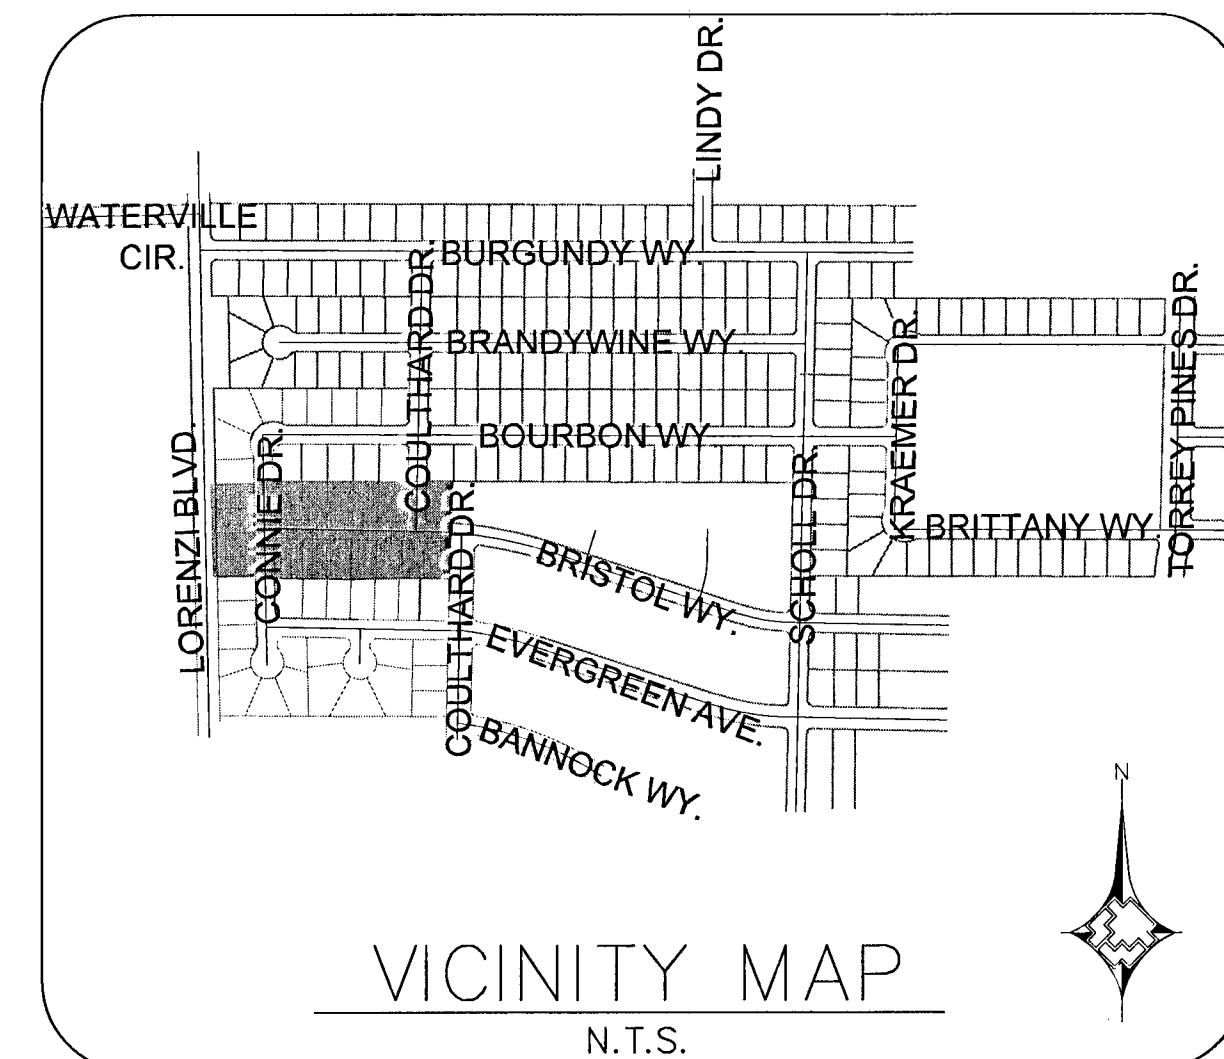

VICINITY MAP
N.T.S.

LEGEND:

	EXISTING GAS LINE
	GAS LINE TO BE ABANDONED
	EXISTING GAS SERVICE
	PROPOSED MAIN GAS LINE (NEW)
	PROPOSED SERVICE LATERAL (NEW)
	PROPOSED SERVICE LINE (NEW)
	RIGHT OF WAY LINE
	STREET CENTERLINE
	PROPERTY LINE
	BACK OF CURB
	MATCHLINE
	EASEMENT
	SAWCUT & PATCH
	EXISTING ANODELESS RISER
	EXISTING ANODE RISER
	EXISTING GAS LIGHT
	EXISTING GAS VALVE

PROPOSED FACILITIES:

- 1. PROP. 2" PE MAIN
- 3. PROP. 2" TEE FULL FLOW (140-3074)
- 4. PROP. 2" PE CAP (140-3060)

ABANDONED FACILITIES:

- 15. ABANDON 2" PVC '68 MOP 43#

RTC NOTES:

BACKFILL SHALL CONFORM TO RTC STD. 503.
PAVEMENT REPAIR SHALL CONFORM TO RTC:

- A1 500.4
- A2 500.5