

RTC NOTES:
BACKFILL AND RIGHT OF WAY RESTORATION SHALL CONFORM TO CLARK COUNTY UNIFORM STANDARD DRAWINGS

- (1) 500.1 0 TO 5 YEARS PAVEMENT RESTORATION LONGITUDINAL CUT
- (2) 500.2 0 TO 5 YEARS PAVEMENT RESTORATION TRANSVERSE CUT
- (3) 500.3 OVER 5 YEARS PAVEMENT RESTORATION LONGITUDINAL CUT, GREATER THAN 60' R.O.W
- (4) 500.4 OVER 5 YRS PAVEMENT RESTORATION LONGITUDINAL CUT, 60' R.O.W OR LESS
- (5) 500.5 OVER 5 YRS PAVEMENT RESTORATION TRANSVERSE ALL R.O.W WIDTHS
- (6) 501 TYPICAL UNDERGROUND UTILITY LOCATIONS IN RESIDENTIAL STREETS 60' OR LESS R.O.W.
- (7) 501.1 TYPICAL UTILITY UNDERGROUND LOCATIONS IN STREETS WITH GREATER THAN 60' R.O.W.
- (8) 503 METHOD B FOR RIGID AND FLEXIBLE PIPE TRENCH BACKFILL - PAVED AREAS
- (9) 503.1 METHOD A FOR FLEXIBLE PIPE TRENCH BACKFILL - PAVED AREAS
- (10) 503.2 METHOD A FOR RIGID PIPE TRENCH BACKFILL - PAVED AREAS
- (11) 234 FILL IN UNPAVED AREA AS REQUIRED BY LOCAL CODE OR AS APPROVED BY AGENCY.
- (12) 234.1 SIDEWALK


APPROVED FOR CONSTRUCTION

THIS APPROVAL IS FOR WORK IN CLV RW & EASEMENT ONLY.
OBTAINING PERMISSIONS OR EASEMENTS FOR WORK SHOWN ON
PRIVATE PROPERTY IS THE RESPONSIBILITY OF THE UTILITY.

David A. Green 1/30/2014

APPROVAL _____ DATE _____

CITY OF LAS VEGAS PERMIT REQUIRED*	
CONTACT CLV LAND DEVELOPMENT (229-6371) CLV CONSTRUCTION SERVICES MUST BE NOTIFIED 24 HOURS PRIOR TO COMMENCING CONSTRUCTION (229-6337)	
HANSEN _____	DATE _____
*NVE INSPECTOR MUST BE NOTIFIED BY FAX 48 HOURS PRIOR TO COMMENCING CONSTRUCTION & WILL VERIFY CITY PERMIT FOR WORK DONE IN STREETS OR SIDEWALK. FAX PERMIT TO: LAS VEGAS NORTH (RYAN CENTER): 402-4354 LAS VEGAS SOUTH (BELTWAY CENTER): 402-0864	

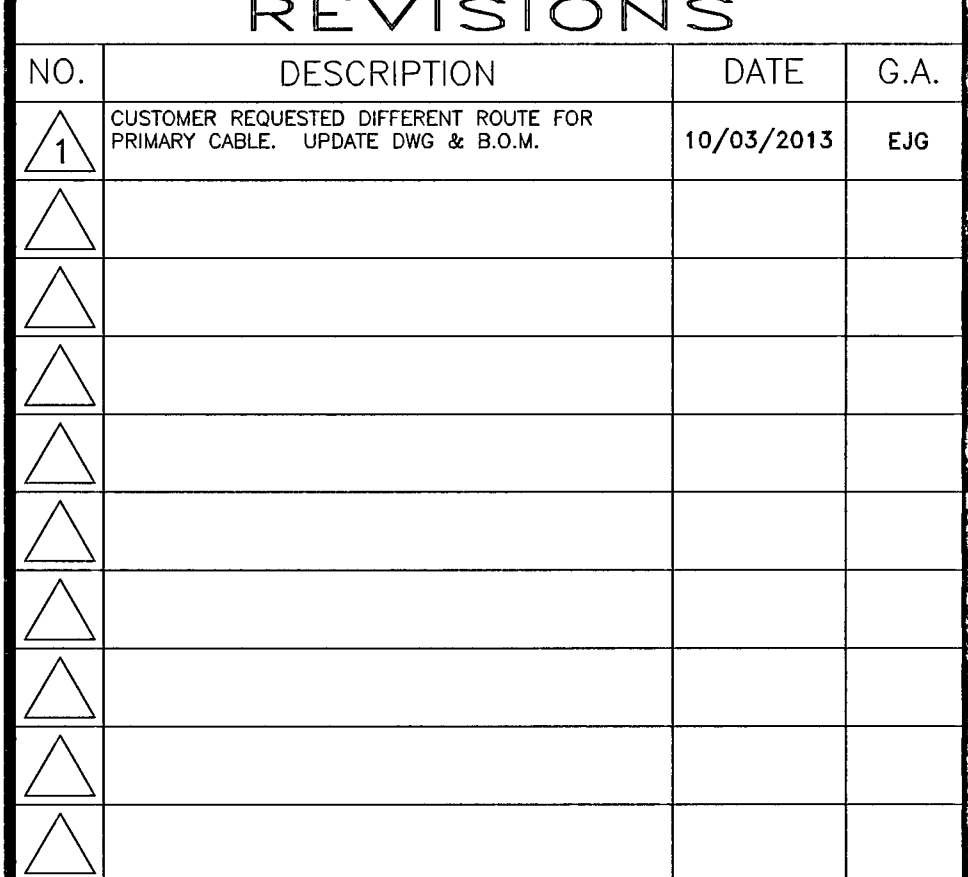

DCA	
TYPE OF EASEMENT: AERIAL: ☐ STANDARD ☐ R/W-31 ☐ UNDERGROUND ☒ AS BUILT UNDERGROUND ☐ R.O.E./R/W-5-COM ☐ 1/4 PART ☐ UNDERGROUND BY EXHIBIT ☐ (N-DOT) PERMIT ☐ (BLM) PERMIT ☐ RAILROAD-UPRR-PERMIT ☐ SO. NEVADA WATER PERMIT ☐ NOT REQUIRED ☐ Misc. Info. ☐	JPA NOTES: EMBARGO CONTACT: <u>N/A</u> PHONE NUMBER: _____ DATE OF CONTACT: _____ TO SET NEW POLES _____ TO STAKE NEW POLES _____ TO PROVIDE _____ POLES _____ FT. CLASS. _____ FT. CLASS. _____ FT. CLASS. _____ TO DIG POLE HOLES _____ TO REMOVE EX. POLES _____ JPA#: <u>N/A</u>





NVE INFORMATION:
COORDINATOR: J. ROBERT BATES
PHONE: 402-6745
DESIGNER: EMMER GARCIA
DCA: 402-4355 JOHN
INSPECTOR: 402-3008
STAND BY: 402-4117,402-4114,402-4118
DISTRICT: LAS VEGAS NORTH

CUSTOMER INFORMATION:
APPLICANT LENNAR COMMUNITIES
ENGINEER: SLATER/HANIFAN GROUP
CONTACT: DAVE WAGNER 376-0536
APPROVAL DATE: 10/30/2013

GOVERNMENT INFORMATION:
AGENCY: CITY OF LAS VEGAS
APPROVAL DATE: _____

FOR EACH SERVICE POINT (POINT OF DELIVERY), ENERGY FOR EACH TENANT SPACE WILL BE MEASURED THROUGH ONE WATTHOUR METER. ENERGY FOR ALL NON-TENANT SPACE WILL BE MEASURED THROUGH ONE WATTHOUR METER. CONTACT NPC

METER OPERATIONS FOR MULTIPLE RATE CLASS INSTALLATIONS	
	
4 of 12 CATALINA PHASE 2 FOX HILL & PASEO BREEZE 4# 52080 107Y5898-2-CTL	
PROJ. ID: 3000327878	SCALE: 1" = 50'
SHEET #: 1 OF 1	DATE: 09/16/2013

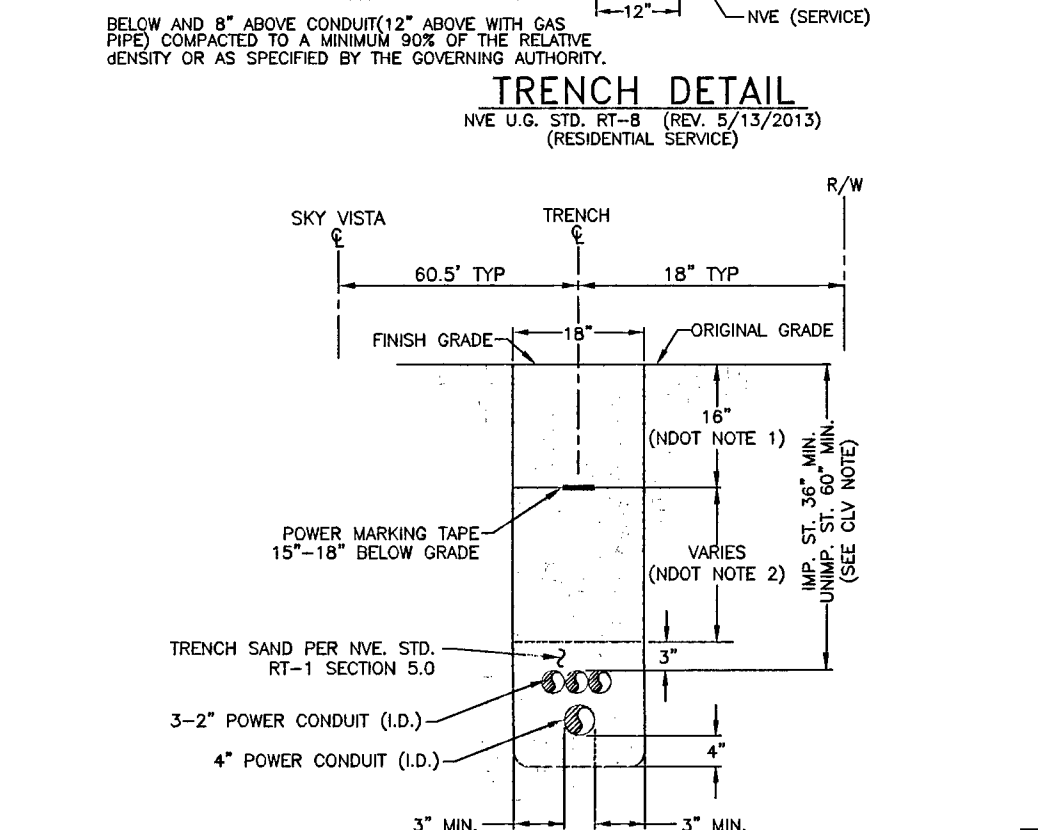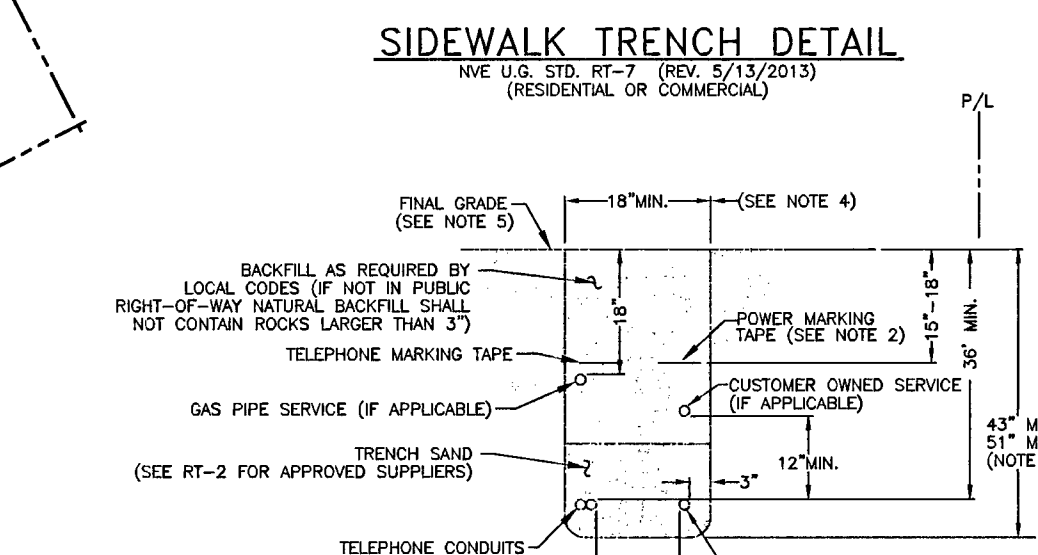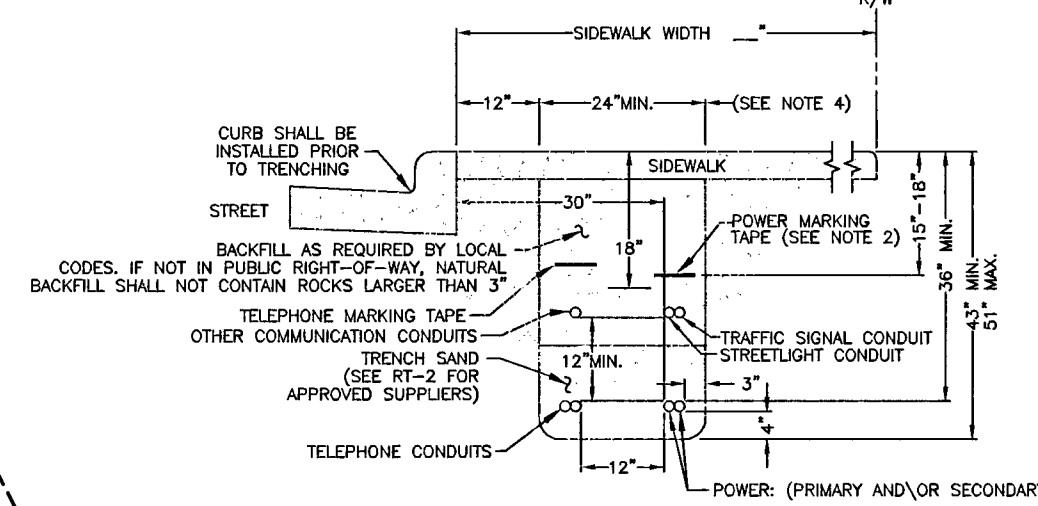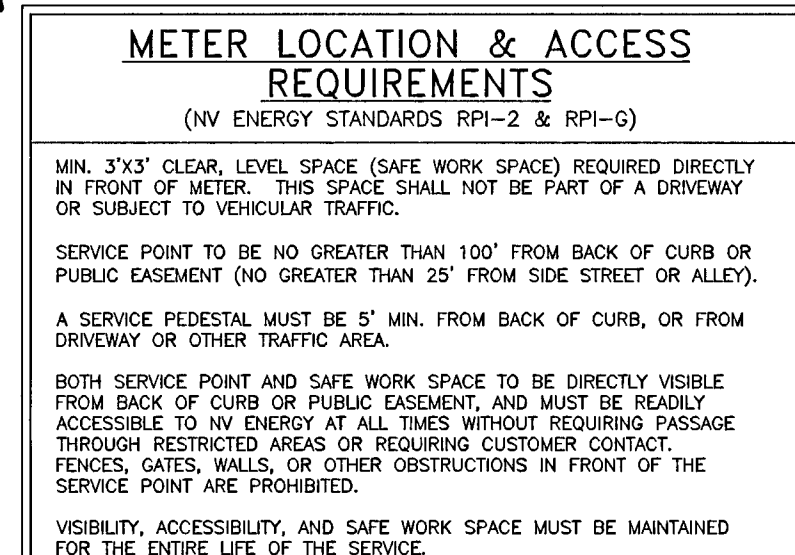

NOTES:

NDOT REQUIREMENTS (APPLICABLE WITHIN NDOT RIGHT-OF-WAY ONLY):

BASE AGGREGATE (AS PER NDOT SPECIFICATIONS; SECTION 704) A MINIMUM OF 18" THICKNESS SHALL BE LAYED IN MAXIMUM 8" HIGH LOOSE LIFTS. 15% COMPACTION REQUIREMENTS SHALL BE MAINTAINED THROUGHOUT THE ENTIRE THICKNESS OF THE BASE.

BACKFILL WITH SELECT MATERIAL TO BOTTOM OF BASE AGGREGATE (AS PER NDOT SPECIFICATIONS; SECTION 704). 50% COMPACTION REQUIREMENTS SHALL BE MAINTAINED THROUGHOUT THE ENTIRE THICKNESS OF THE BACKFILL.

ILX REQUIREMENTS (APPLICABLE WITHIN ILX RIGHT-OF-WAY WITH 15% VEEBES LIMITS ONLY):

IMPROVED AREA (IMP. ST.): (LOCATION OF TRENCH)

AREA WILL BE CONSIDERED IMPROVED IF IT MEETS ONE OR MORE OF THE FOLLOWING CRITERIA:

- EXISTING PERMANENT PAVEMENT WITH CURB & GUTTER AND/OR ADJACENT SIDEWALK PAVING
- WITHIN AN IMPROVED TRAIL AREA
- WITHIN A CONSTRUCTION INSTALLED CURB WITH A PRIVATE OR PUBLIC PROJECT.

UNIMPROVED AREA (UNIMP. ST.): (LOCATION OF TRENCH)

ANY OTHER REQUIREMENTS THAT MAY BE REQUIRED TO MEET THE IMPROVED AREA CRITERIA(S) WILL BE CONSIDERED AN UNIMPROVED AREA.

SEE REQUIREMENTS:

FOR ALL OTHER JURISDICTIONS REFER TO STATE STANDARDS.


BACKFILL REQUIREMENTS NVE. STD. RT-1.

TRENCH DEPTH REQUIREMENTS NVE. STD. RT-5.

TRENCH DETAIL A-A

NVE HAS NOT VERIFIED THE EXISTING
CONDUIT. CUSTOMER TO ENSURE ITS
INTEGRITY AND REPAIR IF NECESSARY.

NVE U.G. STD. RS-5 & RS-13 (RESIDENTIAL) & RS-19 (COMMERCIAL)

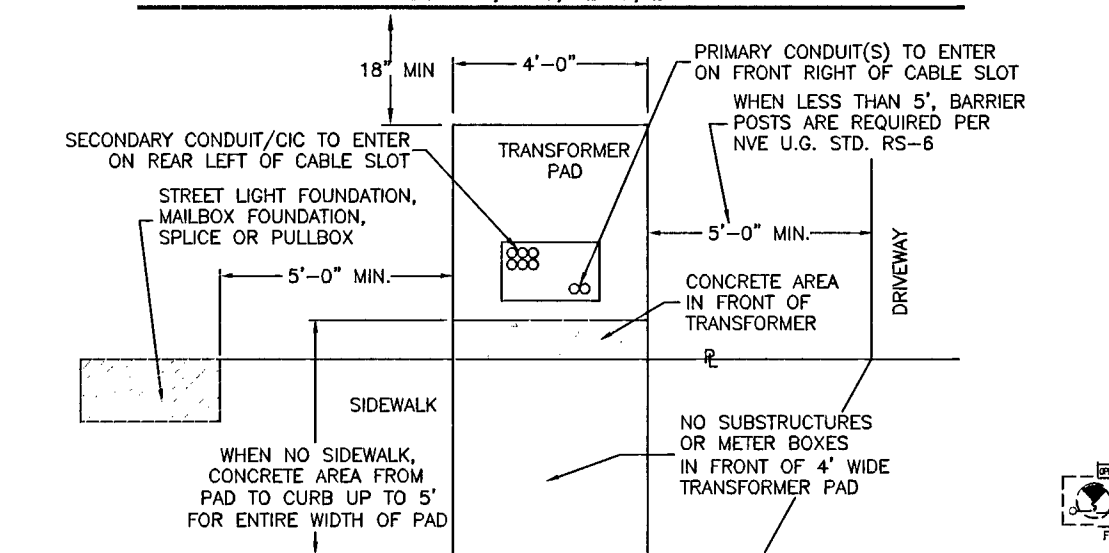

ALL SERVICE CONDUCTOR: 2/0 AL. TRI.
ALL TRANSFORMERS: 7200-120/240V-1Ø PM
COMBINED A/C TONNAGE: 8.5 TON
NUMBER OF UNITS: 36
MAIN SIZE: 200 AMPS
ESTIMATED KVA PER UNIT: 15 KVA
SQ. FT. OF LARGEST HOME: 3297 FT²

	PROPOSED	EXISTING
CENTERLINE	---	---
PROPERTY LINE/ROW	---	---
CURB	---	---
EDGE OF PAVEMENT		
EDGE OF SIDEWALK	---	---
SEWER LINE *	8"	8"
WATER LINE *	8"	8"
GAS LINE *	2"	2"
TELEPHONE LINE *	TEL	TEL
CABLE TV LINE *	CATV	CATV
STORM DRAIN LINE *	12"SD	12"SD
FIRE HYDRANT		
STREET LIGHT		
STREET LIGHT SERVICE		

* UNIDENTIFIED WHERE CONFLICT OCCURS WITH NVE FACILITY