
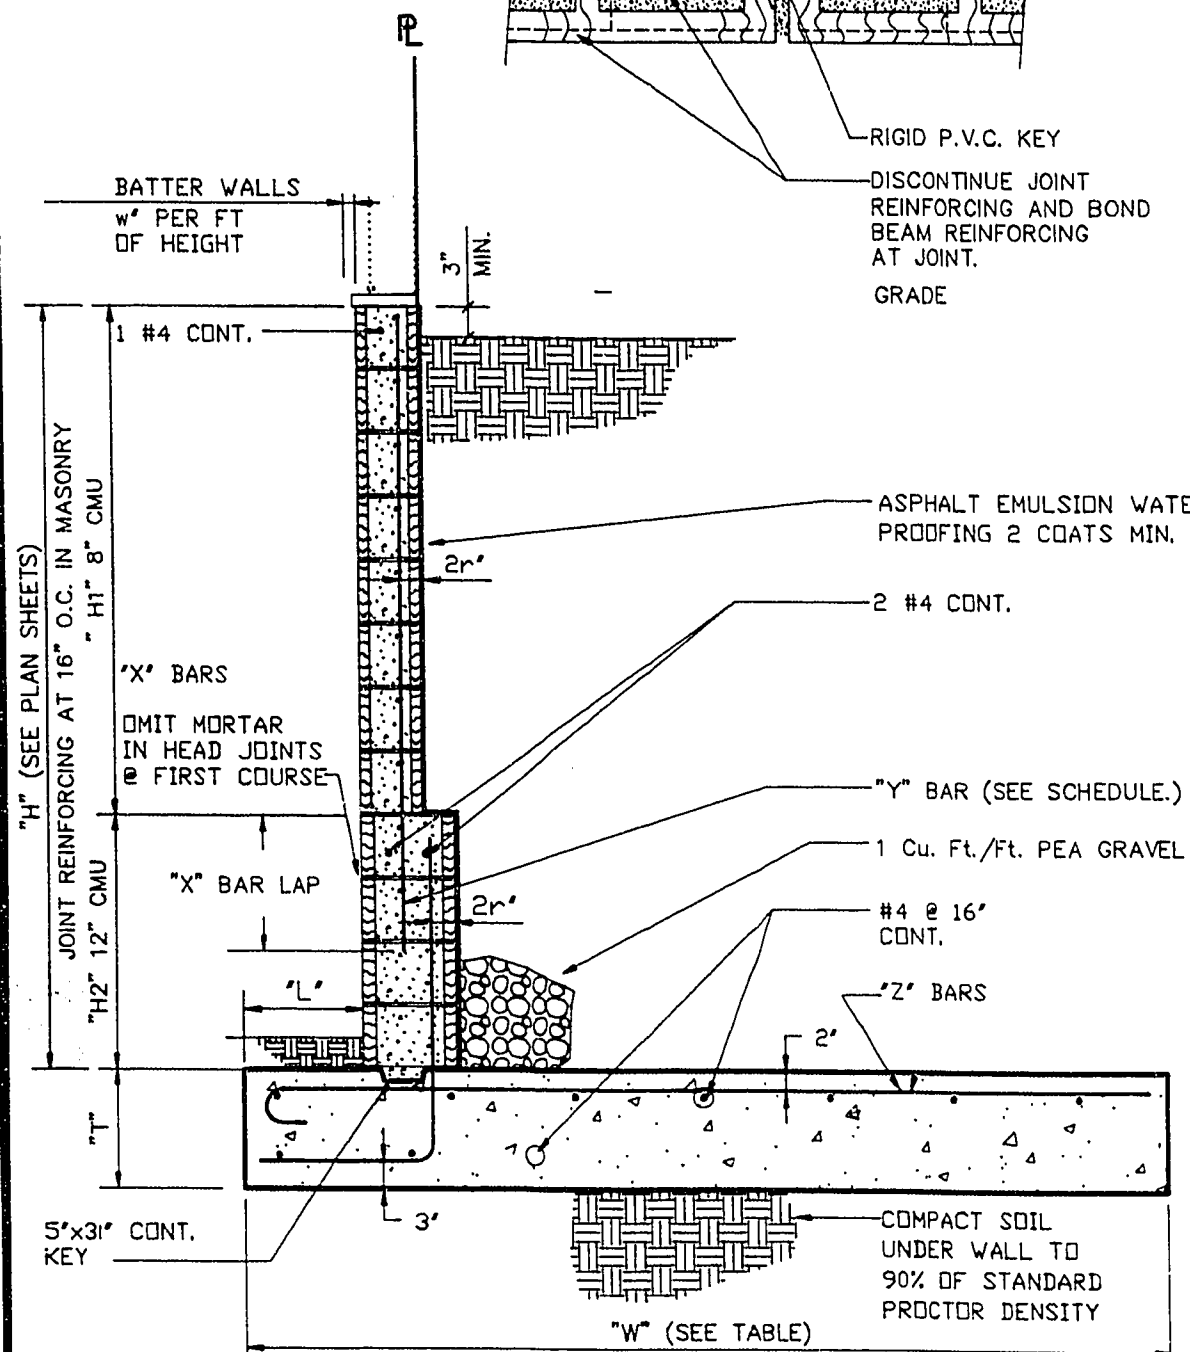


NOTE: SPECIAL INSPECTION IS REQUIRED FOR WALL
HTS. 7'-4" < H < 10'-0"

DIMENSIONS										SPECIAL INS.
H	H1	H2	W	T	L	BAR LAP	"X" BARS	"Y" BARS	"Z" BARS	
2'-0"	H	—	2'-0"	12"	9"	24"	#4 @ 48"	—	#4 @ 24"	NO
3'-4"	H	—	2'-6"	12"	9"	24"	#4 @ 24"	—	#4 @ 24"	NO
4'-8"	H	—	3'-0"	12"	9"	24"	#4 @ 24"	—	#4 @ 12"	NO
5'-4"	H	—	3'-6"	12"	9"	24"	#6 @ 24"	—	#4 @ 12"	NO
6'-0"	3'-4"	2'-8"	4'-0"	12"	9"	24"	#4 @ 24"	#4 @ 24"	#4 @ 12"	NO
6'-8"	4'-0"	2'-8"	4'-3"	12"	9"	24"	#4 @ 24"	#5 @ 24"	#4 @ 12"	NO
7'-4"	4'-0"	3'-4"	4'-9"	14"	9"	24"	#4 @ 24"	#6 @ 24"	#5 @ 12"	NO
8'-0"	4'-8"	3'-4"	5'-6"	14"	9"	24"	#4 @ 24"	#6 @ 24"	#5 @ 12"	YES
8'-8"	5'-4"	3'-4"	6'-3"	18"	1'-6"	36"	#6 @ 24"	#6 @ 24"	#5 @ 12"	YES
9'-4"	5'-4"	4'-0"	6'-6"	18"	1'-6"	36"	#6 @ 24"	#7 @ 24"	#5 @ 12"	YES
10'-0"	5'-4"	4'-8"	7'-9"	18"	1'-6"	36"	#6 @ 24"	#8 @ 24"	#5 @ 12"	YES

- NOTES:
- MASONRY UNITS SHALL BE ASTM C-90, GRADE N-1 HOLLOW CONCRETE UNITS.
 - MORTAR SHALL BE ASTM C270, TYPE "M" OR "S".
 - GROUT SHALL HAVE A MINIMUM STRENGTH OF 2000 PSI AT 28 DAYS USING TYPE V CEMENT PER ASTM C-150.
 - CONCRETE SHALL HAVE A MINIMUM STRENGTH OF 2500 PSI AT 28 DAYS USING TYPE V CEMENT PER ASTM C-150.
 - REINFORCING STEEL SHALL CONFORM TO ASTM A-615, GRADE 60.
 - UNLESS OTHERWISE NOTED, ALL MATERIALS SHALL CONFORM TO THE UNIFORM BUILDING CODE, LATEST EDITION, AND PER STANDARD SPECIFICATIONS FOR THE CITY OF LAS VEGAS, NEVADA.
 - SOLID GROUT ALL MASONRY UNITS THAT ARE BELOW THE HIGHEST FINISH GRADE AT THE WALL.
 - ALL WALLS ARE SUBJECT TO APPROVAL BY THE CITY OF LAS VEGAS, NEVADA BUILDING DEPARTMENT.
 - WALLS SHALL BE STEPPED ONLY AS SHOWN ON THE PLANS.
 - ALL CORNERS OR ANGLES SHALL BE TIED TOGETHER WITH REINFORCING STEEL AND GROUTED SOLID.
 - HORIZONTAL JOINT REINFORCING SHALL BE 9-GA. LADDER TYPE WITH LAP SPLICES OF 12" MINIMUM.
 - BOND BEAMS AND JOINT REINFORCING SHALL NOT BE CONTINUOUS THROUGH WALL CONSTRUCTION JOINTS.
 - BACKFILL BEHIND WALLS SHALL BE COMPACTED TO 90% OF STANDARD PROCTOR DENSITY.
 - WHERE VERTICAL GROUT LIFTS ARE NOT CONTINUOUS FOR THE ENTIRE HEIGHT OF THE WALL, TERMINATE LIFT 1" BELOW TOP OF TOP BLOCK TO FORM A KEY FOR FUTURE LIFTS.
 - WHERE H2 EXCEEDS 2'-6", "Y" BARS MAY BE SPLICED TO SEPARATE FOOTING DOWELS USING A 48 BAR DIAMETER LAP SPLICE.
 - LOCATE CONSTRUCTION JOINTS IN RETAINING WALL AT 24'-0" MAXIMUM.
 - SPECIAL INSPECTION PER UBC SECTION 306 SHALL BE PROVIDED.
 - IF ACTUAL HEIGHT OF WALL IS NOT LISTED IN TABLE BELOW, USE STEEL AND DIMENSIONS FOR NEXT HIGHEST WALL LISTED.
 - PROJECT SOILS REPORT: WESTERN TECHNOLOGIES, INC. PROJECT NO. 4122JM301 SEPTEMBER 28, 1992
ALL RECOMMENDATIONS MADE BY THE ABOVE SOILS REPORT SHALL BE IMPLEMENTED DURING CONSTRUCTION.

CONSTRUCTION JOINT

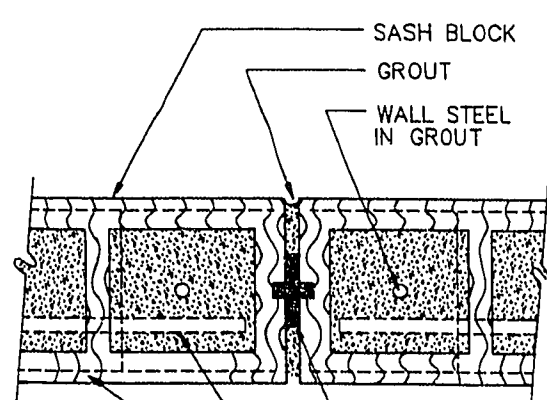

RETAINING WALL DETAIL

SCALE: NO SCALE


- INDICATED GRADES OTHER THAN T.C., F.G. & GUTTER F.L. ARE ROUGH GRADES. (0.3' LOWER THAN FINISHED GRADE).
- THE ROUGH GRADING PLANS SHALL BE ON THE JOB SITE AT ALL TIMES. THE ROUGH GRADING SHALL BE FINISHED IN CONFORMANCE WITH THE LINES AND GRADES SHOWN ON THE PLANS. THE GRADING QUANTITIES ARE BASED ON THE ELEVATION AND DETAILS SHOWN ON THE PLANS. ANY DEVIATIONS FROM THE PLANS WILL RESULT IN QUANTITY CHANGES.
- CARE SHALL BE EXERCISED IN GRADING CORNER LOTS.
- ROUGH PAD ELEVATIONS SHALL BE GRADED TO WITHIN 0.3' OF THE PAD ELEVATIONS SHOWN ON THE PLANS.
- SOILS REPORT PREPARED BY WESTERN TECHNOLOGIES, INC., WITH WTI PROJECT NO. 4122JM301, DATED SEPTEMBER 28, 1992
- EARTH QUANTITIES:
EXCAVATION 132,227 C.Y.
FILL 121,711 C.Y.

A) THE ABOVE QUANTITIES DO NOT REFLECT LOSSES DUE TO SUBSIDENCE OR SHRINKAGE.

B) THE ABOVE QUANTITIES DO NOT REFLECT ANY EARTHWORK WHICH MAY BE REQUIRED BY THE ENGINEER TO CONSTRUCT ADDITIONAL PROTECTIVE DITCHES OR BERMS NOT SHOWN ON THESE DRAWINGS.


GRADING NOTES

SCALE: NO SCALE

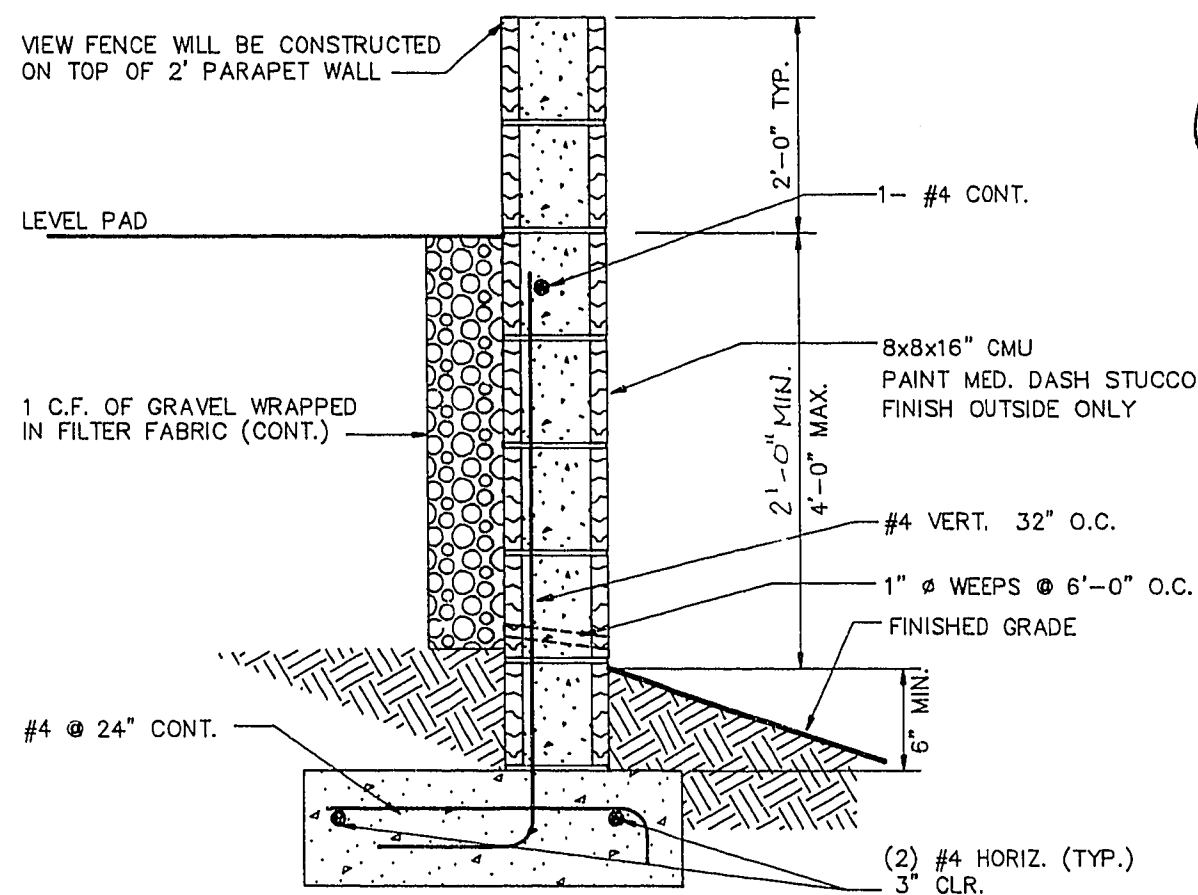


BOUNDARY RETAINING WALL

SCALE: NO SCALE

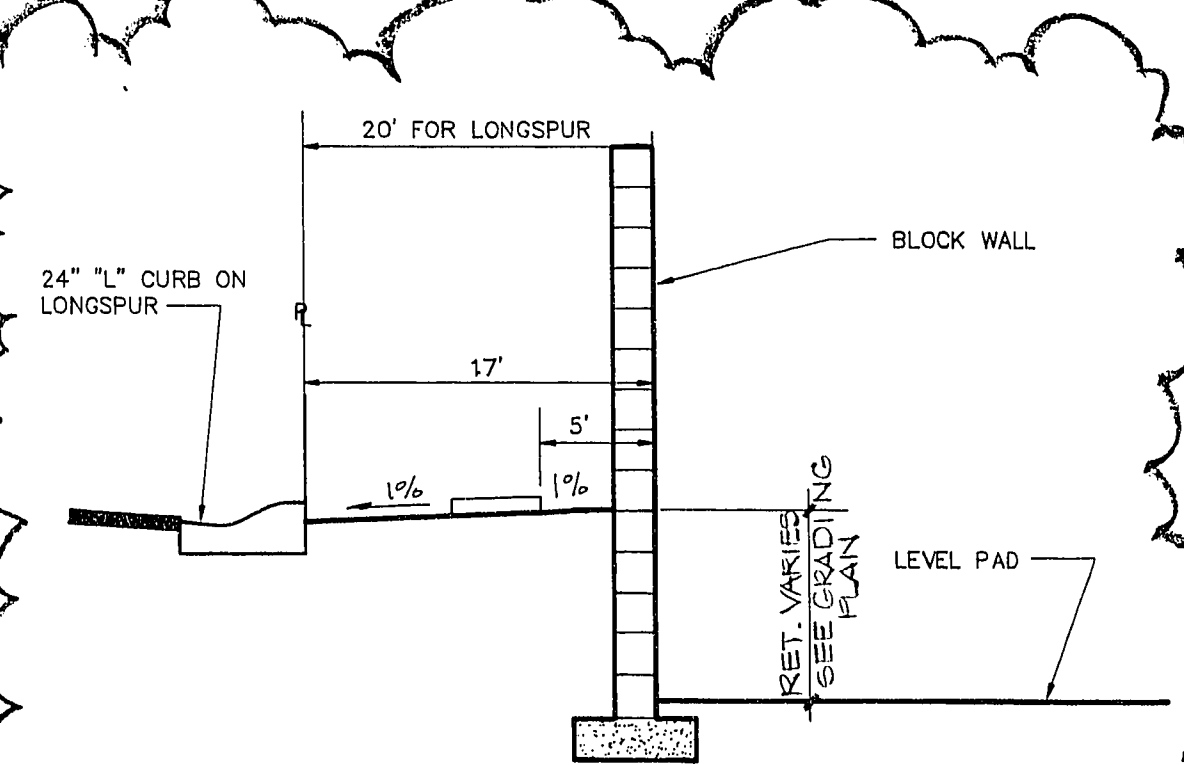


CORNER SIDE YARD WALL SECTION

SCALE: NO SCALE

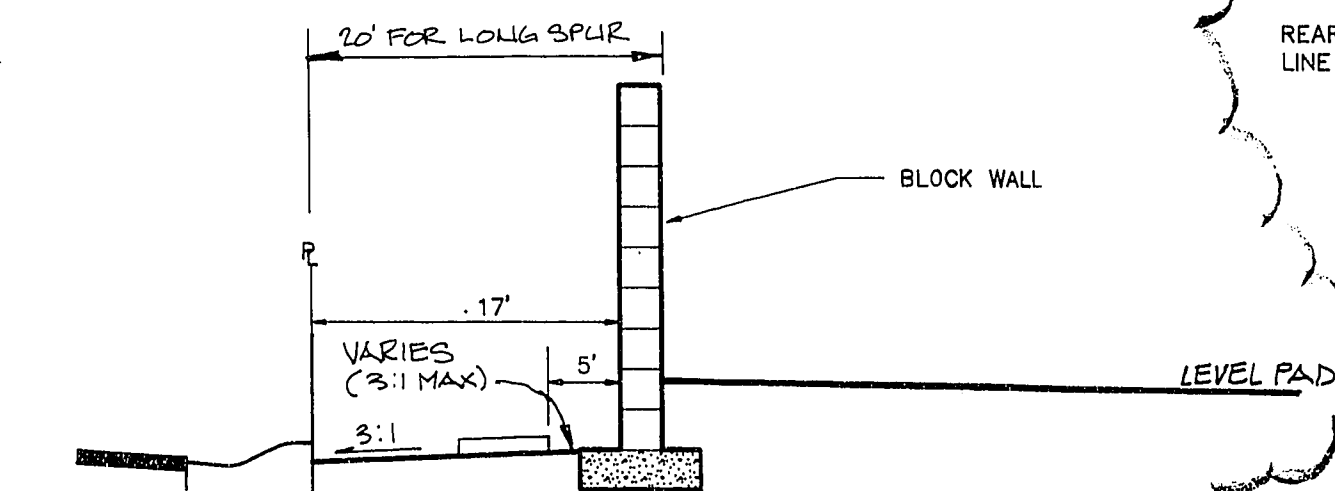


CORNER SIDE YARD WALL SECTION

SCALE: NO SCALE

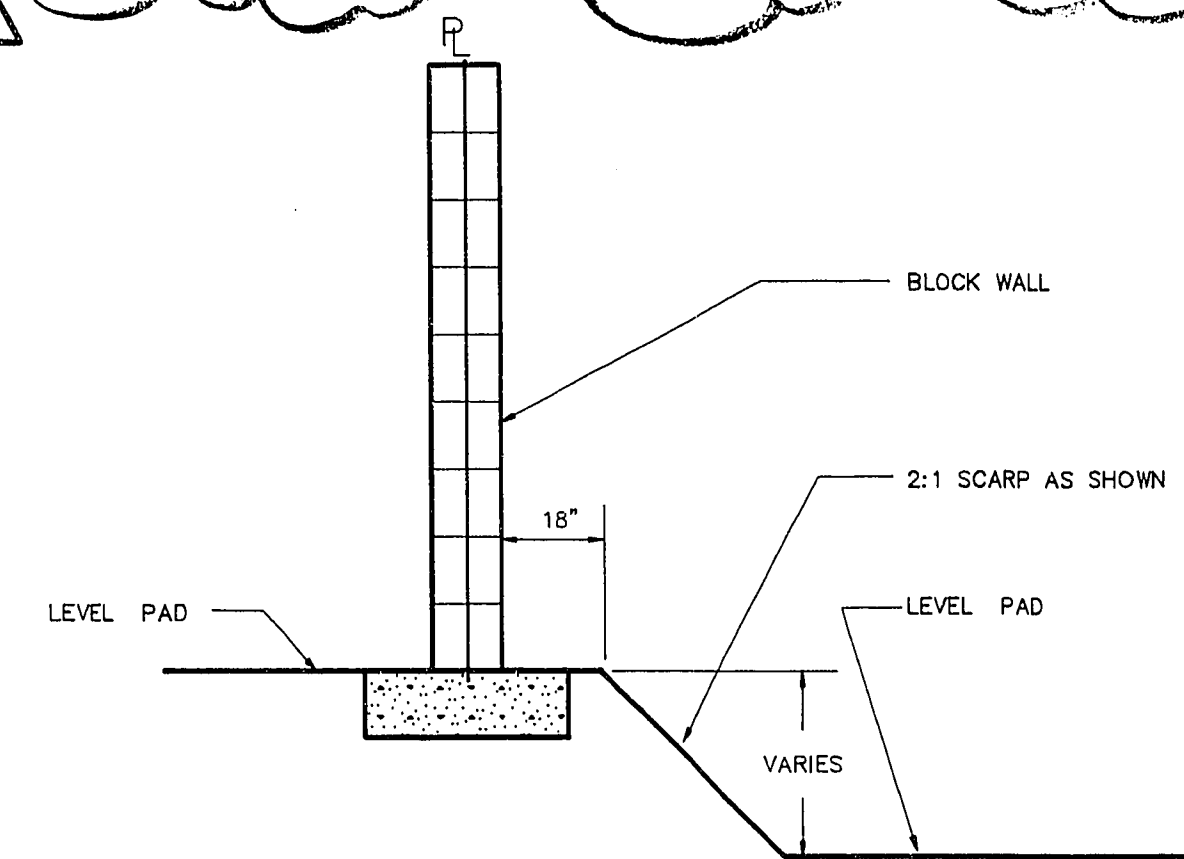


SIDE YARD

SCALE: NO SCALE

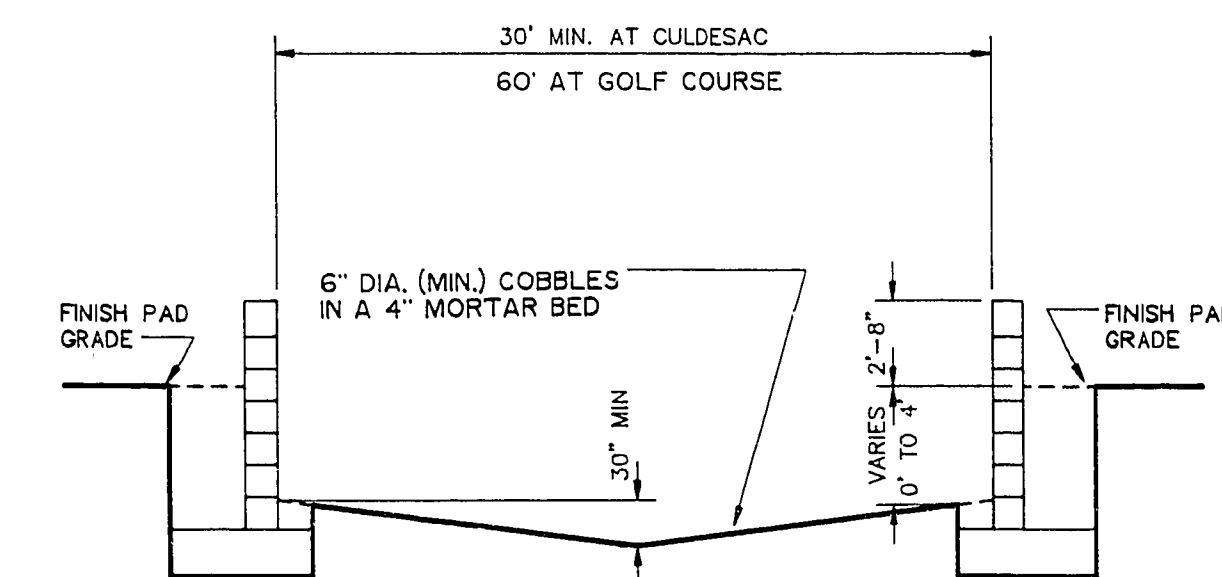


DRAINAGE SECTION

SCALE: NO SCALE

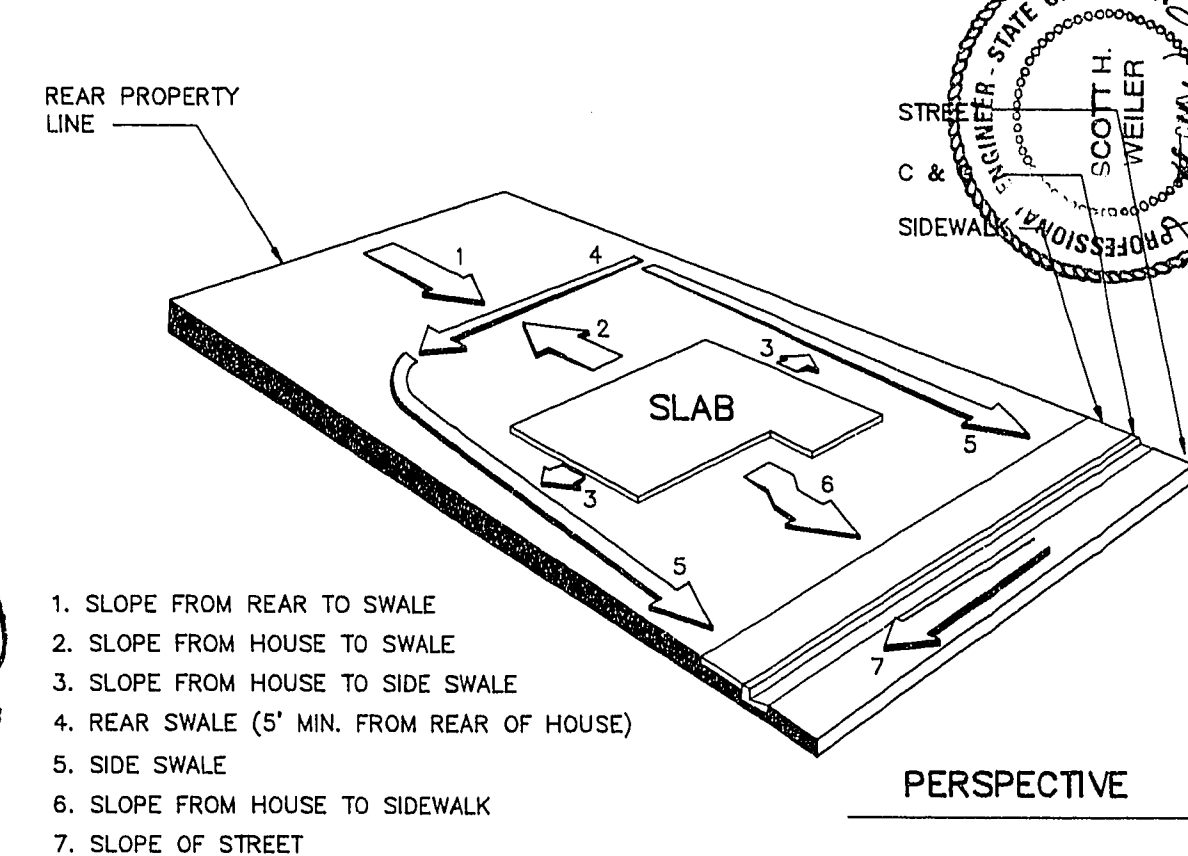


TYPICAL GRADING - TYPE "A" DRAINAGE

SCALE: NO SCALE

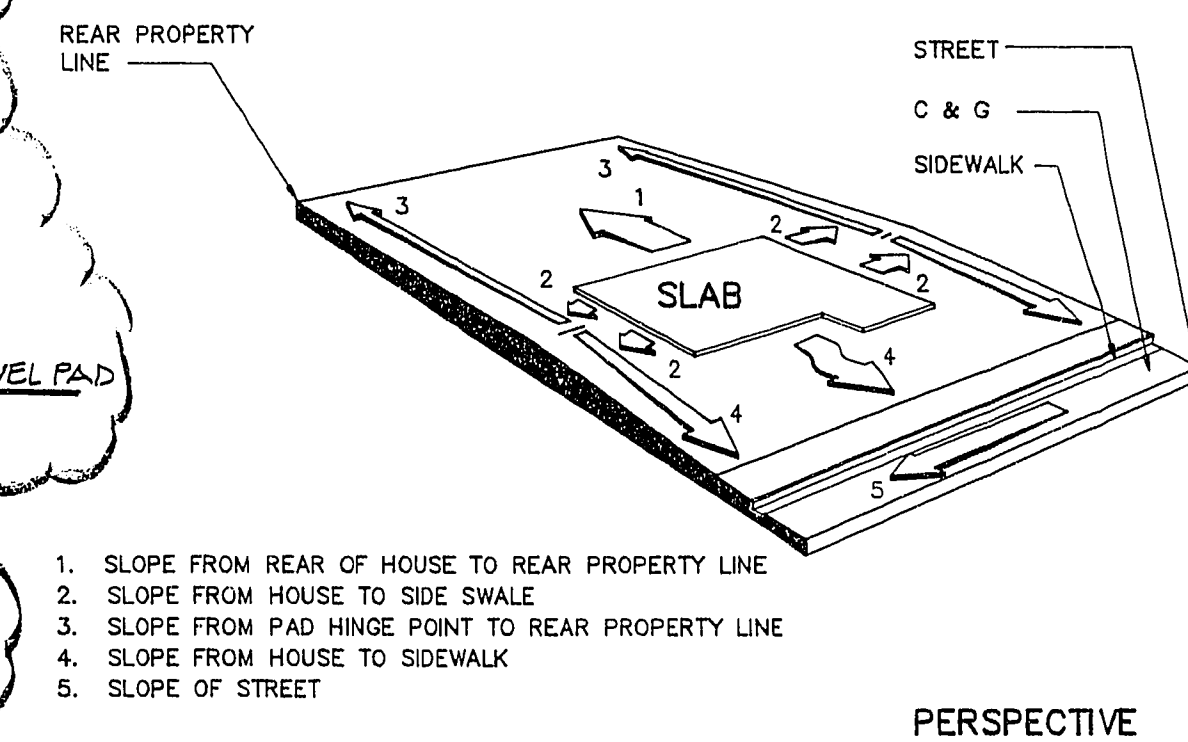


TYPICAL GRADING - TYPE "B" DRAINAGE

SCALE: NO SCALE

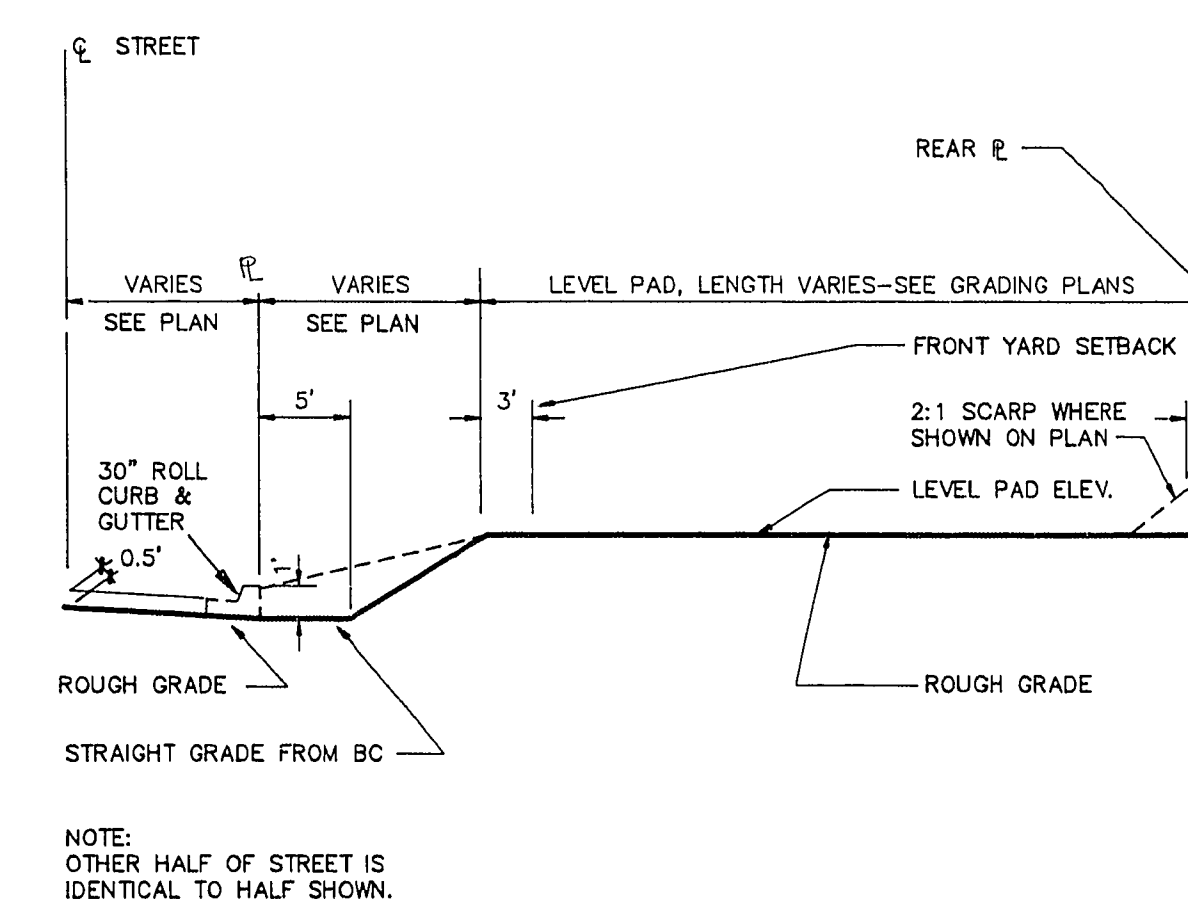


TYPICAL PAD AND STREET SECTION CUT (FOR ROUGH GRADING)

SCALE: NO SCALE

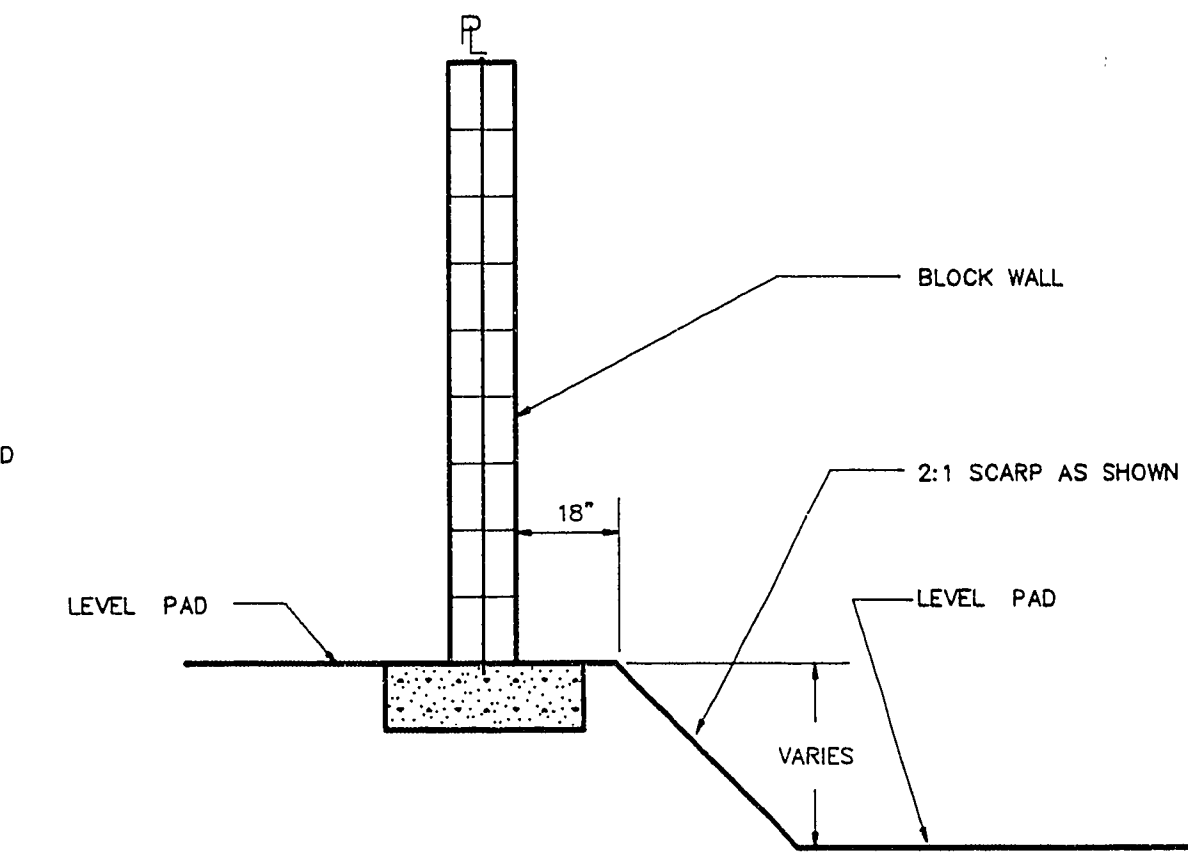

REAR YARD

SCALE: NO SCALE

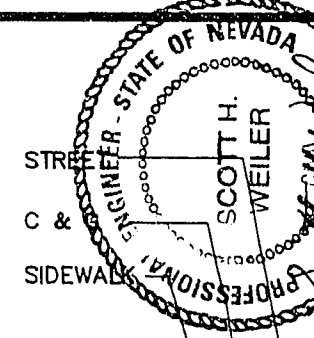

REV.	DATE	DESCRIPTION
1	3-2-94	REV. SECTIONS 3 & 4
2	3-2-94	REV. SECTIONS 3 & 4
3	3-2-94	REV. SECTIONS 3 & 4
4	3-2-94	REV. SECTIONS 3 & 4
5	3-2-94	REV. SECTIONS 3 & 4
6	3-2-94	REV. SECTIONS 3 & 4
7	3-2-94	REV. SECTIONS 3 & 4
8	3-2-94	REV. SECTIONS 3 & 4
9	3-2-94	REV. SECTIONS 3 & 4
10	3-2-94	REV. SECTIONS 3 & 4

DAVID P. WUCKEL
ENGINEER
1555 SOUTH RAINBOW BLVD./LAS VEGAS, NEVADA 89102
(702) 365-7400

G.C. WALLACE, INC.
Engineering/Architecture

CHRISTOPHER HOMES
COUNTRY CLUB HILLS II IN THE HILLS AT SUMMERLIN
GRADING DETAILS

SHEET
14
OF 14 SHEETS

620.711

PLOTTED: 10/21/93 11:46 am
P700

11-1-120

1074-43/2-1