
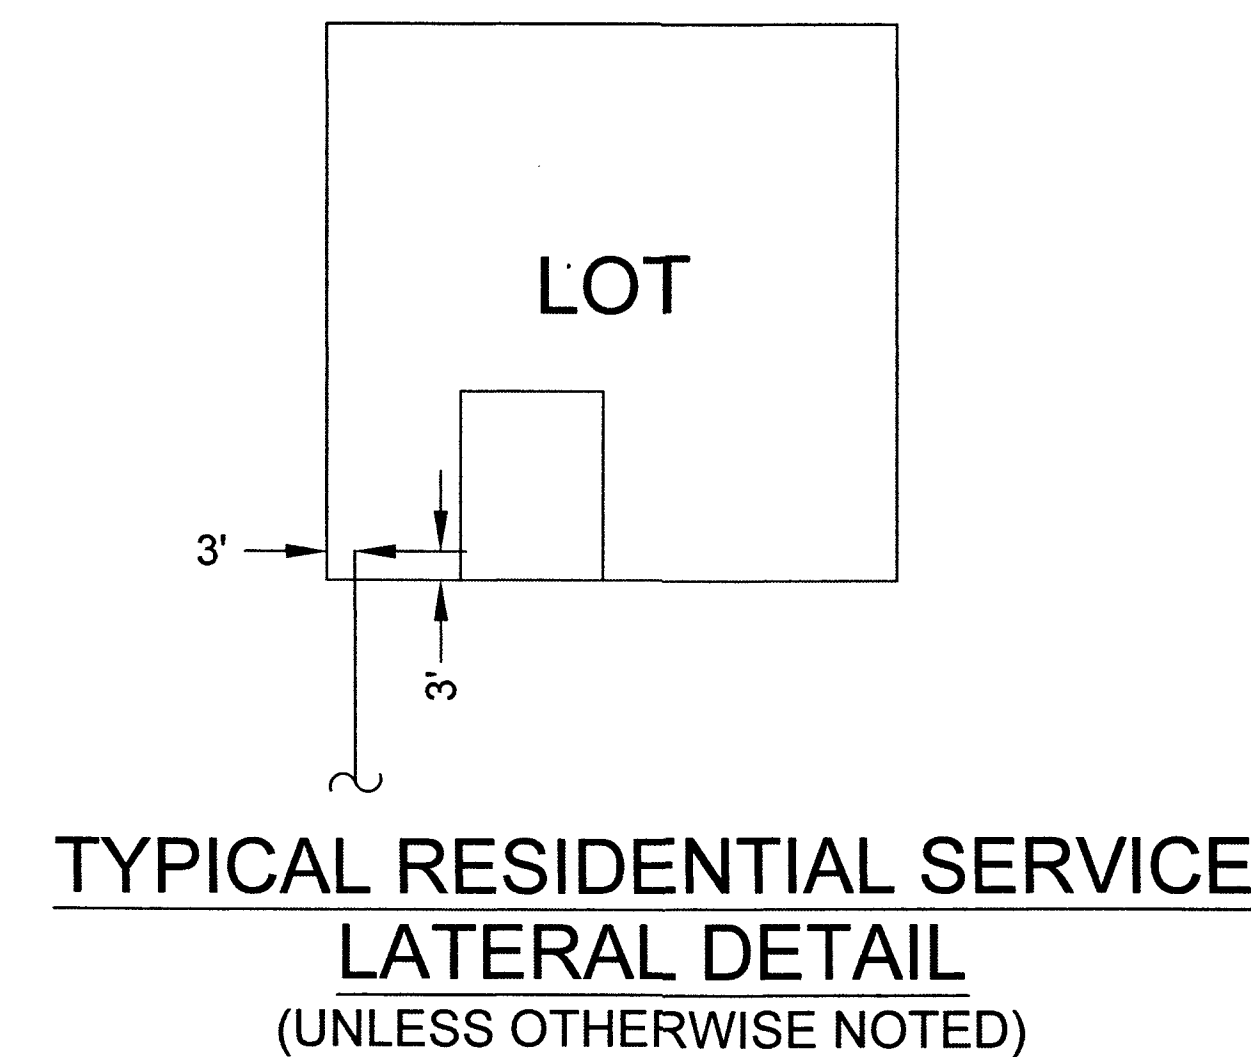


- 1 PROPOSED 2" PE MAIN
- 2 PROPOSED 4"X2" PE TAPPING TEE #160-8174
- 3 PROPOSED 2" PE COUPLING #140-3504
- 4 PROPOSED 2" PE 90 DEGREE ELBOW #140-3067
- 5 PROPOSED 2" PE CAP #140-3060
- 6 PROPOSED 2" PE ROPE

1. SUGGESTED GAS LOCATIONS ARE TO CLEAR SUBSTRUCTURES LOCATE IN FIELD.
2. ALL PIPELINE CONSTRUCTION SHALL CONFORM TO APPLICABLE JURISDICTION SPECIFICATIONS.
3. DO NOT SCALE THIS DRAWING.
4. CHANGE IN PROPOSED MAIN LOCATION MUST BE AUTHORIZED BY SWG ENGINEER PRIOR TO INSTALLATION.
5. GAS MAINS SHALL BE PURGED PER OPERATIONS MANUAL.
6. TRENCHING AND BACKFILL TO CONFORM WITH UNIFORM STANDARD SPECS. SECTION 208, AND RTC STANDARD(S) 503, 500.5 & 500.4.

PAVEMENT REPAIR AND / OR BACKFILL SHALL CONFORM TO RTC:

A1	503
A2	500.5
A3	500.4

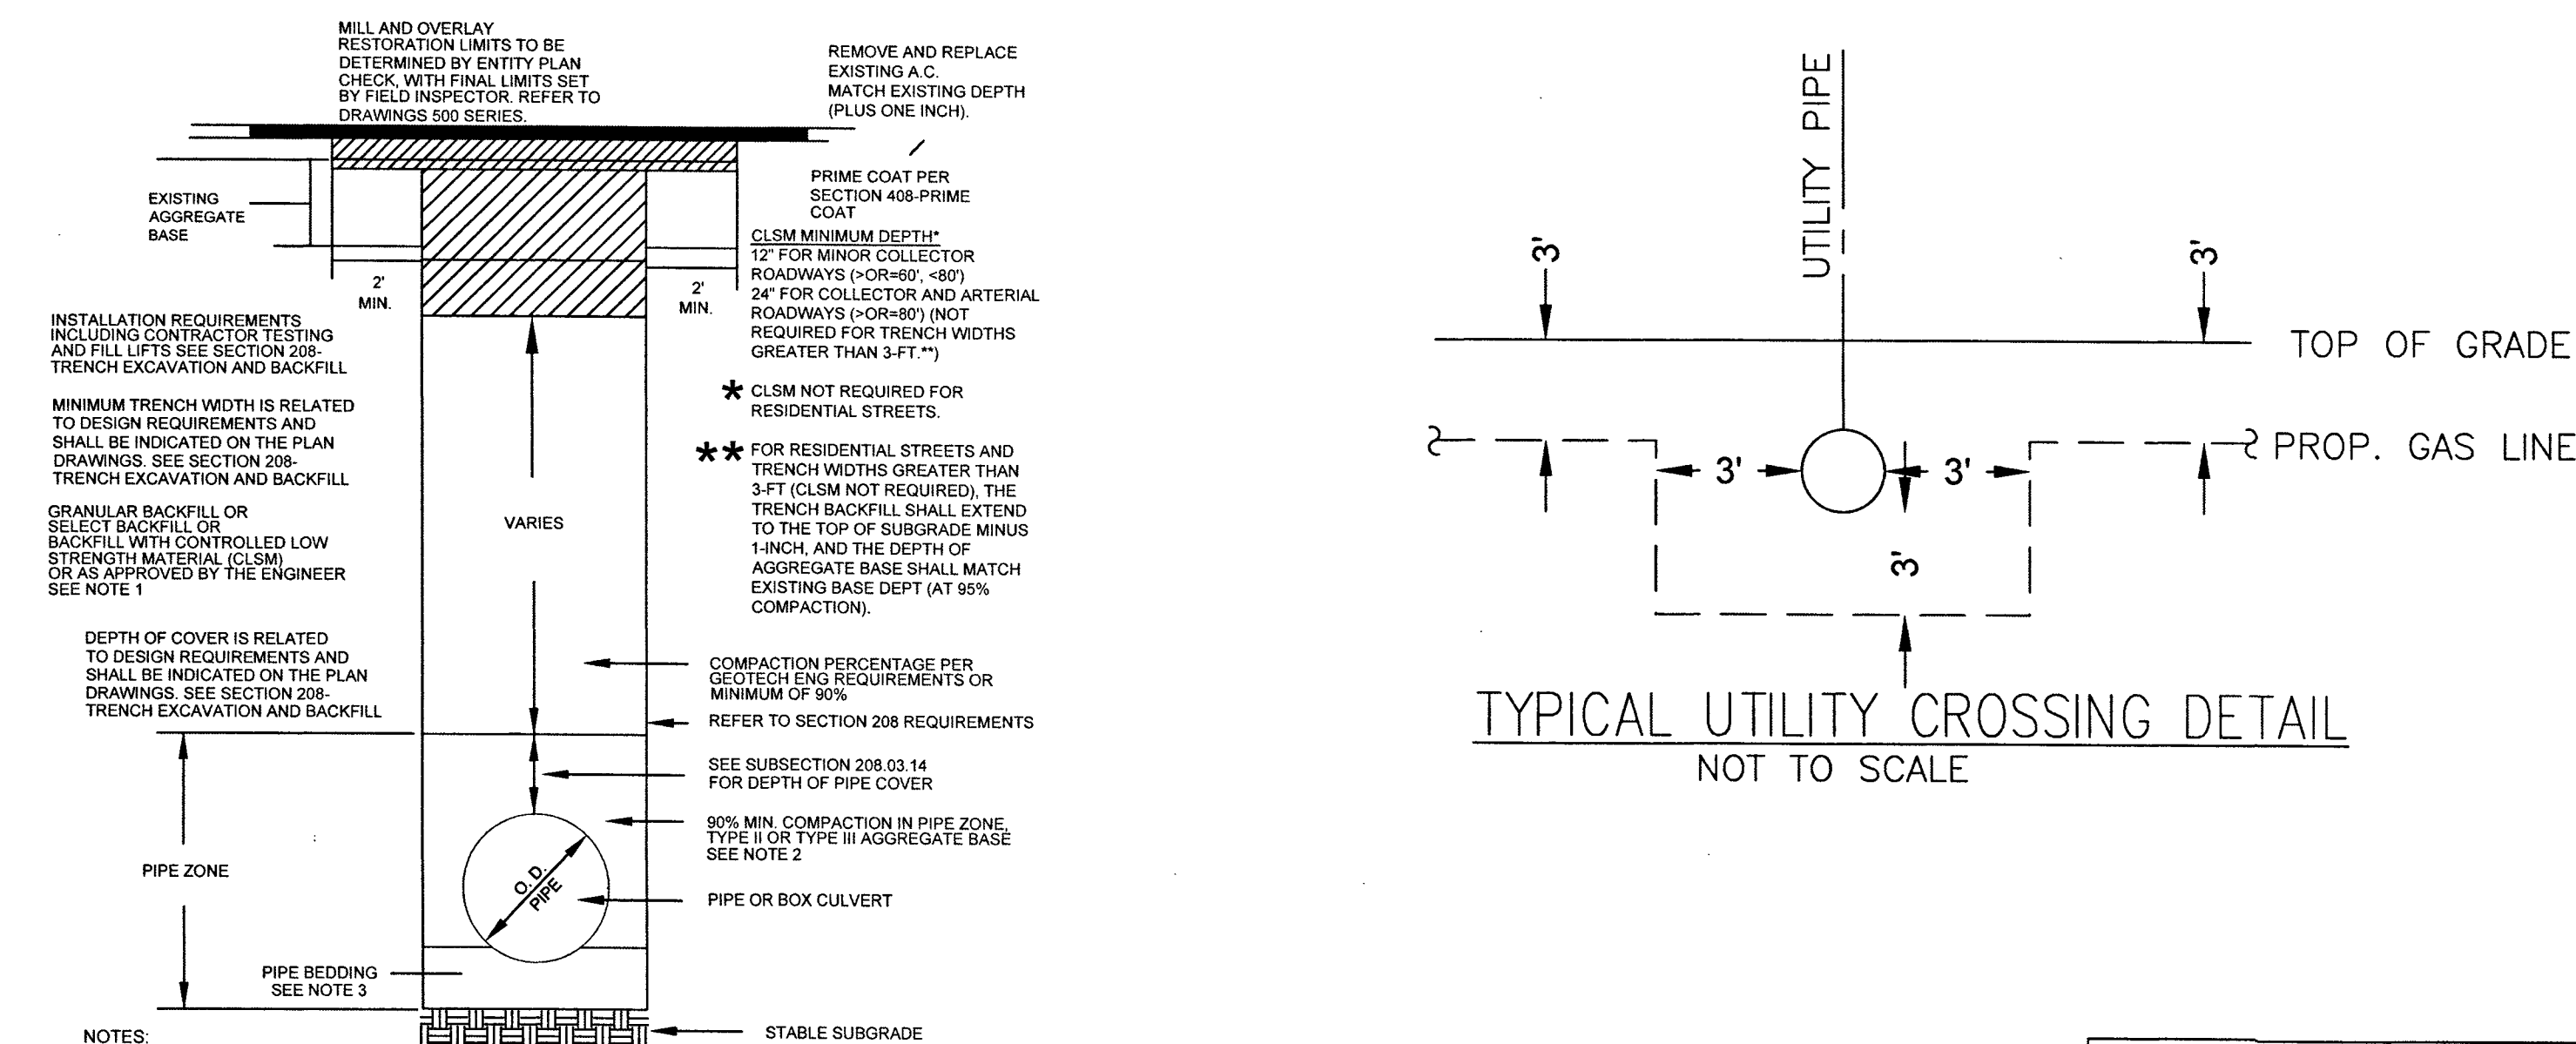

RTC STD DWG 503

	SYSTEM	D_VALLEY_WIDE
	DR. NO.	21DS10014199
SEGMENT	M.A.O.P.	N/A
	SYSTEM M.A.O.P.	43 PSIG
	SYSTEM M.O.P.	43 PSIG

PURGE PLAN WAS COMPLETED IN ACCORDANCE
WITH THE OPERATIONS MANUAL GUIDELINES BY:

PRINT: _____ DATE: _____

SIGNATURE: _____



Know what's **below**.
Call before you dig.

[illegible]