OVERALL PROJECT

-NOT TO SCALE-

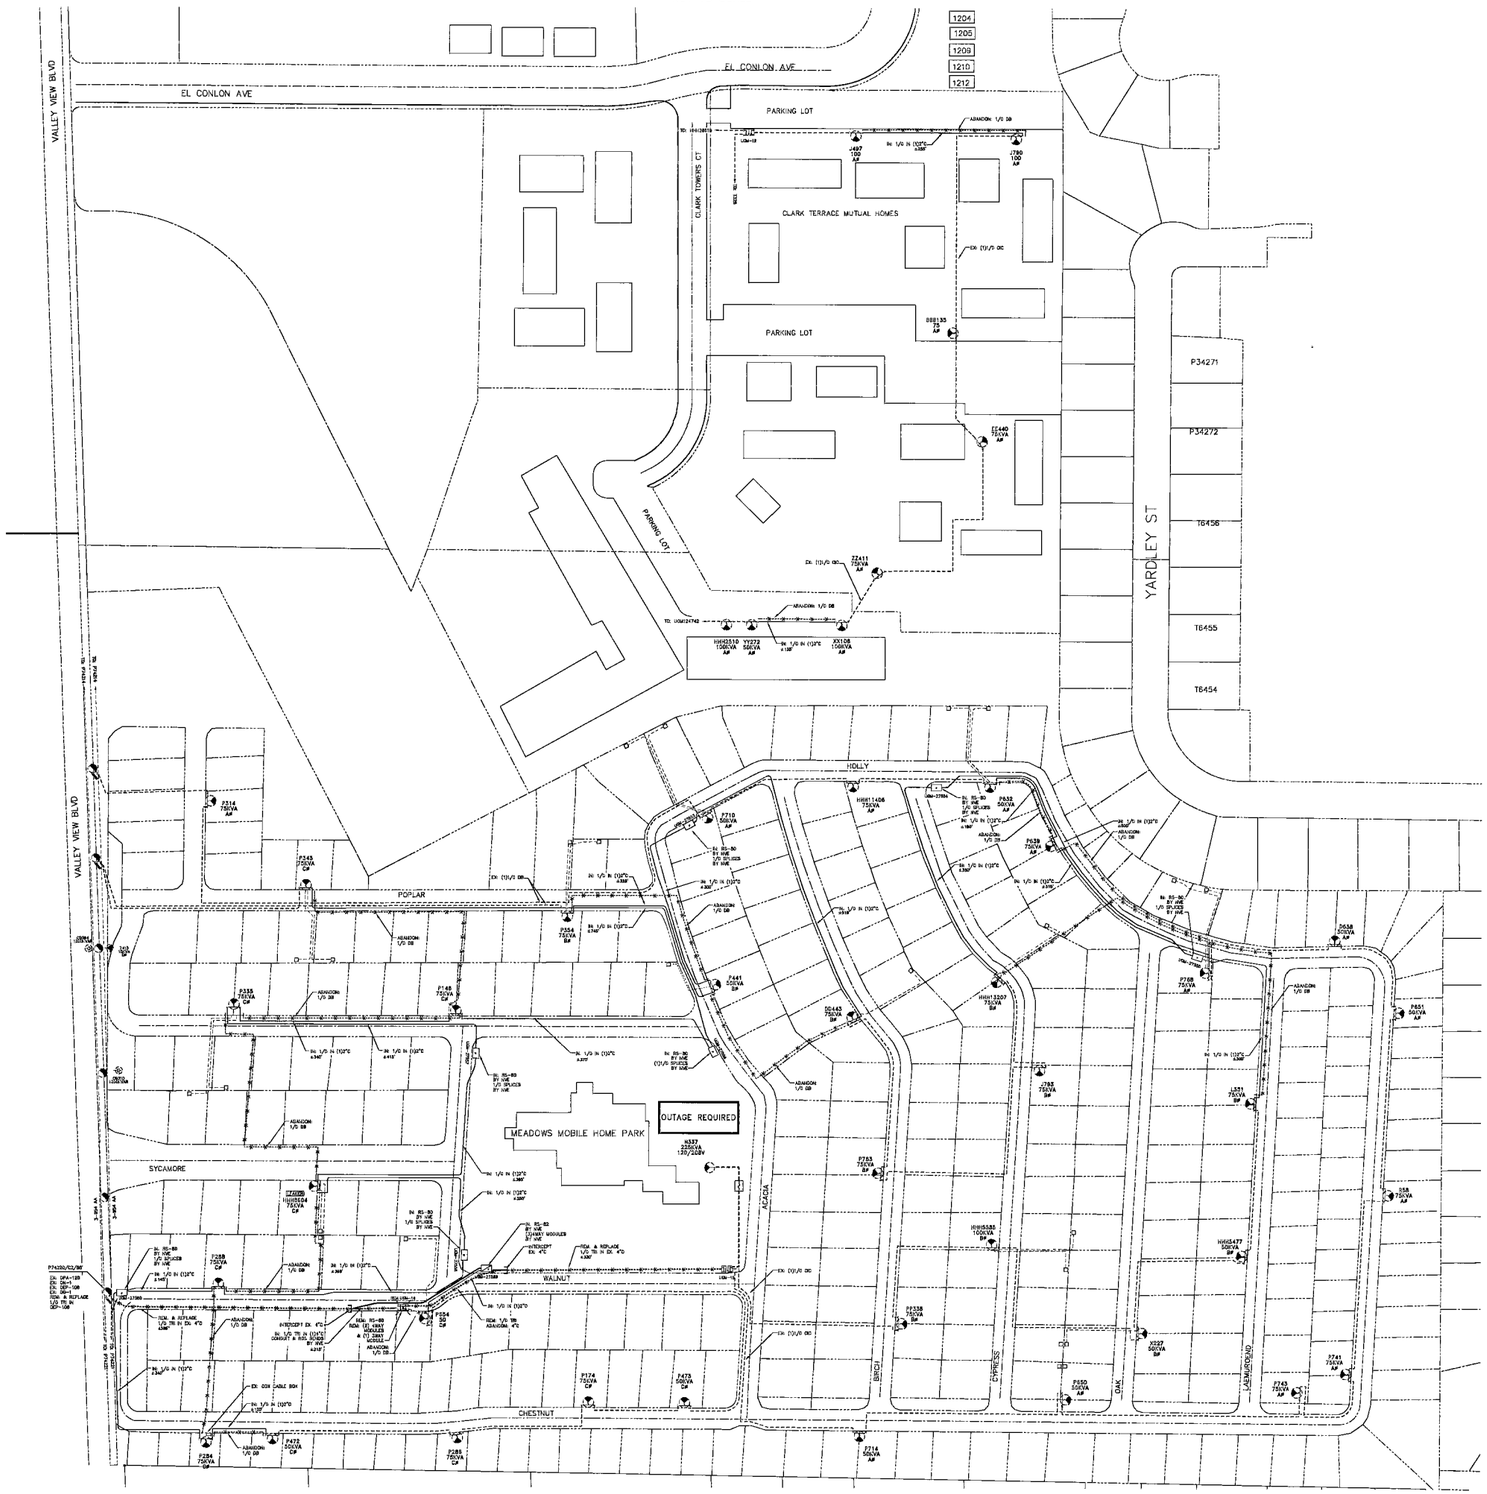

115969

T,R,S: 2151-08

APN: 16208201003

PURPOSE OF PROJECT:
REPLACE REJECTED CABLE WITH NEW 1/0 IN 2"C

MAINTENANCE PROJECTS REQUIRE THE USE OF SCHEDULE 40 FOR ALL 2" & 4" CONDUIT. D.B. 60 IS REQUIRED FOR ALL 6"CONDUIT. IF COILABLE CONDUIT IS USED, IT MUST BE H.D.P.E. WITHOUT RE-GROUND MATERIALS.

CITY OF LAS VEGAS
PERMIT REQUIRED*

CONTACT CLV LAND DEVELOPMENT (229-6371)
CLV CONSTRUCTION SERVICES MUST BE NOTIFIED 24 HOURS PRIOR TO COMMENCING CONSTRUCTION (229-6337)

*NVE INSPECTOR MUST BE NOTIFIED BY FAX 48 HOURS PRIOR TO COMMENCING CONSTRUCTION & WILL VERIFY CITY PERMIT FOR WORK DONE IN STREETS OR SIDEWALK. FAX PERMIT TO:
LAS VEGAS NORTH: 402-4354
LAS VEGAS SOUTH (HENDERSON): 402-6863
LAS VEGAS SOUTH (SPRING VALLEY): 402-6898

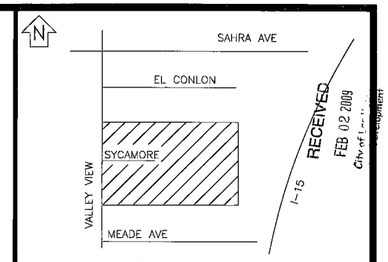

RECEIVED FEB 02 2009 City of Las Vegas Development

VICINITY MAP
(NOT TO SCALE)

EVERY EFFORT HAS BEEN MADE TO IDENTIFY ALL NVE FACILITIES. THE CUSTOMER SHALL CONFIRM THE EXISTENCE AND LOCATION OF THESE FACILITIES.

AVOID HITTING OVERHEAD POWER LINES. IT'S COSTLY.
CALL BEFORE YOU DO OVERHEAD
CALL 1-702-227-2929

Call before you Dig
Avoid cutting underground utility lines. It's easy.
Call 811
OR
1-800-227-2600
AND
CLARK COUNTY TRAFFIC OPERATIONS
1-702-455-7544

REVISIONS

NO.	DESCRIPTION	DATE	G.A.
△			
△			
△			
△			
△			
△			
△			
△			
△			
△			

TYPE OF EASEMENT:	
AERIAL	■
STANDARD	□
R/W-31	□
UNDERGROUND	■
AS BUILT UNDERGROUND	□
R.O.E./R/W-5-COM	□
3rd PARTY	□
UNDERGROUND BY EXHIBIT	□
(N-DOT) PERMIT	□
(BLM) PERMIT	□
RAILROAD-UPRR-PERMIT	□
SO. NEVADA WATER PERMIT	□
NOT REQUIRED	□
Misc. Info.	□

JPA NOTES:
EMBARQ CONTACT: MIKE EMERSON
PHONE NUMBER: 244-7907
DATE OF CONTACT: 12/15/2008
____ TO SET NEW POLES
____ TO STAKE NEW POLES
____ TO PROVIDE ____ POLES
____ FT. CLASS ____
____ FT. CLASS ____
____ FT. CLASS ____
____ TO DIG POLE HOLES
____ TO REMOVE EX. POLES
REM. AND REPLACE 1/0 TRI IN RISER U2960 ON P74220
JPA#: P200800339

EXHIBIT 'A'

NVE INFORMATION:
COORDINATOR: RICHARD GRIFFITH
PHONE: 402-6528
DESIGNER: JORDAN JOHNSTON
DCA: N/A
INSPECTOR: 378-3695
STAND BY: 402-4117,402-4116,402-4118
DISTRICT: LAS VEGAS

CUSTOMER INFORMATION:
APPLICANT NVE
ENGINEER: N/A
CONTACT: RICHARD GRIFFITH
APPROVAL DATE:

GOVERNMENT INFORMATION:
AGENCY: CITY OF LAS VEGAS For work in R/W only
APPROVAL DATE: 2/4/09

FOR EACH SERVICE POINT (POINT OF DELIVERY), ENERGY FOR EACH TENANT SPACE WILL BE MEASURED THROUGH ONE WATTHOUR METER. ENERGY FOR ALL NON-TENANT SPACE WILL BE MEASURED THROUGH ONE WATTHOUR METER. CONTACT NPC METER OPERATIONS FOR MULTIPLE RATE CLASS INSTALLATIONS

NVEnergy

CABLE REPLACEMENT EL CONLON 2

107V5777-PWR

PROJ. ID: M28926	SCALE: 1" = 50'
SHEET #COVER OF 3	DATE: 11/13/2008

FEB 02 2009 #33005 CABLE REPLACEMENT EL CONLON 2