
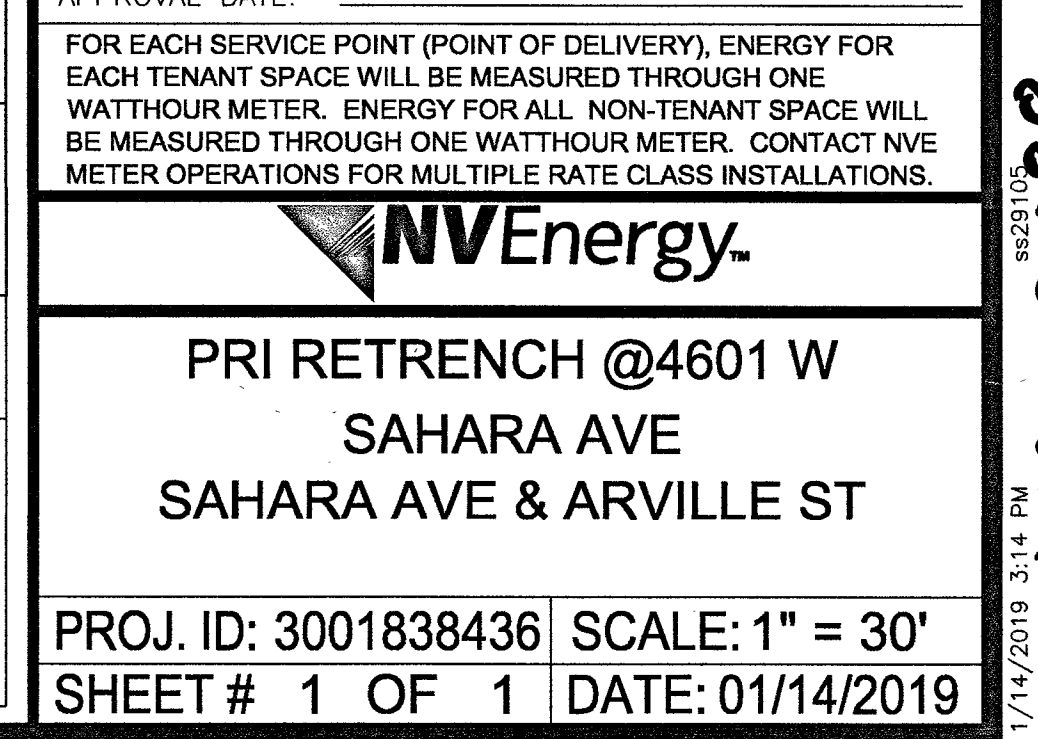
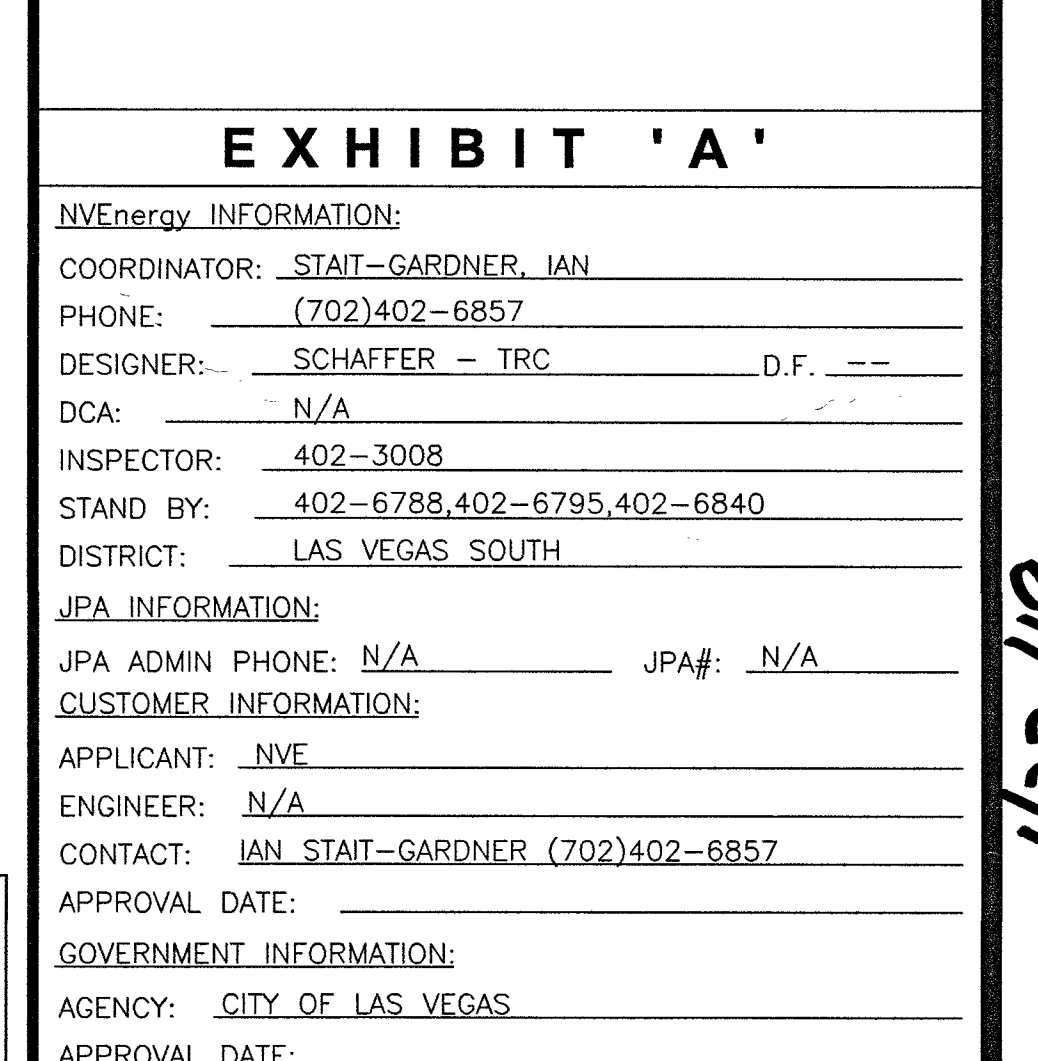
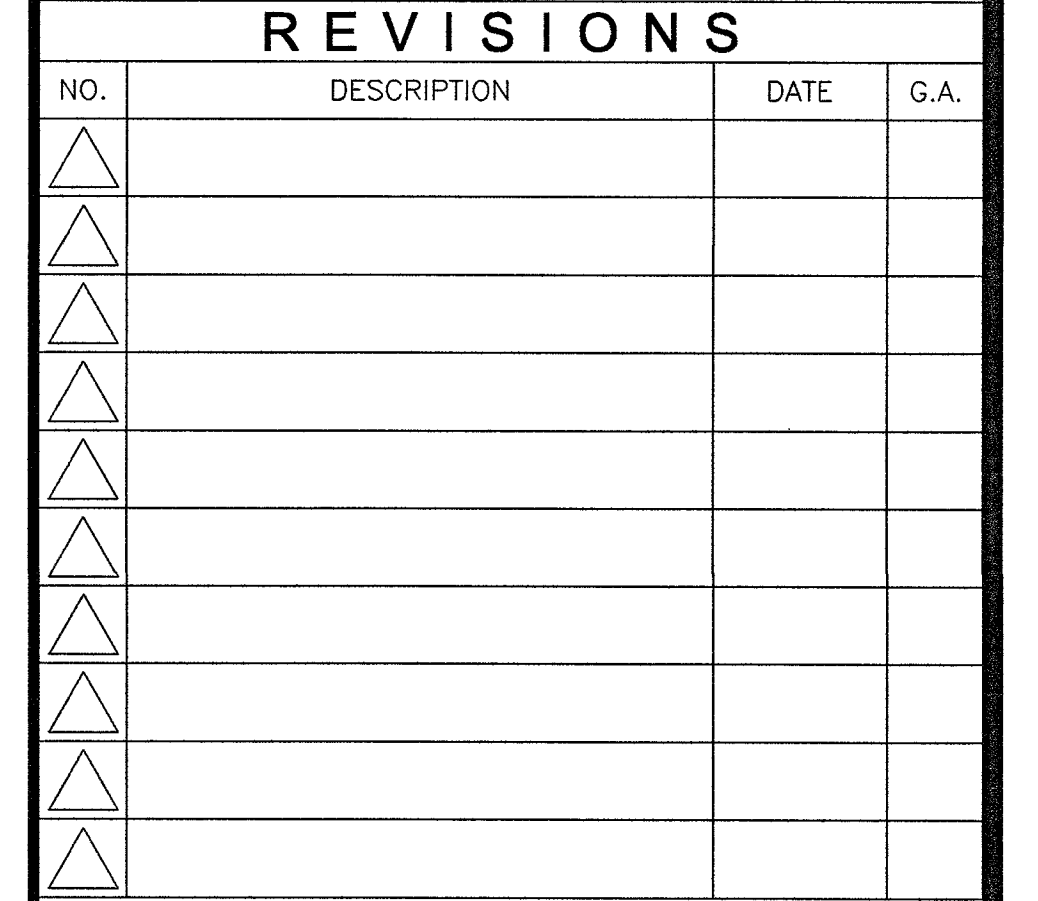


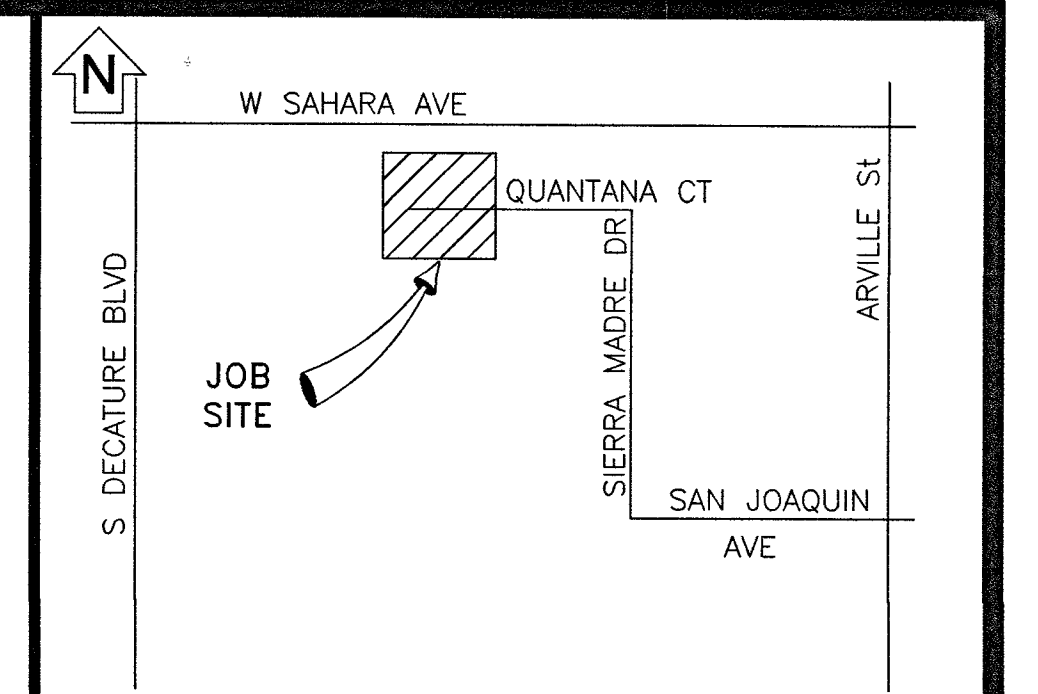

		2'-6" X 4' X 4' SPLICE PULLBOX PER NVE U.G. STD. RS-80.
		3' X 7' X 4' PULLBOX PER NVE U.G. STD. RS-82.
		PAD FOR (1) SINGLE PHASE RESIDENTIAL TRANSFORMER, PER NVE U.G. STD. RS-13 AND RS-5.
		PAD FOR (2) SINGLE PHASE RESIDENTIAL TRANSFORMERS, PER NVE U.G. STD. RS-14 AND RS-5.
		PAD FOR (1) SINGLE PHASE COMMERCIAL TRANSFORMER, PER NVE U.G. STD. RS-19 AND RS-5.

VEHICLE PROTECTIVE BARRIERS PER NVE U.G. STD. RS-6,
WHERE APPLICABLE.

MAINTENANCE PROJECTS REQUIRE THE
USE OF SCHEDULE 40 FOR ALL 2",
3", & 4" CONDUIT. D.B. 60 IS REQUIRED
FOR ALL 6" CONDUIT. IF COILABLE CONDUIT
IS USED, IT MUST BE H.D.P.E. WITHOUT
RE-GROUND MATERIALS.

CITY OF LAS VEGAS PERMIT REQUIRED*	
CONTACT CLV LAND DEVELOPMENT (229-6337)	
CLV CONSTRUCTION SERVICES MUST BE	
NOTIFIED 24 HOURS PRIOR TO COMMENCING	
CONSTRUCTION (229-6337)	
HANSEN _____	DATE _____
*NVE INSPECTOR MUST BE NOTIFIED BY FAX 48 HOURS PRIOR TO COMMENCING CONSTRUCTION & WILL VERIFY CITY PERMIT FOR WORK DONE ON STREETS OR SIDEWALK. FAX PERMIT TO: LAS VEGAS NORTH (RYAN CENTER): 402-4534 LAS VEGAS SOUTH (BELTWAY CENTER): 402-6664	