

THIS DRAWING IS
NOT A SITE SURVEY

THE PURPOSE OF THIS DRAWING IS
TO SHOW HOW THE DEVELOPED SITE
RELATES TO THE PARENT PARCEL AND
ADJACENT PROPERTIES. R.O.W.
MEASUREMENTS ARE APPROXIMATIONS.



AT&T MOBILITY
10550 W. CHARLESTON
SUITE B
LAS VEGAS, NV 89135



BLACK & VEATCH


BLACK & VEATCH CORPORATION
8965 S EASTERN AVE
SUITE #325
LAS VEGAS, NV 89123

PROJECT NO: 129084.1501

DRAWN BY: SAL

CHECKED BY: GAC

0	04/01/19	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION

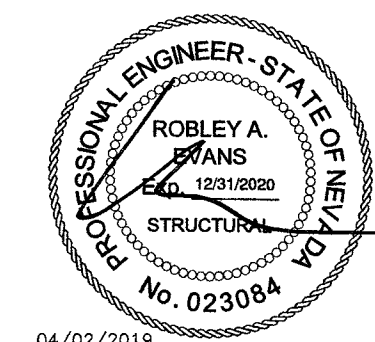

04/02/2019



IT IS A VIOLATION OF LAW FOR ANY PERSON,
UNLESS THEY ARE ACTING UNDER THE DIRECTION
OF A LICENSED PROFESSIONAL ENGINEER,
TO ALTER THIS DOCUMENT.

NVL08176F_R02
ADJACENT TO
BALZAR & WILLOWBURY DR
LAS VEGAS, NV 89108
PICO SMALL CELL

SHEET TITLE
EXPANDED SITE PLAN AND
UTILITY ROUTE

SHEET NUMBER


A-1

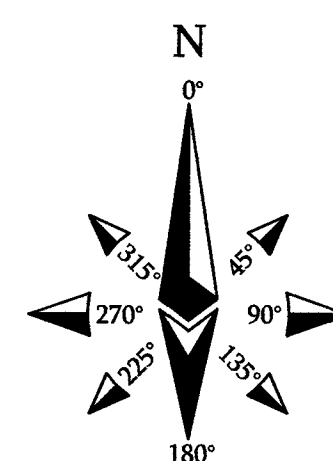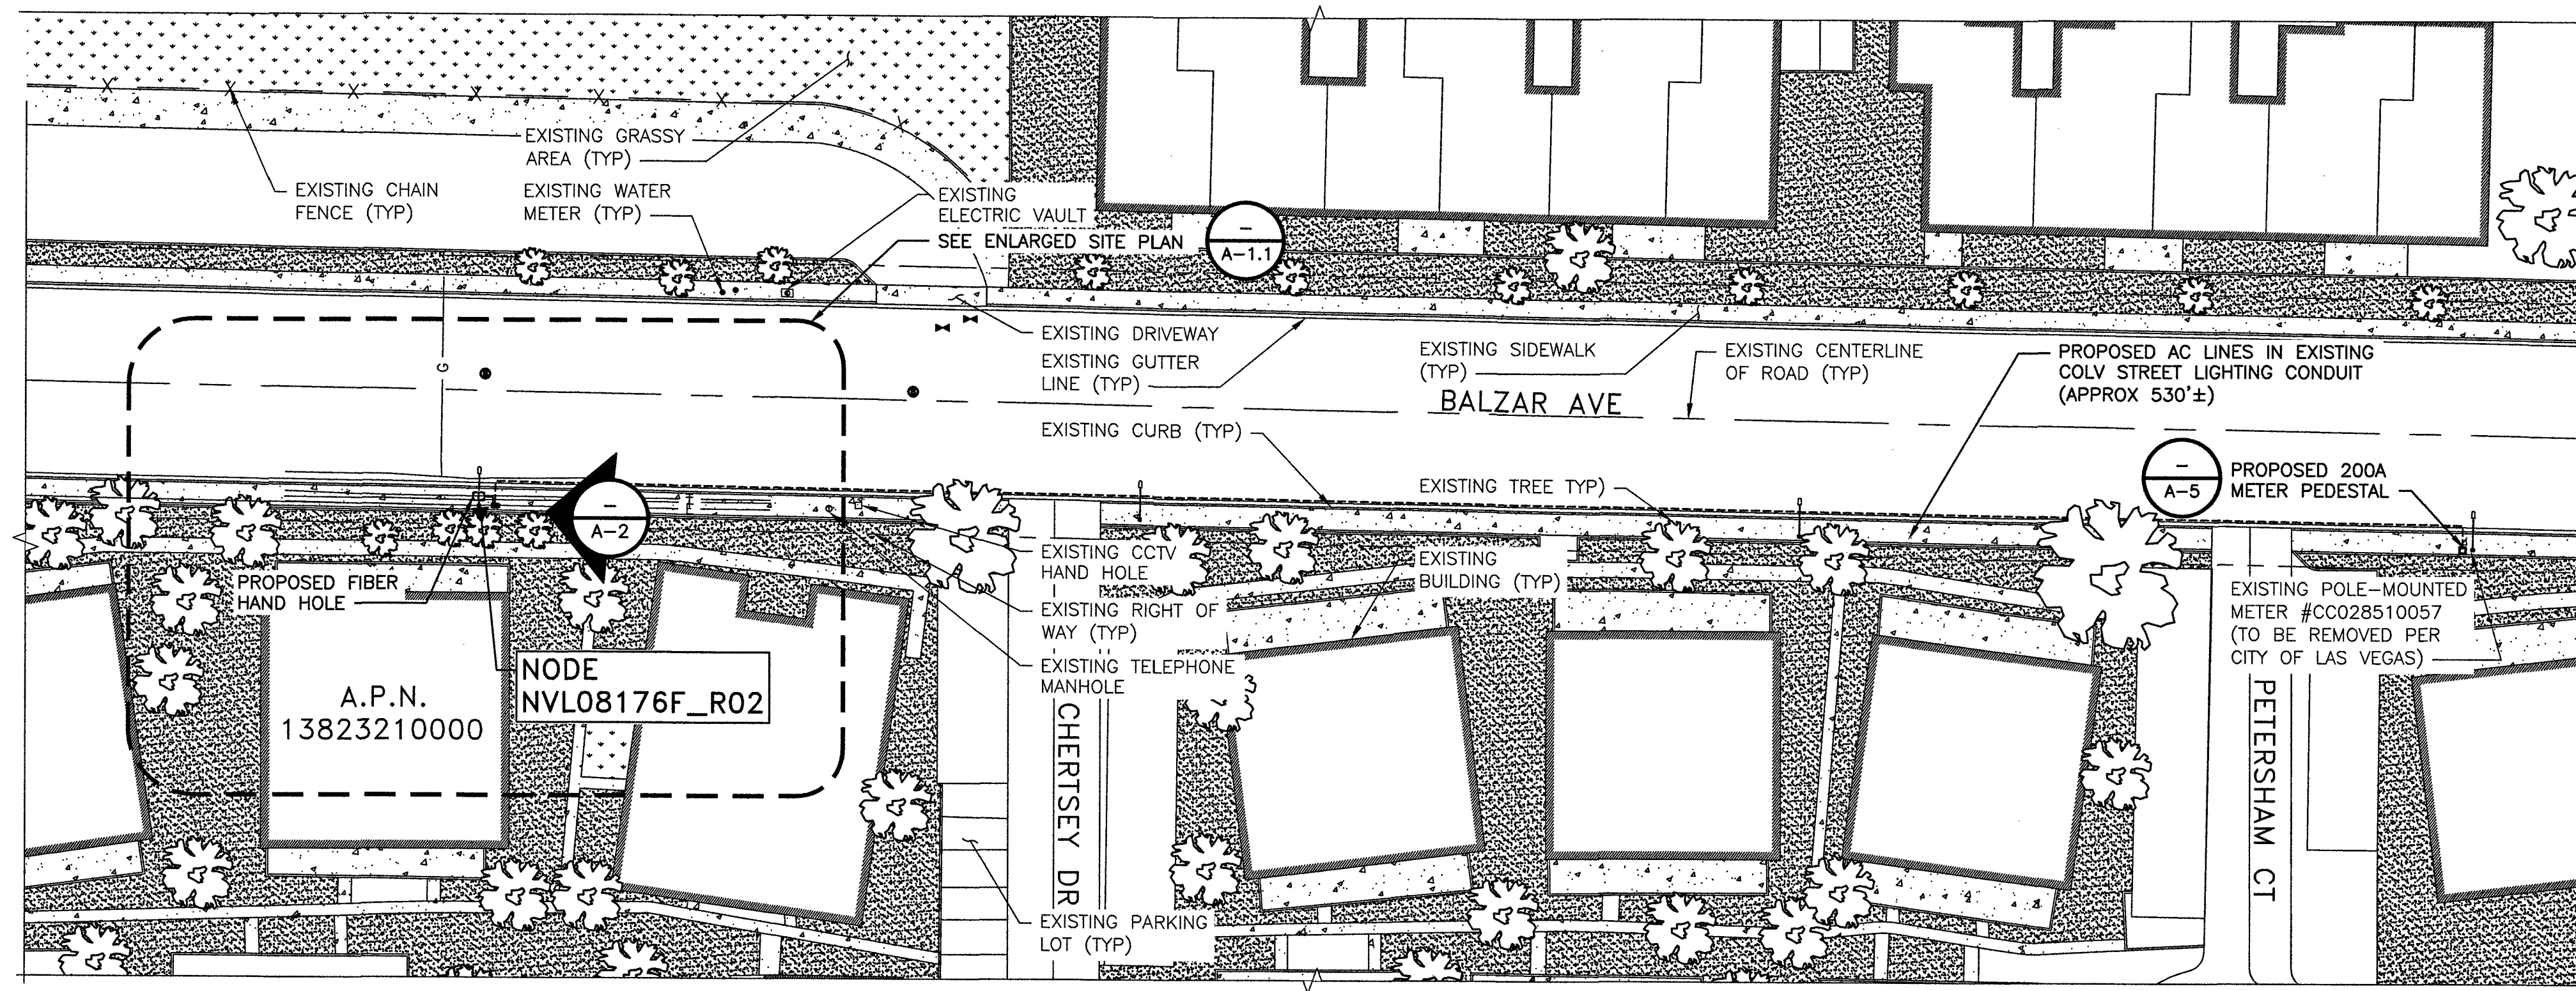

EXPANDED SITE PLAN AND UTILITY ROUTE

32' 24' 16" 8' 0' 32' 64'
1/32"=1'-0"

A

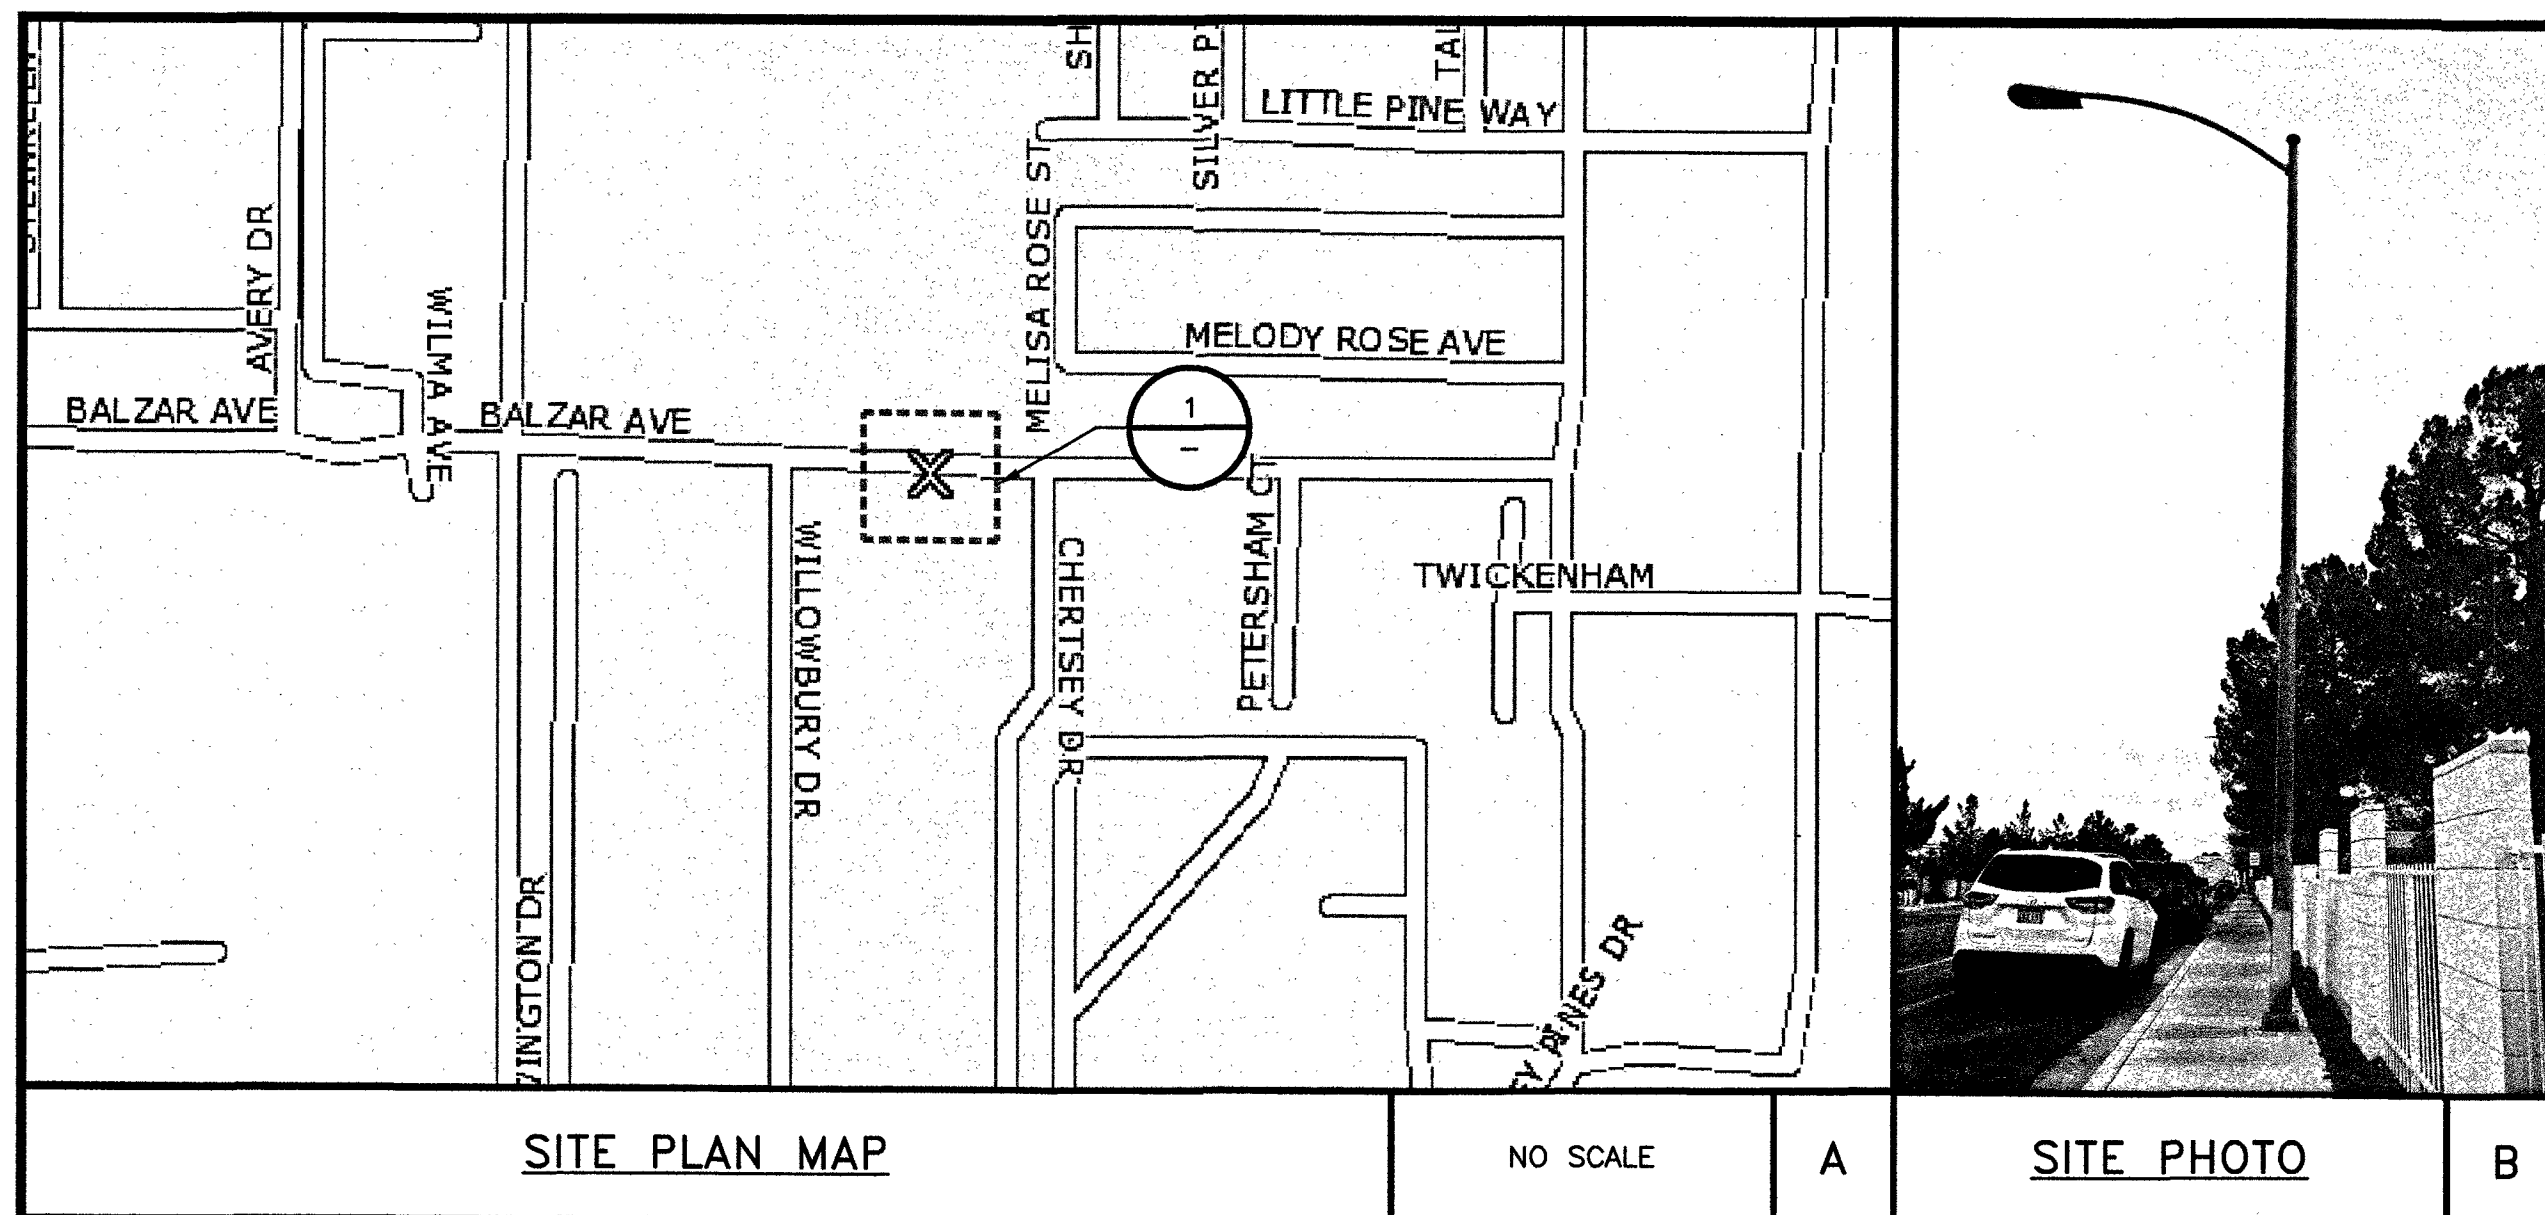

THIS DRAWING IS NOT A SITE SURVEY

THE PURPOSE OF THIS DRAWING IS TO SHOW HOW THE DEVELOPED SITE RELATES TO THE PARENT PARCEL AND ADJACENT PROPERTIES. R.O.W. MEASUREMENTS ARE APPROXIMATIONS.

at&t

AT&T MOBILITY
10550 W. CHARLESTON
SUITE B
LAS VEGAS, NV 89135

BLACK & VEATCH

BLACK & VEATCH CORPORATION
8965 S EASTERN AVE
SUITE #325
LAS VEGAS, NV 89123

PROJECT NO: 129084.1501
DRAWN BY: SAL
CHECKED BY: GAC

REV	DATE	DESCRIPTION
0	04/01/19	ISSUED FOR CONSTRUCTION


PROFESSIONAL ENGINEER - STATE OF NEVADA
ROSEY A. [Signature]
No. 023084
04/02/2019




IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

NVL08176F_R02
ADJACENT TO
BALZAR & WILLOWBURY DR
LAS VEGAS, NV 89108
PICO SMALL CELL


SHEET TITLE
ENLARGED SITE PLAN

SHEET NUMBER
A-1.1

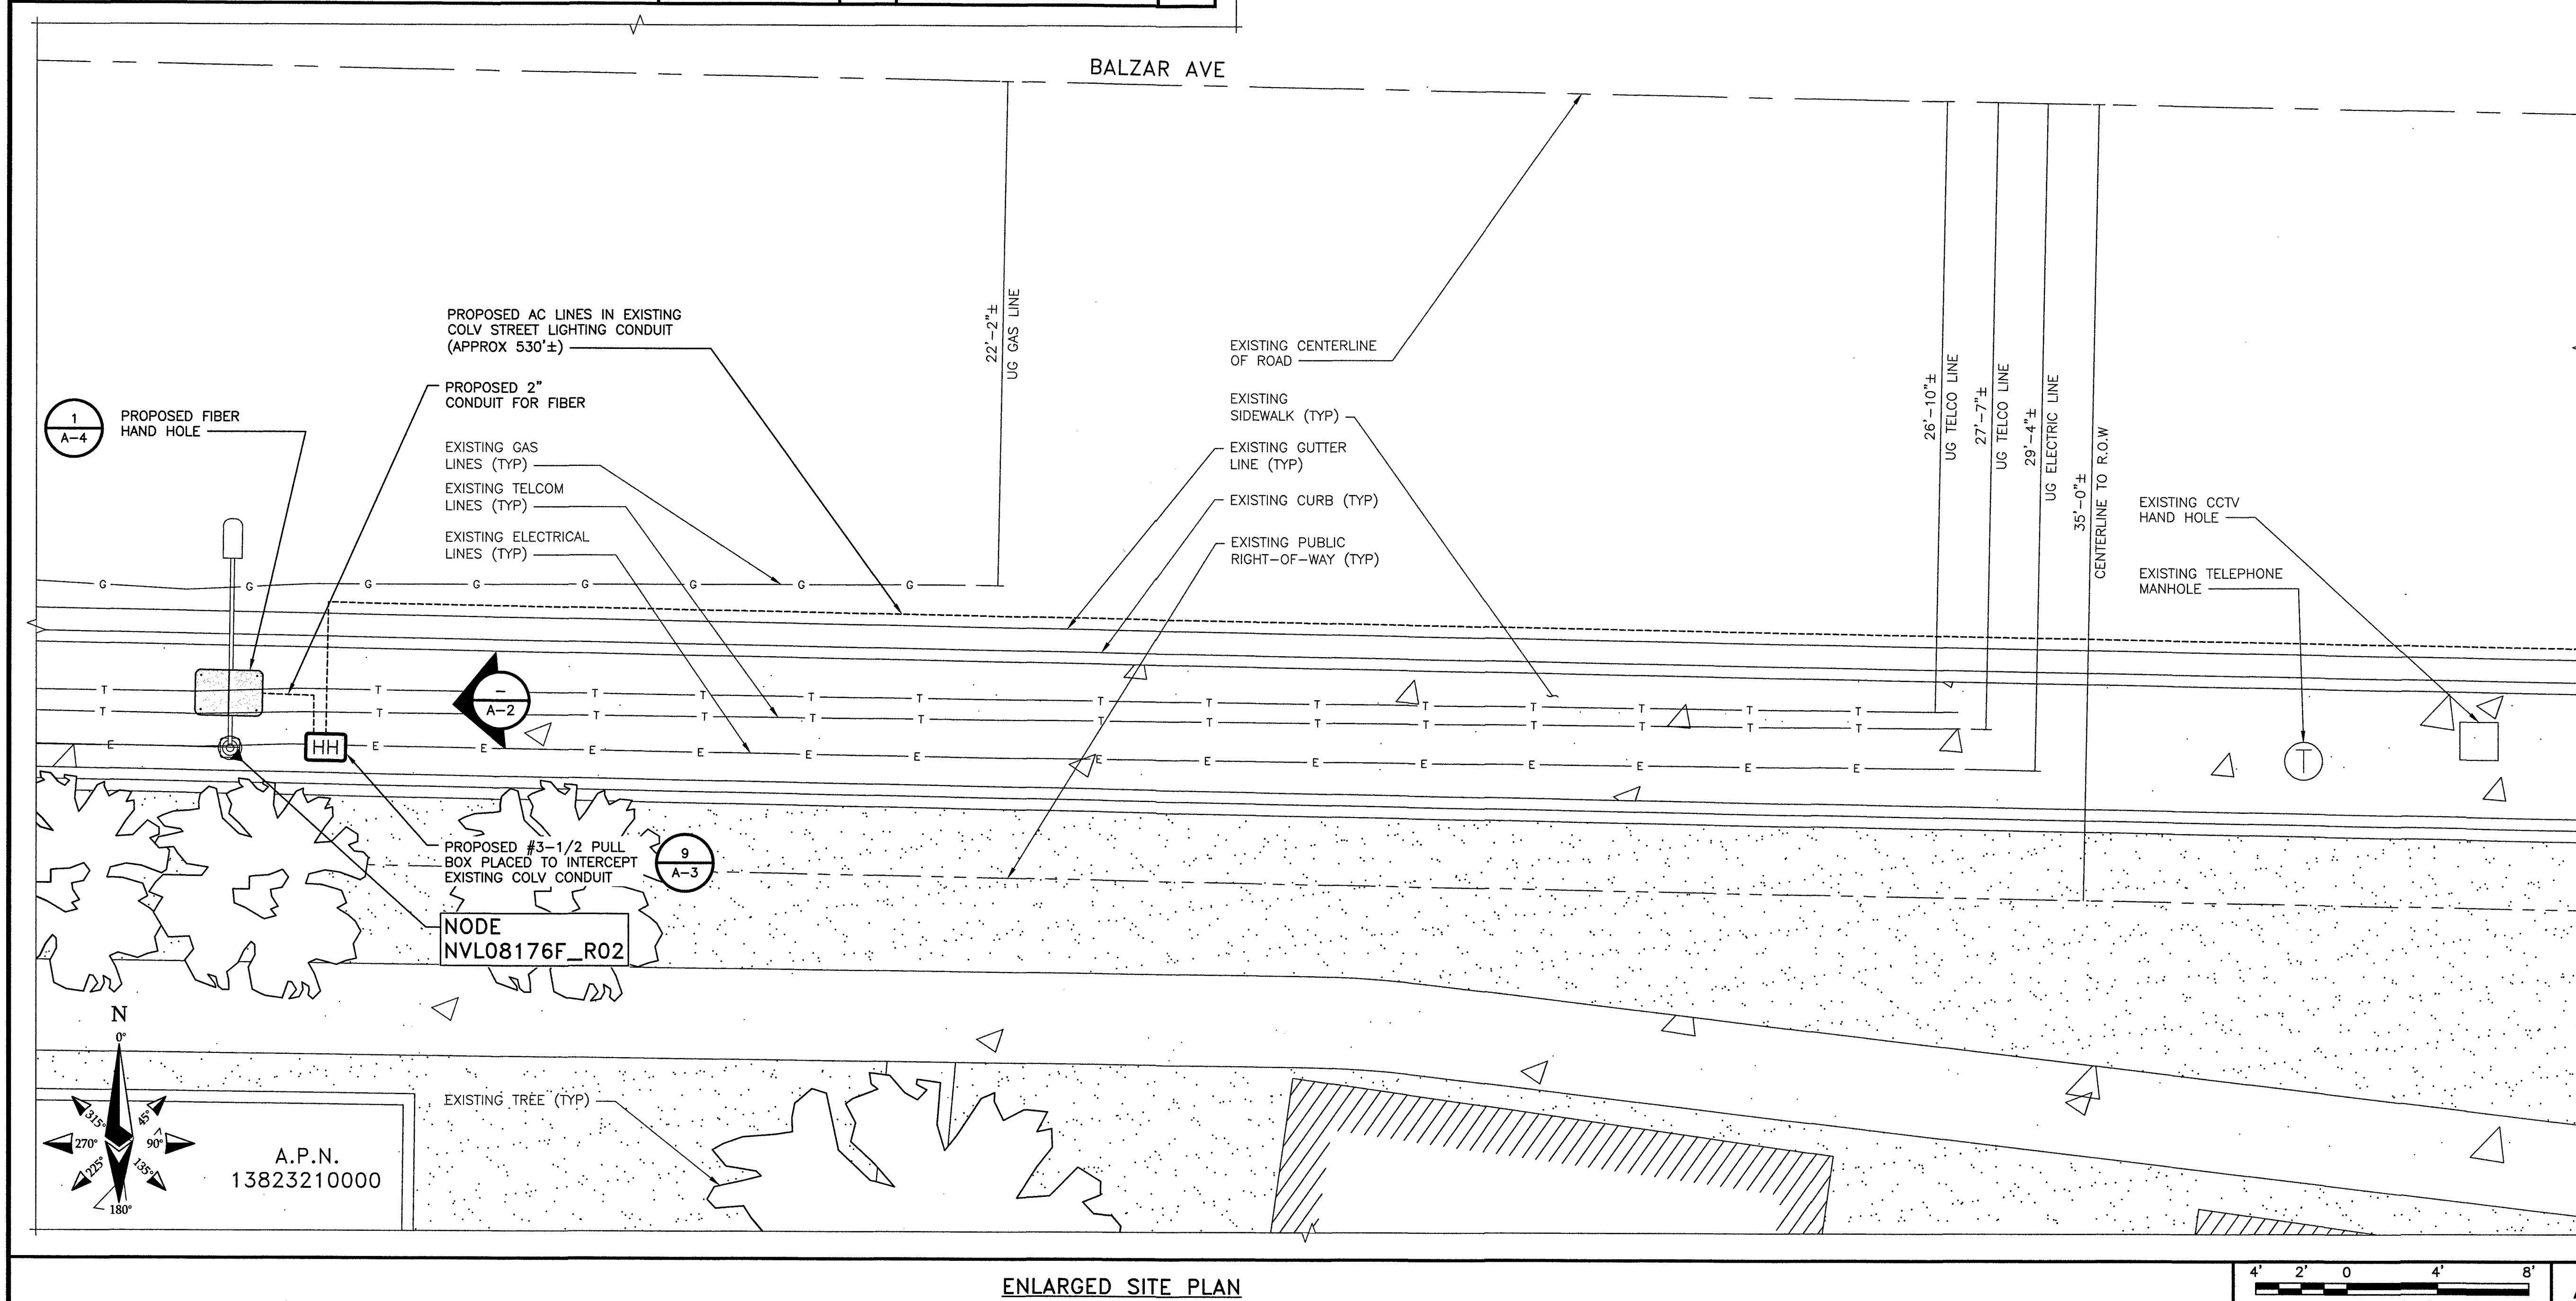

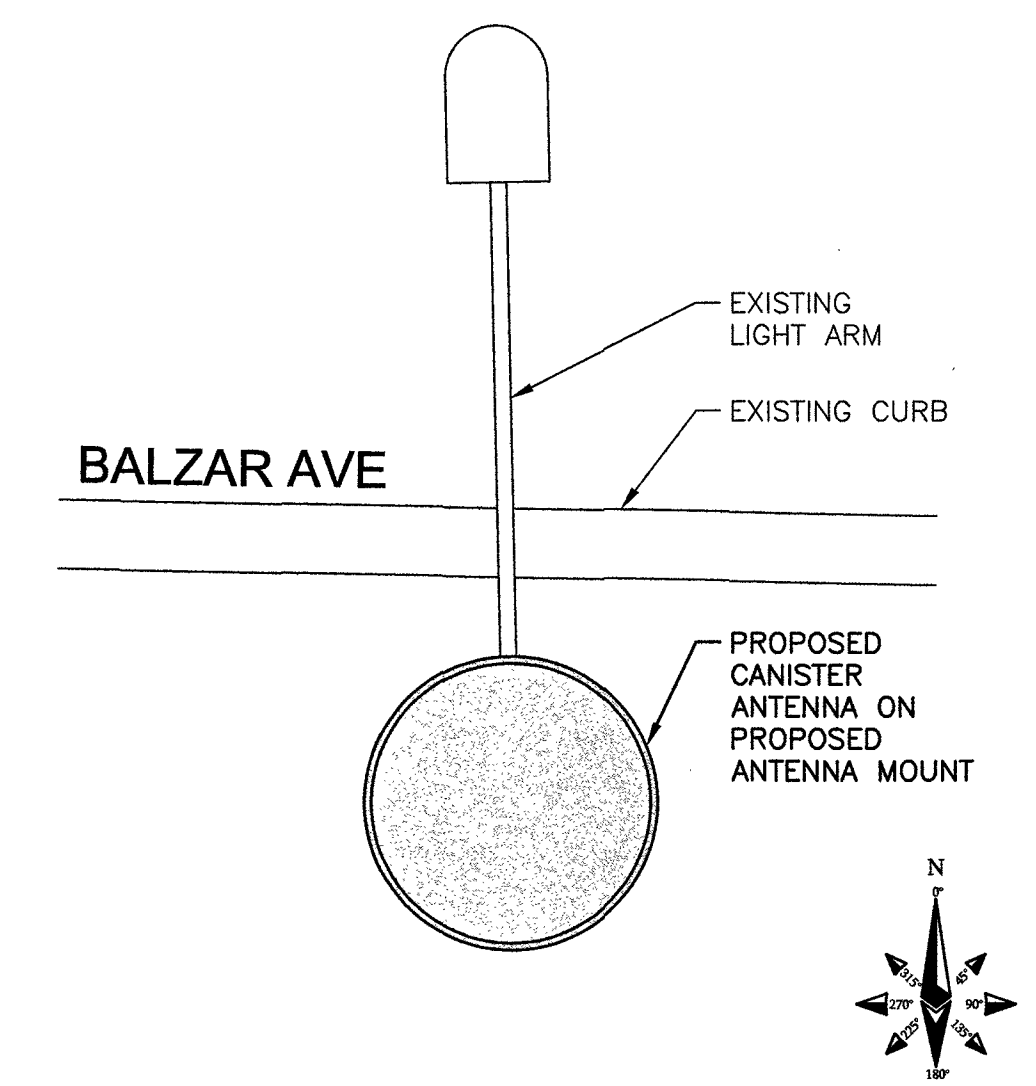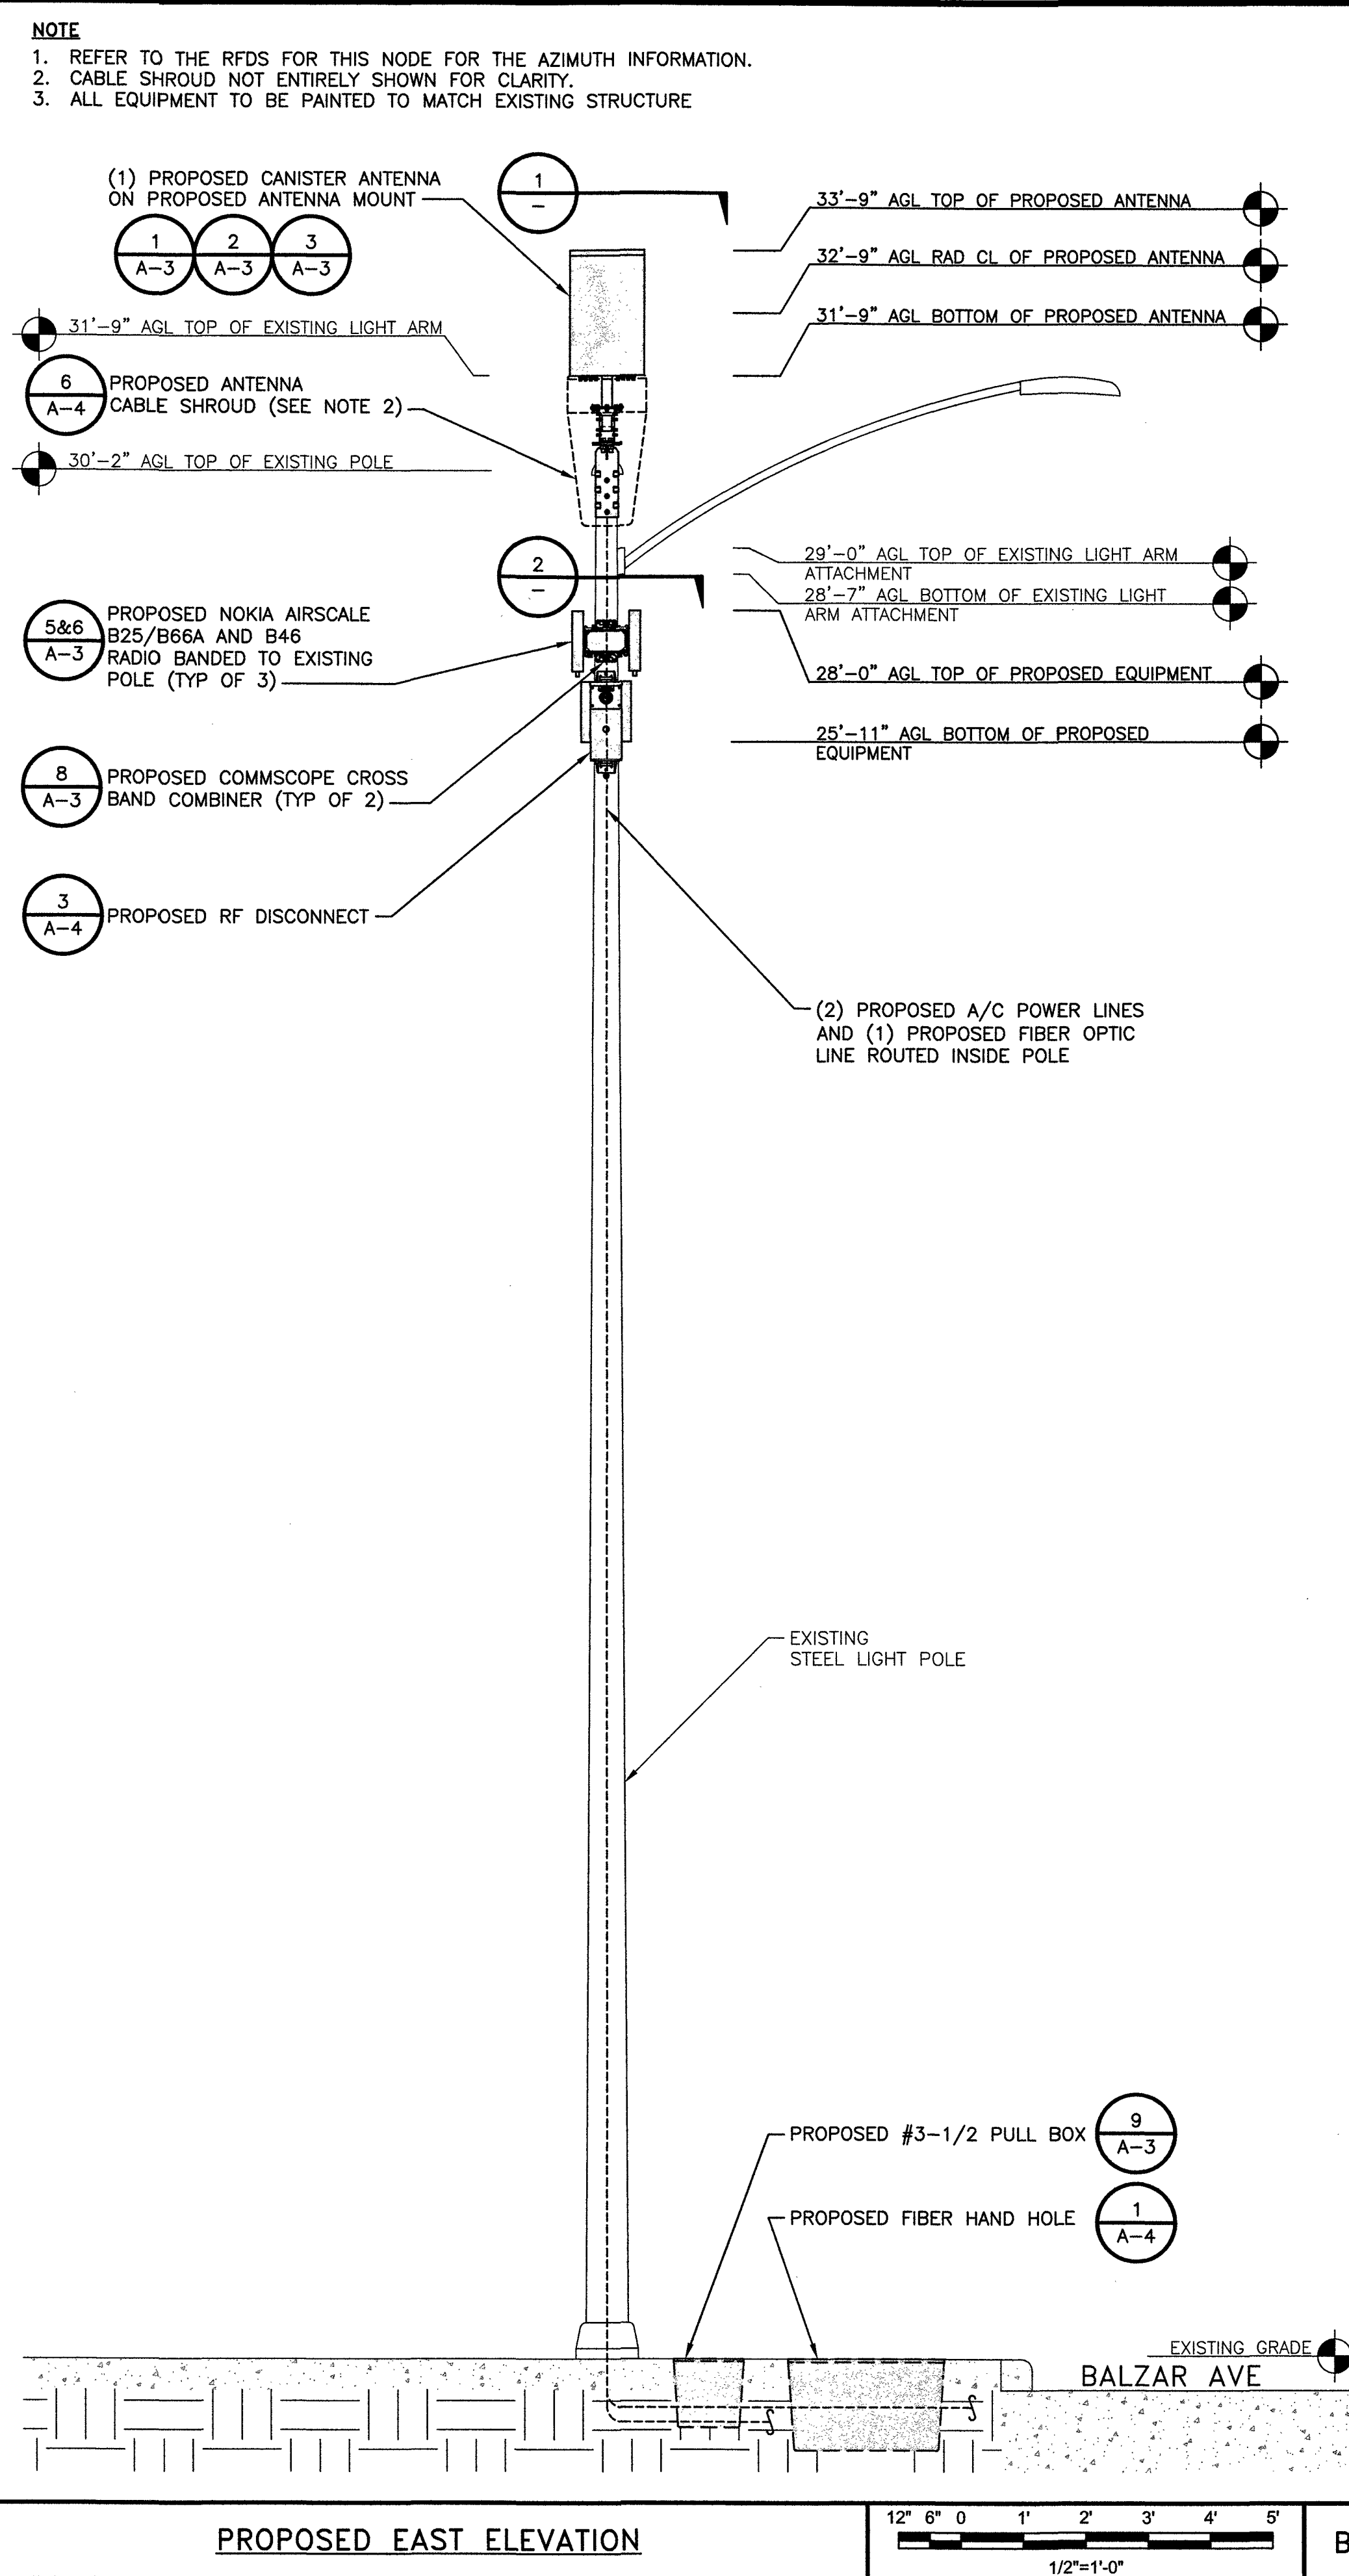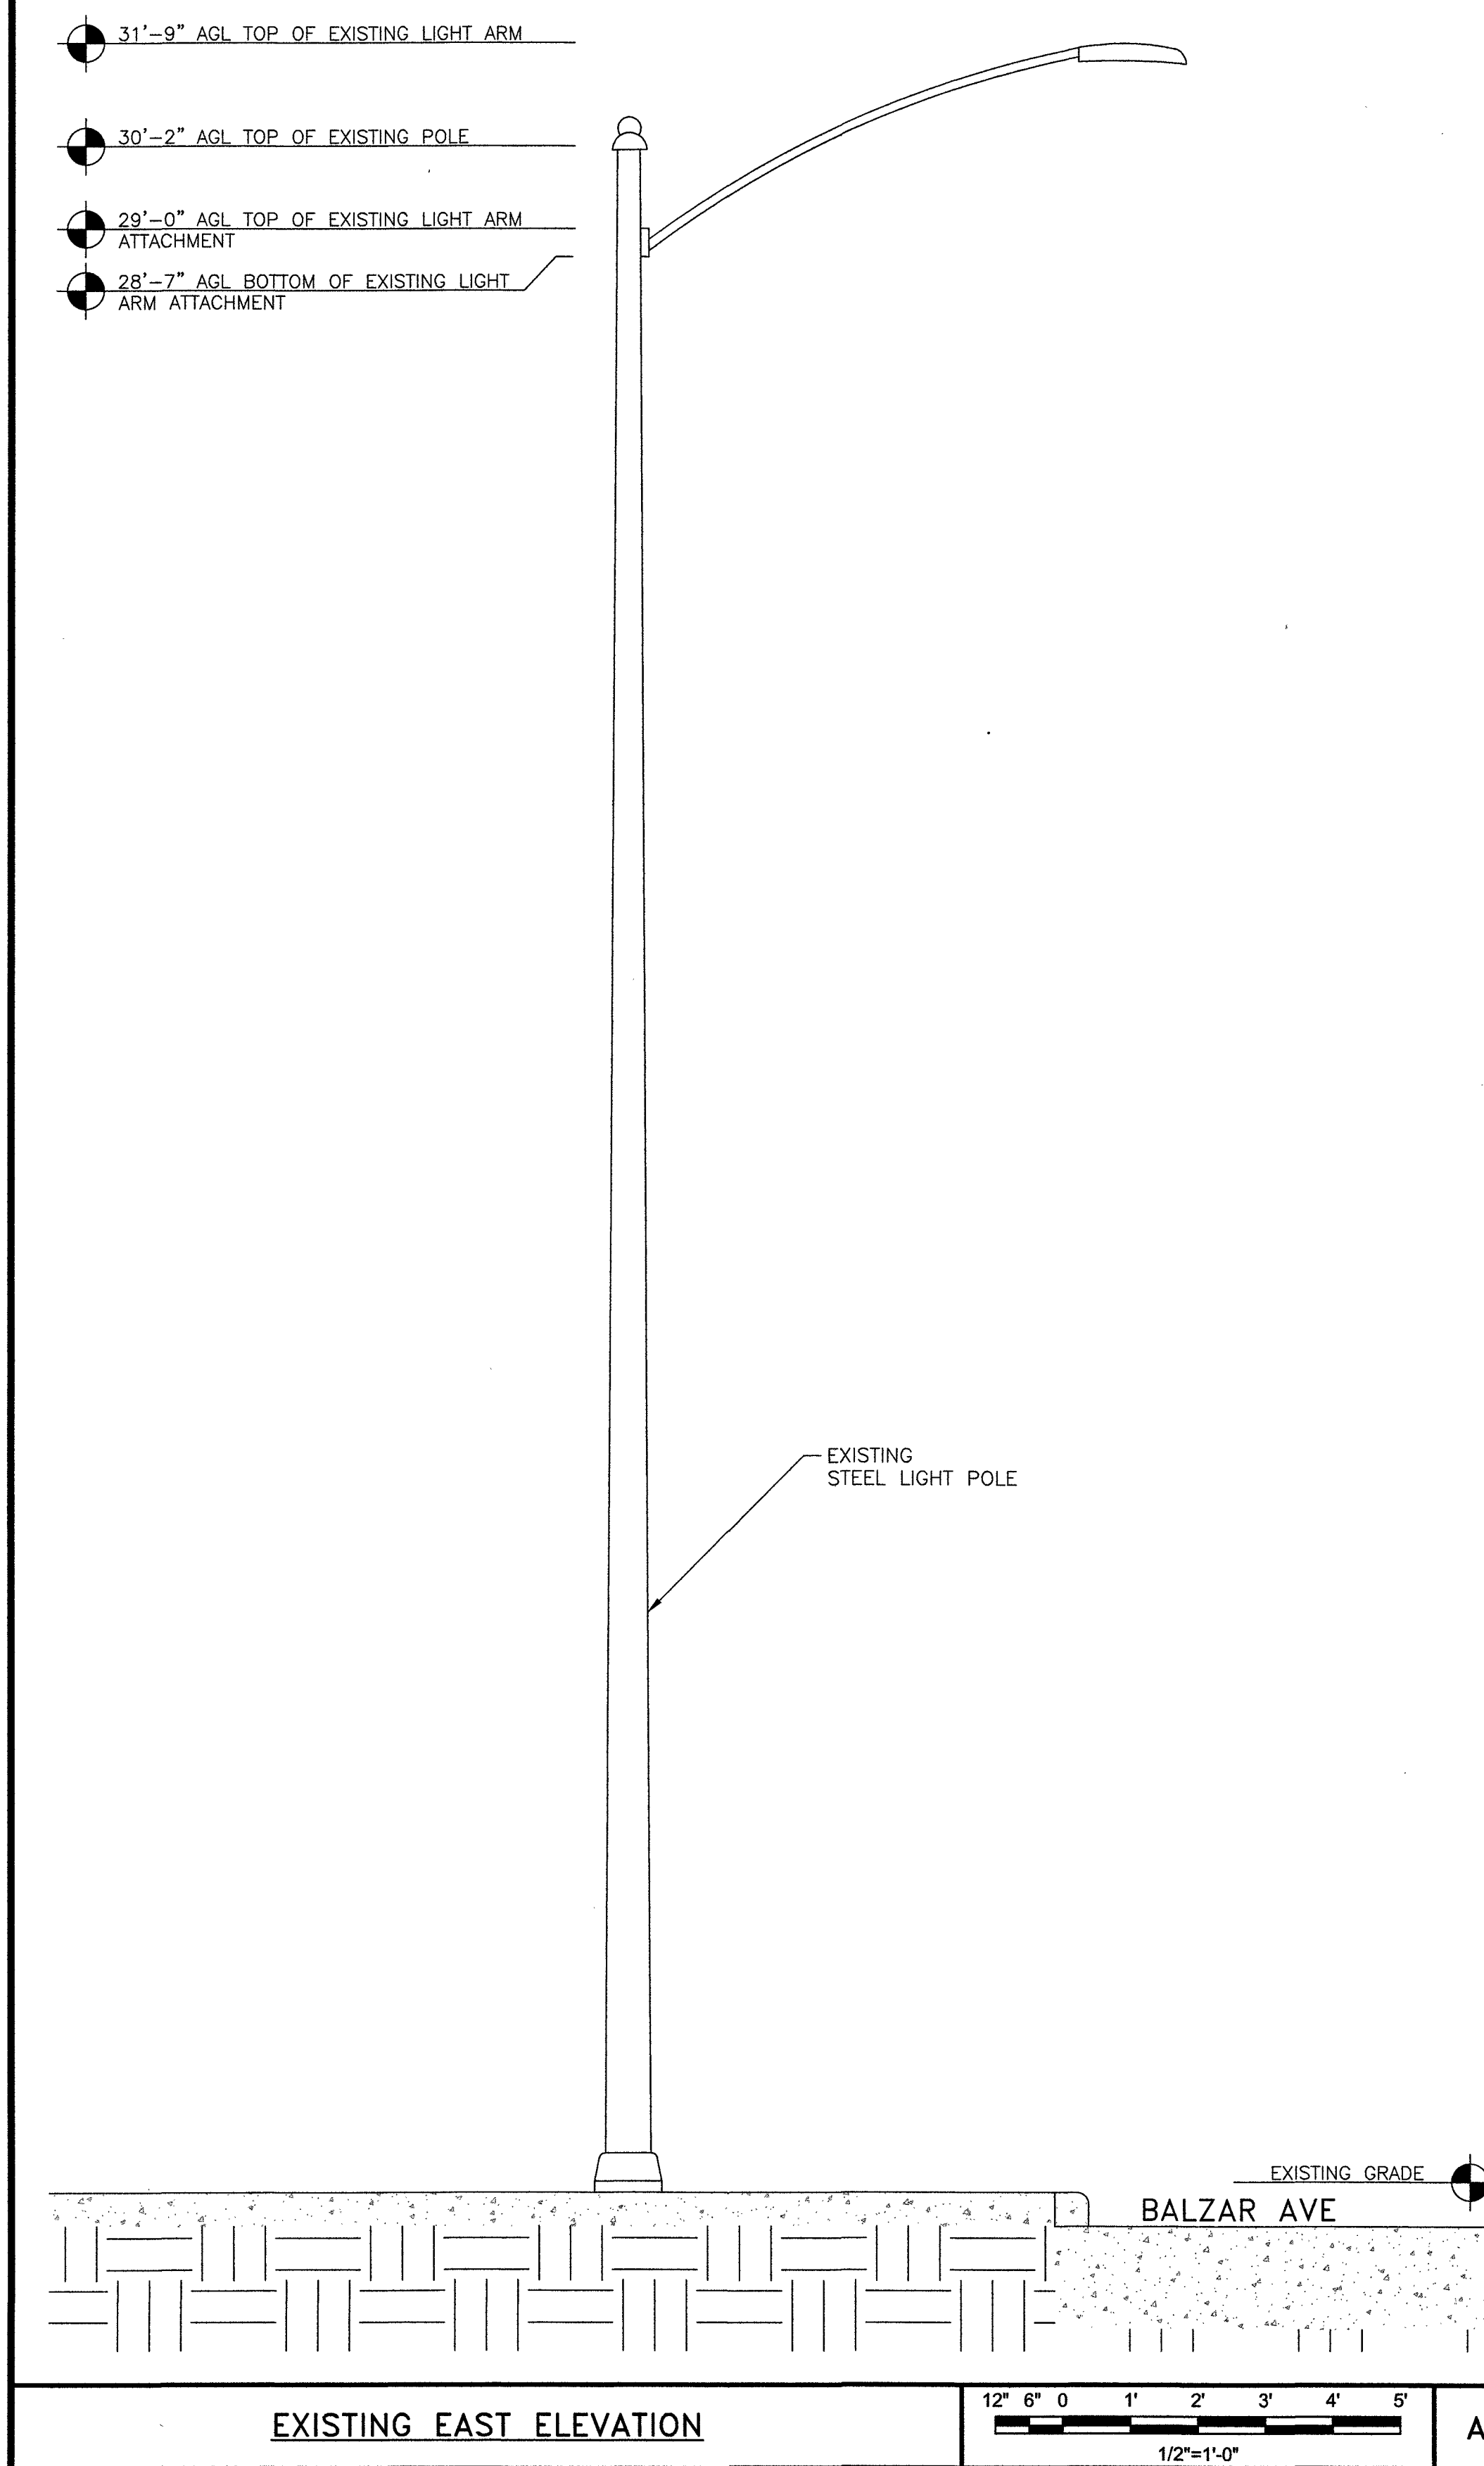

ANTENNA PLAN VIEW NO SCALE 1

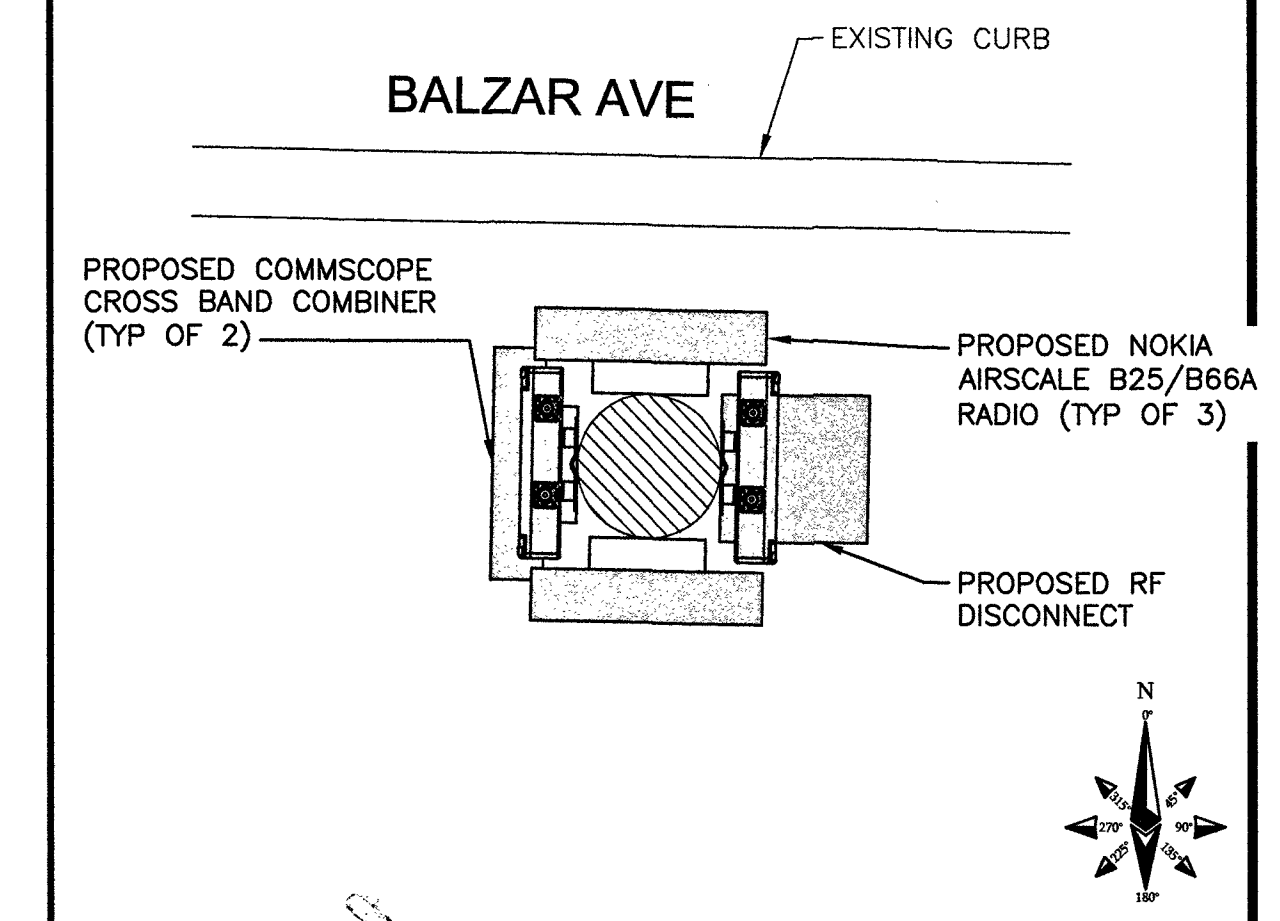

RADIO PLAN VIEW NO SCALE 2



NOT USED NO SCALE 3

AT&T MOBILITY
 10550 W. CHARLESTON
 SUITE B
 LAS VEGAS, NV 89135

BLACK & VEATCH CORPORATION
 8965 S EASTERN AVE
 SUITE #325
 LAS VEGAS, NV 89123

PROJECT NO:	129084.1501
DRAWN BY:	SAL
CHECKED BY:	GAC

REV	DATE	DESCRIPTION
0	04/01/19	ISSUED FOR CONSTRUCTION

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

NVL08176F_R02
 ADJACENT TO
 BALZAR & WILLOWBURY DR
 LAS VEGAS, NV 89108
 PICO SMALL CELL

SHEET TITLE
 POLE ELEVATIONS AND
 RISER DETAILS

SHEET NUMBER
A-2

FCA243624T-00006 FIBERGLASS/PCX POLYMER CONCRETE ASSEMBLY


DIMENSIONS (LxWxH): 36"x24"x24"
INTERIOR DIMENSIONS (LxWxH): 33"x21"x21"

- USDA/RUS APPROVED
- DROP-IN NAMEPLATE
- SHIPPED ASSEMBLED
- SKID RESISTANT COVER
- STAINLESS STEEL BOLTS
- CAST-IN FLOATING NUT BOX
- INTEGRAL DRAIN HOLES

LOAD RATINGS:
INCIDENTAL TRAFFIC - PARKING LOT, SIDEWALK

CONFORMS TO:
• WUC 3.6
• ASTM C 857
• ANSI/SCTE 77 - "T15/20K"

INSIDE DIMENSIONS		
Length	Width	Depth
33 1/8"	21 1/2"	21"
43 7/8"	32 3/8"	

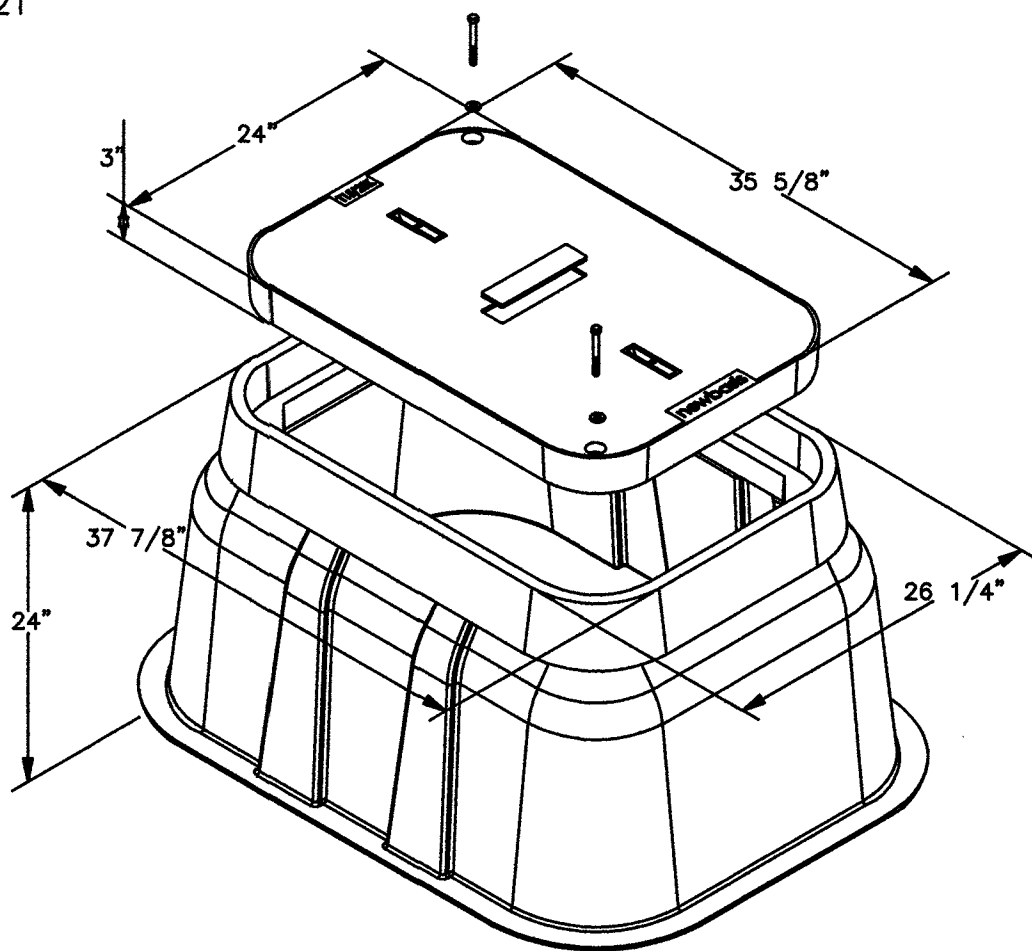

HAND HOLE SPECIFICATIONS

NO SCALE

1

NOT USED


NO SCALE

2

LOAD CENTER DETAIL

NO SCALE

3

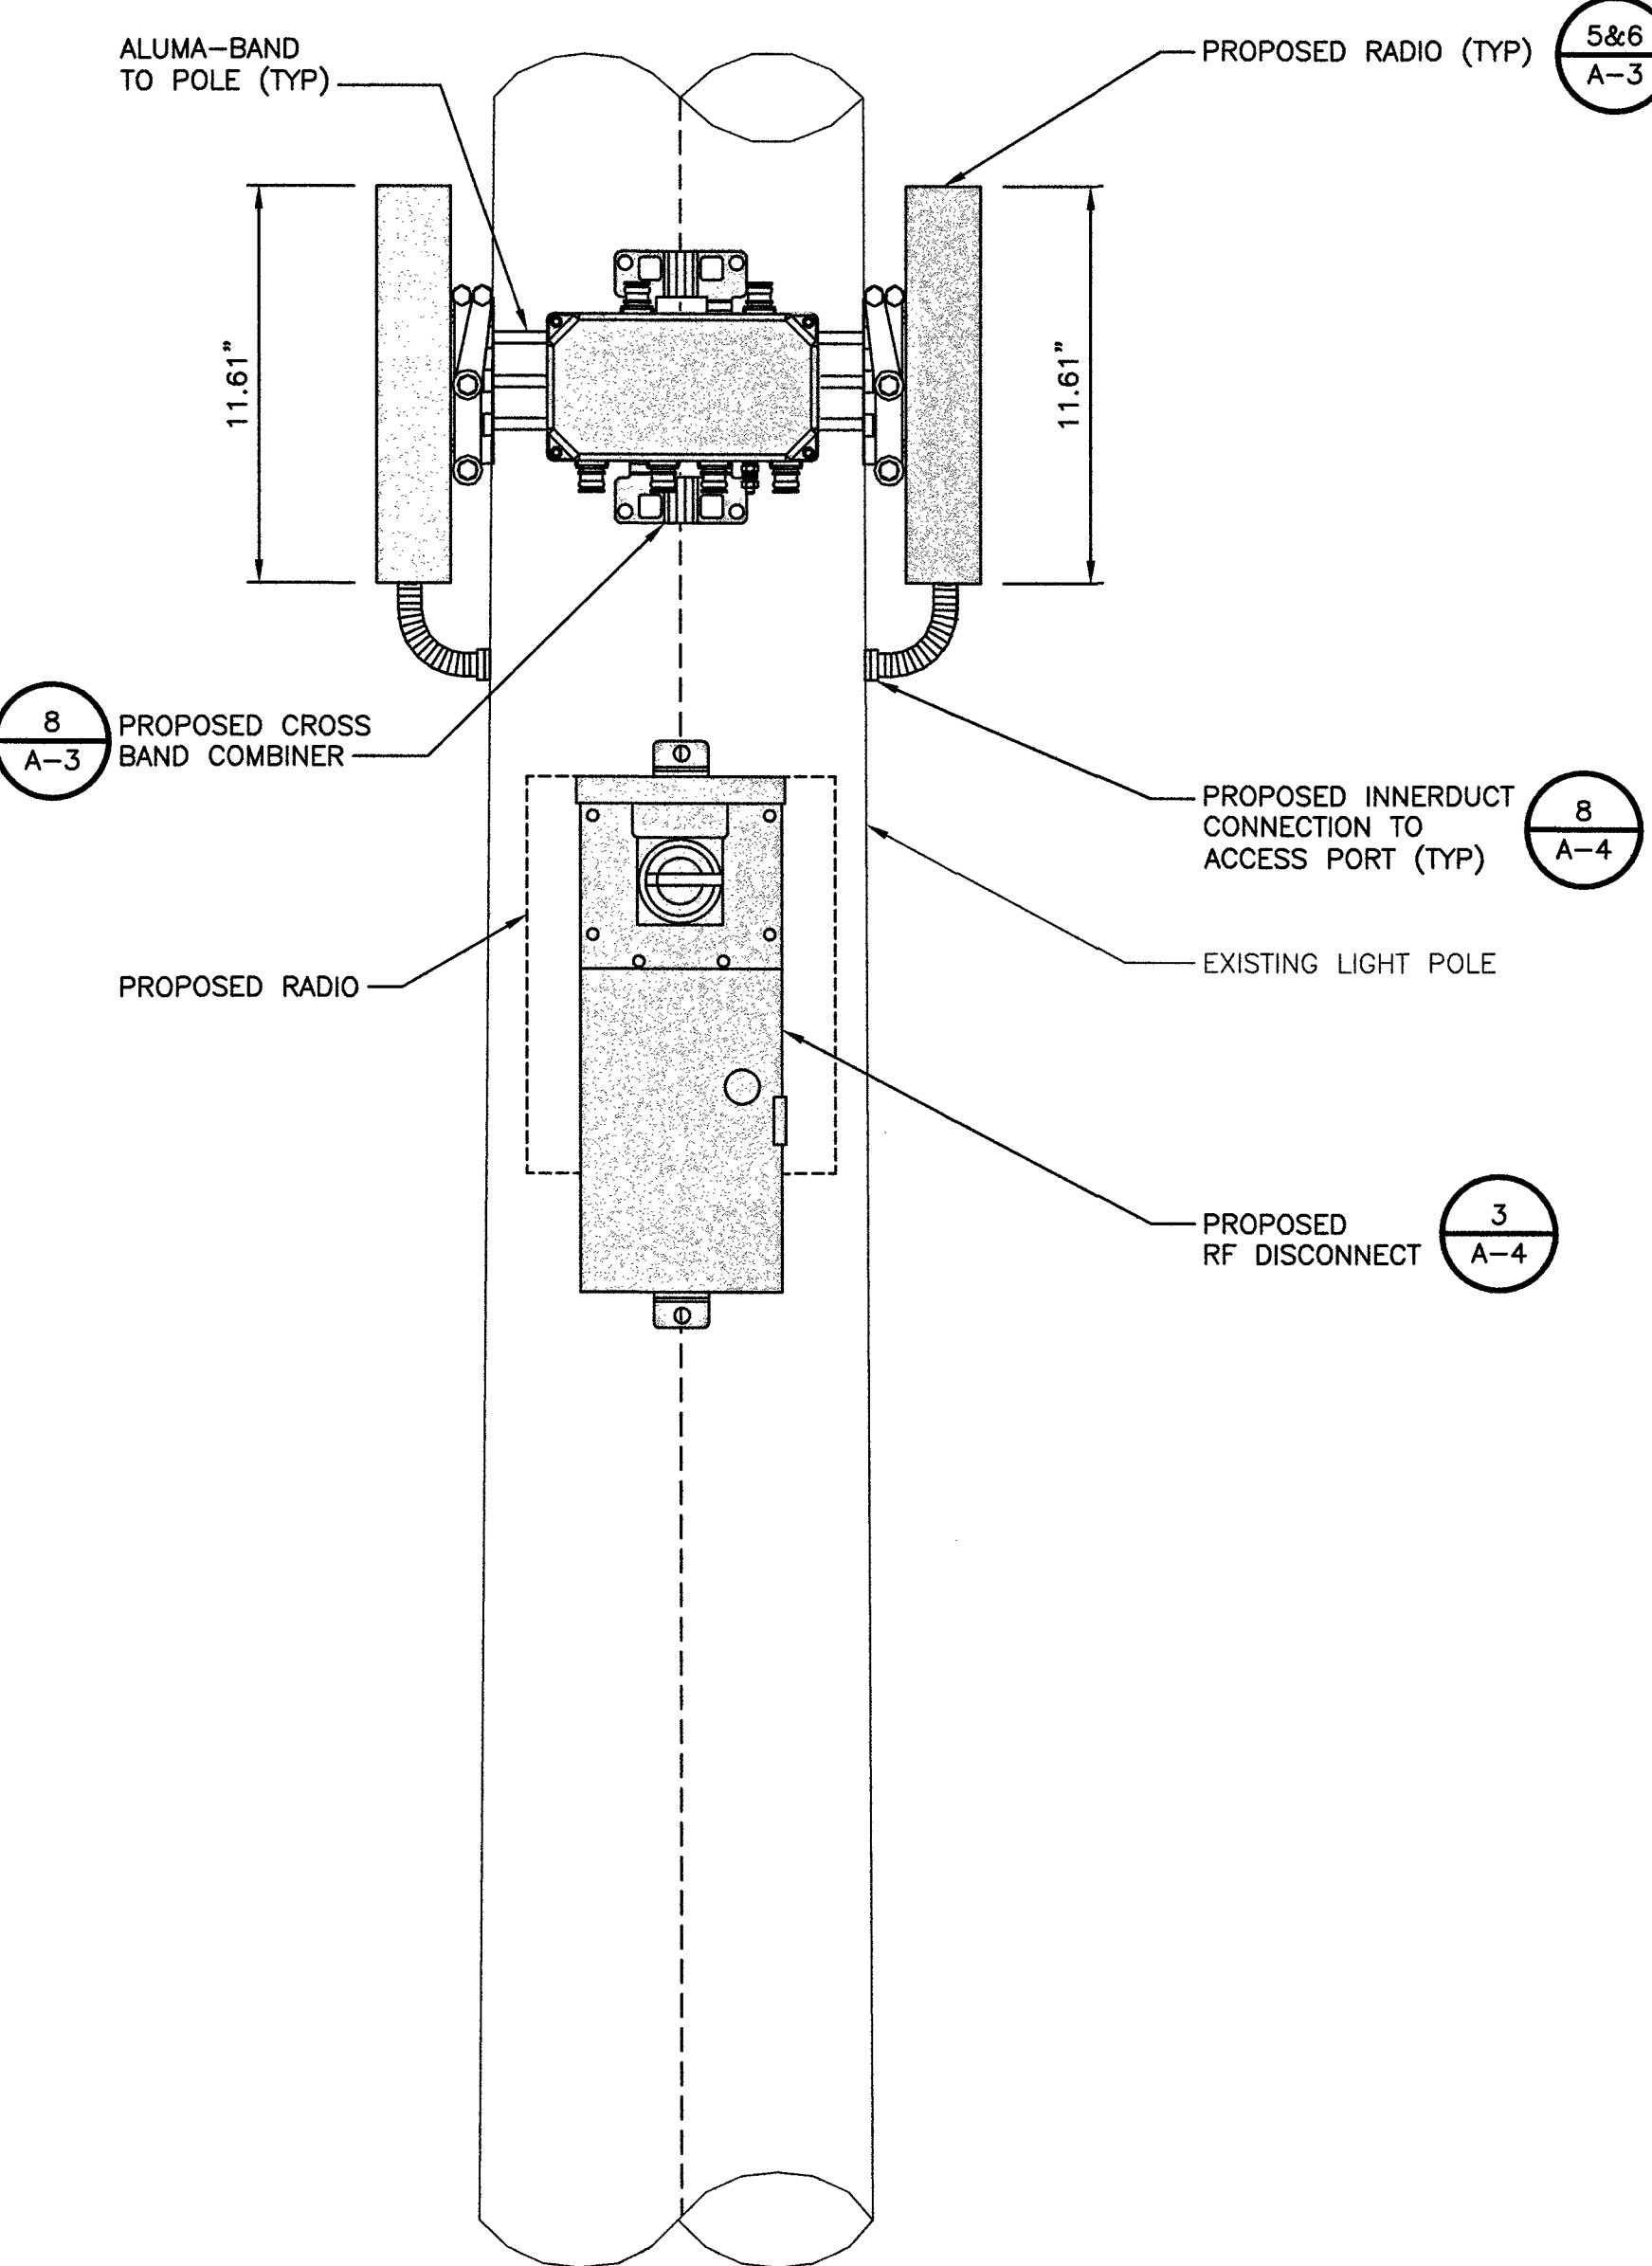

EQUIPMENT PLACEMENT DETAIL

NO SCALE

4

NOT USED


NO SCALE

7

PACTECHSOL PTS90123

DIMENSIONS, HxWxD (VOLUME): 16.15"x6.68"x6.285" (0.39ft³)
OPERATING VOLTAGE: 120 VAC
MAIN BREAKER: 60 amps
NUMBER OF BREAKERS (MAX): (5) UL-489 BREAKERS;
0-25 amp; DUAL SPD
POWER INPUT WIRE SIZE: #14-#4 awg CU-AI
POWER OUTPUT WIRE SIZE: #14-#4 awg CU-AI
NEUTRAL & GROUND CONTACTS: #14-#4 AWG CU-AI
TOTAL WEIGHT: 13 lbs


BOLT PIN		POSITION		DESCRIPTION		STANDARD		MATERIAL	
PT90123	1	A	A	A	A	PT	PT	PT	PT
PT90123	2	A	A	A	A	PT	PT	PT	PT
PT90123	3	A	A	A	A	PT	PT	PT	PT
PT90123	4	A	A	A	A	PT	PT	PT	PT
PT90123	5	A	A	A	A	PT	PT	PT	PT
PT90123	6	A	A	A	A	PT	PT	PT	PT
PT90123	7	A	A	A	A	PT	PT	PT	PT
PT90123	8	A	A	A	A	PT	PT	PT	PT
PT90123	9	A	A	A	A	PT	PT	PT	PT
PT90123	10	A	A	A	A	PT	PT	PT	PT
PT90123	11	A	A	A	A	PT	PT	PT	PT
PT90123	12	A	A	A	A	PT	PT	PT	PT
PT90123	13	A	A	A	A	PT	PT	PT	PT
PT90123	14	A	A	A	A	PT	PT	PT	PT
PT90123	15	A	A	A	A	PT	PT	PT	PT
PT90123	16	A	A	A	A	PT	PT	PT	PT
PT90123	17	A	A	A	A	PT	PT	PT	PT
PT90123	18	A	A	A	A	PT	PT	PT	PT
PT90123	19	A	A	A	A	PT	PT	PT	PT
PT90123	20	A	A	A	A	PT	PT	PT	PT
PT90123	21	A	A	A	A	PT	PT	PT	PT
PT90123	22	A	A	A	A	PT	PT	PT	PT
PT90123	23	A	A	A	A	PT	PT	PT	PT
PT90123	24	A	A	A	A	PT	PT	PT	PT
PT90123	25	A	A	A	A	PT	PT	PT	PT
PT90123	26	A	A	A	A	PT	PT	PT	PT
PT90123	27	A	A	A	A	PT	PT	PT	PT
PT90123	28	A	A	A	A	PT	PT	PT	PT
PT90123	29	A	A	A	A	PT	PT	PT	PT
PT90123	30	A	A	A	A	PT	PT	PT	PT
PT90123	31	A	A	A	A	PT	PT	PT	PT
PT90123	32	A	A	A	A	PT	PT	PT	PT
PT90123	33	A	A	A	A	PT	PT	PT	PT
PT90123	34	A	A	A	A	PT	PT	PT	PT
PT90123	35	A	A	A	A	PT	PT	PT	PT
PT90123	36	A	A	A	A	PT	PT	PT	PT
PT90123	37	A	A	A	A	PT	PT	PT	PT
PT90123	38	A	A	A	A	PT	PT	PT	PT
PT90123	39	A	A	A	A	PT	PT	PT	PT
PT90123	40	A	A	A	A	PT	PT	PT	PT
PT90123	41	A	A	A	A	PT	PT	PT	PT
PT90123	42	A	A	A	A	PT	PT	PT	PT
PT90123	43	A	A	A	A	PT	PT	PT	PT
PT90123	44	A	A	A	A	PT	PT	PT	PT
PT90123	45	A	A	A	A	PT	PT	PT	PT
PT90123	46	A	A	A	A	PT	PT	PT	PT
PT90123	47	A	A	A	A	PT	PT	PT	PT
PT90123	48	A	A	A	A	PT	PT	PT	PT
PT90123	49	A	A	A	A	PT	PT	PT	PT
PT90123	50	A	A	A	A	PT	PT	PT	PT
PT90123	51	A	A	A	A	PT	PT	PT	PT
PT90123	52	A	A	A	A	PT	PT	PT	PT
PT90123	53	A	A	A	A	PT	PT	PT	PT
PT90123	54	A	A	A	A	PT	PT	PT	PT
PT90123	55	A	A	A	A	PT	PT	PT	PT
PT90123	56	A	A	A	A	PT	PT	PT	PT
PT90123	57	A	A	A	A	PT	PT	PT	PT
PT90123	58	A	A	A	A	PT	PT	PT	PT
PT90123	59	A	A	A	A	PT	PT	PT	PT
PT90123	60	A	A	A	A	PT	PT	PT	PT
PT90123	61	A	A	A	A	PT	PT	PT	PT
PT90123	62	A	A	A	A	PT	PT	PT	PT
PT90123	63	A	A	A	A	PT	PT	PT	PT
PT90123	64	A	A	A	A	PT	PT	PT	PT
PT90123	65	A	A	A	A	PT	PT	PT	PT
PT90123	66	A	A	A	A	PT	PT	PT	PT
PT90123	67	A	A	A	A	PT	PT	PT	PT
PT90123	68	A	A	A	A	PT	PT	PT	PT
PT90123	69	A	A	A	A	PT	PT	PT	PT
PT90123	70	A	A	A	A	PT	PT	PT	PT
PT90123	71	A	A	A	A	PT	PT	PT	PT
PT90123	72	A	A	A	A	PT	PT	PT	PT
PT90123	73	A	A	A	A	PT	PT	PT	PT
PT90123	74	A	A	A	A	PT	PT	PT	PT
PT90123	75	A	A	A	A	PT	PT	PT	PT
PT90123	76	A	A	A	A	PT	PT	PT	PT
PT90123	77	A	A	A	A	PT	PT	PT	PT
PT90123	78	A	A	A	A	PT	PT	PT	PT
PT90123	79	A	A	A	A	PT	PT	PT	PT
PT90123	80	A	A	A	A	PT	PT	PT	PT
PT90123	81	A	A	A	A	PT	PT	PT	PT
PT90123	82	A	A	A	A	PT	PT	PT	PT
PT90123	83	A	A	A	A	PT	PT	PT	PT
PT90123	84	A	A	A	A	PT	PT	PT	PT
PT90123	85	A	A	A	A	PT	PT	PT	PT
PT90123	86	A	A	A	A	PT	PT	PT	PT
PT90123	87	A	A	A	A	PT	PT	PT	PT
PT90123	88	A	A	A	A	PT	PT	PT	PT
PT90123	89	A	A	A	A	PT	PT	PT	PT
PT90123	90	A	A	A	A	PT	PT	PT	PT
PT90123	91	A	A	A	A	PT	PT	PT	PT
PT90123	92	A	A	A	A	PT	PT	PT	PT
PT90123	93	A	A	A	A	PT	PT	PT	PT
PT90123	94	A	A	A	A	PT	PT	PT	PT
PT90123	95	A	A	A	A	PT	PT	PT	PT
PT90123	96	A	A	A	A	PT	PT	PT	PT
PT90123	97	A	A	A	A	PT	PT	PT	PT
PT90123	98	A	A	A	A	PT	PT	PT	PT
PT90123	99	A	A	A	A	PT	PT	PT	PT
PT90123	100	A	A	A	A	PT	PT	PT	PT

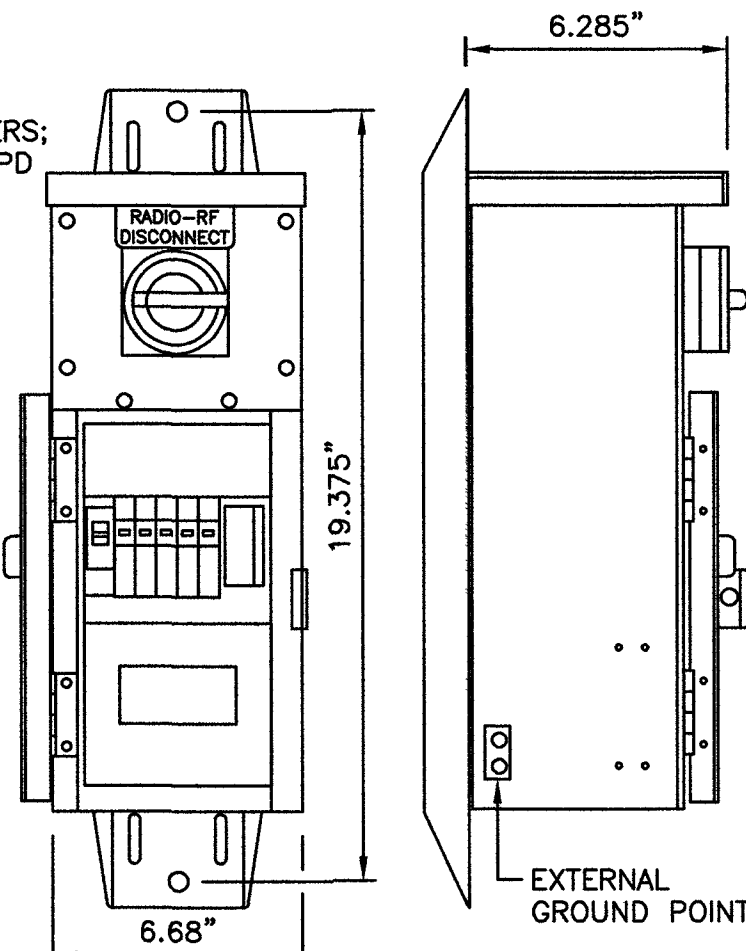

CONCEALFAB 900086

HEIGHT: 28.75" (703.25 mm)
DIAMETER: 15.25" (387.35 mm)
WEIGHT: 6.95 lbs (3.15 kg)

* DETAIL IS FOR GRAPHIC REPRESENTATION, CONTRACTOR MUST REFERENCE MANUFACTURERS DRAWINGS PRIOR TO CONSTRUCTION.

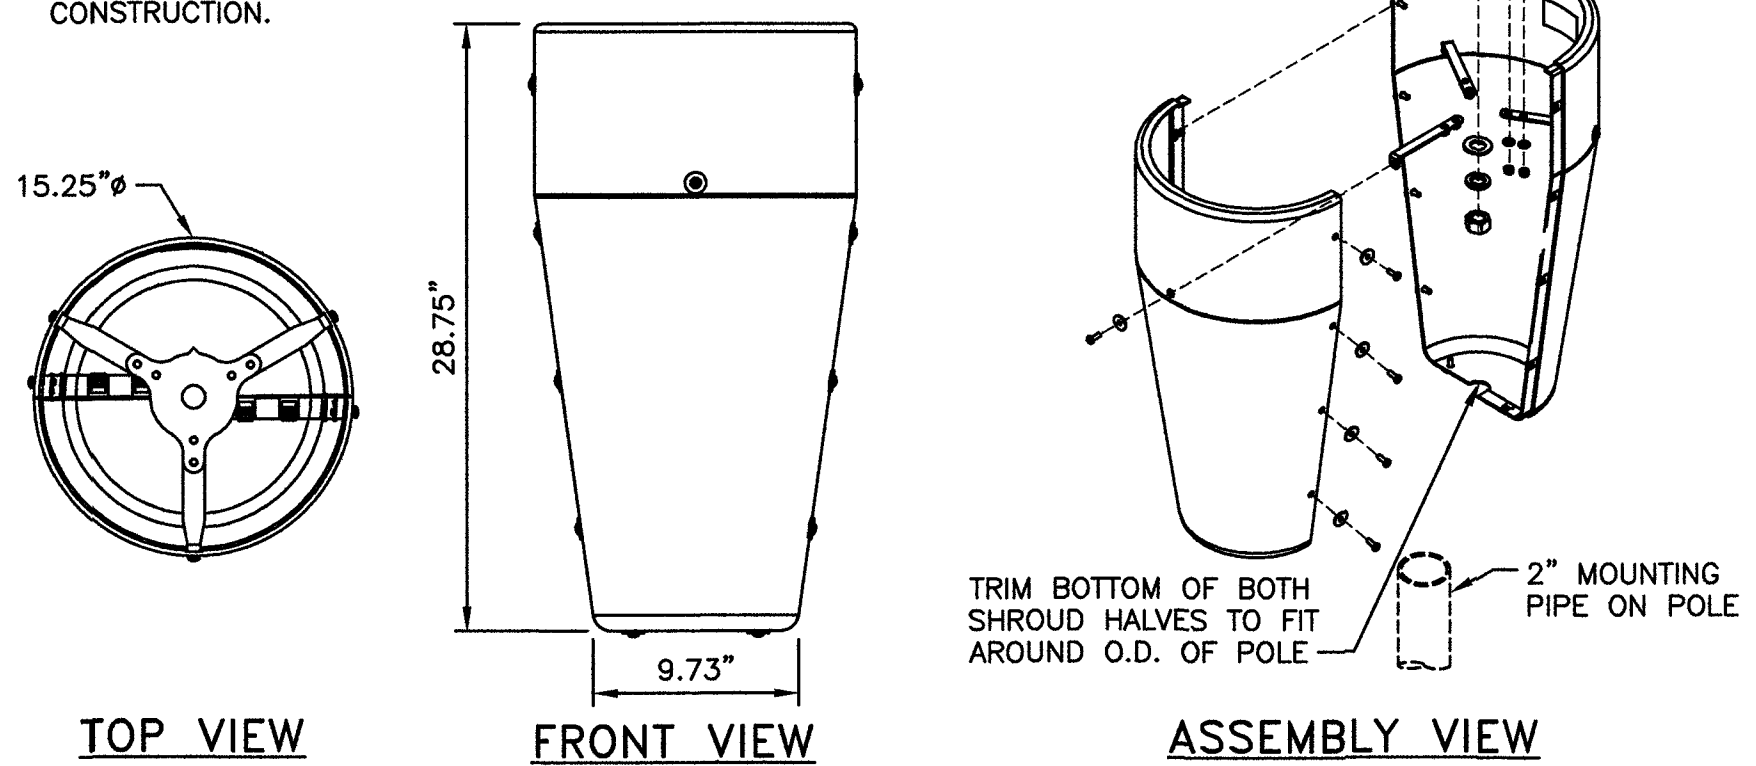

TOP VIEW

FRONT VIEW

ASSEMBLY VIEW

NOT USED

NO SCALE

5


POLE TOP MOUNT CABLE SHROUD

NO SCALE

6

MINIMUM SIZE OF FILLET WELDS	
MATERIAL THICKNESS OF THICKER PART JOINED (IN.)	MINIMUM SIZE OF FILLET WELD* (IN.)
TO 1/4 INCLUSIVE	3/16
OVER 1/4 TO 1/2	3/8
OVER 1/2 TO 3/4	1/2
OVER 3/4	5/8

*LEG DIMENSION OF FILLET WELDS. SINGLE-PASS WELDS MUST BE USED.

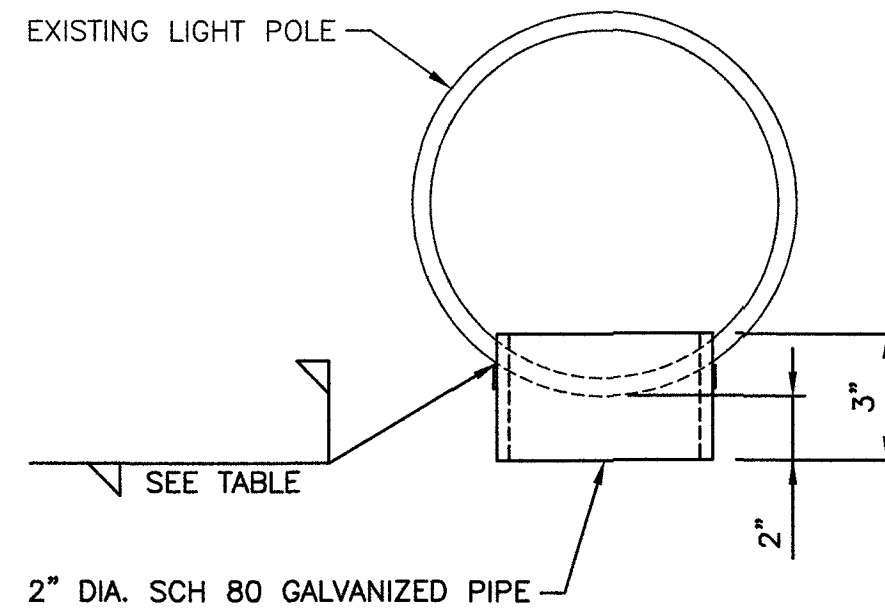

VERTICAL ACCESS PORT DETAIL

NO SCALE

8



AT&T MOBILITY
10550 W. CHARLESTON
SUITE B
LAS VEGAS, NV 89135



BLACK & VEATCH


BLACK & VEATCH CORPORATION
8965 S EASTERN AVE
SUITE #325
LAS VEGAS, NV 89123

PROJECT NO: 129084.1501

DRAWN BY: SAL

CHECKED BY: GAC

REV	DATE	DESCRIPTION
0	04/01/19	ISSUED FOR CONSTRUCTION

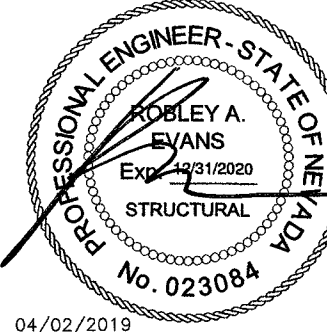

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.


NVL08176F_R02
ADJACENT TO
BALZAR & WILLOWBURY DR
LAS VEGAS, NV 89108
PICO SMALL CELL

SHEET TITLE
EQUIPMENT DETAILS

SHEET NUMBER

A-4

MYERS_MEUG16-M100 CALTRANS TYPE III-BF

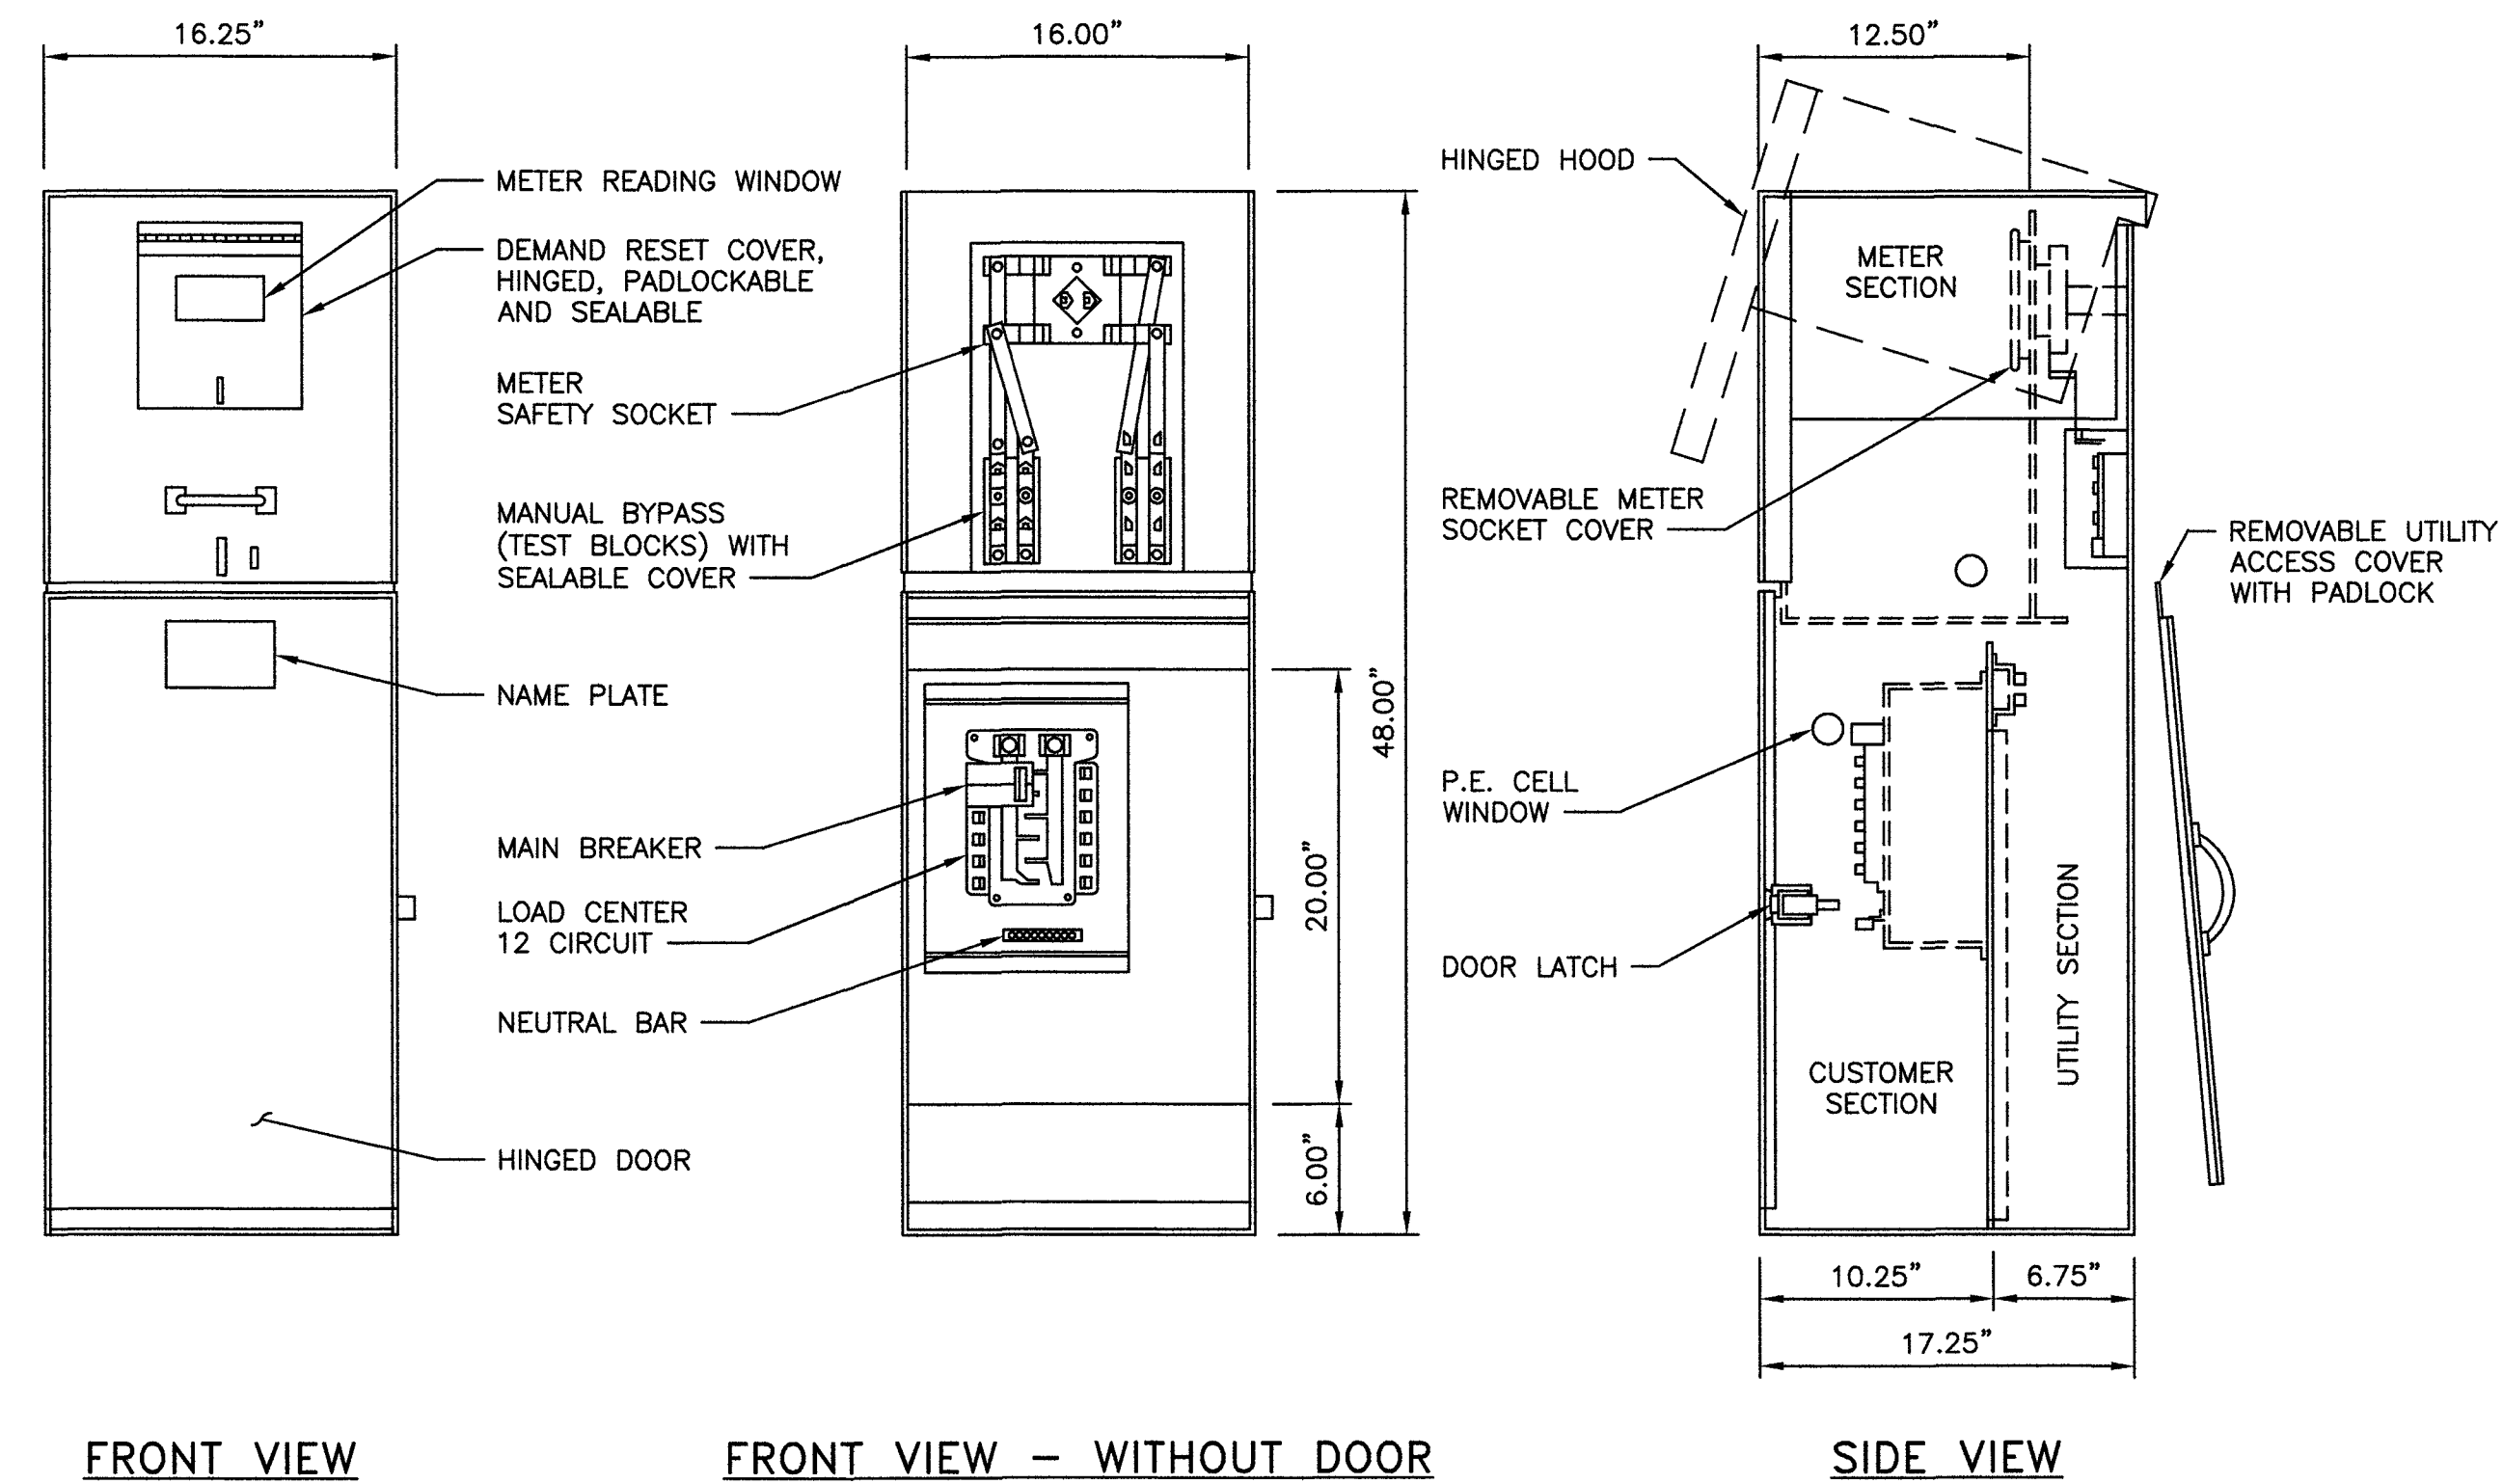


METER PEDESTAL DETAIL

NO SCALE

1

NOTES


1. MINIMUM CLEARANCE REQUIRED 36" PER NEC 110-16, TYPICAL FRONT AND BACK.
2. FOUNDATION DIMENSIONS AND DEPTH PER JOB SPECIFICATIONS.

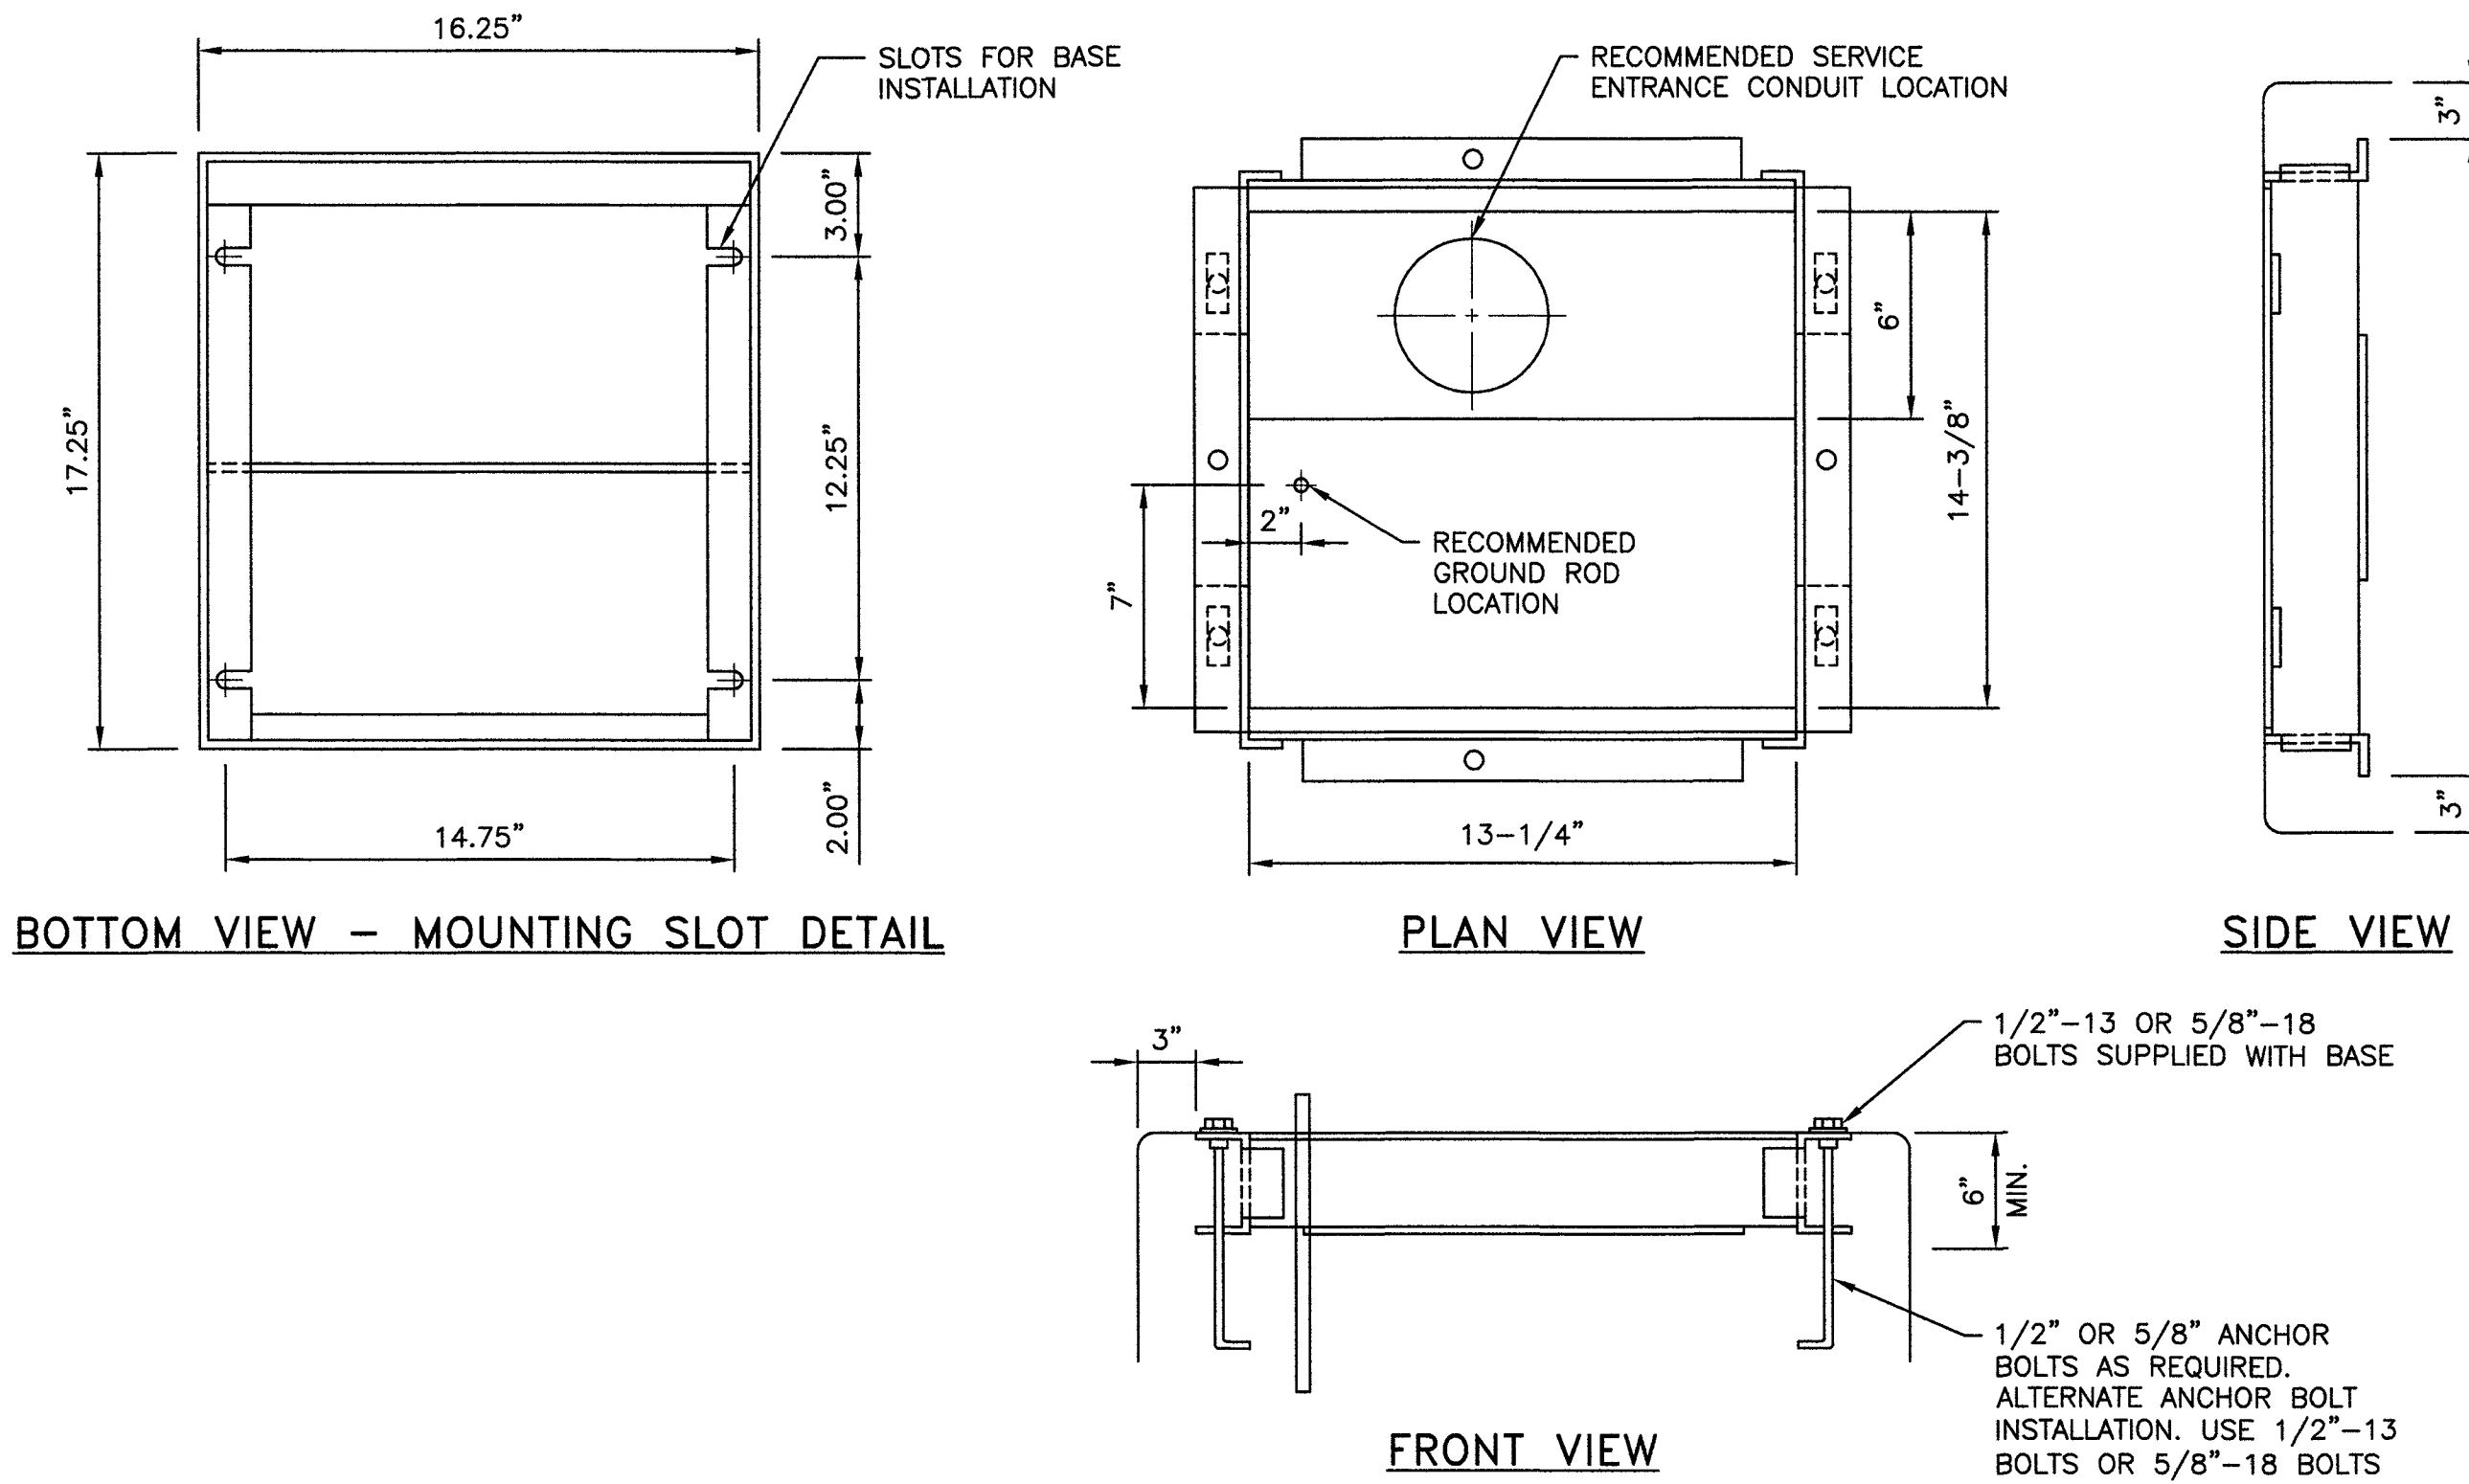

BASEPLATE DETAIL

NO SCALE

3

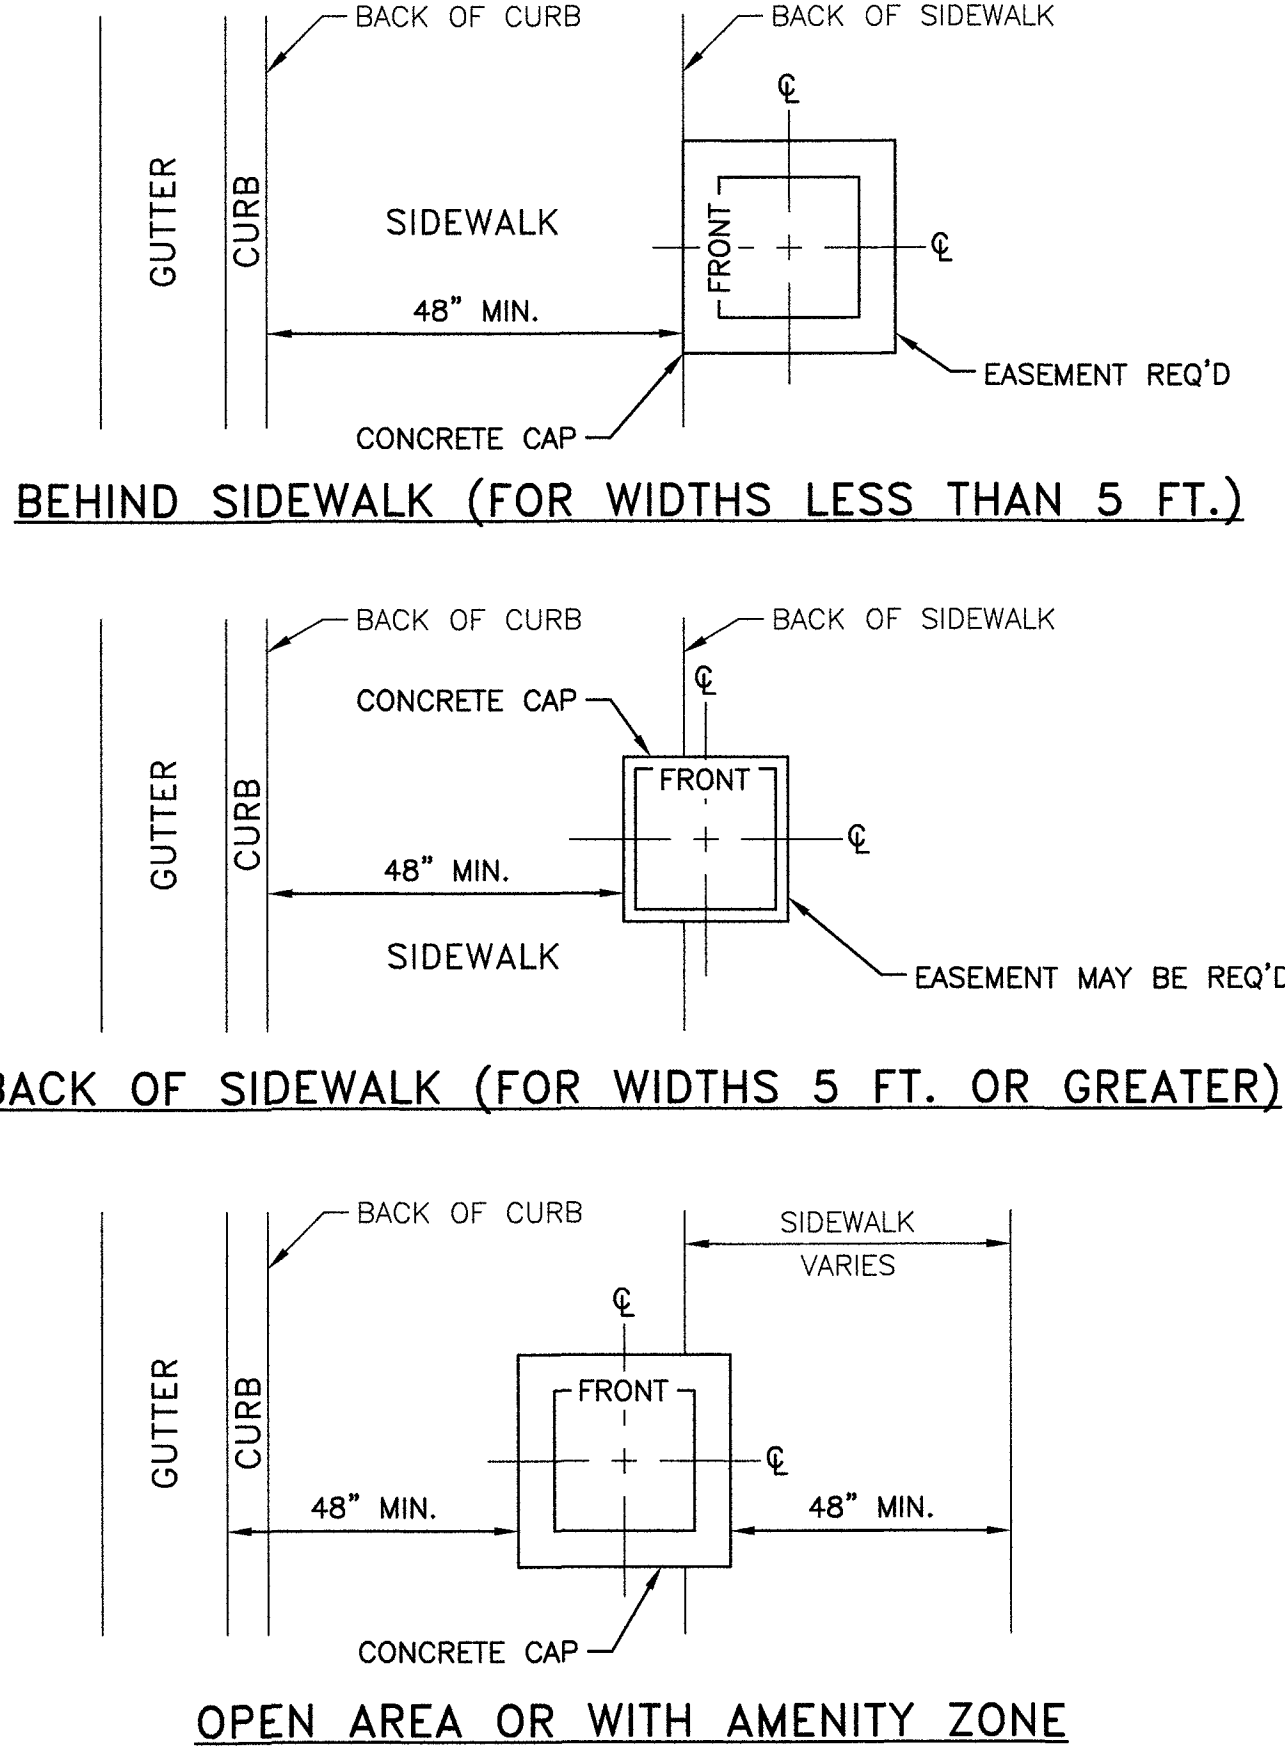

SERVICE PEDESTAL SETBACK DETAILS (USDCCA DRAWING #331)


NO SCALE

2

NOTES

1. BARE COPPER GROUNDING CONDUCTOR SHALL BE LOOPED AROUND ANCHOR BOLTS ONE TIME AND CONNECTED TO EACH ANCHOR BOLT BEFORE CONTINUING DOWN TO THE GROUNDING PLATE.
2. CABINET COVERS SHALL BE PARALLEL WITH CURB.
3. IN AREAS WHERE R/W PERMITS, THE CONCRETE BASE SHALL BE PLACED AT THE BACK EDGE OF THE SIDEWALK.
4. CABINET COVERS SHALL OPEN TOWARDS THE STREET WHEN CABINETS ARE LOCATED AT BACK OF WALK. CABINET COVERS SHALL OPEN PARALLEL TO THE SIDEWALK FACING THE DIRECTION OF TRAFFIC WHEN LOCATED WITHIN THE SIDEWALK.
5. WIRE SIZES ARE BASED ON UNDERGROUND FEED.
6. WIRE SIZES SHALL BE INCREASED FOR VOLTAGE DROP LIMITATION WHEN RUN IS LONG.

NO	125 AMP SERVICE	200 AMP SERVICE (CLARK COUNTY)	200 AMP SERVICE (LAS VEGAS)
1	(2) #1/0 THW AND (1) #1/0 WHITE THW IN 2" CONDUIT	(2) #4/0 THW AND (1) #4/0 WHITE THW IN 2" CONDUIT	(2) #3/0 THW AND (1) #3/0 WHITE THW IN 2" CONDUIT

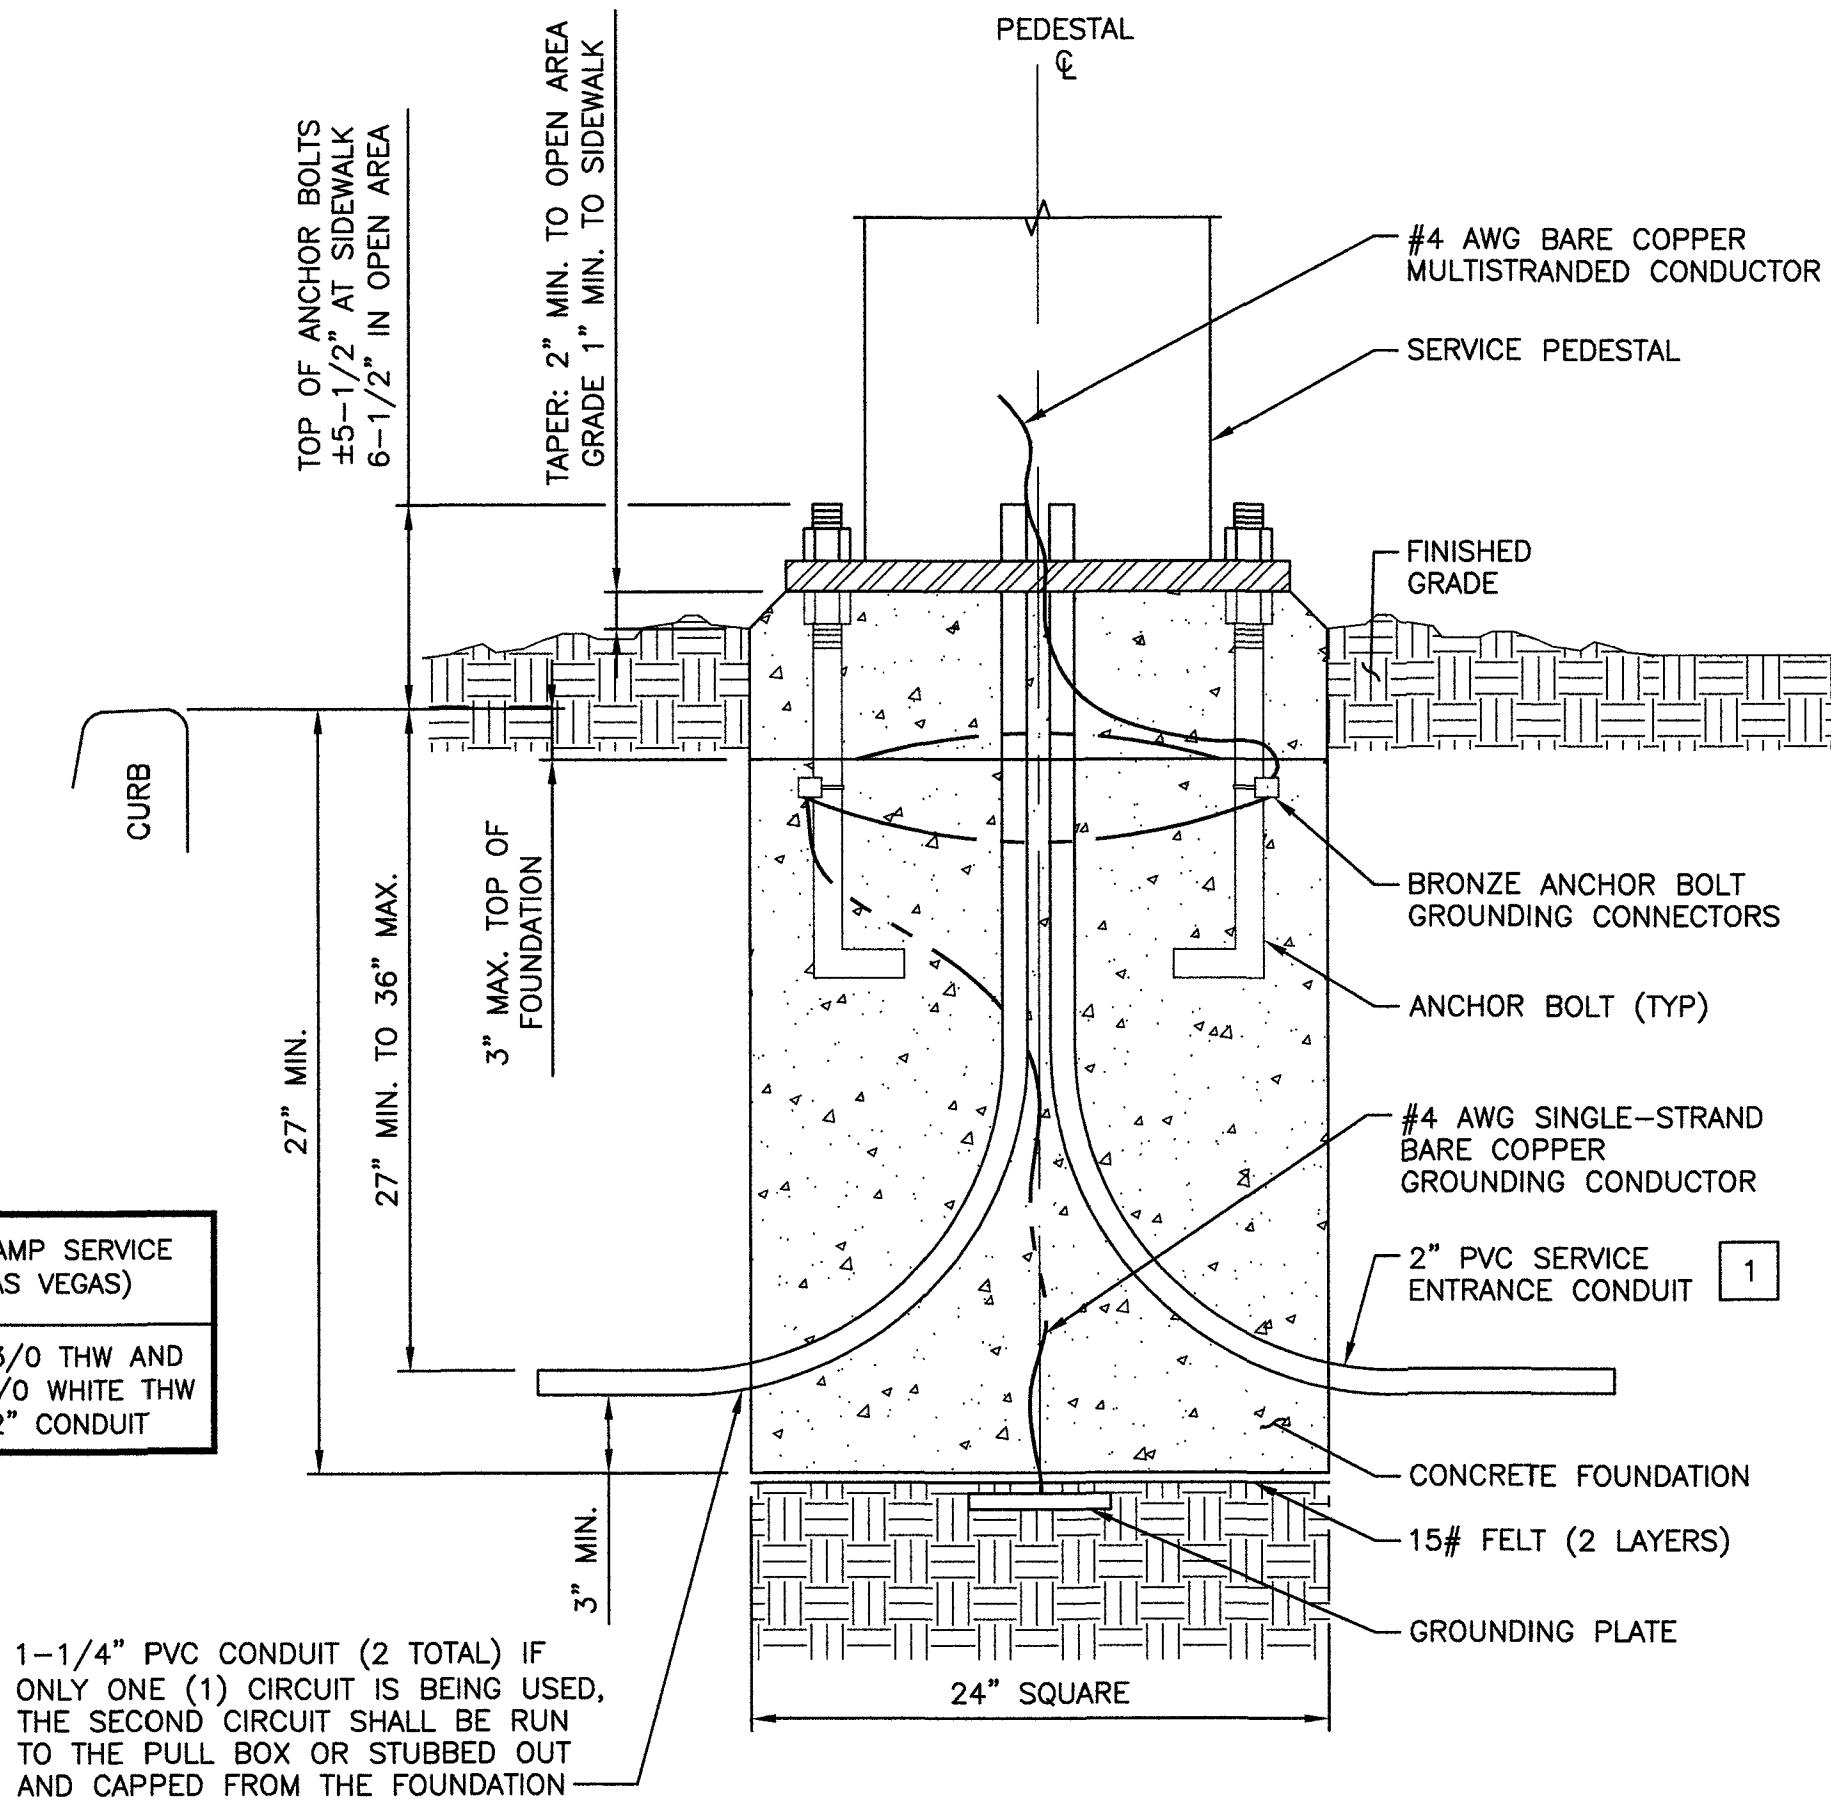

SERVICE PEDESTAL FOUNDATION DETAIL

NO SCALE

4



AT&T MOBILITY
10550 W. CHARLESTON
SUITE B
LAS VEGAS, NV 89135



BLACK & VEATCH


BLACK & VEATCH CORPORATION
8965 S EASTERN AVE
SUITE #325
LAS VEGAS, NV 89123

PROJECT NO: 129084.1501

DRAWN BY: SAL

CHECKED BY: GAC

REV	DATE	DESCRIPTION
0	04/01/19	ISSUED FOR CONSTRUCTION

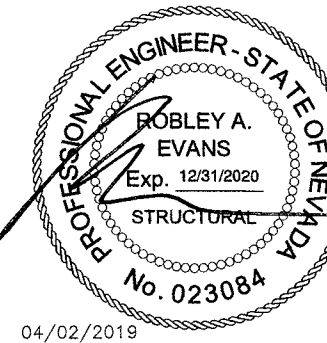

IT IS A VIOLATION OF LAW FOR ANY PERSON,
UNLESS THEY ARE ACTING UNDER THE DIRECTION
OF A LICENSED PROFESSIONAL ENGINEER,
TO ALTER THIS DOCUMENT.

NVL08176F_R02
ADJACENT TO
BALZAR & WILLOWBURY DR
LAS VEGAS, NV 89108
PICO SMALL CELL

SHEET TITLE
METER PEDESTAL DETAILS

SHEET NUMBER

A-5



NOTICE

RF energy emitted by this device may exceed the FCC's general public exposure limits. Stay at least 1 foot away from the device. Call 800-638-2822 for help if you need access within 1 foot.

RF NOTICE DECAL

NOTICE

AT&T operates antennas at this structure.

Above this point you are entering an area where radio frequency (RF) fields may exceed the FCC General Population Exposure limits.

Follow safety guidelines for working in an RF environment.

Keep **1** ft. away from the fronts of antennas.

Contact AT&T at 800-638-2822, opt. 9, 3 and follow their instructions prior to performing and maintenance or repairs above this point.

This is AT&T Site USID _____

CAUTION

AT&T operates antennas at this structure.

Above this point you are entering an area where radio frequency (RF) fields may exceed the FCC General Occupational Exposure limits.

Follow safety guidelines for working in an RF environment.

Keep **1** ft. away from the fronts of antennas.

Contact AT&T at 800-638-2822, opt. 9, 3 and follow their instructions prior to performing and maintenance or repairs above this point.

Cell Site USID _____

EME PLACARD/DECAL


NOTE: SPECIFIC EME PLACARD WILL BE PLACED AFTER EME REPORT

RF SIGNAGE DETAIL

NO SCALE

1

MULTI-TAP CONNECTOR WITH CLEAR INSULATION, DOUBLE-SIDED (PCSB4-4-6Y)

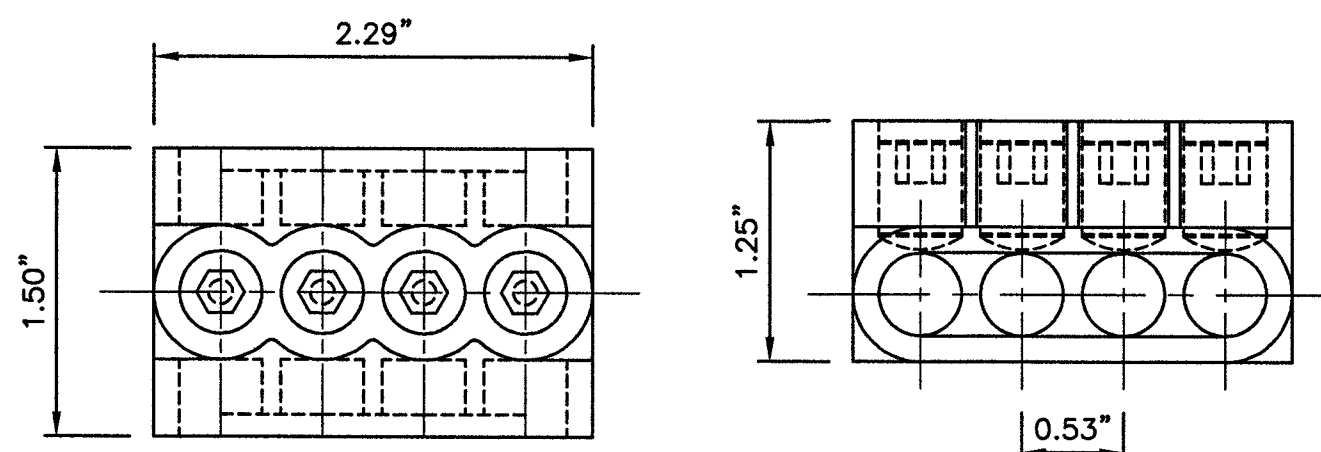

CONNECTOR DETAIL

NO SCALE

2

BUSSMANN — HEB SERIES

BREAKAWAY MODEL#: HEB-AW-RLC-A (5.8" LONG)


NON-BREAKAWAY MODEL#: HEB-AA (4.4" LONG)

WIRE RANGE: #8-16; (2) #12-16

RECOMMENDED FUSES: BAF, FNM, FNQ, KLM AND KTK

AMPS: UP TO 30A

VOLTS: 600V

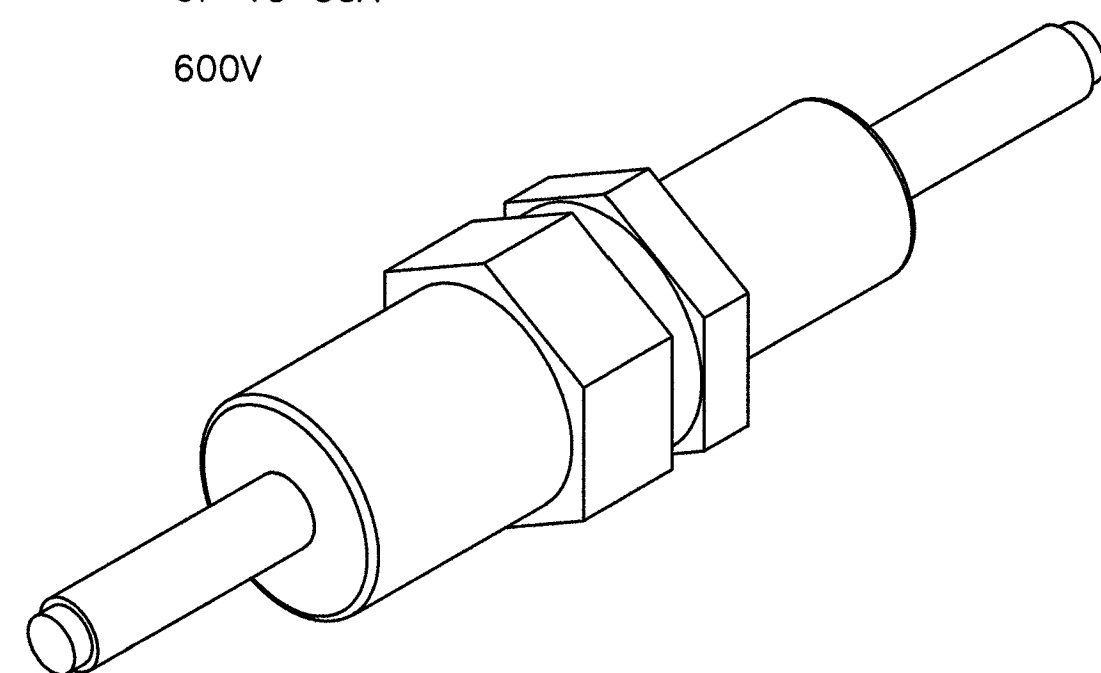


PROPOSED BREAKAWAY AND NON-BREAKAWAY IN-LINE FUSE HOLDER

NO SCALE

3

NOTES

1. CONTRACTOR IS TO FIELD VERIFY ALL EXISTING ITEMS SHOWN ON THE ELECTRICAL ONE-LINE DIAGRAM AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES.
2. ALL NEW CONDUCTOR WIRE TO BE INSTALLED SHALL BE COPPER THWN-2, THW-2, RHW-2, XHHW-2 WIRE UNLESS NOTED OTHERWISE.
3. ALL GROUNDING AND BONDING TO BE PER THE RECOGNIZED EDITION OF THE NATIONAL ELECTRIC CODE (NEC).
4. ALL INSTALLED CONDUCTORS AND SIGNAL CABLES TO BE CLEARLY MARKED "COX COMMUNICATIONS" WITH BRASS OR FIBERGLASS TAGS.

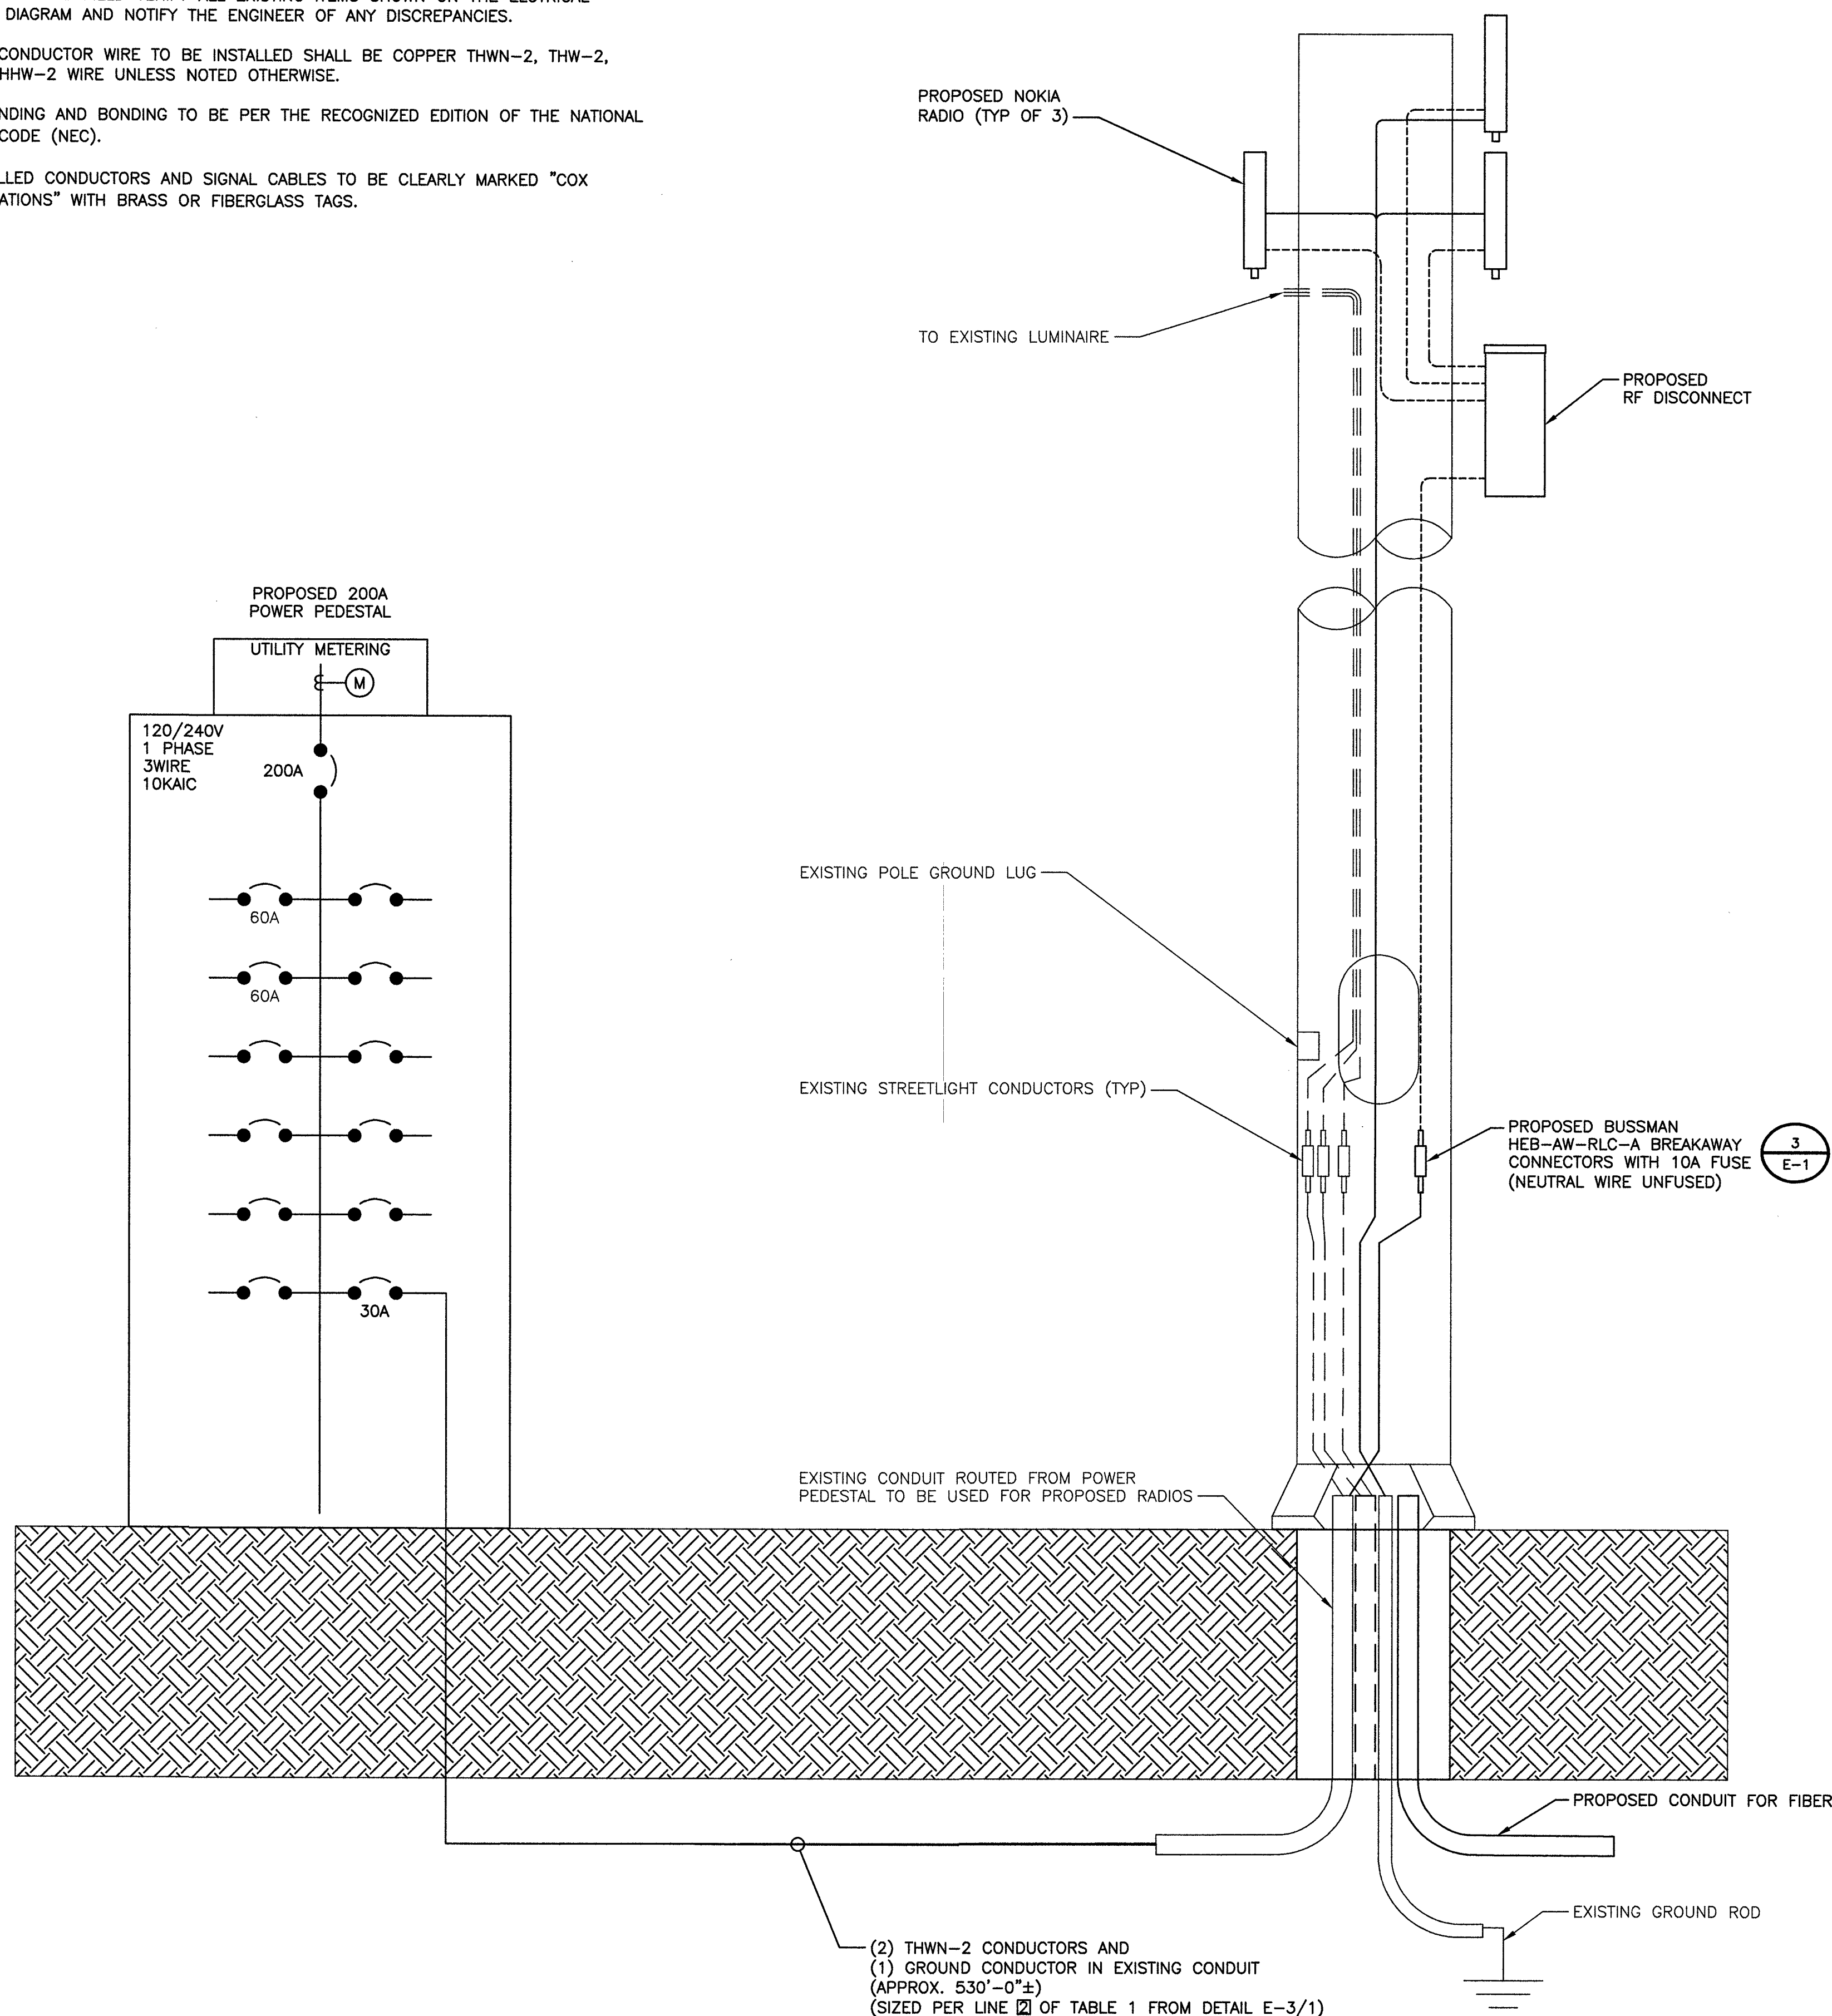

TYPICAL POLE SITE TEMPLATE

NO SCALE

4



AT&T MOBILITY
10550 W. CHARLESTON
SUITE B
LAS VEGAS, NV 89135



BLACK & VEATCH


BLACK & VEATCH CORPORATION
8965 S EASTERN AVE
SUITE #325
LAS VEGAS, NV 89123

PROJECT NO: 129084.1501

DRAWN BY: SAL

CHECKED BY: GAC

REV	DATE	DESCRIPTION
0	04/01/19	ISSUED FOR CONSTRUCTION
3		E-1

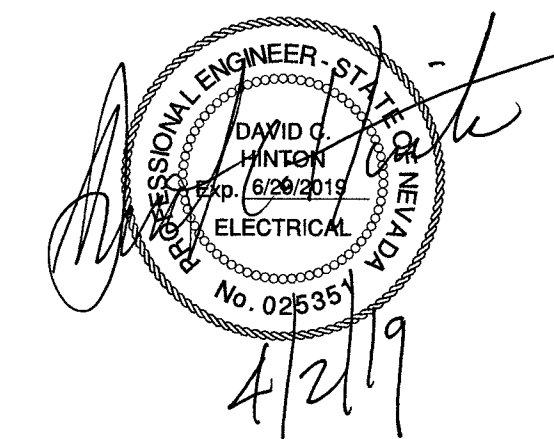

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

NVL08176F_R02
ADJACENT TO
BALZAR & WILLOWBURY DR
LAS VEGAS, NV 89108
PICO SMALL CELL


SHEET TITLE
ELECTRICAL DETAILS

SHEET NUMBER

E-1


EXISTING ELECTRICAL LOAD STUDY

EXISTING LOAD.....48.0 AMPS
ALLOWED LOAD 80%.....160.00 AMPS

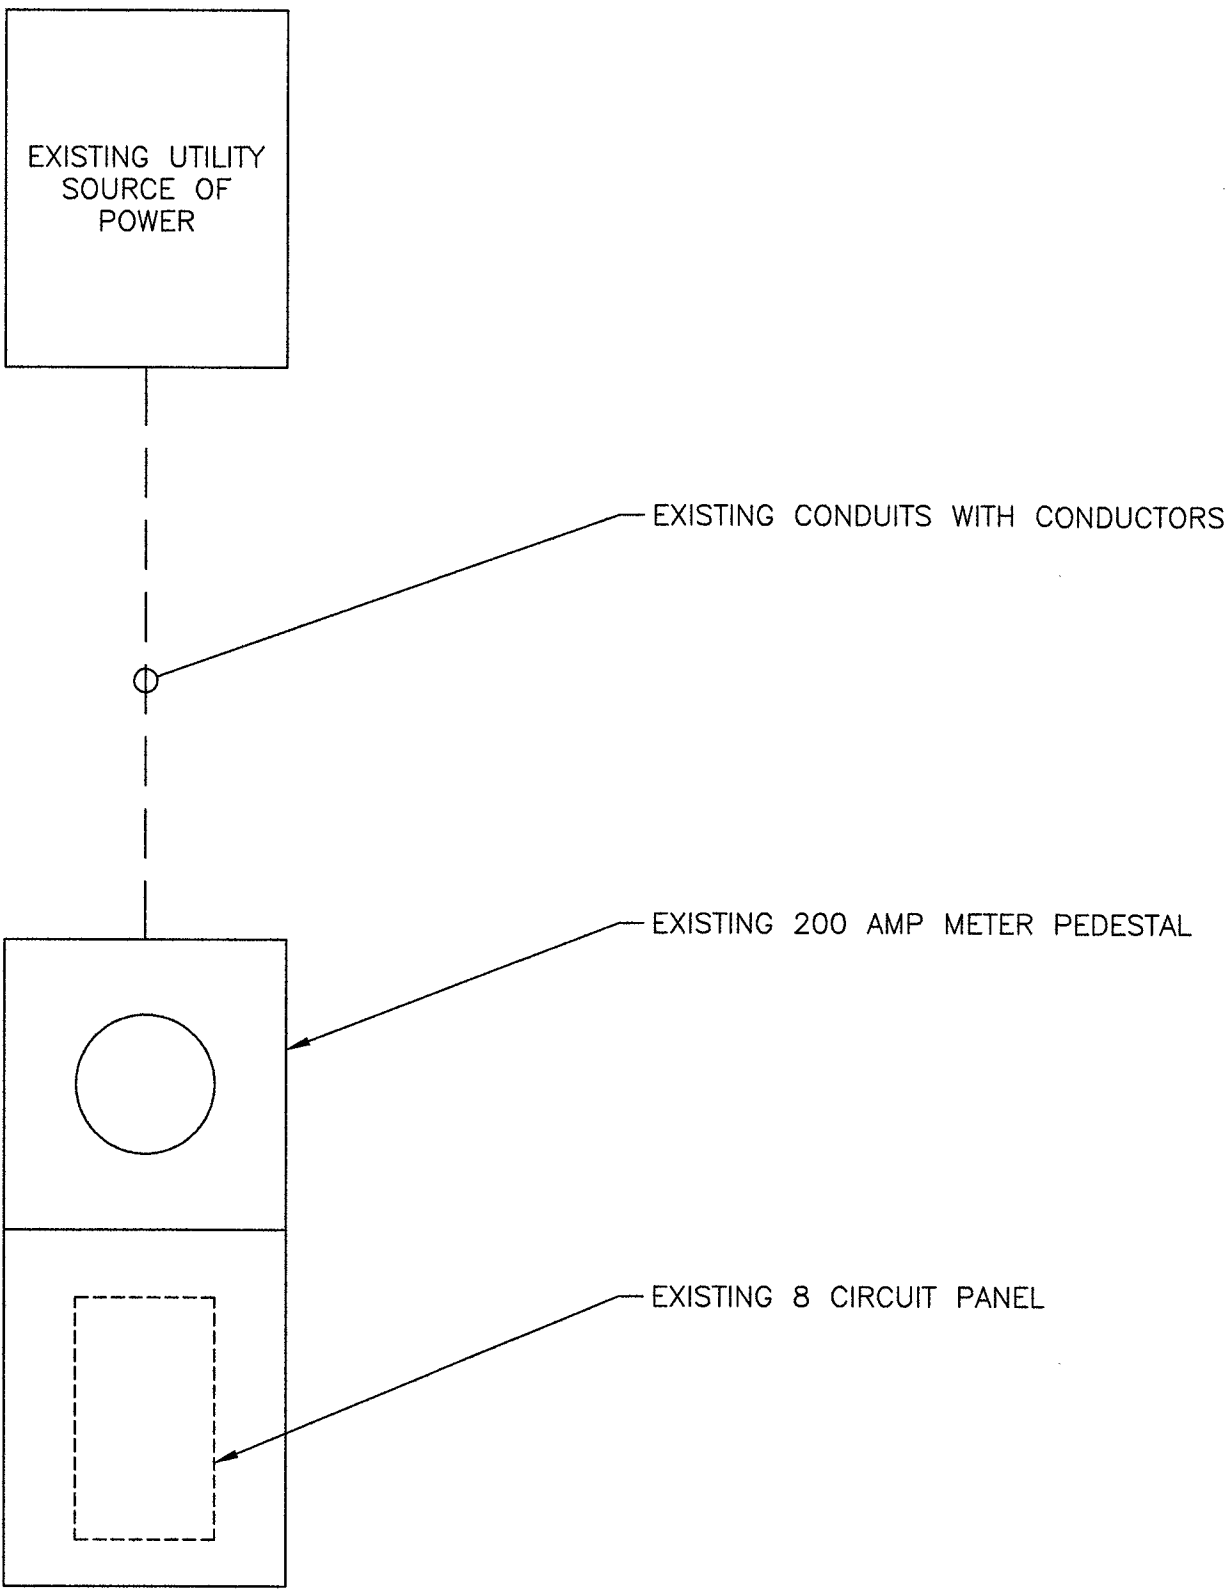

PROPOSED ELECTRICAL LOAD STUDY

EXISTING LOAD.....48.00 AMPS
SAFETY FACTOR 125%.....60.00 AMPS
PROPOSED LOAD.....2.34 AMPS
TOTAL LOAD.....62.34 AMPS
ALLOWED LOAD 80% OF 200 AMPS.....160.00 AMPS

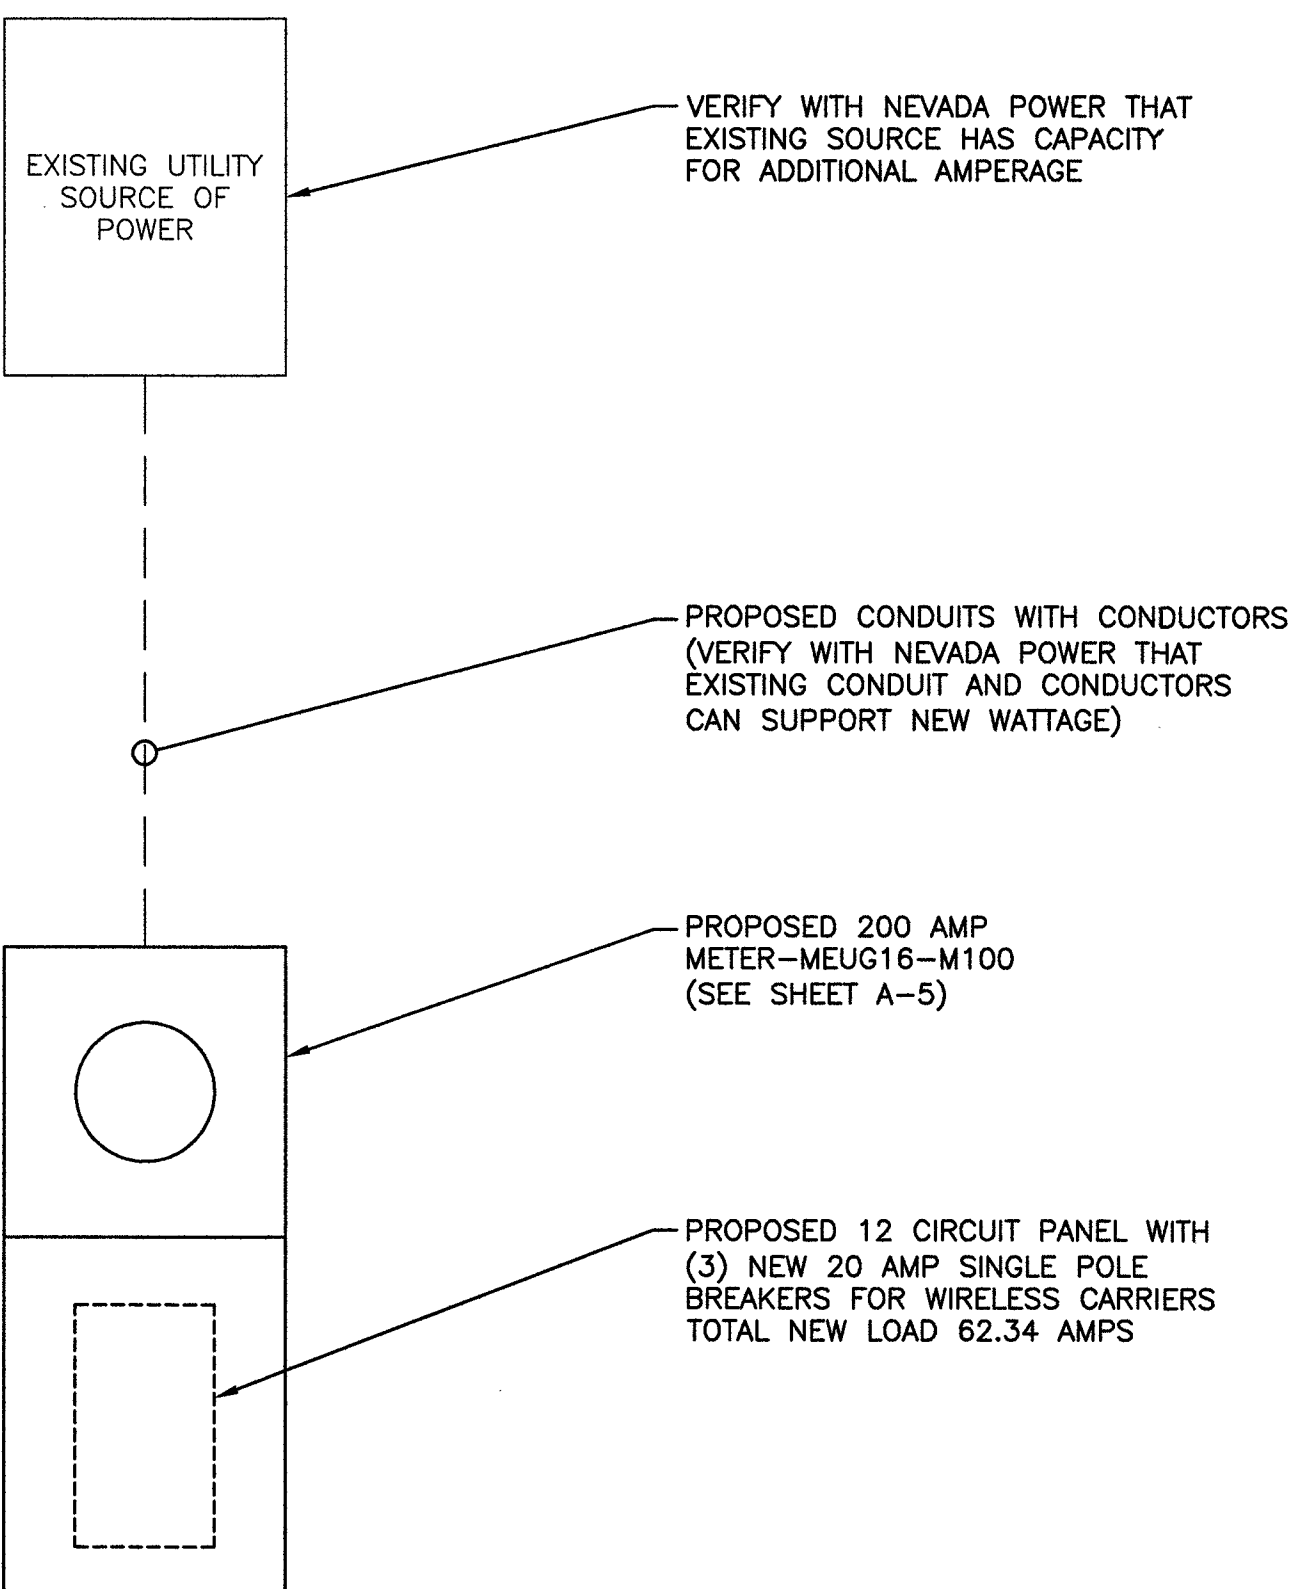

EXISTING SINGLE LINE DIAGRAM

NO SCALE

1

PROPOSED SINGLE LINE DIAGRAM

NO SCALE

2

Site Name:		BALZER & WILLOWBURY DR						MODEL NUMBER:		PROPOSED METER AND LOAD CENTER PEDESTAL							
SITE NUMBER:		CRAN_NVLO8176F_R02						PHASE:		1		WIRE:		3			
VOLTAGE:		240 /120		Volts AC				BUSS RATING:		200		AMPS					
MAIN BREAKER:		200 AMPS															
MOUNT:		SURFACE															
ENCLOSURE TYPE:		NEMA 3R															
PANEL STATUS:		PROPOSED															
CKT	LOAD DESCRIPTION	BREAKER AMPS	BREAKER POLES	BREAKER STATUS	SERVICE LOAD VA	Demand Factor	USAGE FACTOR	PHASE A VA	PHASE B VA	USAGE FACTOR	Demand Factor	SERVICE LOAD VA	BREAKER STATUS	BREAKER POLES	BREAKER AMPS	LOAD DESCRIPTION	CKT
1	MAINS	200	2	NEW	0	1.00	1.00	563		1.25	1.00	450	NEW	1	30	PACTEHSOL PTS90122-3-AA777-PN-8	2
3					0	1.00	1.00		0								4
5	EXISTING STREET LIGHT	60	2	ON	5760	1.00	1.25	7200									6
7					5760	1.00	1.25		7200								8
9								0									10
11									0								12
								PHASE A	PHASE B								
								7763	7200	VA							
								TOTAL		KVA	14.96						
										AMPS	62.34	≤ 80% OF MAIN BREAKER					

PROPOSED PANEL SCHEDULE AND CALCS

NO SCALE

3



AT&T MOBILITY
10550 W. CHARLESTON
SUITE B
LAS VEGAS, NV 89135



BLACK & VEATCH


BLACK & VEATCH CORPORATION
8965 S EASTERN AVE
SUITE #325
LAS VEGAS, NV 89123

PROJECT NO: 129084.1501

DRAWN BY: SAL

CHECKED BY: GAC

0	04/01/19	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION

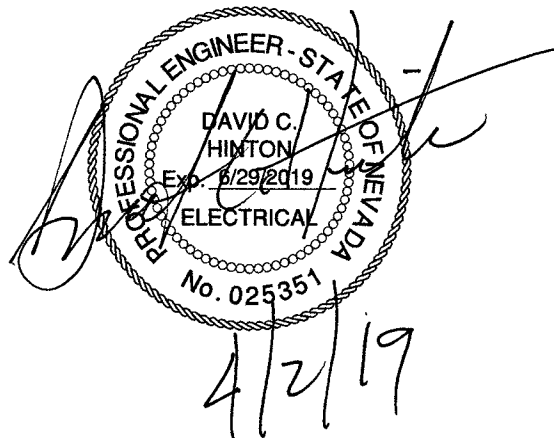


IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

NVLO8176F_R02
ADJACENT TO
BALZAR & WILLOWBURY DR
LAS VEGAS, NV 89108
PICO SMALL CELL

SHEET TITLE
ELECTRICAL CALCULATIONS
AND SCHEDULES

SHEET NUMBER

E-2

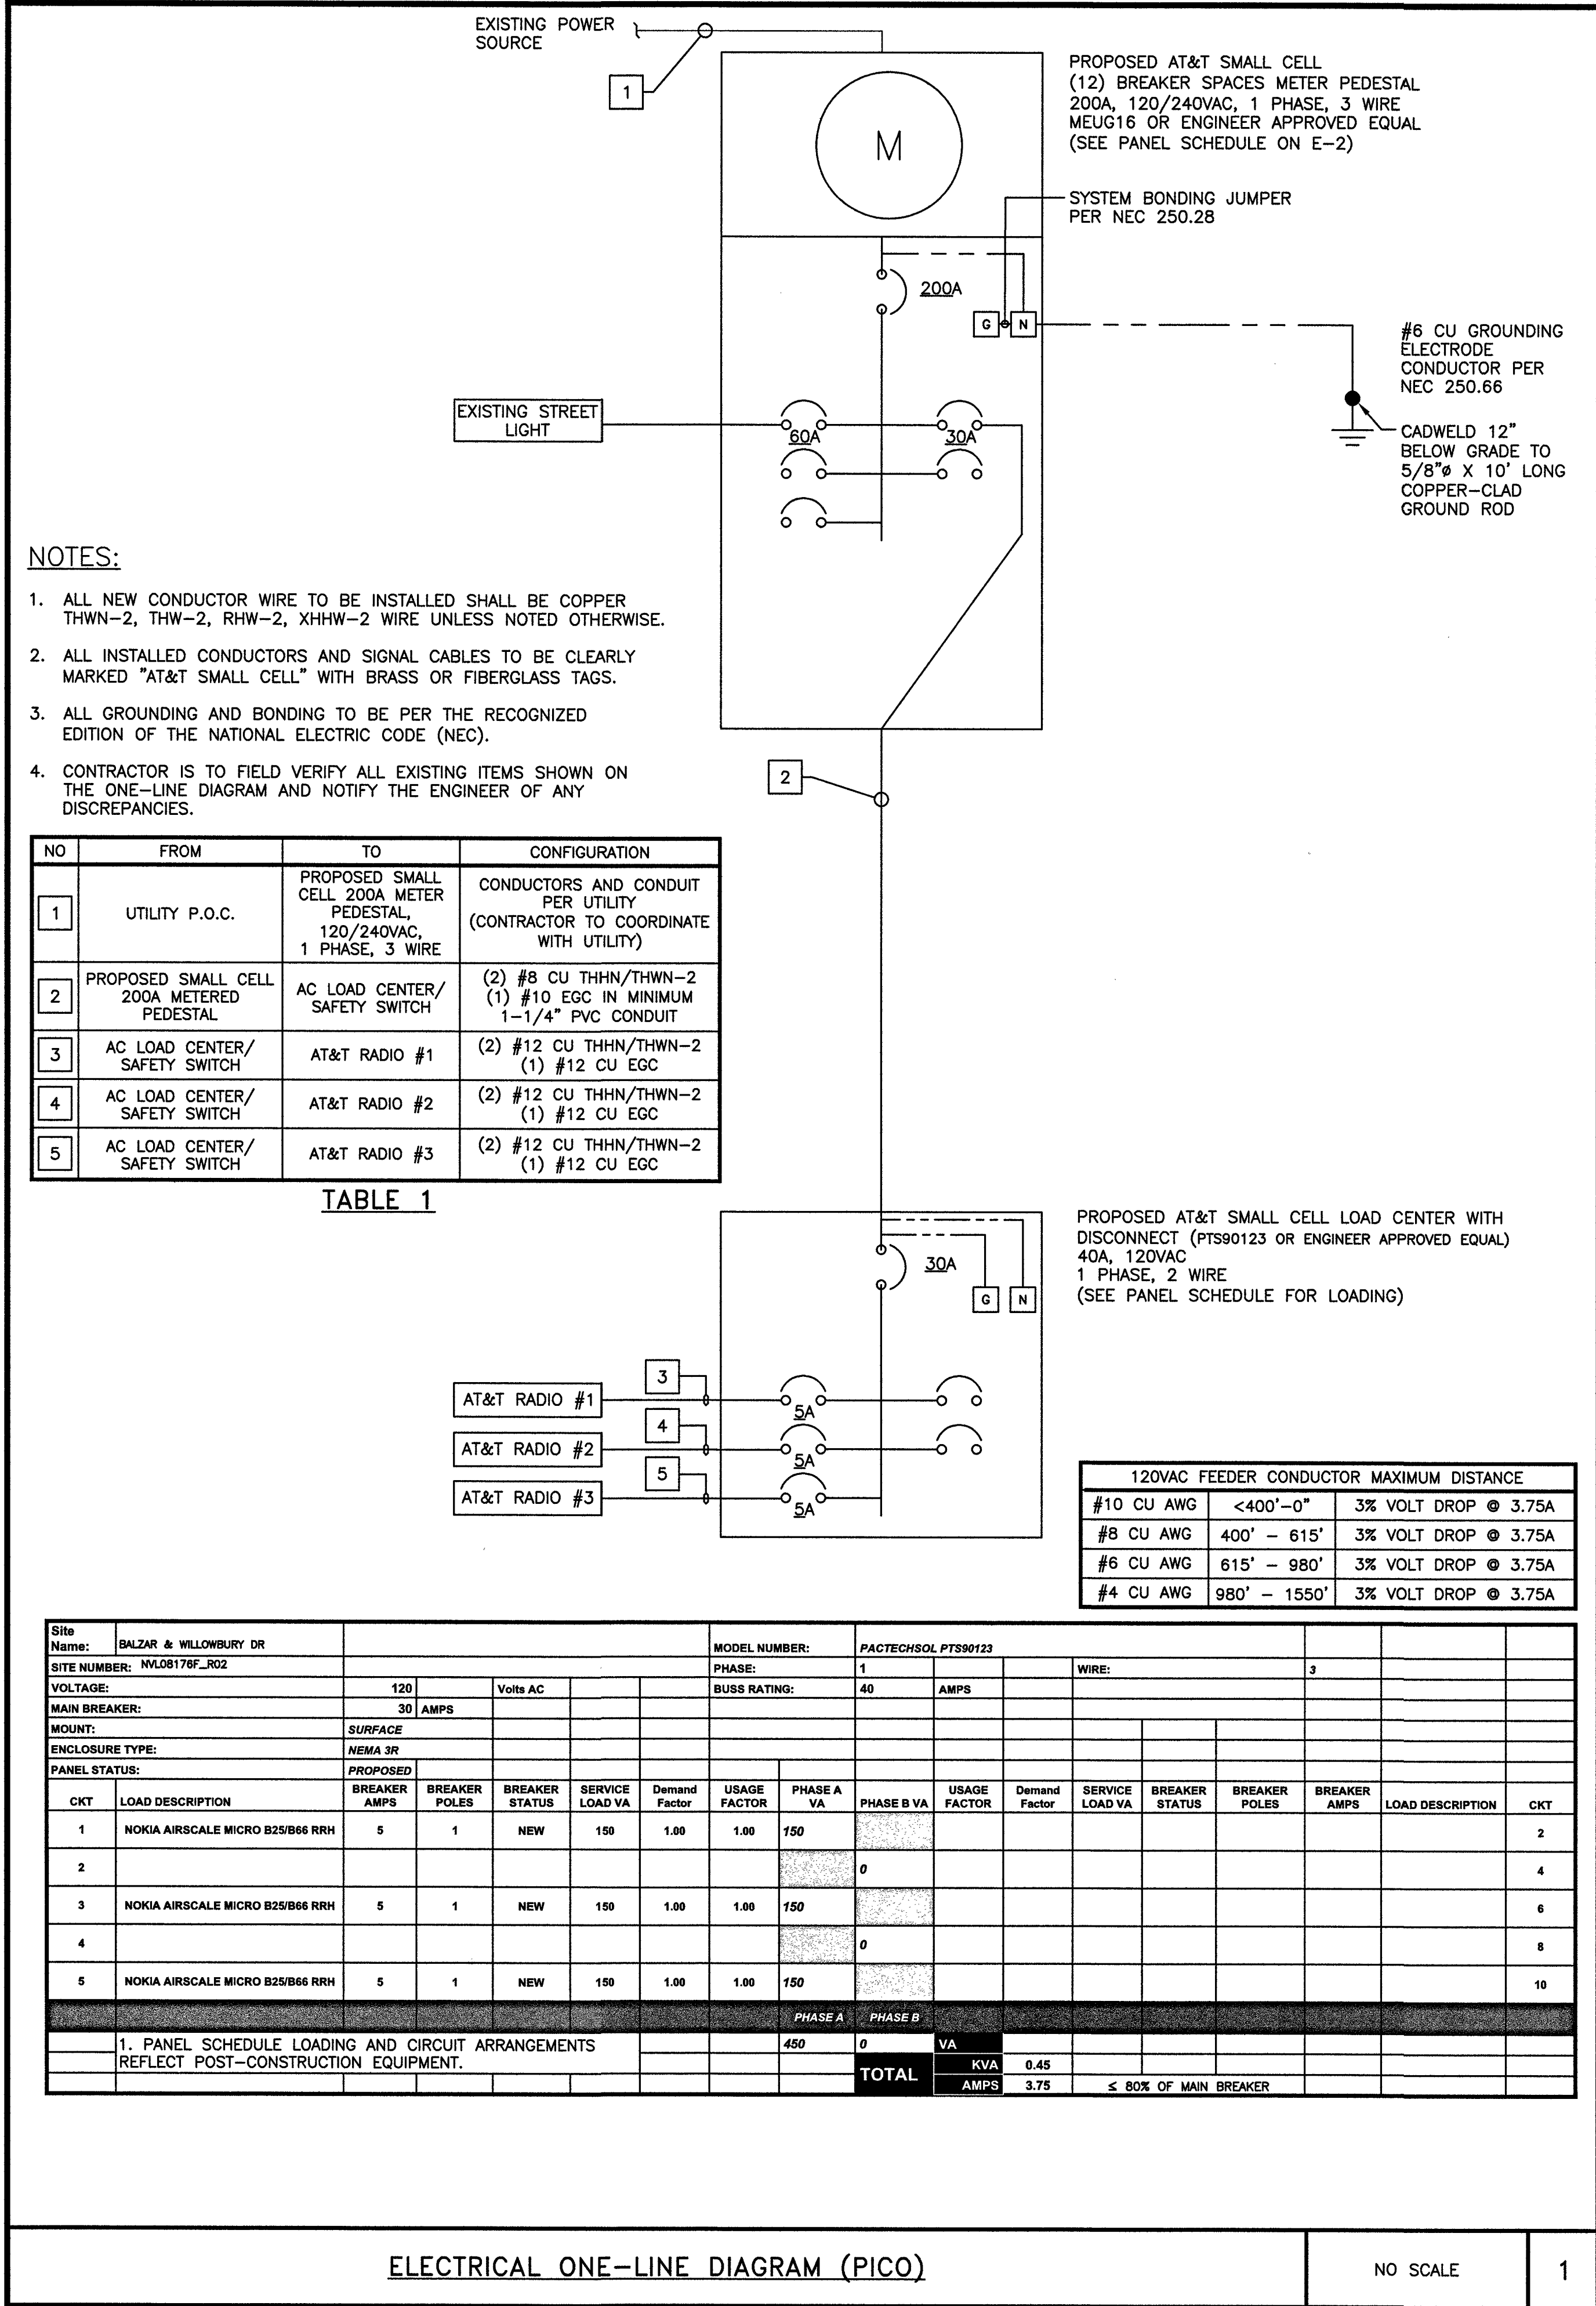

AT&T MOBILITY
10550 W. CHARLESTON
SUITE B
LAS VEGAS, NV 89135




BLACK & VEATCH

BLACK & VEATCH CORPORATION
8965 S EASTERN AVE
SUITE #325
LAS VEGAS, NV 89123

PROJECT NO: 129084.1501
DRAWN BY: SAL
CHECKED BY: GAC

0	04/01/19	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION

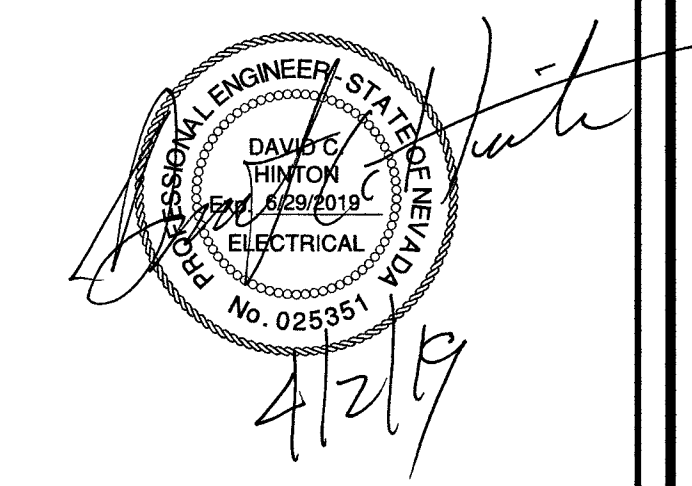

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

NVL08176F_R02
ADJACENT TO
BALZAR & WILLOWBURY DR
LAS VEGAS, NV 89108
PICO SMALL CELL

SHEET TITLE
ELECTRICAL ONE-LINE
DIAGRAM

SHEET NUMBER

E-3

ELECTRICAL ONE-LINE DIAGRAM (PICO)

NO SCALE

1


NOT USED

NO SCALE

2

NOTES

1. FOR CONDUIT SIZE AND WIRING REQUIREMENTS FOR STREETLIGHT SERVICE, SEE STANDARD DRAWING NO. 332.S2 FOR LAS VEGAS AND CLARK COUNTY ONLY AND 332.S1 FOR ALL OTHER ENTITIES.
2. SEE STANDARD DRAWING NO. 321, 332.S1, OR 332.S2.

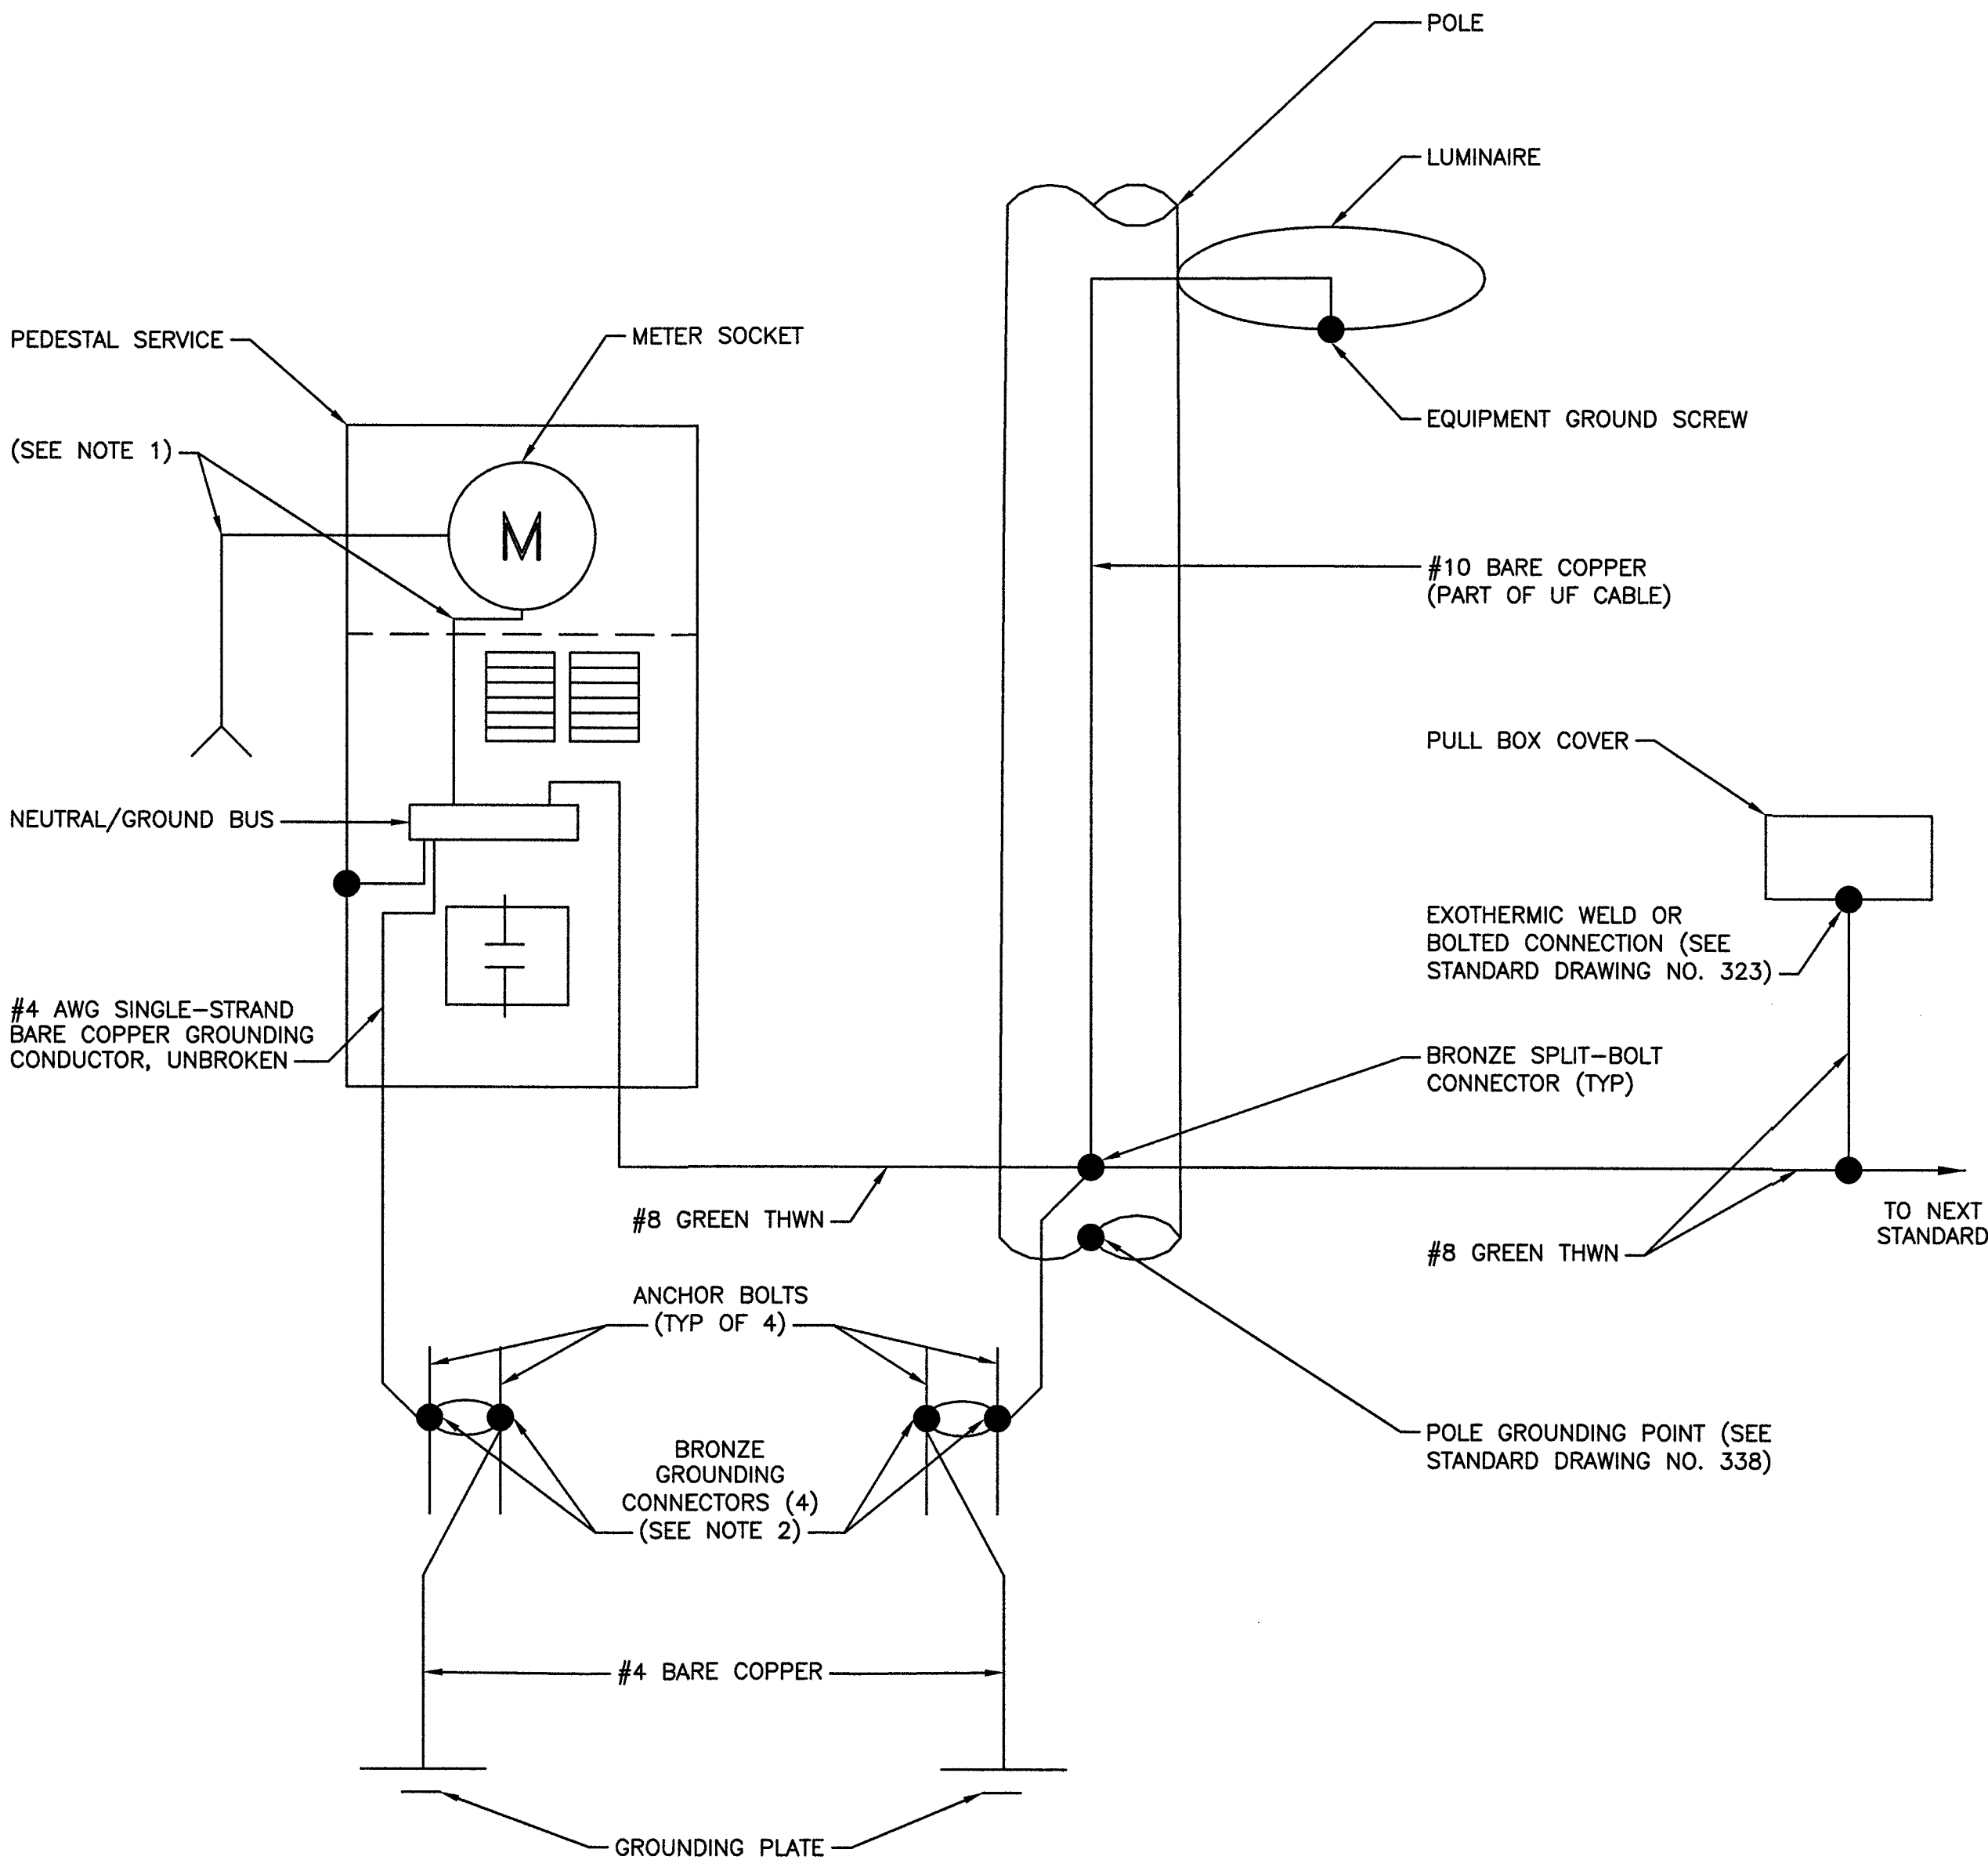


METER PEDESTAL GROUNDING DIAGRAM

NO SCALE

1

NOTES

1. 125 AMP SERVICE: 1 #4 WHITE THW
200 AMP SERVICE: 1 #1/0 WHITE THW

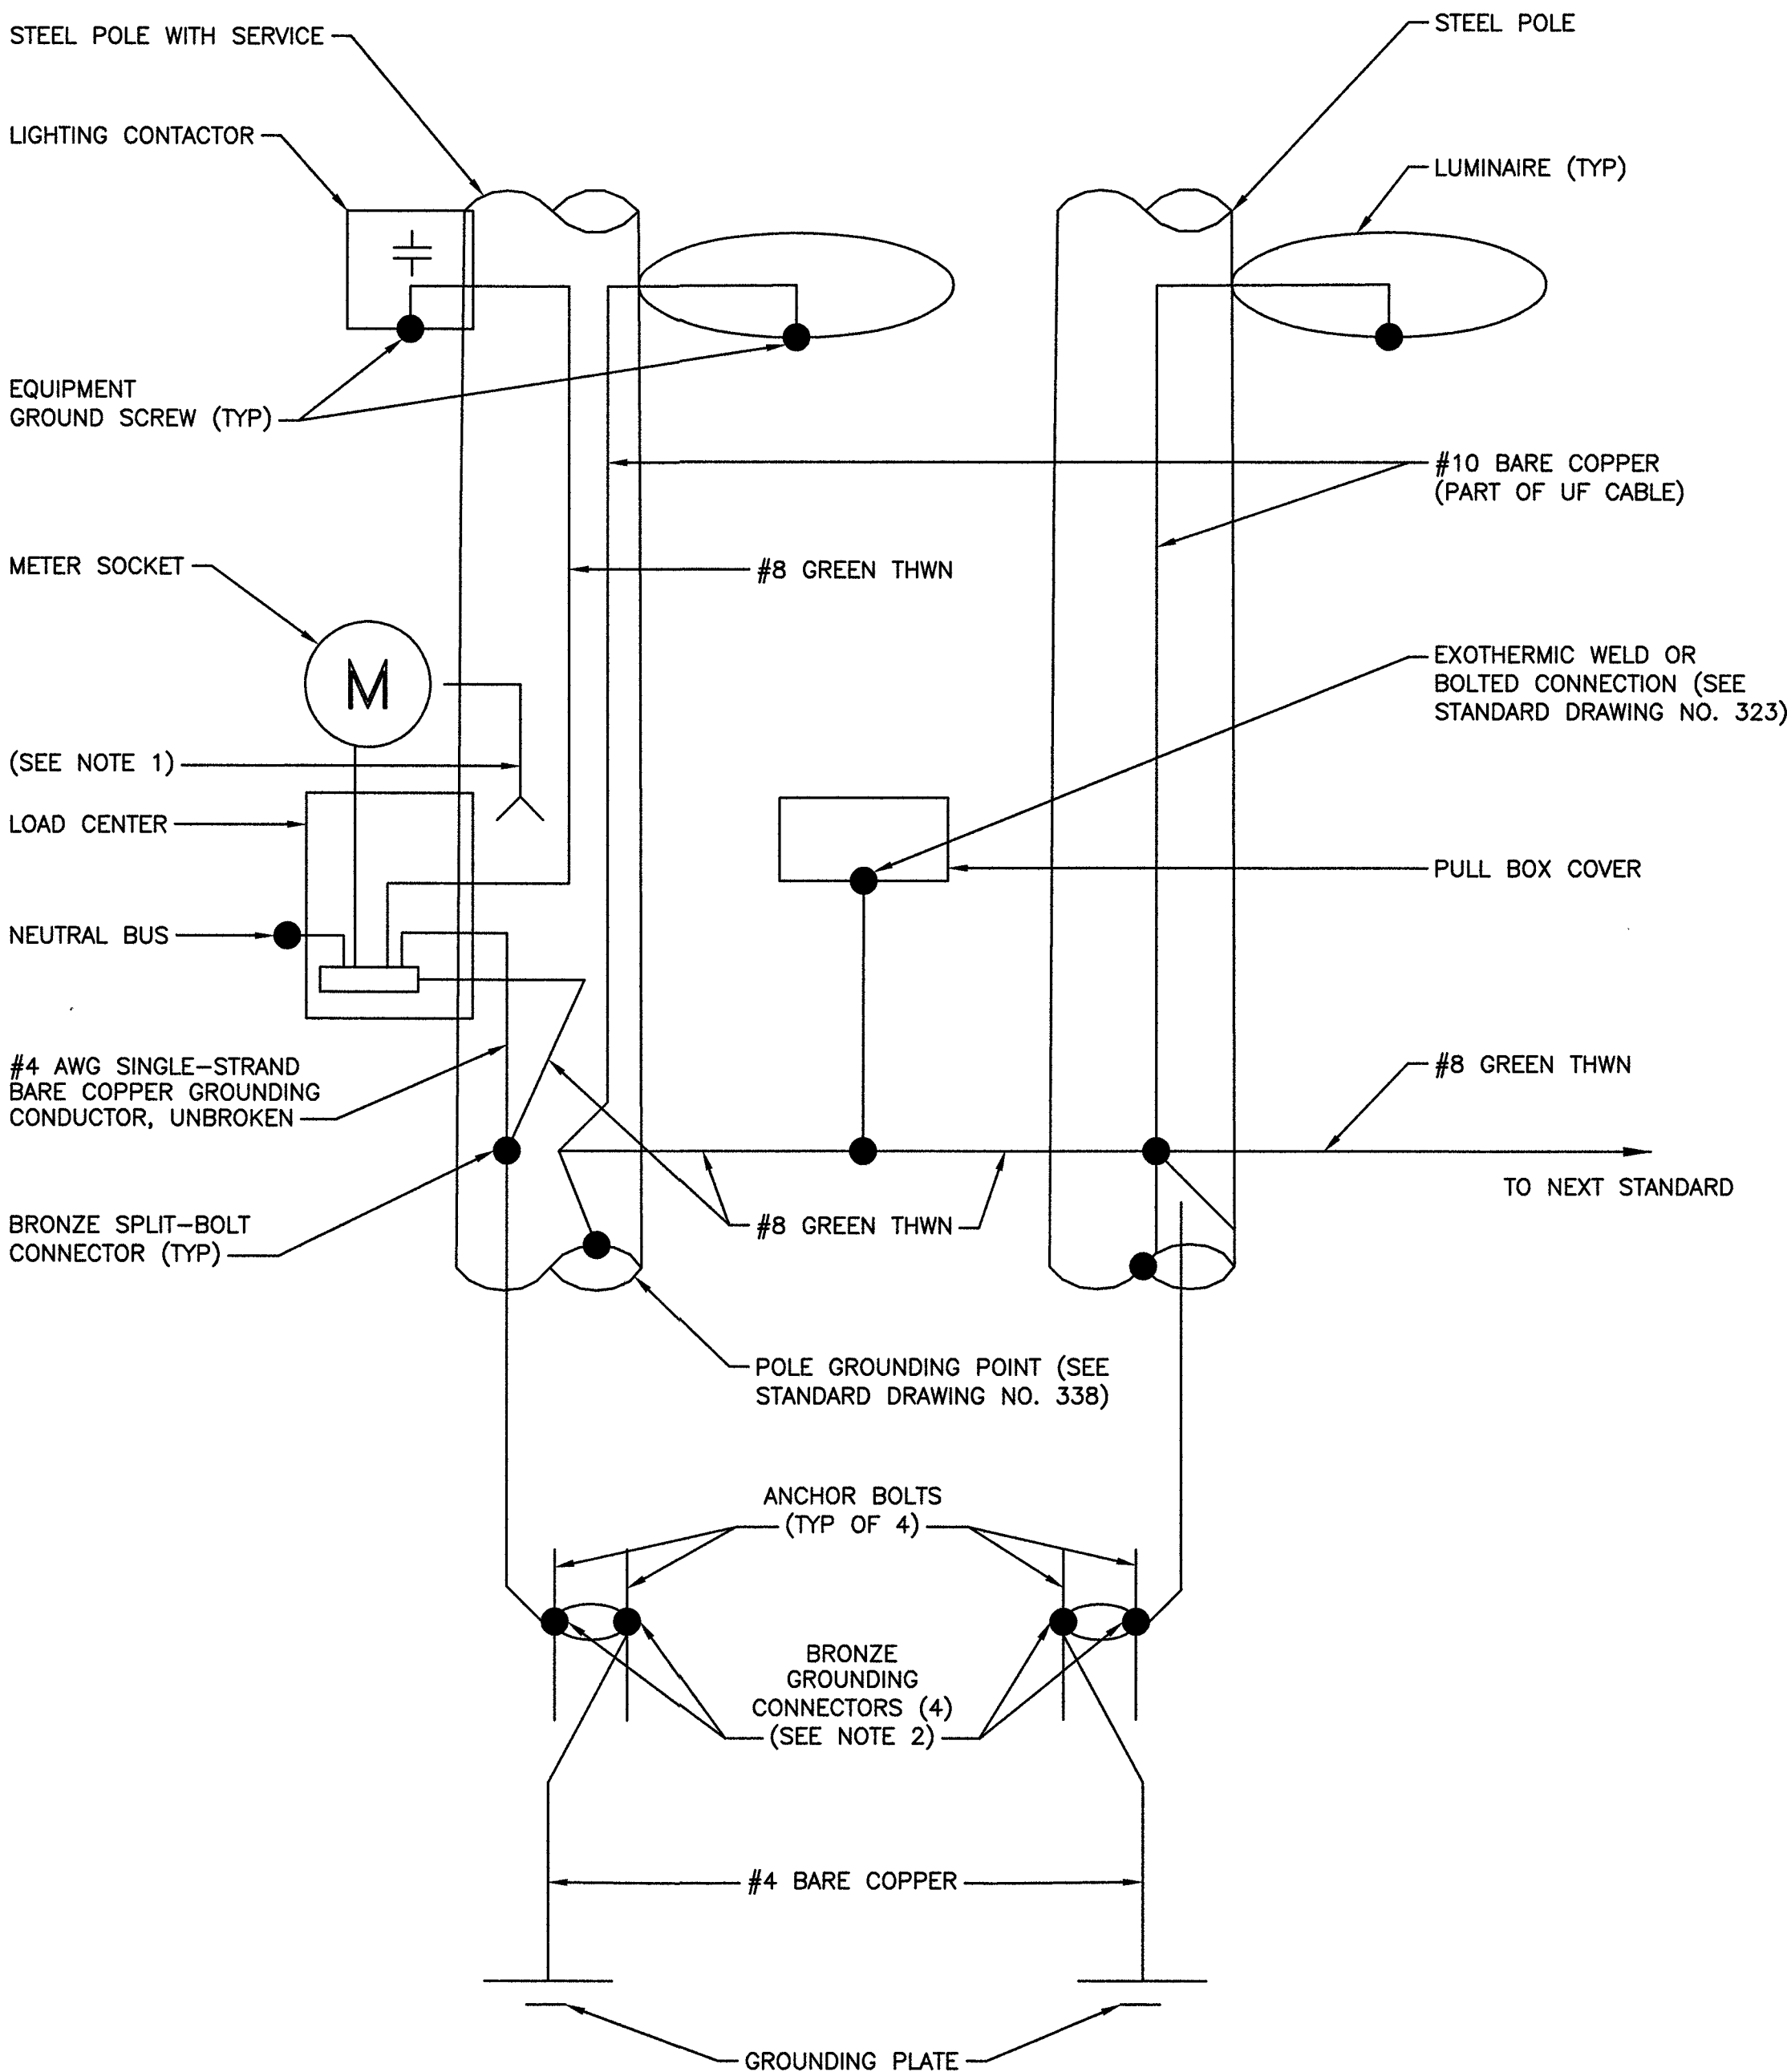

POLE EQUIPMENT GROUNDING DIAGRAM

NO SCALE

2



AT&T MOBILITY
10550 W. CHARLESTON
SUITE B
LAS VEGAS, NV 89135



BLACK & VEATCH

BLACK & VEATCH CORPORATION
8965 S EASTERN AVE
SUITE #325
LAS VEGAS, NV 89123

PROJECT NO: 129084.1501

DRAWN BY: SAL

CHECKED BY: GAC

REV	DATE	DESCRIPTION
0	04/01/19	ISSUED FOR CONSTRUCTION

Professional Engineer Seal for David C. Minzen, License No. 92595, State of Nevada, Electrical. Includes a signature and the date 4/2/19.

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

NVL08176F_R02
ADJACENT TO
BALZAR & WILLOWBURY DR
LAS VEGAS, NV 89108
PICO SMALL CELL

SHEET TITLE
GROUNDING DIAGRAMS

SHEET NUMBER
G-1

1. FOR THE PURPOSE OF CONSTRUCTION DRAWINGS, THE FOLLOWING DEFINITIONS SHALL APPLY:
GENERAL CONTRACTOR – OVERLAND CONTRACTING INC. (B&V)
SUBCONTRACTOR – CONTRACTOR (CONSTRUCTION)
OWNER – AT&T
2. ALL SITE WORK SHALL BE COMPLETED AS INDICATED ON THE DRAWINGS.
3. GENERAL CONTRACTOR AND SUBCONTRACTOR SHALL VISIT THE SITE AND SHALL BECOME FAMILIAR WITH ALL CONDITIONS AFFECTING THE PROPOSED WORK AND SHALL MAKE PROVISIONS. GENERAL CONTRACTOR AND SUBCONTRACTOR SHALL BE RESPONSIBLE FOR FAMILIARIZING HIMSELF WITH ALL CONTRACT DOCUMENTS, FIELD CONDITIONS, DIMENSIONS, AND CONFIRMING THAT THE WORK MAY BE ACCOMPLISHED AS SHOWN PRIOR TO PROCEEDING WITH CONSTRUCTION. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER PRIOR TO THE COMMENCEMENT OF WORK.
4. ALL MATERIALS FURNISHED AND INSTALLED SHALL BE IN STRICT ACCORDANCE WITH ALL APPLICABLE CODES, REGULATIONS, AND ORDINANCES. GENERAL CONTRACTOR SHALL ISSUE ALL APPROPRIATE NOTICES AND COMPLY WITH ALL LAWS, ORDINANCES, RULES, REGULATIONS, AND LAWFUL ORDERS OF ANY PUBLIC AUTHORITY REGARDING THE PERFORMANCE OF WORK.
5. ALL WORK CARRIED OUT SHALL COMPLY WITH ALL APPLICABLE MUNICIPAL AND UTILITY COMPANY SPECIFICATIONS AND LOCAL JURISDICTIONAL CODES, ORDINANCES, AND APPLICABLE REGULATIONS.
6. UNLESS NOTED OTHERWISE, THE WORK SHALL INCLUDE FURNISHING MATERIALS, EQUIPMENT, APPURTENANCES, AND LABOR NECESSARY TO COMPLETE ALL INSTALLATIONS AS INDICATED ON THE DRAWINGS.
7. PLANS ARE NOT TO BE SCALED. THESE PLANS ARE INTENDED TO BE A DIAGRAMMATIC OUTLINE ONLY UNLESS OTHERWISE NOTED. DIMENSIONS SHOWN ARE TO FINISH SURFACES UNLESS OTHERWISE NOTED. SPACING BETWEEN EQUIPMENT IS THE MINIMUM REQUIRED CLEARANCE. THEREFORE, IT IS CRITICAL TO FIELD VERIFY DIMENSIONS, SHOULD THERE BE ANY QUESTIONS REGARDING THE CONTRACT DOCUMENTS, THE SUBCONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING A CLARIFICATION FROM THE ENGINEER PRIOR TO PROCEEDING WITH THE WORK. DETAILS ARE INTENDED TO SHOWN DESIGN INTENT. MODIFICATIONS MAY BE REQUIRED TO SUIT JOB DIMENSIONS OR CONDITIONS AND SUCH MODIFICATIONS SHALL BE INCLUDED AS PART OF WORK AND PREPARED BY THE ENGINEER PRIOR TO PROCEEDING WITH WORK.
8. THE SUBCONTRACTOR SHALL INSTALL ALL EQUIPMENT AND MATERIALS IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS UNLESS SPECIFICALLY STATED OTHERWISE.
9. IF THE SPECIFIED EQUIPMENT CANNOT BE INSTALLED AS SHOWN ON THESE DRAWINGS, THE SUBCONTRACTOR SHALL PROPOSE AN ALTERNATIVE INSTALLATION SPACE FOR APPROVAL BY THE ENGINEER AND DSA PRIOR TO PROCEEDING.
10. GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR THE SAFETY OF WORK AREA, ADJACENT AREAS AND BUILDING OCCUPANTS THAT ARE LIKELY TO BE AFFECTED BY THE WORK UNDER THIS CONTRACT. WORK SHALL CONFORM TO ALL OSHA REQUIREMENTS AND THE LOCAL JURISDICTION.
11. GENERAL CONTRACTOR SHALL COORDINATE WORK AND SCHEDULE WORK ACTIVITIES WITH OTHER DISCIPLINES.
12. ERECTION SHALL BE DONE IN A WORKMANLIKE MANNER BY COMPETENT EXPERIENCED WORKMAN IN ACCORDANCE WITH APPLICABLE CODES AND THE BEST ACCEPTED PRACTICE. ALL MEMBERS SHALL BE LAID PLUMB AND TRUE AS INDICATED ON THE DRAWINGS.
13. SEAL ANY PENETRATION WITH UL LISTED MATERIALS APPROVED BY LOCAL JURISDICTION. SUBCONTRACTOR SHALL KEEP AREA CLEAN, HAZARD FREE, AND DISPOSE OF ALL DEBRIS.
14. WORK PREVIOUSLY COMPLETED IS REPRESENTED BY LIGHT SHADED LINES AND NOTES. THE SCOPE OF WORK FOR THIS PROJECT IS REPRESENTED BY DARK SHADED LINES AND NOTES. SUBCONTRACTOR SHALL NOTIFY THE GENERAL CONTRACTOR OF ANY EXISTING CONDITIONS THAT DEVIATE FROM THE DRAWINGS PRIOR TO BEGINNING CONSTRUCTION.
15. SUBCONTRACTOR SHALL PROVIDE WRITTEN NOTICE TO THE CONSTRUCTION MANAGER 48 HOURS PRIOR TO COMMENCEMENT OF WORK.
16. THE SUBCONTRACTOR SHALL PROTECT EXISTING IMPROVEMENTS, PAVEMENTS, CURBS, LANDSCAPING AND STRUCTURES. ANY DAMAGED PART SHALL BE REPAIRED AT SUBCONTRACTOR'S EXPENSE TO THE SATISFACTION OF THE OWNER.
17. THE SUBCONTRACTOR SHALL CONTACT UTILITY LOCATING SERVICES PRIOR TO THE START OF CONSTRUCTION.
18. GENERAL CONTRACTOR SHALL COORDINATE AND MAINTAIN ACCESS FOR ALL TRADES AND SUBCONTRACTORS TO THE SITE AND/OR BUILDING.
19. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR SECURITY OF THE SITE FOR THE DURATION OF CONSTRUCTION UNTIL JOB COMPLETION.
20. THE GENERAL CONTRACTOR SHALL MAINTAIN IN GOOD CONDITION ONE COMPLETE SET OF PLANS WITH ALL REVISIONS, ADDENDA, AND CHANGE ORDERS ON THE PREMISES AT ALL TIMES.
21. THE GENERAL CONTRACTOR AND SUBCONTRACTOR SHALL PROVIDE PORTABLE FIRE EXTINGUISHERS WITH A RATING OF NOT LESS THAN 2-A OT 2-A:10-B:C AND SHALL BE WITHIN 25 FEET OF TRAVEL DISTANCE TO ALL PORTIONS OF WHERE THE WORK IS BEING COMPLETED DURING CONSTRUCTION.
22. ALL EXISTING ACTIVE SEWER, WATER, GAS, ELECTRIC, AND OTHER UTILITIES SHALL BE PROTECTED AT ALL TIMES, AND WHERE REQUIRED FOR THE PROPER EXECUTION OF THE WORK, SHALL BE RELOCATED AS DIRECTED BY THE ENGINEER. EXTREME CAUTION SHOULD BE USED BY THE SUBCONTRACTOR WHEN EXCAVATING OR DRILLING PIERS AROUND OR NEAR UTILITIES. SUBCONTRACTOR SHALL PROVIDE SAFETY TRAINING FOR THE WORKING CREW. THIS SHALL INCLUDE BUT NOT BE LIMITED TO A) FALL PROTECTION, B) CONFINED SPACE, C) ELECTRICAL SAFETY, AND D) TRENCHING & EXCAVATION.
23. ALL EXISTING INACTIVE SEWER, WATER, GAS, ELECTRIC AND OTHER UTILITIES, WHICH INTERFERE WITH THE EXECUTION OF THE WORK, SHALL BE REMOVED, CAPPED, PLUGGED OR OTHERWISE DISCONNECTED AT POINTS WHICH WILL NOT INTERFERE WITH THE EXECUTION OF THE WORK, AS DIRECTED BY THE RESPONSIBLE ENGINEER, AND SUBJECT TO THE APPROVAL OF THE OWNER AND/OR LOCAL UTILITIES.
24. THE AREAS OF THE OWNER'S PROPERTY DISTURBED BY THE WORK AND NOT COVERED BY THE TOWER, EQUIPMENT OR DRIVEWAY, SHALL BE GRADED TO A UNIFORM SLOPE, AND STABILIZED TO PREVENT EROSION.
25. SUBCONTRACTOR SHALL MINIMIZE DISTURBANCE TO THE EXISTING SITE DURING CONSTRUCTION. EROSION CONTROL MEASURES, IF REQUIRED DURING CONSTRUCTION, SHALL BE IN CONFORMANCE WITH THE FEDERAL AND LOCAL JURISDICTION FOR EROSION AND SEDIMENT CONTROL.
26. NO FILL OR EMBANKMENT MATERIAL SHALL BE PLACED ON FROZEN GROUNDING. FROZEN MATERIALS, SNOW OR ICE SHALL NOT BE PLACED IN ANY FILL OR EMBANKMENT.
27. THE SUBGRADE SHALL BE BROUGHT TO A SMOOTH UNIFORM GRADE AND COMPACTED TO 95 PERCENT STANDARD PROCTOR DENSITY UNDER PAVEMENT AND STRUCTURES AND 80 PERCENT STANDARD PROCTOR DENSITY IN OPEN SPACE. ALL TRENCHES IN PUBLIC RIGHT OF WAY SHALL BE BACKFILLED WITH FLOWABLE FILL OR OTHER MATERIAL PRE-APPROVED BY THE LOCAL JURISDICTION.
28. ALL NECESSARY RUBBISH, STUMPS, DEBRIS, STICKS, STONES, AND OTHER REFUSE SHALL BE REMOVED FROM THE SITE AND DISPOSED OF IN A LAWFUL MANNER.
29. ALL BROCHURES, OPERATING AND MAINTENANCE MANUALS, CATALOGS, SHOP DRAWINGS, AND OTHER DOCUMENTS SHALL BE TURNED OVER TO THE GENERAL CONTRACTOR AT COMPLETION OF CONSTRUCTION AND PRIOR TO PAYMENT.
30. CONTRACTOR SHALL SUBMIT A COMPLETE SET OF AS-BUILT REDLINES TO THE GENERAL CONTRACTOR UPON COMPLETION OF PROJECT AND PRIOR TO FINAL PAYMENT.
31. CONTRACTOR SHALL LEAVE PREMISES IN A CLEAN CONDITION.
32. THE PROPOSED FACILITY WILL BE UNMANNED AND DOES NOT REQUIRE POTABLE WATER OR SEWER SERVICE, AND IS NOT FOR HUMAN HABITAT (NO HANDICAP ACCESS REQUIRED).
33. OCCUPANCY IS LIMITED TO PERIODIC MAINTENANCE AND INSPECTION, APPROXIMATELY 2 TIMES PER MONTH, BY AT&T TECHNICIANS.
34. NO OUTDOOR STORAGE OR SOLID WASTE CONTAINERS ARE PROPOSED.
35. ALL MATERIAL SHALL BE FURNISHED AND WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE LATEST REVISION AT&T MOBILITY GROUNDING STANDARD "TECHNICAL SPECIFICATION FOR CONSTRUCTION OF GSM/GPRS WIRELESS SITES" AND "TECHNICAL SPECIFICATION FOR FACILITY GROUNDING". IN CASE OF A CONFLICT BETWEEN THE CONSTRUCTION SPECIFICATION AND THE DRAWINGS, THE DRAWINGS SHALL GOVERN.
36. CONTRACTORS SHALL BE RESPONSIBLE FOR OBTAINING ALL PERMITS AND INSPECTIONS REQUIRED FOR CONSTRUCTION. IF CONTRACTOR CANNOT OBTAIN A PERMIT, THEY MUST NOTIFY THE GENERAL CONTRACTOR IMMEDIATELY.
37. CONTRACTOR SHALL REMOVE ALL TRASH AND DEBRIS FROM THE SITE ON A DAILY BASIS.
38. INFORMATION SHOWN ON THESE DRAWINGS WAS OBTAINED FROM SITE VISITS AND/OR DRAWINGS PROVIDED BY THE SITE OWNER. CONTRACTORS SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES PRIOR TO ORDERING MATERIAL OR PROCEEDING WITH CONSTRUCTION.
39. NO WHITE STROBE LIGHTS ARE PERMITTED. LIGHTING IF REQUIRED, WILL MEET FAA STANDARDS AND REQUIREMENTS.
40. ALL COAXIAL CABLE INSTALLATIONS TO FOLLOW MANUFACTURER'S INSTRUCTIONS AND RECOMMENDATIONS.
41. CONTRACTOR TO ENSURE LOCATES ARE COMPLETED PRIOR TO DIGGING IN THE ROW. IF UTILITIES ARE INDICATED WITHIN 3 FEET OF THE PROPOSED ROUTE, OR IF CROSSING EXISTING UTILITY, CONTRACTOR TO POTHOLE EXISTING UTILITY TO DETERMINE DEPTH AND EXACT LOCATION PRIOR TO CONSTRUCTION. IF UTILITY IS DAMAGED DURING THE INSTALLATION OF THE NEW CONDUIT, IT SHALL BE THE CONTRACTORS RESPONSIBILITY TO CONTACT THE UTILITY IMMEDIATELY AND IT IS ALSO THE CONTRACTORS RESPONSIBILITY TO HAVE ANY DAMAGE FIXED AND/OR REPAIRED PRIOR TO CLOSING THE EXCAVATION.

GENERAL NOTES

EXOTHERMIC CONNECTION

MECHANICAL CONNECTION

CHEMICAL ELECTROLYTIC GROUNDING SYSTEM

TEST CHEMICAL ELECTROLYTIC GROUNDING SYSTEM

EXOTHERMIC WITH INSPECTION SLEEVE

GROUNDING BAR

GROUND ROD

TEST GROUND ROD WITH INSPECTION SLEEVE

SINGLE POLE SWITCH

DUPLEX RECEPTACLE

DUPLEX GFCI RECEPTACLE

FLUORESCENT LIGHTING FIXTURE
(2) TWO LAMPS 48-T8

SMOKE DETECTION (DC)

EMERGENCY LIGHTING (DC)

SECURITY LIGHT W/PHOTOCCELL LITHONIA ALXW
LED-1-25A400/51K-SR4-120-PE-DBDXTD

CHAIN LINK FENCE

WOOD/WROUGHT IRON FENCE

WALL STRUCTURE

LEASE AREA

PROPERTY LINE (PL)

SETBACKS

ICE BRIDGE

CABLE TRAY

WATER LINE

UNDERGROUND POWER

UNDERGROUND TELCO

OVERHEAD POWER

OVERHEAD TELCO

UNDERGROUND TELCO/POWER

ABOVE GROUND POWER

ABOVE GROUND TELCO

ABOVE GROUND TELCO/POWER

ABOVE GROUND FIBER

ABOVE GROUND FIBER/POWER

UNDERGROUND FIBER

UNDERGROUND FIBER/POWER

UNDERGROUND DUCT

ABOVE GROUND POWER/AC

ABOVE GROND POWER/DC

SECTION REFERENCE

DETAIL REFERENCE

ELEVATION REFERENCE

BREAKLINE

LEGEND

AB ANCHOR BOLT

ABV ABOVE

AC ALTERNATING CURRENT

ADDL ADDITIONAL

AFF ABOVE FINISHED FLOOR

AFG ABOVE FINISHED GRADE

AIC AMPERAGE INTERRUPTION CAPACITY

ALUM ALUMINUM

ALT ALTERNATE

ANT ANTENNA

APPROX APPROXIMATE

ARCH ARCHITECTURAL

ATS AUTOMATIC TRANSFER SWITCH

AWG AMERICAN WIRE GAUGE

BATT BATTERY

BLDG BUILDING

BLK BLOCK

BLKG BLOCKING

BM BEAM

BTC BARE TINNED COPPER CONDUCTOR

BOF BOTTOM OF FOOTING

CAB CABINET

CANT CANTILEVERED

CEC CALIFORNIA ELECTRIC CODE

CHG CHARGING

CLG CEILING

CLR CLEAR

COL COLUMN

COMM COMMON

CONC CONCRETE

CONSTR CONSTRUCTION

DBL DOUBLE

DC DIRECT CURRENT

DEPT DEPARTMENT

DF DOUGLAS FIR

DIA DIAMETER

DIAG DIAGONAL

DIM DIMENSION

DWG DRAWING

DWL DOWEL

(E) EXISTING

EA EACH

EC ELECTRICAL CONDUCTOR

EL ELEVATION

ELEC ELECTRICAL

EMT ELECTRICAL METALLIC TUBING

ENG ENGINEER

EQ EQUAL

EXP EXPANSION

EXT EXTERIOR

FAB FABRICATION

FF FINISH FLOOR

FG FINISH GRADE

FIF FACILITY INTERFACE FRAME

FIN FINISH(ED)

FLR FLOOR

FDN FOUNDATION

FOC FACE OF CONCRETE

FOM FACE OF MASONRY

FOS FACE OF STUD

FOW FACE OF WALL

FS FINISH SURFACE

FT FOOT

FTG FOOTING

GA GAUGE

GEN GENERATOR

GFCI GROUND FAULT CIRCUIT INTERRUPTER

GLB GLUE LAMINATED BEAM

GLV GALVANIZED

GPS GLOBAL POSITIONING SYSTEM

GND GROUND

GSM GLOBAL SYSTEM FOR MOBILE

HDR HEADER

HGR HANGER

HVAC HEAT/VENTILATION/AIR CONDITIONING

HT HEIGHT

IGR INTERIOR GROUND RING

IN INCH

INT INTERIOR

LB(S) POUND(S)

LF LINEAR FEET

LTE LONG TERM EVOLUTION

MAS MASONRY

MAX MAXIMUM

MB MACHINE BOLT

MECH MECHANICAL

MFR MANUFACTURER

MGB MASTER GROUND BAR

MIN MINIMUM

MISC MISCELLANEOUS

MTL METAL

MTS MANUAL TRANSFER SWITCH

MW MICROWAVE

(N) NEW

NEC NATIONAL ELECTRIC CODE

NO.(#) NUMBER

NTS NOT TO SCALE

OC ON CENTER

OPNG OPENING

(P) PROPOSED

P/C PRECAST CONCRETE

PCS PERSONAL COMMUNICATION SERVICES

PCU PRIMARY CONTROL UNIT

PRC PRIMARY RADIO CABINET

PP POLARIZING PRESERVING

PSF POUNDS PER SQUARE FOOT

PSI POUNDS PER SQUARE INCH

PT PRESSURE TREATED

PWR POWER CABINET

QTY QUANTITY

RAD RADIUS

RECT RECTIFIER

REF REFERENCE

REINF REINFORCEMENT

REQ'D REQUIRED

RET REMOTE ELECTRIC TILT

RMC RIGID METALLIC CONDUIT

RRH REMOTE RADIO HEAD

RRU REMOTE RADIO UNIT

RWY RACEWAY

SCH SCHEDULE

SHT SHEET

SIAD SMART INTEGRATED DEVICE

SIM SIMILAR

SPEC SPECIFICATION

SQ SQUARE

SS STAINLESS STEEL

STD STANDARD

STL STEEL

STRUCT STRUCTURAL

TEMP TEMPORARY

THK THICKNESS

TMA TOWER MOUNTED AMPLIFIER

TN TOE NAIL

TOA TOP OF ANTENNA

TOC TOP OF CURB

TOF TOP OF FOUNDATION

TOP TOP OF PLATE (PARAPET)

TOS TOP OF STEEL

TOW TOP OF WALL

TVSS TRANSIENT VOLTAGE SUPPRESSION SYSTEM

TYP TYPICAL

UG UNDERGROUND

UL UNDERWRITERS LABORATORY

UNO UNLESS NOTED OTHERWISE

UMTS UNIVERSAL MOBILE TELECOMMUNICATIONS SYSTEM

UPS UNINTERRUPTIBLE POWER SYSTEM (DC POWER PLANT)

VIF VERIFIED IN FIELD

W WIDE

W/ WITH

WD WOOD

W.P. WORK POINT

WP WEATHERPROOF

WT WEIGHT

ABBREVIATIONS



AT&T MOBILITY
10550 W. CHARLESTON
SUITE B
LAS VEGAS, NV 89135



BLACK & VEATCH


BLACK & VEATCH CORPORATION
8965 S EASTERN AVE
SUITE #325
LAS VEGAS, NV 89123

PROJECT NO: 129084.1501

DRAWN BY: SAL

CHECKED BY: GAC

0	04/01/19	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION

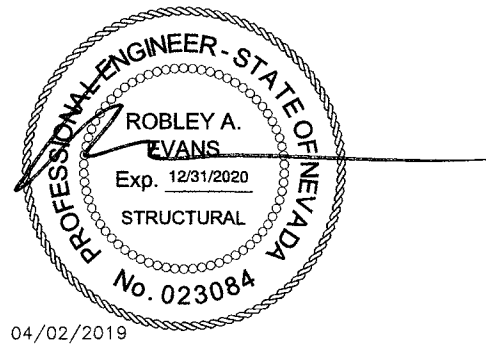

04/02/2019

IT IS A VIOLATION OF LAW FOR ANY PERSON,
UNLESS THEY ARE ACTING UNDER THE DIRECTION
OF A LICENSED PROFESSIONAL ENGINEER,
TO ALTER THIS DOCUMENT.

NVL08176F_R02
ADJACENT TO
BALZAR & WILLOWBURY DR
LAS VEGAS, NV 89108
PICO SMALL CELL

SHEET TITLE
GENERAL NOTES, LEGEND
AND ABBREVIATIONS

SHEET NUMBER

GN-1

STRUCTURAL STEEL NOTES

- DESIGN, FABRICATION, ERECTION, ALTERATION AND MAINTENANCE SHALL CONFORM TO THE FOLLOWING, UNLESS NOTED OTHERWISE (UNO).
 - TIA-222: STRUCTURAL STANDARD FOR ANTENNA SUPPORTING STRUCTURES AND ANTENNAS
 - TIA-1019-A: INSTALLATION, ALTERATION, AND MAINTENANCE OF ANTENNA SUPPORTING STRUCTURES AND ANTENNAS
 - AISC: MANUAL OF STEEL CONSTRUCTION
- ALL STRUCTURAL ELEMENTS SHALL CONFORM TO THE FOLLOWING REQUIREMENTS, UNO.
 - STRUCTURAL STEEL, ASTM A572 GRADE 65 (FY = 65 KSI).
 - ALL BOLTS, ASTM A325 TYPE 1 GALVANIZED HIGH STRENGTH BOLTS.
 - ALL NUTS, ASTM A563 CARBON AND ALLOY STEEL NUTS.
 - ALL WASHERS, ASTM F436 HARDENED STEEL WASHERS.
- ALL HOLES SHALL BE CUT WITH A GRINDER OR DRILLED. HOLES SHALL NOT BE FLAME CUT THRU STEEL UNLESS APPROVED BY THE ENGINEER OF RECORD.
- ALL FASTENERS SHALL NOT BE REUSED.
- A NUT LOCKING DEVICE SHALL BE INSTALLED ON ALL PROPOSED AND/OR REPLACED ASTM A325 BOLTS.
- ALL PROPOSED AND/OR REPLACED BOLTS SHALL BE OF SUFFICIENT LENGTH SUCH THAT THE END OF THE BOLT BE AT LEAST FLUSH WITH THE FACE OF THE NUT. IT IS NOT PERMITTED FOR THE BOLT END TO BE BELOW THE FACE OF THE NUT AFTER TIGHTENING IS COMPLETED.
- HOT-DIP GALVANIZE ALL ITEMS, UNO.
GALVANIZE PER ASTM A123, ASTM A153/A153M OR ASTM A653 G90, AS APPLICABLE.
- AFTER FINAL INSPECTION, ALL EXPOSED STRUCTURAL STEEL AS THE RESULT OF THIS SCOPE OF WORK INCLUDING WELDS, FIELD DRILLED HOLES, AND SHAFT INTERIORS (WHERE ACCESSIBLE), SHALL BE CLEANED AND COLD GALVANIZING APPLIED BY BRUSH. PHOTO DOCUMENTATION IS REQUIRED TO BE SUBMITTED TO THE INSPECTOR.

WELDING NOTES

- ALL WELDING SHALL BE IN ACCORDANCE WITH THE AWS D1.1/D1.1M, "STRUCTURAL WELDING CODE-STEEL".
- ALL WELDING SHALL BE PERFORMED BY AWS CERTIFIED WELDERS.
- ALL ARC WELDING ON STRUCTURES SHALL BE DONE IN ACCORDANCE WITH AWS D1.1 (LATEST EDITION). THIS SHALL INCLUDE A CERTIFIED WELDING INSPECTOR (CWI) FOR ACCEPTANCE OR REJECTION OF ALL WELDING OPERATIONS, PRE-DURING-POST, USING THE ACCEPTANCE CRITERIA OF AWS D1.1. THE CWI SHALL WORK WITH THE GC ON THE LEVEL OF INTERACTION NEEDED TO CONDUCT THE WELDING INSPECTION. THE CERTIFIED WELDING INSPECTION IS THE RESPONSIBILITY OF THE GC.
- FOR ALL WELDING, USE E80XX ELECTRODES FOR SMAW PROCESS AND E8XT-XX ELECTRODES FOR FCAW PROCESS, UNO.
- SURFACES TO BE WELDED SHALL BE FREE FROM SCALE, SLAG, RUST, MOISTURE, GREASE OR ANY OTHER FOREIGN MATERIAL THAT WOULD PREVENT PROPER WELDING. GRIND THE SURFACE ADJACENT TO THE WELD FOR A DISTANCE OF 2" MINIMUM ALL AROUND. ENSURE BOTH AREAS ARE 100% FREE OF ALL GALVANIZING.
- REPAIR THE GALVANIZED COATING. ALL AREAS AFFECTED BY THE FIELD DRILLING, FIELD GRINDING AND FIELD WELDING, BOTH INSIDE AND OUTSIDE THE MONOPOLE, SHALL BE REPAIRED. PRODUCTS TO BE APPLIED IN STRICT ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. AREAS THAT HAVE BEEN TOUCHED UP SHOULD BE INSPECTED AS PART OF THE ROUTINE MAINTENANCE OF THE STRUCTURE. NO SPRAY PAINT IS ALLOWED. AFTER ZINC-RICH PAINT IS DRY, OVERCOAT WITH OWNER'S PAINT SPECIFICATIONS, APPLIED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
- DO NOT WELD IF THE TEMPERATURE OF THE STEEL IN THE VICINITY OF THE WELD AREA IS BELOW 0° F. WHEN THE TEMPERATURE IS BETWEEN 0° F AND 32° F, PREHEAT AND MAINTAIN THE STEEL IN THE VICINITY OF THE WELD AREA AT 70° F DURING THE WELDING PROCESS.
- DO NOT WELD ON WET OR FROST-COVERED SURFACES & PROVIDE ADEQUATE PROTECTION FROM HIGH WINDS.
- MOVE ALL COAX AND OTHER FLAMMABLE MATERIALS FROM ANY AREA THAT MAY BE HEATED DURING CONSTRUCTION.
- CONTRACTOR SHALL MAKE PROPER PRECAUTIONS AND PROCEDURES TO PROTECT THE STRUCTURE FROM CATCHING FIRE DURING ALL WELDING OPERATIONS. THE FOLLOWING FIRE SAFETY PREVENTION PROTOCOL IS THE MINIMUM REQUIREMENTS DURING WELDING OPERATIONS:
 - 500 GALLON WATER TANK WITH PUMP TO BE ON SITE AT ALL TIMES.
 - 2 FIRE EXTINGUISHERS ON SITE AT ALL TIMES.
 - 2 MAN FIRE WATCH ON ANY ADJACENT STRUCTURES, FIELDS AND POLE.
 - INTERMITTENT COOLING OF WELDED SURFACE TO REDUCE HEAT IN STRUCTURE.

CLARK COUNTY NV STORMWATER BMP NOTES:

- THE OWNER, SITE DEVELOPER, CONTRACTOR, AND/OR THEIR AUTHORIZED AGENTS SHALL EACH DAY REMOVE ALL SEDIMENT, MUD, CONSTRUCTION DEBRIS, OR OTHER POTENTIAL POLLUTANTS THAT MAY HAVE BEEN DISCHARGED TO, OR ACCUMULATED IN, THE PUBLIC RIGHTS OF WAY OF CLARK COUNTY AS A RESULT OF CONSTRUCTION ACTIVITIES ASSOCIATED WITH THIS SITE DEVELOPMENT OR CONSTRUCTION PROJECT. SUCH MATERIALS SHALL BE PREVENTED FROM ENTERING THE STORM SEWER SYSTEM.
- ADDITIONAL CONSTRUCTION SITE DISCHARGE BEST MANAGEMENT PRACTICES MAY BE REQUIRED OF THE OWNER AND HIS OR HER AGENTS DUE TO UNFORESEEN EROSION PROBLEMS OR IF THE SUBMITTED PLAN DOES NOT MEET THE PERFORMANCE STANDARDS SPECIFIED IN THE LAS VEGAS VALLEY CONSTRUCTION SITE BMP GUIDANCE MANUAL.
- AT A MINIMUM, THE CONTRACTOR OR HIS AGENT SHALL INSPECT ALL DISTURBED AREAS, AREAS USED FOR STORAGE OF MATERIALS AND EQUIPMENT THAT ARE EXPOSED TO PRECIPITATION, VEHICLE ENTRANCE AND EXIT LOCATIONS, AND ALL BMPs WEEKLY, AND WITHIN 24 HOURS AFTER ANY RAIN EVENT OF 0.5 INCHES OR MORE. THE CONTRACTOR OR HIS AGENT SHALL UPDATE OR MODIFY THE STORMWATER POLLUTION PREVENTION PLAN AS NECESSARY. SOME EXCEPTIONS TO WEEKLY INSPECTIONS MAY APPLY, SUCH AS SUSPENSION OF LAND DISTURBANCE ACTIVITIES. REFER TO THE NEVADA STORMWATER GENERAL PERMIT FOR CONSTRUCTION ACTIVITY NVR100000, SECTION III.A.12.
- ACCUMULATED SEDIMENT IN BMPs SHALL BE REMOVED WITHIN SEVEN DAYS AFTER A STORMWATER RUNOFF EVENT OR PRIOR TO THE NEXT ANTICIPATED STORM EVENT, WHICHEVER IS EARLIER. SEDIMENT MUST BE REMOVED WHEN BMP DESIGN CAPACITY HAS BEEN REDUCED BY 50 PERCENT OR MORE.
- BMP'S TO BE IMPLEMENTED INCLUDE BUT ARE NOT LIMITED TO:
 - MINIMIZE DISTURBED AREA AND PROTECT NATURAL FEATURES AND SOIL
 - CONTROLLING STORMWATER FLOWING ONTO AND THROUGH THE PROJECT VIA THE USE OF SEDIMENT BERMES AND STRAW WADDLES AS APPROPRIATE
 - STABILIZING SOILS THROUGH SITE RESTORATION AT COMPLETION OF PROJECT
 - PROTECTING STORM DRAIN INLETS VIA THE USE OF SAND BAGS, STRAW WADDLES AND FILTER FABRIC AS APPROPRIATE
- BMP'S MUST BE IN PLACE WHEN SOILS ARE EXPOSED (NO WAITING PERIODS)

CLARK COUNTY NV PUBLIC WORKS DEVELOPMENT NOTES

- STRUCTURAL DESIGN ACCEPTANCE IS VALID ONLY FOR POLE FOUNDATIONS INSTALLED ON LEVELED SURFACES. ANY FOUNDATION INSTALLED WITHIN (5FT) FROM A SLOPE WILL REQUIRE SLOPE STABILITY ANALYSIS AND CALCULATIONS WITH A SEPARATE STRUCTURAL REVIEW AND FEE. GEOTECHNICAL WILL BE NEEDED FOR THE REVIEW.
- SIDEWALKS MUST BE UNOBSTRUCTED AND HAVE AN ACCESS OF AT LEAST 3.0-FT FROM BACK OF CURB.

SPECIAL INSPECTIONS REQUIRED

- PERFORM THIRD PARTY SPECIAL INSPECTION FOR (STREET LIGHT FOUNDATION...),SPECIAL INSPECTION IS REQUIRED.
- INSPECTIONS SHALL BE PERFORMED BY AN ICC CERTIFIED INSPECTOR APPROVED BY CLARK COUNTY; EMPLOYED BY THE OWNER/DEVELOPER.
 - PROVIDE SPECIAL INSPECTIONS IN ACCORDANCE WITH THE 2012 INTERNATIONAL BUILDING CODE FOR THE ITEMS LISTED BELOW.
 - MASONRY- PERIODIC
 - REINFORCING STEEL PLACEMENT- PERIODIC
 - GROUT-CONTINUOUS
 - CONCRETE PLACEMENT-CONTINUOUS
 - CONCRETE STRENGTH- CONTINUOUS
 - EPOXY FASTENED DOWELS AND ANCHORS-PERIODIC
 -
 - THE INSPECTOR SHALL SUBMIT A STATEMENT TO THE OWNER/DEVELOPER, AND STRUCTURAL ENGINEER INDICATING COMPLIANCE WITH THE PLANS AND SPECIFICATIONS.
 - SPECIAL INSPECTION OF THE FILL AROUND THE ((STREET LIGHT FOUNDATION...)) SHALL BE PROVIDED AT A FREQUENCY AS NECESSARY TO ENSURE THAT PROPER FILL AND COMPACTION IS ACHIEVED. COMPACTION TEST FOR EACH LIFT SHALL BE TAKEN PER CCAUSD 203.05.02. THE SPECIAL INSPECTOR SHALL SUBMIT A COMPLIANCE REPORT TO THE OWNER/DEVELOPER



AT&T MOBILITY
10550 W. CHARLESTON
SUITE B
LAS VEGAS, NV 89135




BLACK & VEATCH

BLACK & VEATCH CORPORATION
8965 S EASTERN AVE
SUITE #325
LAS VEGAS, NV 89123

PROJECT NO:	129084.1501
DRAWN BY:	SAL
CHECKED BY:	GAC

0	04/01/19	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION

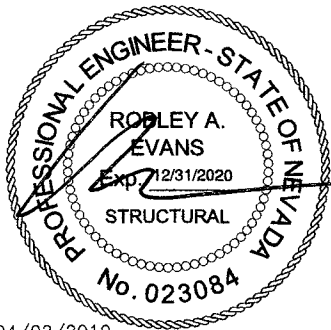

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

NVL08176F_R02
ADJACENT TO
BALZAR & WILLOWBURY DR
LAS VEGAS, NV 89108
PICO SMALL CELL

SHEET TITLE




GENERAL NOTES

SHEET NUMBER

GN-3

SMALL CELL SITE SURVEY
SITE: CRAN_NVL08176F_R02
SE¼NW¼ OF SECTION 23, TOWNSHIP 20 SOUTH, RANGE 60 EAST

SITE #/PACE_NAME: CRAN_NVL08176F_R02_LTE_1C_1900
FA LOCATION CODE: 14819930
USID: 208966

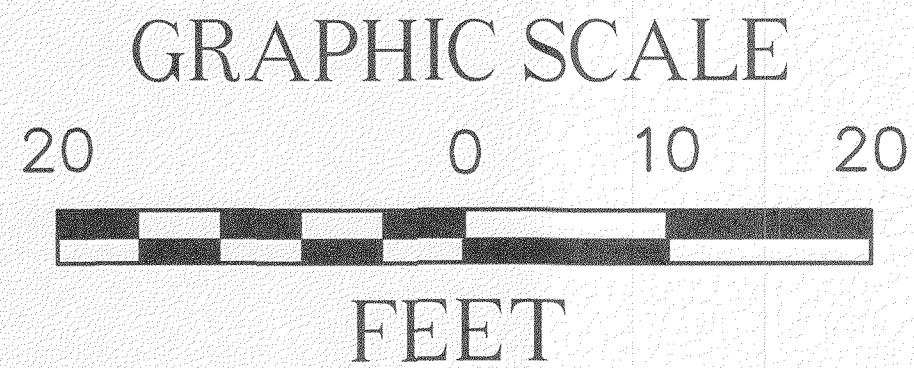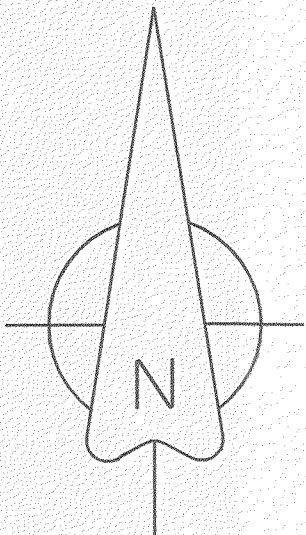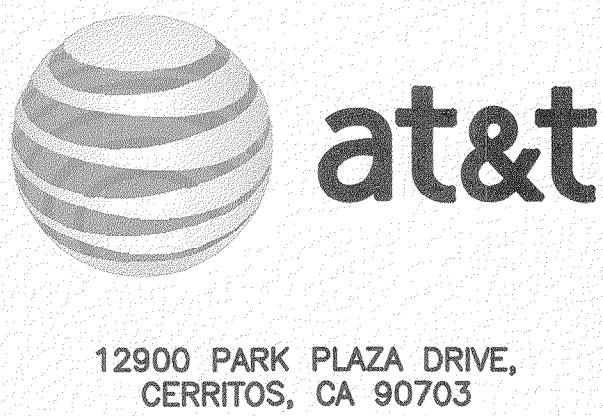

A LATITUDE: 36°11'58.22"N
LONGITUDE: 115°14'08.90"W
GROUND ELEVATION: 2308.41'
NAVD '88

Legend	
	MONUMENT
	POLE
	DOWN GUY
	GAS VALVE
	PEDASTAL
	LAMP POST
	WATER VALVE
	FIRE HYDRANT
	WATER MANHOLE
	WATER METER
	SEWER MANHOLE
	UNKNOWN OR LABELED MANHOLE
	SANITARY SEWER MANHOLE
	STORM WATER MANHOLE
	ELECTRIC MANHOLE
	TELECOM MANHOLE
	TREE
	FENCE LINE
	ROW LINE
	CENTER LINE
	SEWER
	TELEPHONE
	WATER
	ELECTRIC
	GAS LINE
	OVERHEAD ELEC
	FENCE BARB
	PROPERTY LINE

ENGINEERS:

BLACK & VEATCH

6 SUNSET WAY
SUITE B108
HENDERSON, NV 89014

SITE NO:	CRAN_NVL08176F_R02	
DRAWN BY:	KJC	
CHECKED BY:	CIS	
REV	DATE	DESCRIPTION
A	3/15/19	PRELIMINARY SUBMITAL

SURVEYOR:

PROFESSIONAL LAND SURVEYING
435-660-0816

CIS JOB NO:
CIS 315-1-31-62

SHEET TITLE
**SMALL CELL
SITE SURVEY**

SHEET NUMBER
1 OF 1