

717 LINESHACK LN.

OWNER	Hilltop Developers	ADDRESS	717 Lineshack Ln
DATE	8-30-88	GEN. CONT.	Conco Dev
BUILD. TYPE	SFD	PERMIT No.	4516-13
LEGAL	Lot 18 B-1	LOG No.	T-89

LEGAL		BUILDING		MECHANICAL	
Pl. Loc. & Ft. ☐		Plumbing Cont. <i>Kilassic Plg</i>			
Location & Footing ☐ <i>RS 10/17/88</i>		Permit No. <i>5179-3</i>		Date <i>9/14/88</i>	
Stemwall ☐		A/C Cont. <i>YV Energy Mgt</i>			
Concrete Slab Floor ☐ <i>RS 11/18/88</i>		Permit No. <i>2343-5</i>		Date <i>11/18/88</i>	
Chimney Steel ☐		Sewer Fe <i>4516-13</i>			
Fireplace Footing ☐		Irrig. Cont.			
Vert. Steel Reinf. ☐		Permit No.		Date	
Horiz. Steel Reinf. ☐		Hood Cont.			
Roof Sheathing <i>RS 11/30/88</i>		Permit No.		Date	
Insulation <i>RS 1-5-89</i>		Rough Soil ☐			
Framing <i>RS 1-4-89</i>		Rough Water ☐ <i>EH 11/2/88</i>			
Ext. Lath <i>RS 11/17/88</i>		Top-Out		<i>EH 12 30 88</i>	
Scratch		Rough Gas		<i>EH 12 30 88</i>	
Frown		A/C Rough Duct. <i>EH 12 30 88</i>			
Drywall <i>RS 1-1-89</i>		Final Plumbing			
Final Building		Final Gas			
Appr. for Occu. Final Building		Final Air Cond.			
		Final Sewer <i>EH 11/2/88</i>			
		Rough Hood ☐			
Electrical Cont. <i>Kenning Const</i>		Final Hood ☐			
Permit No. <i>9581-3</i> <i>12/28/88</i>		Final Irrig			
PT Rough <i>RS 12-30-88</i>					
Ground Electrode					
Temporary Power		Temp. Pole Cont.			
Meter Tag		Permit No.		Date	
Final Electrical		Inspection		Date	

DEPARTMENT OF BUILDING & SAFETY CITY OF LAS VEGAS

DEPARTMENT OF BUILDINGS		PERMIT NO
717 LINESHACK		9581-3
LOT NO	MAP NO	INSPECTOR 72
SUBMITTER'S NAME		PHONE
INSPECTOR'S SIGNATURE Robert Smith		INSPECTION DATE 3-21-89

☐ PARTIAL INSPECTION - DESCRIPTION

☒ **APPROVED**

☐ **PERMIT REQUIRED**

☐ **STOP WORK**


☐ **REJECTED - CORRECTION NOTICE - REINSPECTION REQUIRED CALL 799-2071**

INSPECT	DESCRIPTION	INSPECT	DESCRIPTION	INSPECT	DESCRIPTION
☐ E-1	FOUNDATION/OUT REBAR/CONC	☐ P-1	ON SITE SEWER	☐ X-2	UNDERGROUND HYDRO
☐ E-2	STEM WALL - FORMS - REBAR	☐ P-2	ON SITE WATER	☐ X-3	UNDERGROUND FINAL FLOW
☐ E-3	FIRE SLAB	☐ P-3	BUILDING SEWER (WATERTIGHT)	☐ X-4	SPRINKLER SYSTEM HYDRO
☐ E-4	ROOF SHEATHING	☐ P-4	UNDERSLAB PLUMBING	☐ X-5	FIRE ALARM
☐ E-5	FRAMING	☐ P-5	TOP-OUT WATER/GAS WASTE	☐ X-6	OTHER
☐ E-6	INSULATION	☐ P-6	FINAL GAS TEST	☐ X-7	FINAL FIRE
☐ E-7	DRYWALL/PAINTING	☐ P-7	FINAL PLUMBING		
☐ E-8	EXTERIOR LATH STUCCO			☐ E-1	UNDERGROUND ELECTRICAL
☐ E-9	W.D. BRICK & STEEL	☐ M-1	ROUGH VENT	☐ E-2	ROUGH ELECTRICAL
☐ E-10	POOL - FTL/SLATE	☐ M-2	HOOD	☐ E-3	LOW VOLTAGE ELECTRICAL
☐ E-11	POOL - PRE-PLASTER/FINAL	☐ M-3	FINAL MECHANICAL	☐ E-4	SEWAGE INSPECTION
☐ E-12	BUILDING FINAL			☒ E-5	FINAL ELECTRICAL
☐ E-13	CERT OF OCC	☐ X-1	KICKER / FLUSH	☐ E-6	TEMP POWER

☒ **FINAL INSPECTION**

BRING HARD CARD WITH FIRE, QUALITY CONTROL & PLANNING APPROVALS
 SIGNED CFF TO BLDG & SAFETY FOR C. of O. ISSUANCE (Commercial Only)

TECHNICAL ASSISTANCE CALL 799-6016

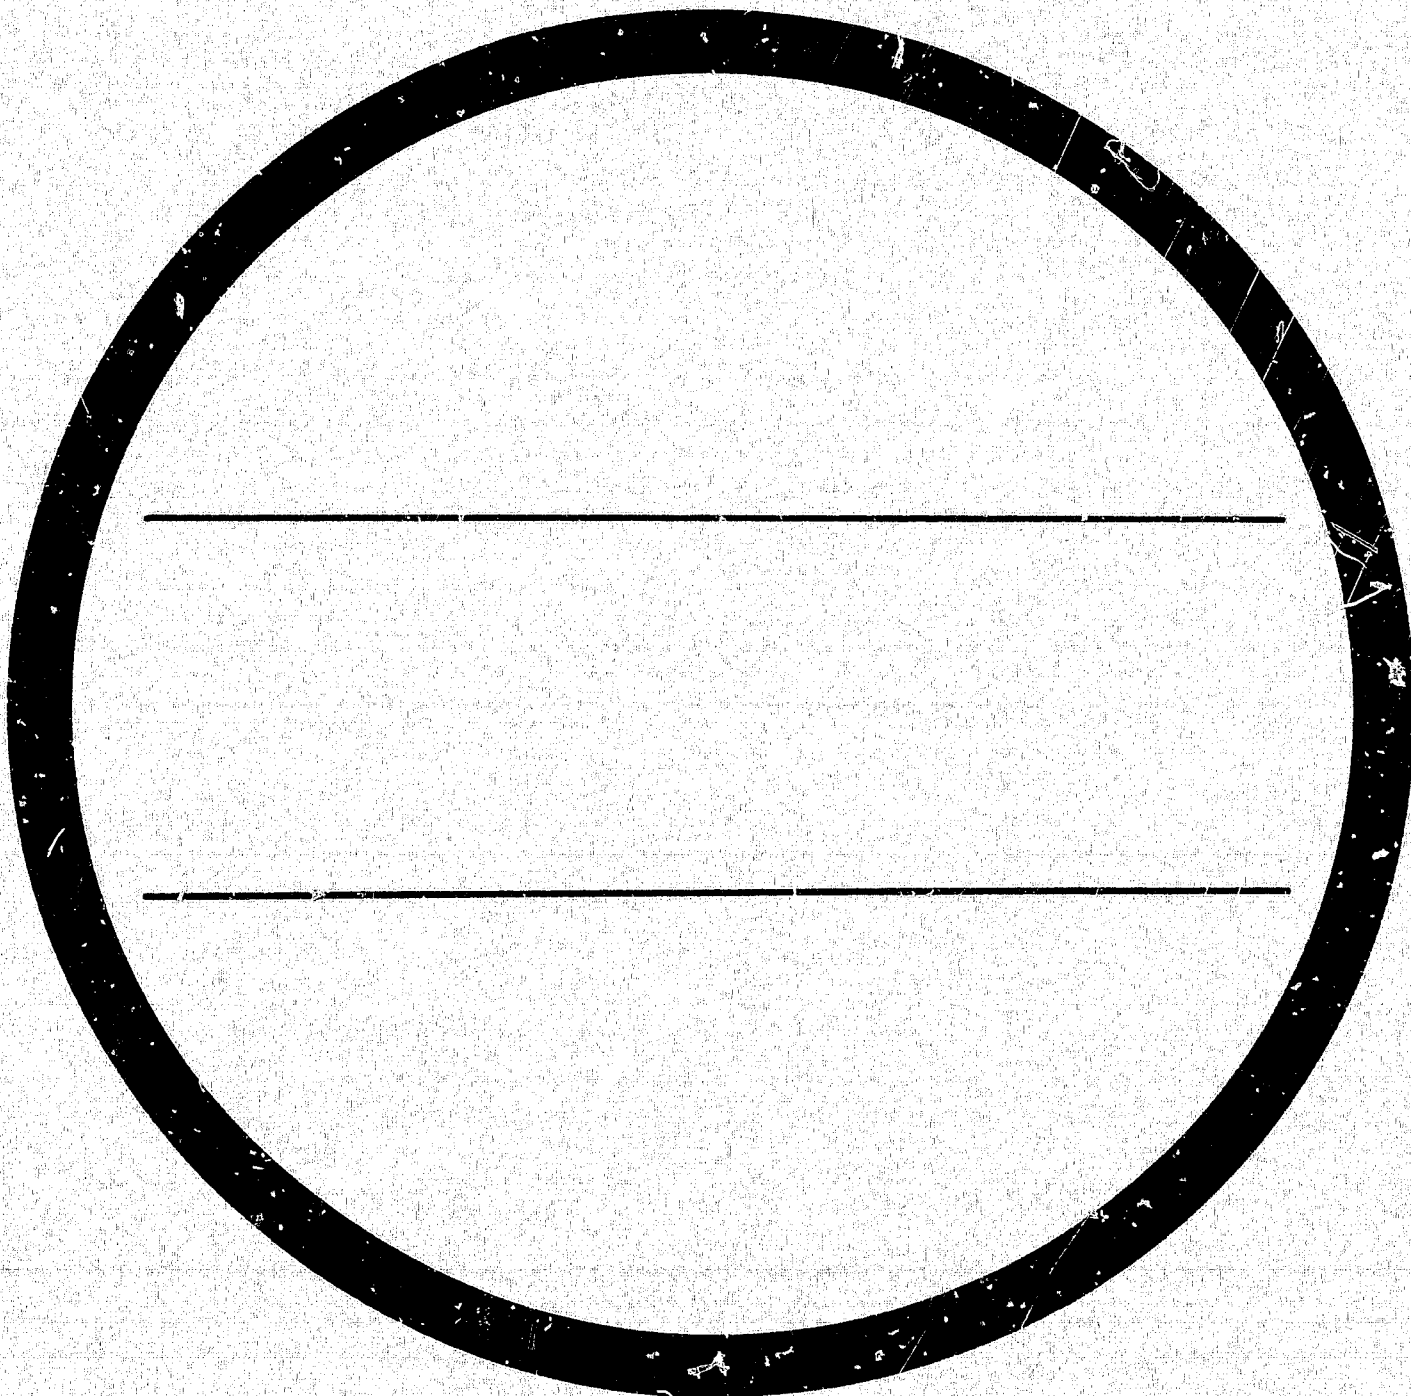

COMGRAPHIX, INC.



Southwest Microfilm Division