





- ① PROVIDE (1) IN-LINE TWO POLE FUSE HOLDER WITH 10A FUSES AND (1) IN-LINE SINGLE POLE FUSE HOLDER WITH 10A FUSE PER POLE LOCATED AT THE HANMOHLE
- ② WIRE FROM HANMOHLE TO 120V RECEPTACLE SHALL BE 10/3 THW STR (3 TOTAL)
- ③ WIRING TO LUMINAIRES AND RECEPTACLE FROM HANMOHLE SHALL INCLUDE GROUND
- ④ 2" CONDUIT WITH 4-#4, 1-#6 THW WIRE (TYP)
- * ⑤ 2" CONDUIT WITH 2-#4, 1-#6 THW WIRE (TYP)
- ⑥ CONTROL CIRCUIT FOR 120V RECEPTACLE SHALL BE FED FROM STREET LIGHT PHOTO EYE
- ⑦ COORDINATE ALL WORK WITH CITY OF LAS VEGAS ELECTRICAL SHOP PHONE # 229-6831


* FOR CAMPBELL & INTERIOR STREET




ALL HAND HOLE COVERS MUST BE INSTALLED
POLE CAPS POURED, AND PULL BOX LIDS
BOLTED DOWN PRIOR TO ENERGIZING CIRCUIT.

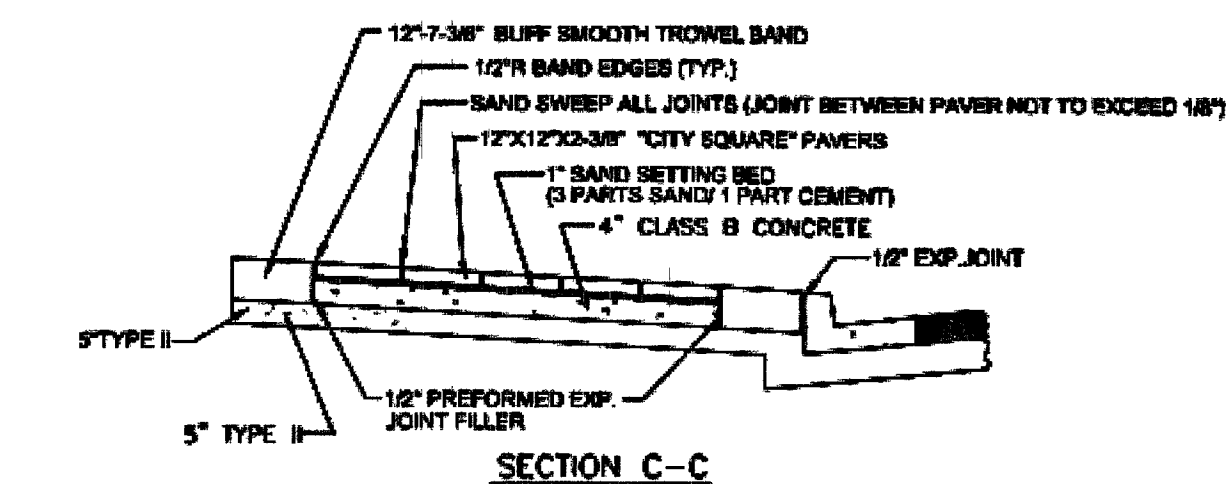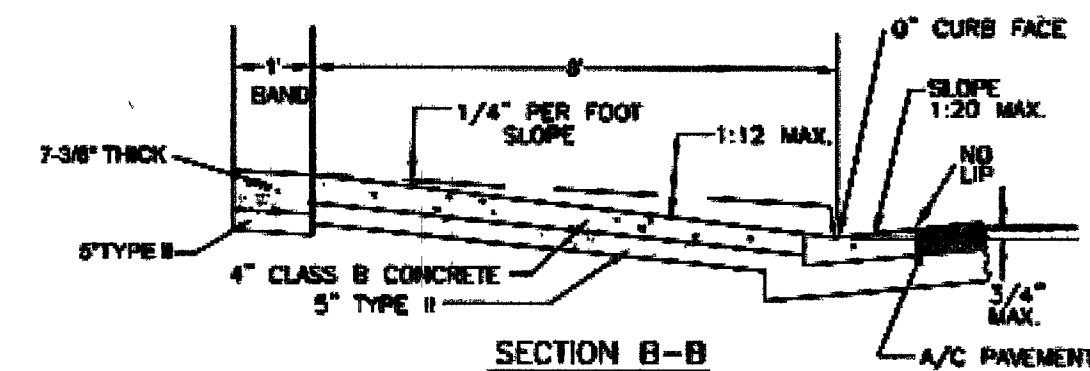

**COMMERCIAL DRIVEWAY ADJACENT
TO STREET GREATER THAN 90' R.O.W.**



CONCRETE SIDEWALK
NTS



AVOID HITTING UNDERGROUND
TRAFFIC SIGNAL AND STREET LIGHT
SYSTEM CONDUITS
IT'S DANGEROUS!

Call
before you
UnderGround

1-702-455-7511
CLARK COUNTY TRAFFIC OPERATIONS
AND
1-702-229-6611

86035