





- ① PROVIDE (1) IN-LINE TWO POLE FUSE HOLDER WITH 10A FUSES AND (1) IN-LINE SINGLE POLE FUSE HOLDER WITH 10A FUSE PER POLE LOCATED AT THE HANDHOLE
- ② WIRE FROM HANDHOLE TO 120V RECEPTACLE SHALL BE #10 THIN STR. (3 TOTAL)
- ③ WIRING TO LUMINAIRES AND RECEPTACLE FROM HANDHOLE SHALL INCLUDE GROUND.
- ④ 2" CONDUIT WITH 4-#1, 1-#2 THW WIRE (TYP)
- * ④A 2" CONDUIT WITH 2-#4, 1-#2 THW WIRE (TYP)
- ⑤ CONTROL CIRCUIT FOR 120V RECEPTACLE SHALL BE FED FROM STREET LIGHT PHOTO EYE
- ⑥ COORDINATE ALL WORK WITH CITY OF LAS VEGAS ELECTRIC PHONE # 229-6431

* FOR CAMPBELL & INTERIOR STREET



ALL HAND HOLE COVERS MUST BE INSTALLED
POLE CAPS POURED, AND PULL BOX LIDS
BOLTED DOWN PRIOR TO ENERGIZING CIRCUIT

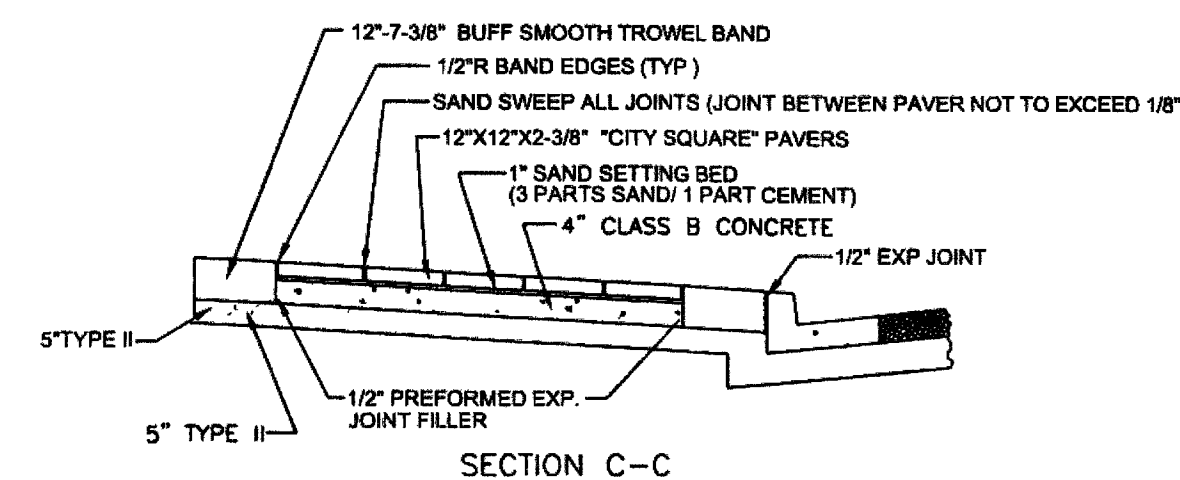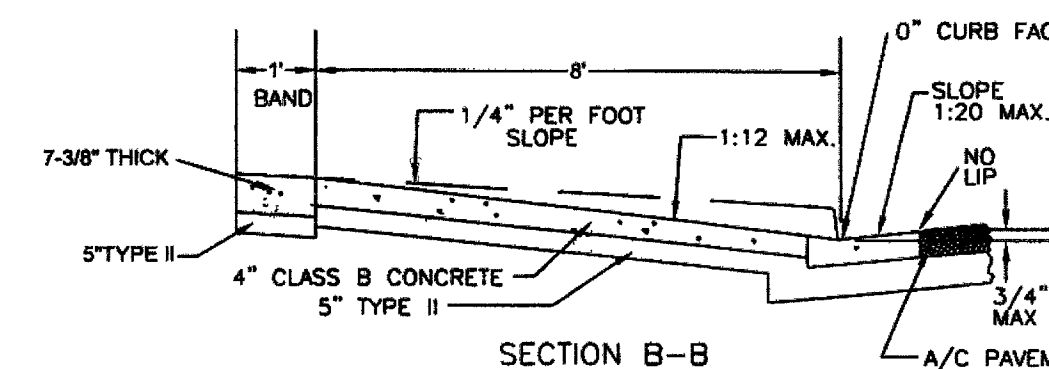

**COMMERCIAL DRIVEWAY ADJACENT
TO STREET GREATER THAN 90' R.O.W.**



CONCRETE SIDEWALK



10 OF 14 SHEETS
DRAWING NO.

2480 E. Tompkins Ave.
Suite # 232
Las Vegas, NV 89121
phone: 702.456.4664
fax: 702.456.4919



INTEGRITY

ENGINEERING

DESCRIPTION
REVISION APPROVAL BLOCK

REV #	BY	DATE
-------	----	------

JOB NO. 11-104