



1-800-227-2600
UNDERGROUND SERVICE (USA)

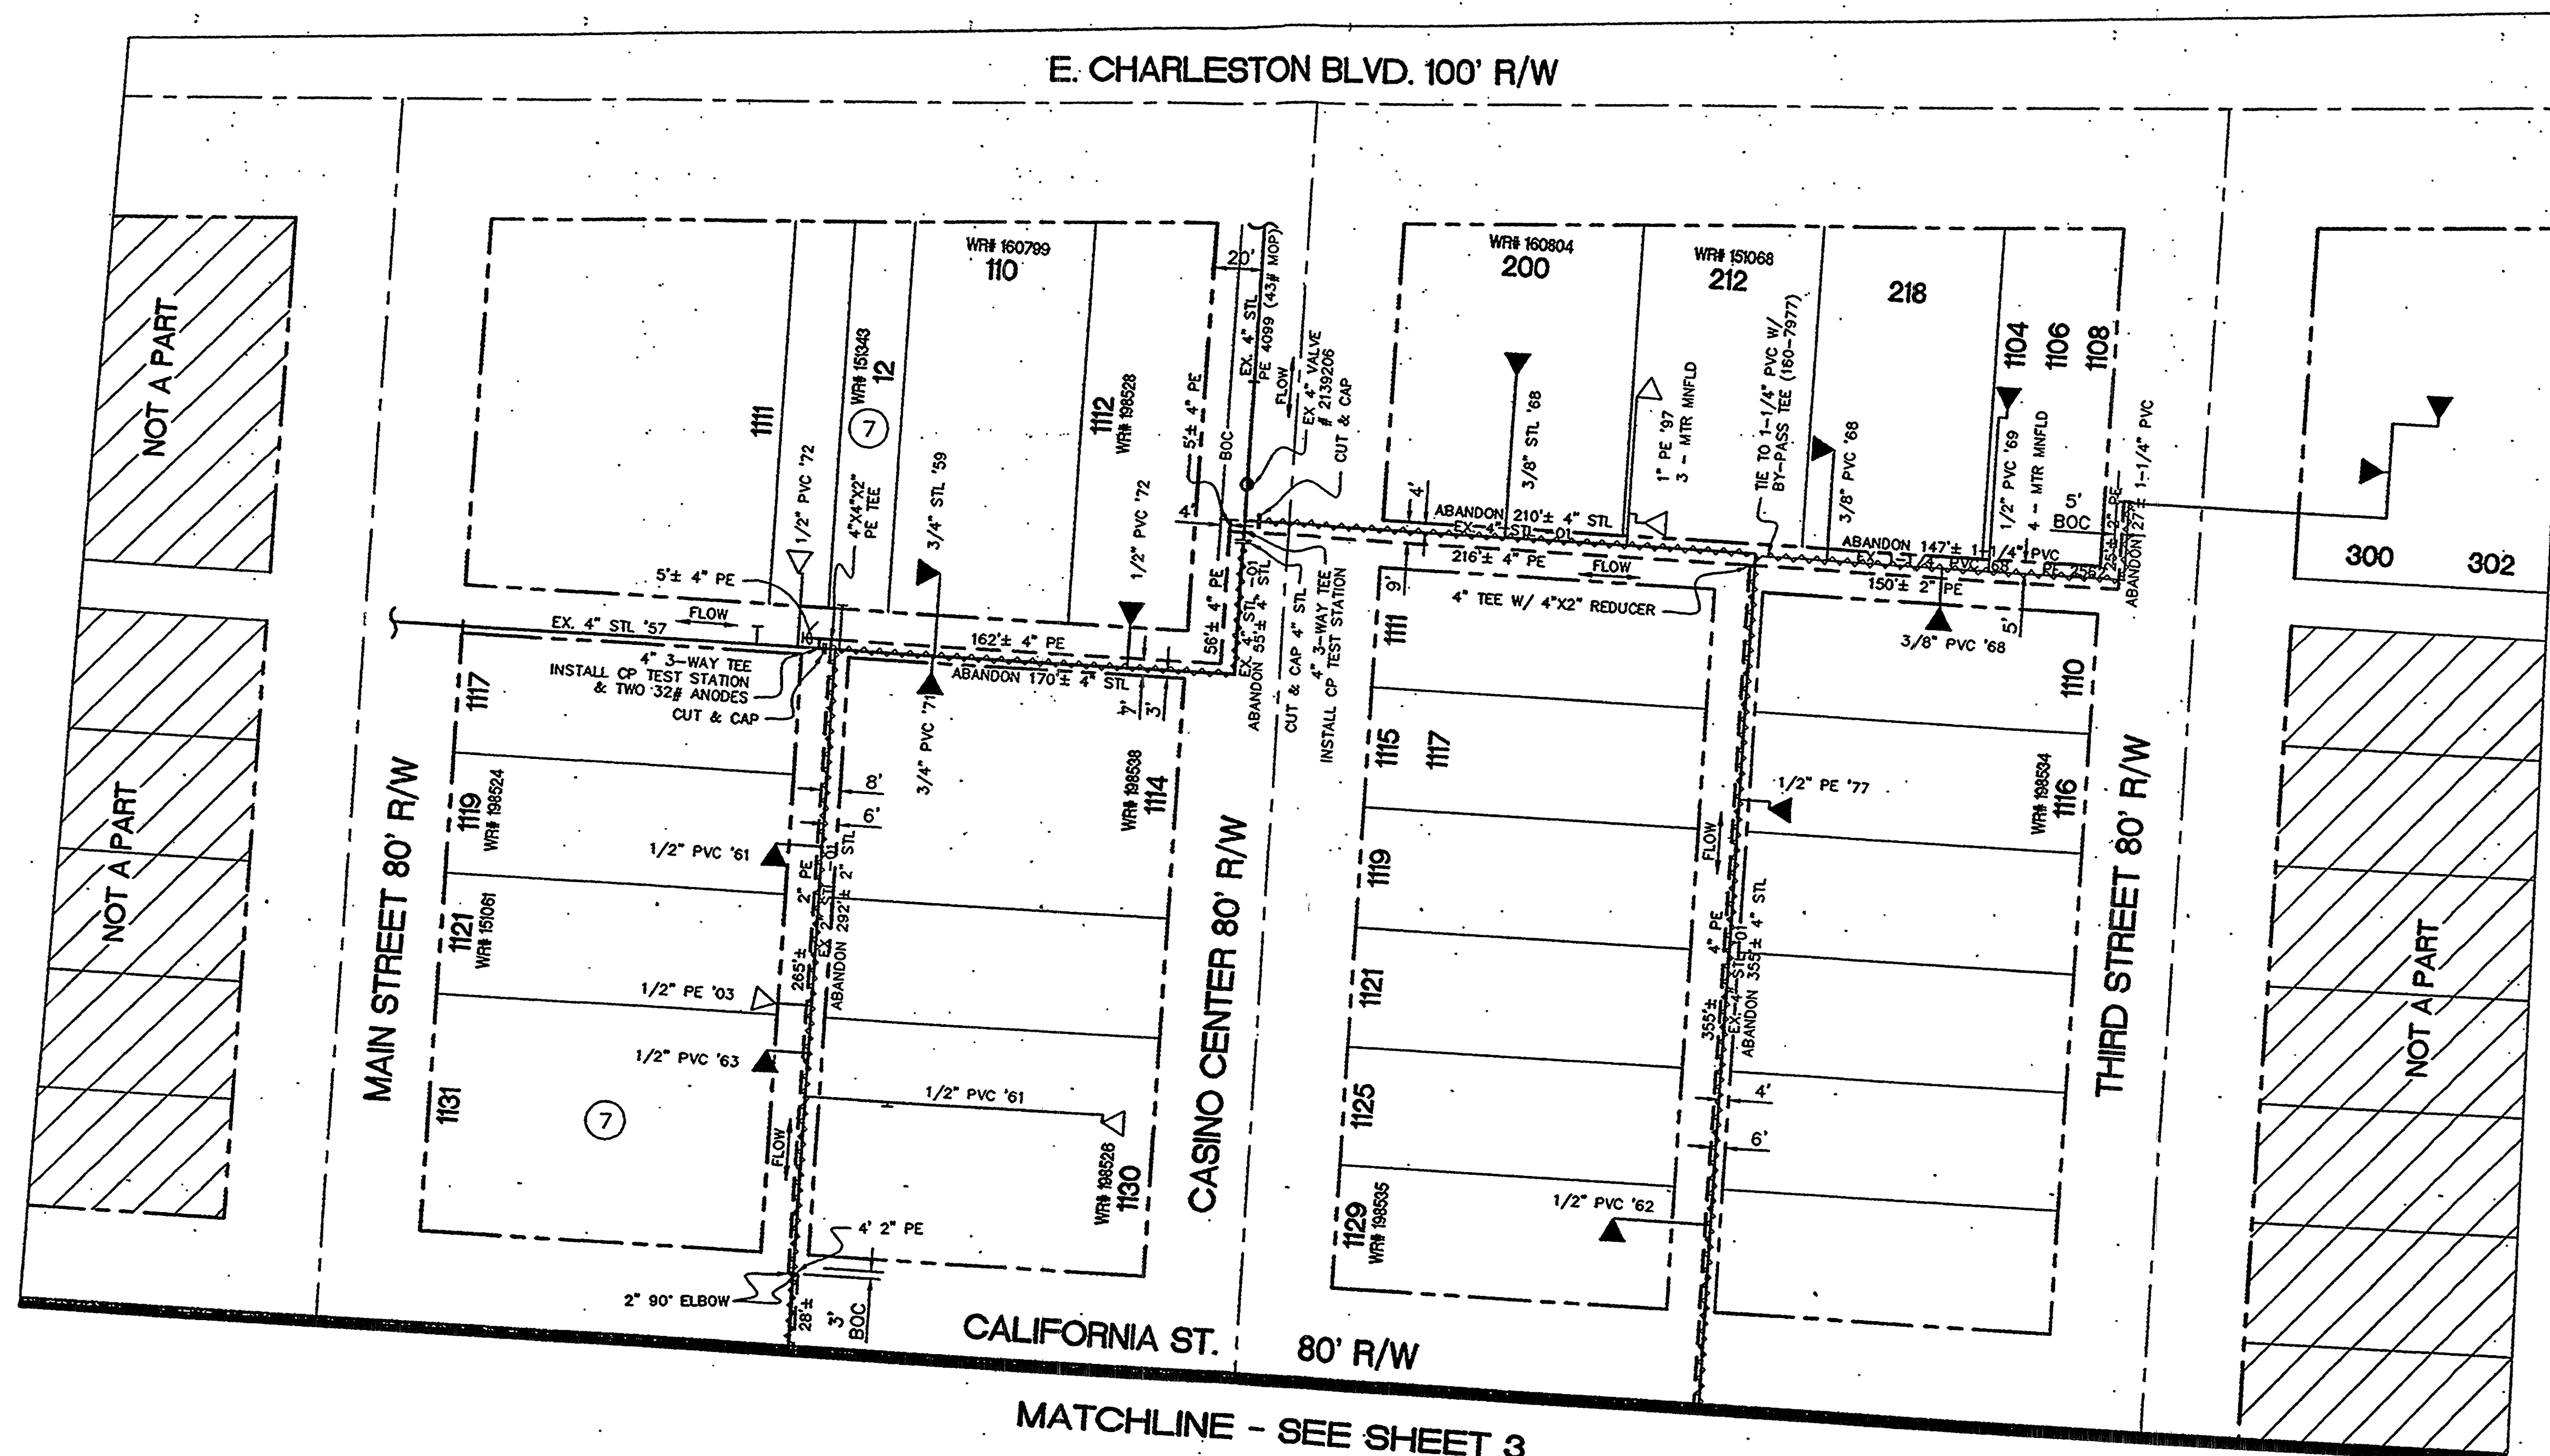

GRAPHIC SCALE

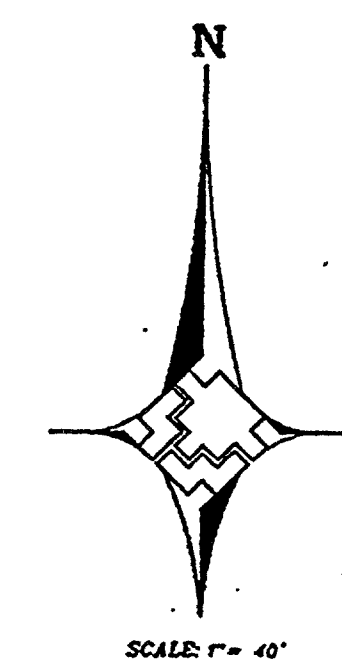

(IN FEET)
1 inch = 40

NOTHING ON THESE DRAWINGS SHALL BE RELIED ON OR CONSTRUED BY CONTRACTOR TO ESTABLISH THE METHOD OF INSTALLATION (I.E. INSERTION, SPLITTING OF SERVICE, OPEN CUT, OR BORING).

MAIN + SERVICE REPLACEMENT

REVISED

				3760102	2" PE MAIN	917%					AS-BUILT DRAWING-PRESSURE TEST DATA				VISUAL INSPECTION CERTIFICATION				CONSTRUCTION		ISOLATION AREA		W. R. NO.		ENGINEER/TECHNICIAN KIRK OVERBY				PHONE (702) 365-2008			
				3760104	4" PE MAIN	1336%					TEST MEDIUM				TEST METHOD				I HAVE VISUALLY INSPECTED ALL HEATED FLUIONS, SOLVENT CEMENT, MECHANICAL JOINTS, AND WELDS THAT HAVE PERFORMED				INSPECTOR		11		147369		ACCOUNT REP.		PHONE	
				3760202	2" STL MAIN		904%				PIPE DIA. _____				☐ GAUGE ☐ NITROGEN ☐ WATER ☐ SOAP				NAME _____				FOREMAN _____		LOCATION		PROJECT CONTACT BRYAN THATCHER		(702) 365-2165			
				3760204	4" STL MAIN		1312%				PIPE LENGTH _____				☐ CHART ☐ PRESS REC				REVIEWED BY _____				E. CHARLESTON / CASINO CENTER		TITLE NO.		SHEET NO. 2 OF 3		SCALE 1" = 40'		DATE APR, 2005	
REVISIONS				3800101	< 2" PE	195%					PIPE TYPE _____				MIN. DURATION _____				PERMIT INFORMATION				x627 y512		DWN.BY REH		CHKD. BY _____		APPRD. BY _____			
				3800201	< 2" STL	192%					TEST PRESS. (PSIG) _____				START _____				CITY OF LAS VEGAS						TITLE		SI - CLV - CASINO CENTER		MAIN REPLACEMENT			
				3800501	< 2" PVC						TIME _____				DATE _____				TAX CODE						E. CHARLESTON / CASINO CENTER		CITY OF LAS VEGAS					
				UNIT NO.	UNIT TYPE	INSTL.	RET.	INSTL.	RET.			POSTED BY _____				DATE _____				02-0203												
				PROPERTY UNITS								PERFORMED BY _____																				
 Southwest Gas Corporation																																
86792																																

107N 9460-SW6