
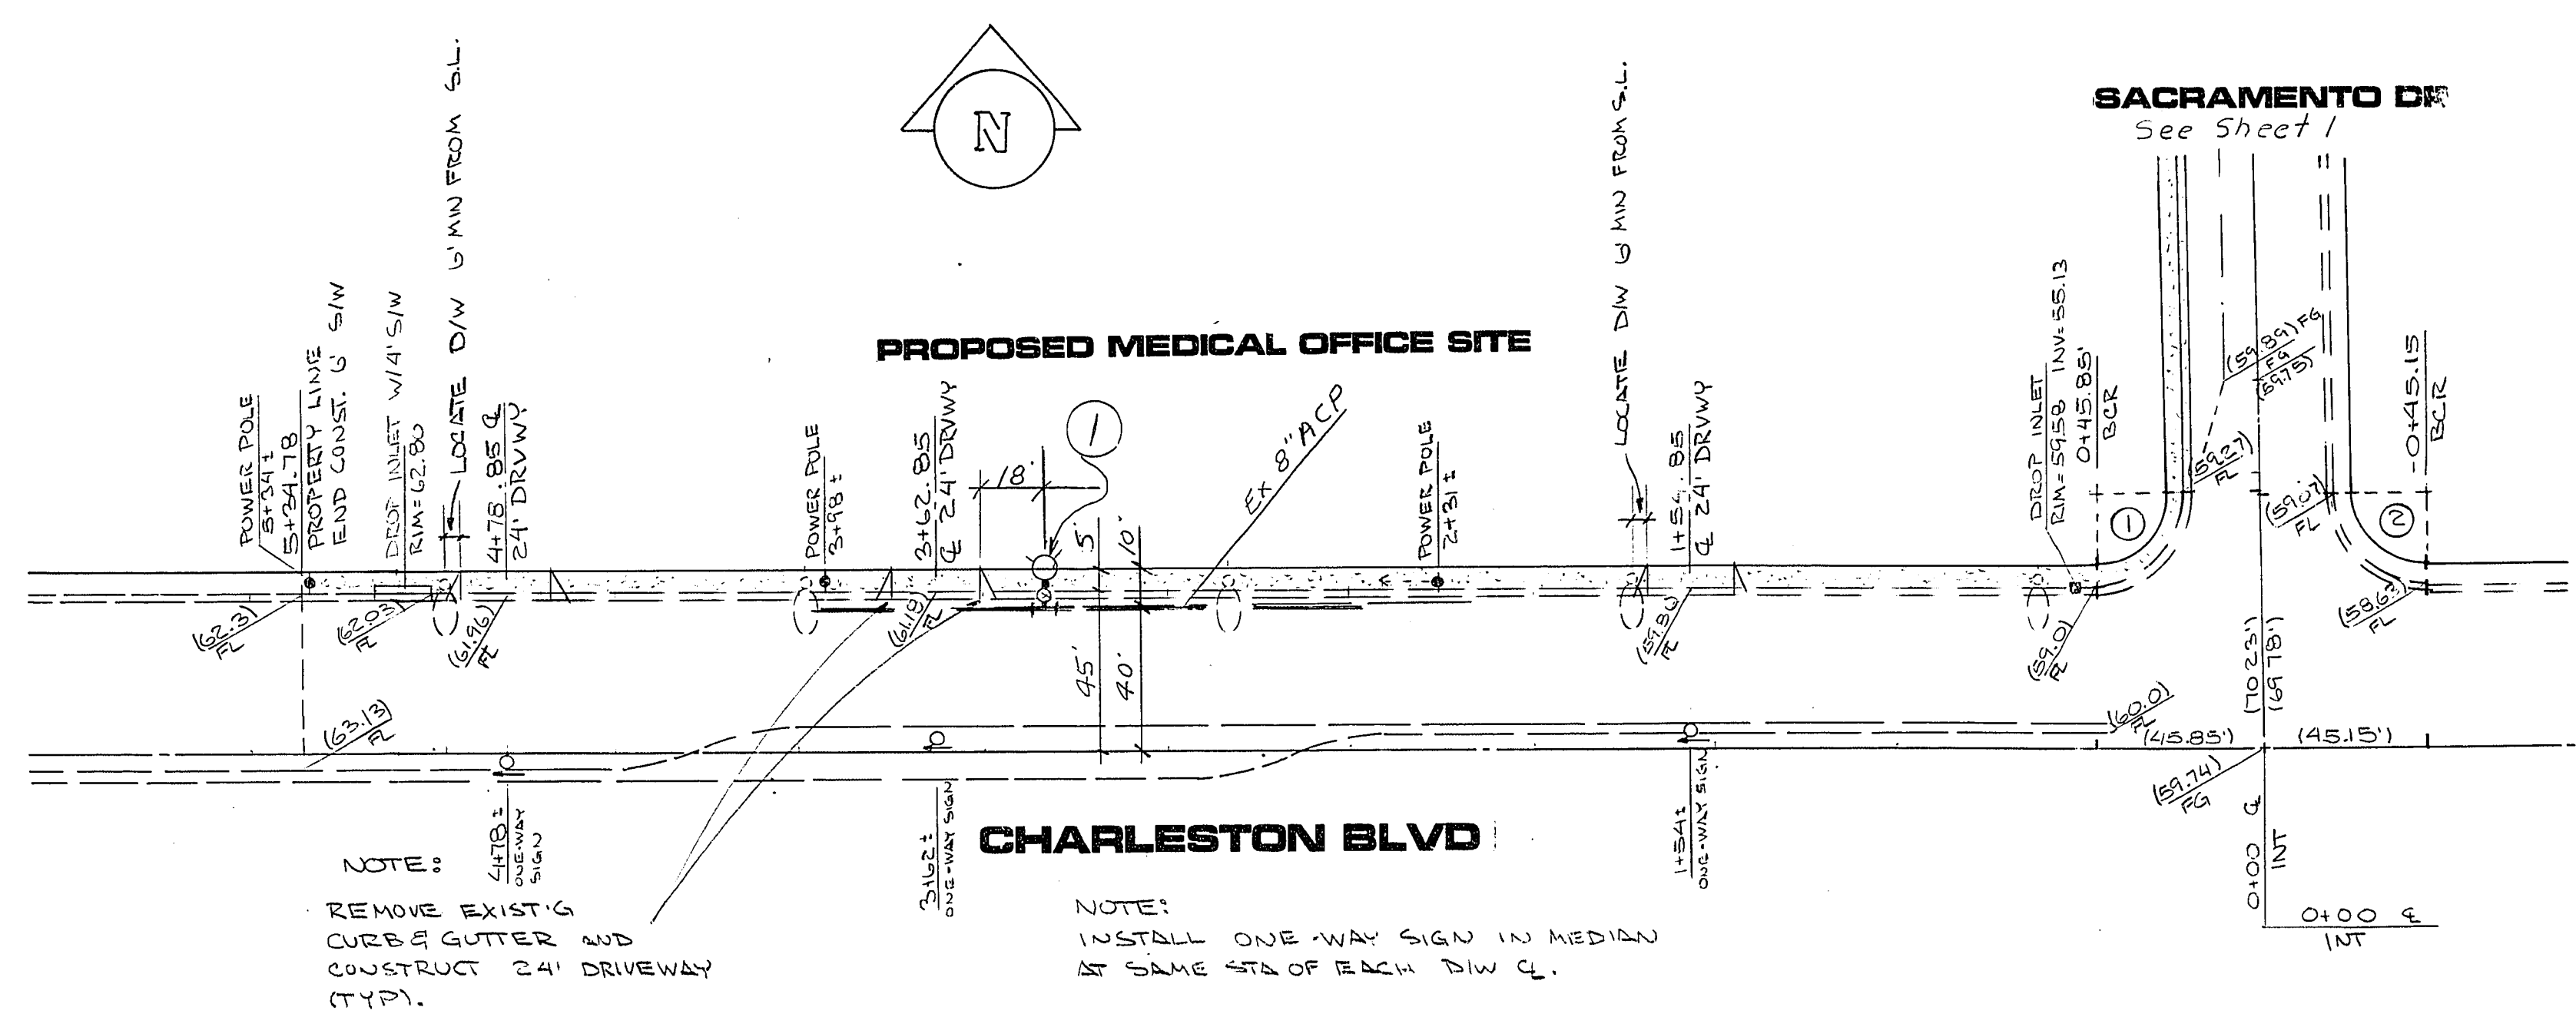
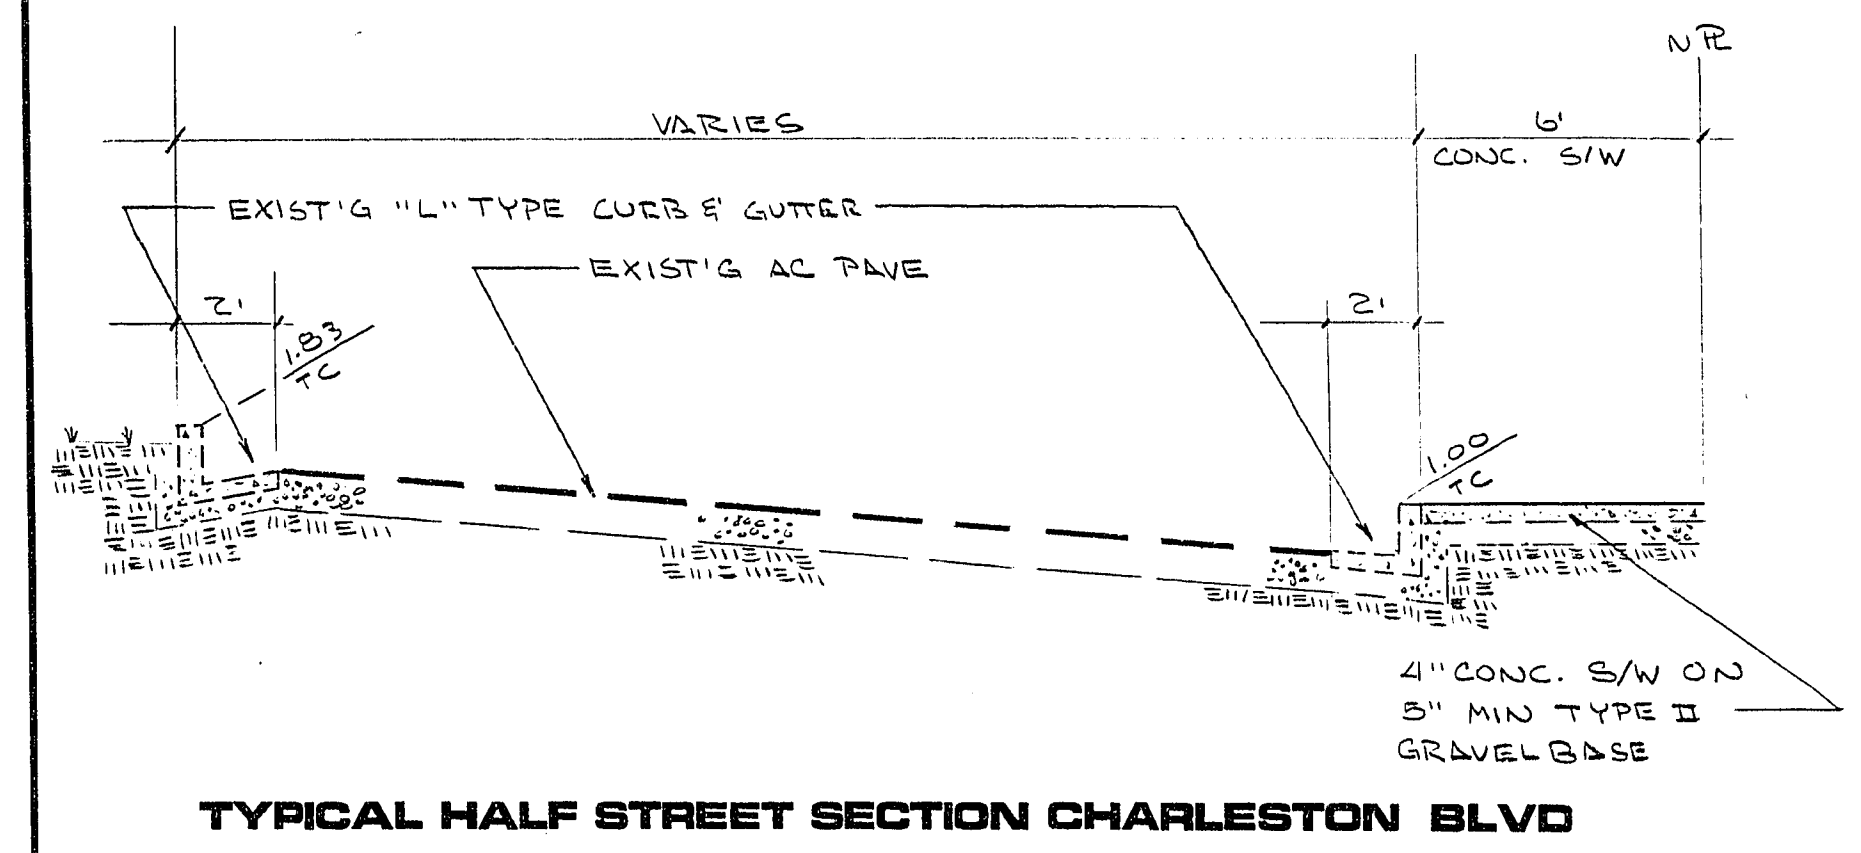


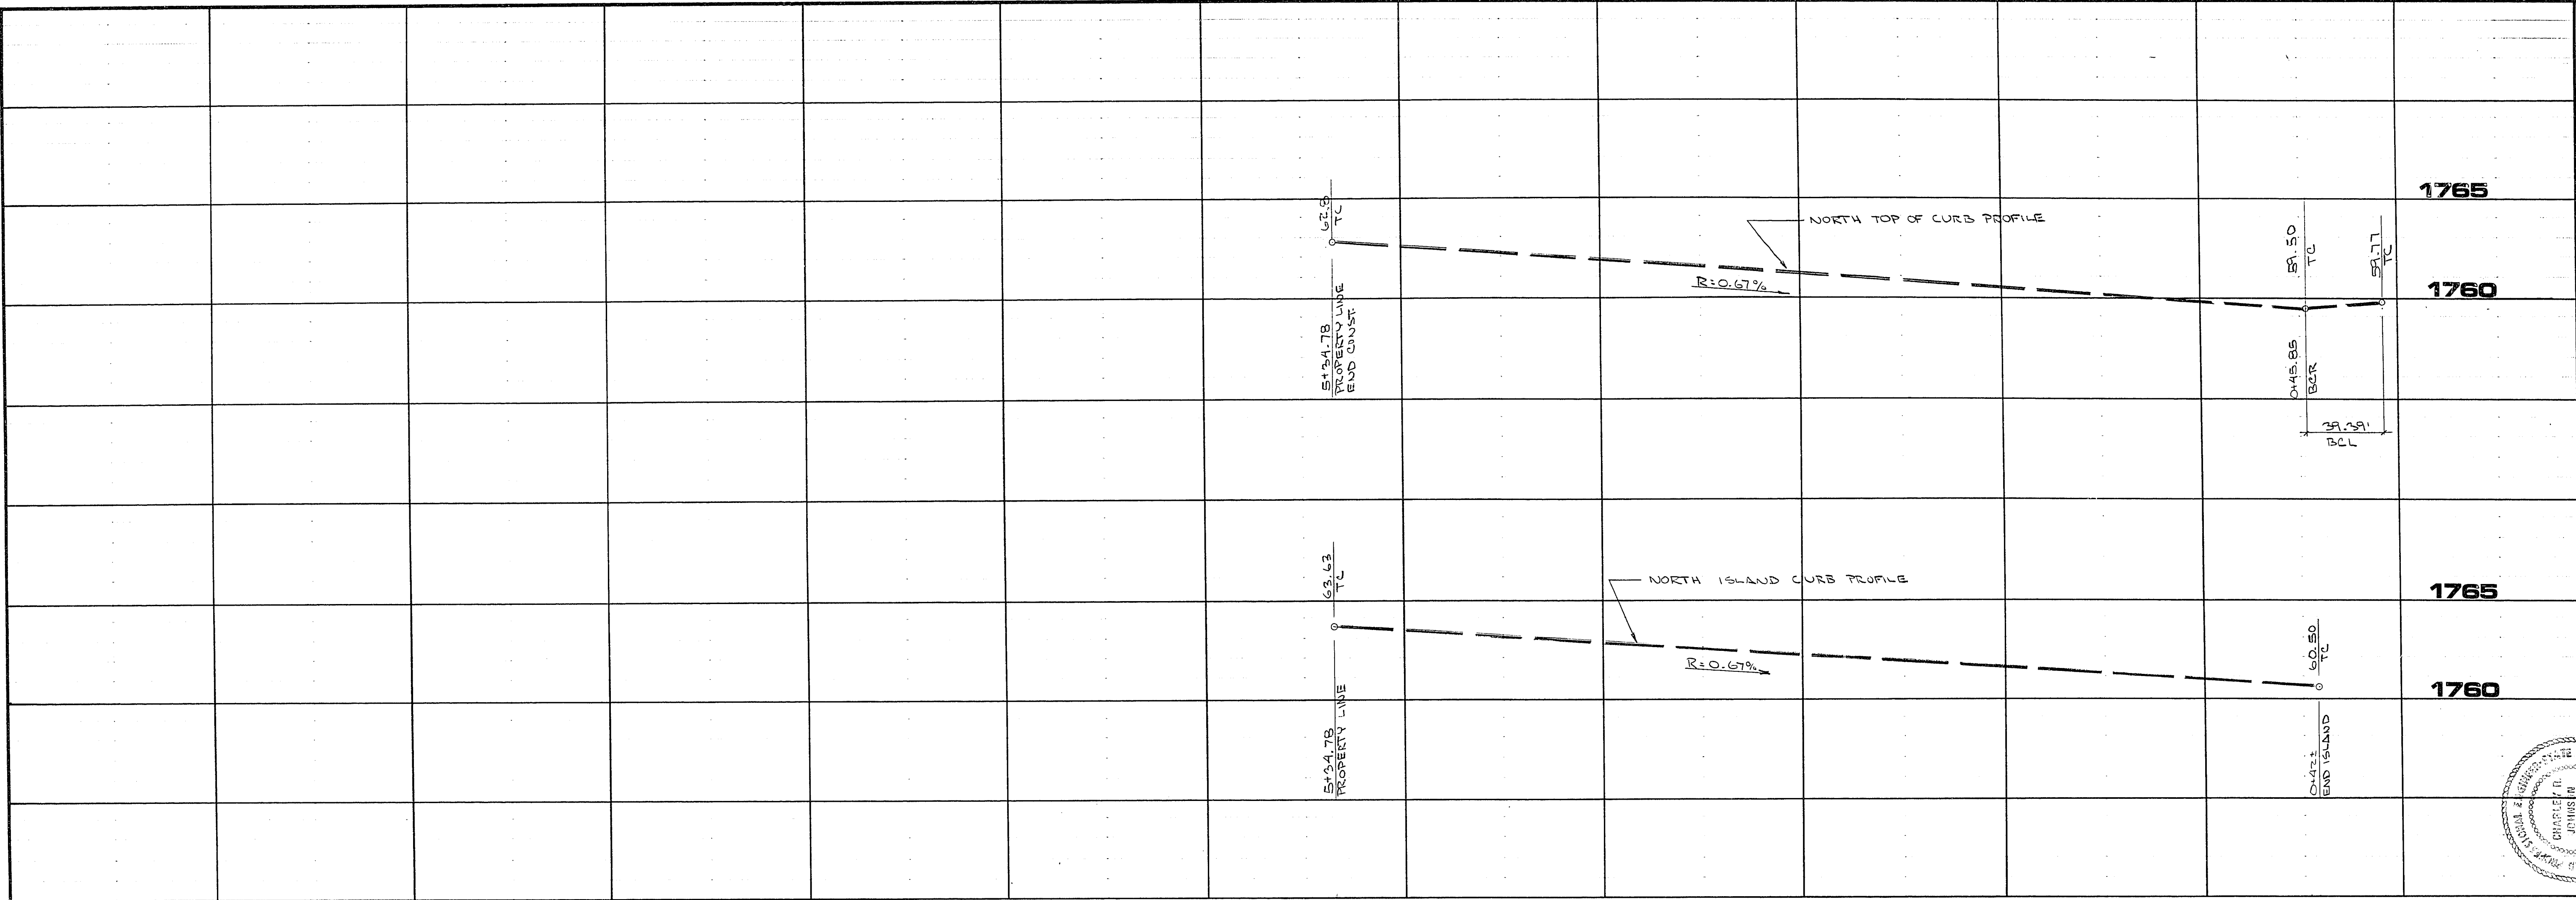

- 1(a) Construct Std Fire Hydrant Assy per City of Las Vegas standards as to location in sidewalk
- (b) 8"x6" Tapping sleeve w/6" tapping valve. Tap must be performed in the presence of a Las Vegas Valley Water District Inspector

CURVE DATA B/C				
#	Δ	R	L	T
1	90°16'59"	25.00	29.29	25.12
2	89°43'01"	25.00	29.16	24.88

APPROVED BY:

Tommy Brown 9/18/81
CLV ELECTRICAL COORDINATOR DATE

N.A.
CLV CITY ELECTRICIAN DATE

NEVADA POWER CO. DATE

N.A.
CLV ENGINEERING DEPT. DATE

Tommy Brown 9/18/81
CLV QUALITY CONTROL DATE

Tommy Brown 9-17-81
CLV TRAFFIC ENGR. DATE

Tommy Brown 9-14-81
CLV FIRE MARSHALL DATE

REV	DATE	BY	REVISION
1	1/27/82	CCJ	Added FH Assy on Charleston Blvd
1	8/19/81	CCJ	

SUBMITTED BY: *Tommy Brown* DATE: 8/19/81

CHARLEY R. JOHNSON PE
NEVADA CERT #3005

CONSULTING ENGINEERS • PLANNERS
2800 WEST SAHARA AVENUE BUILDING 4 SUITE B
LAS VEGAS, NEVADA 89102 PHONE (702) 873-7550

vtm nevada

TITLE	STREET PLAN & PROFILE CHARLESTON BLVD EAST CHARLESTON MEDICAL OFFICE BUILDING
PROJECT	
WO NO.	22946
BY	D.W.M. C.P.S.
DATE	
SCALE	HORIZ: 1"=40' VERT: 1"=4'
SHEET	2
OF 2 SHEETS	