


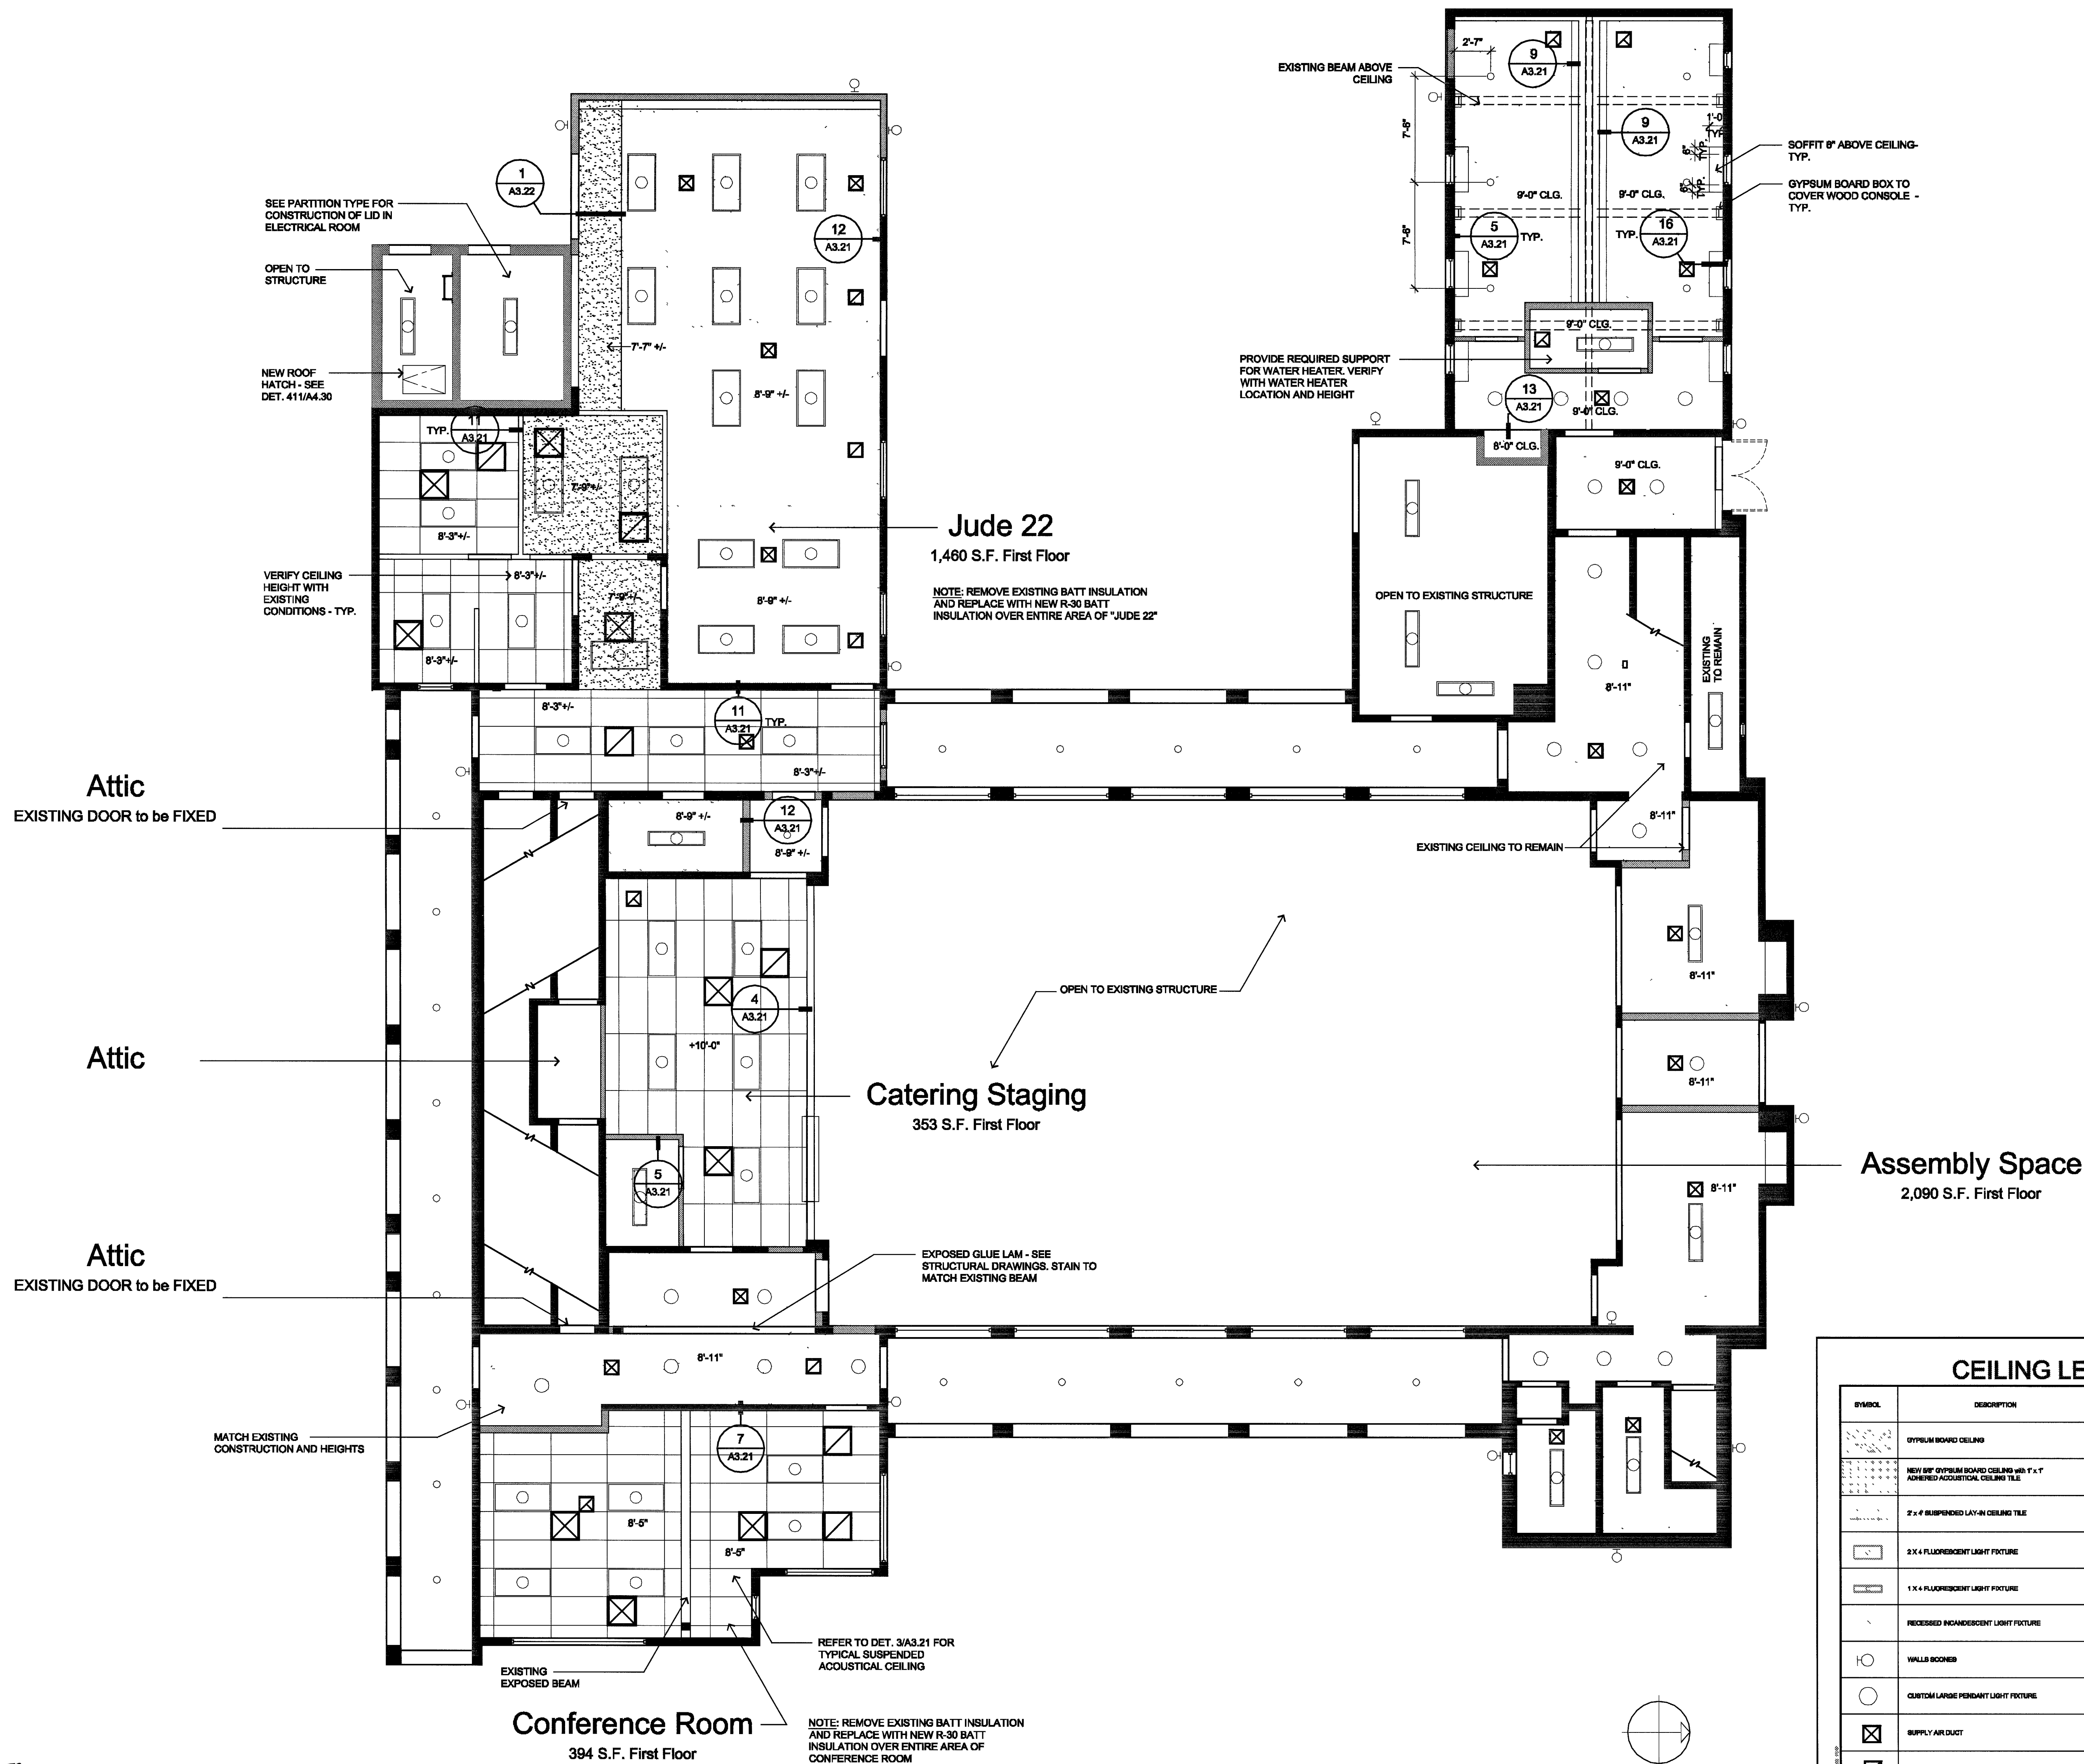

CEILING LEGEND		
SYMBOL	DESCRIPTION	DETAIL
	GYPSUM BOARD CEILING	
	NEW 5/8\"/>	
	2\"/>	
	2\"/>	
	1\"/>	
	RECESSED FLUORESCENT LIGHT FIXTURE	
	WALL SCONCE	BOTTOM OF FIXTURE MOUNT 8\"/>
	CUSTOM LARGE PENDANT LIGHT FIXTURE	
	SUPPLY AIR DUCT	
	RETURN AIR DUCT	
	EXHAUST AIR DUCT	

CEILING NOTES	
1. ALL CEILING HEIGHTS ARE AT 11' 0\"/>	
2. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.	
3. ALL HANG RESISTERS TO MATCH CEILING COULDS.	
4. REFER TO FINISH SCHEDULE FOR ADDITIONAL INFORMATION.	
5. PROVIDE ACCESS PANELS IN CEILINGS AS REQUIRED. COORDINATE LOCATIONS WITH ARCHITECT.	
6. ALL CEILING DIMS TO BE COVERTED TO ROOMS AS SHOWN. TYPICAL UNLESS NOTED OTHERWISE.	
7. SEE SHEET 410 AND 411 FOR EXISTING CEILING SCHEDULE.	
8. REMOVE EXISTING BATT INSULATION AND REPLACE WITH NEW R-30 BATT INSULATION OVER ALL AREAS WITH FLAT ROOF ON FIRST FLOOR OF BUILDING 3 AND OVER ENTIRE AREA OF SECOND FLOOR OF BUILDING 3.	

95873
BUILDING 3 - FIRST FLOOR - REFLECTED CEILING PLAN
3/16\"/>