

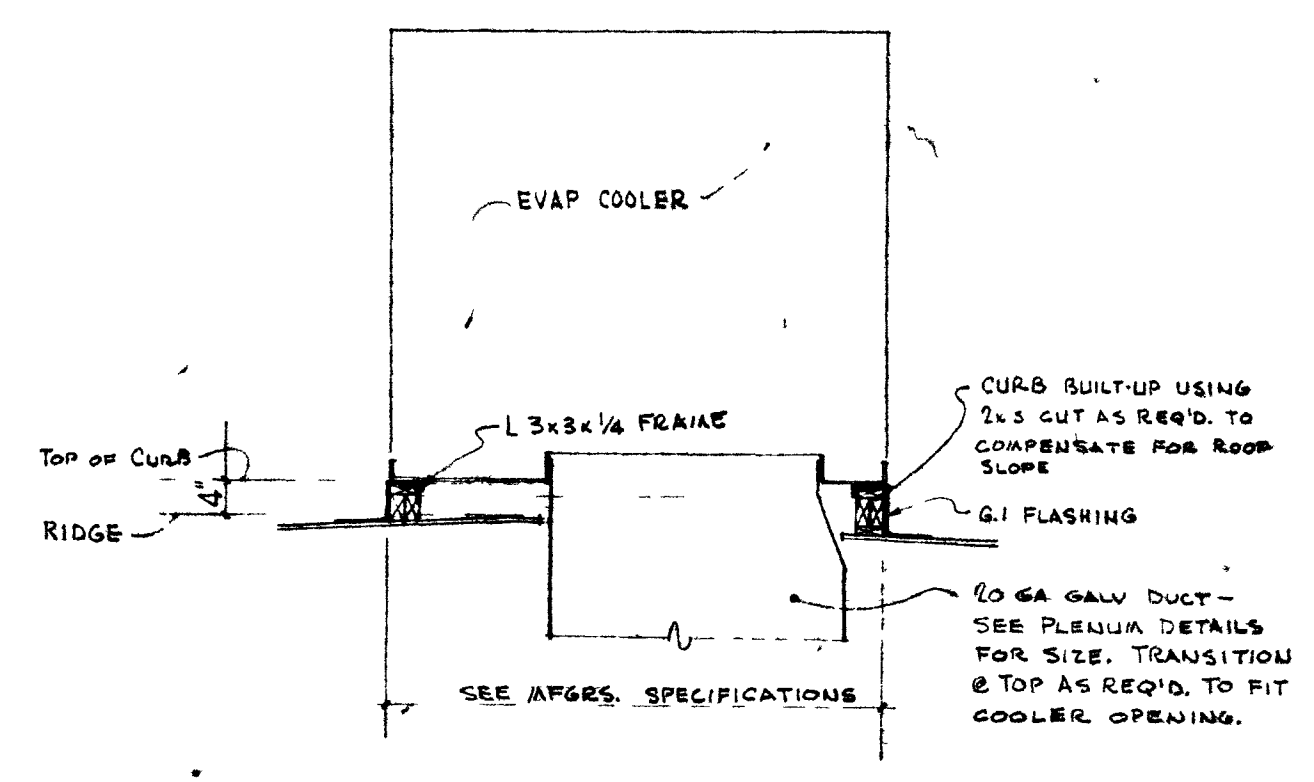
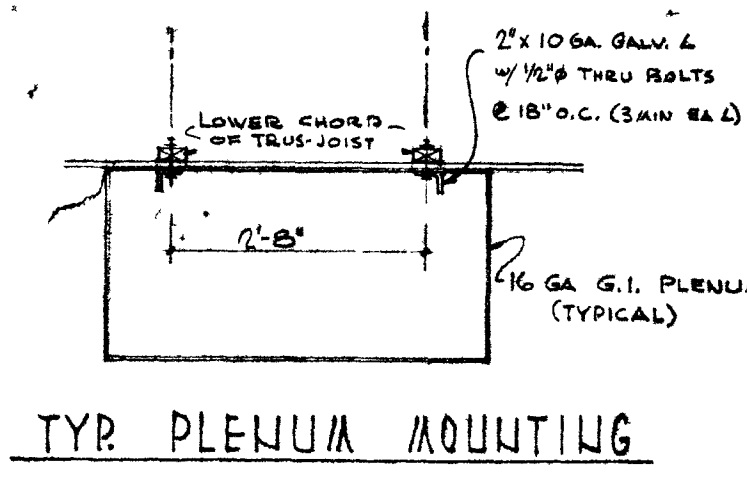
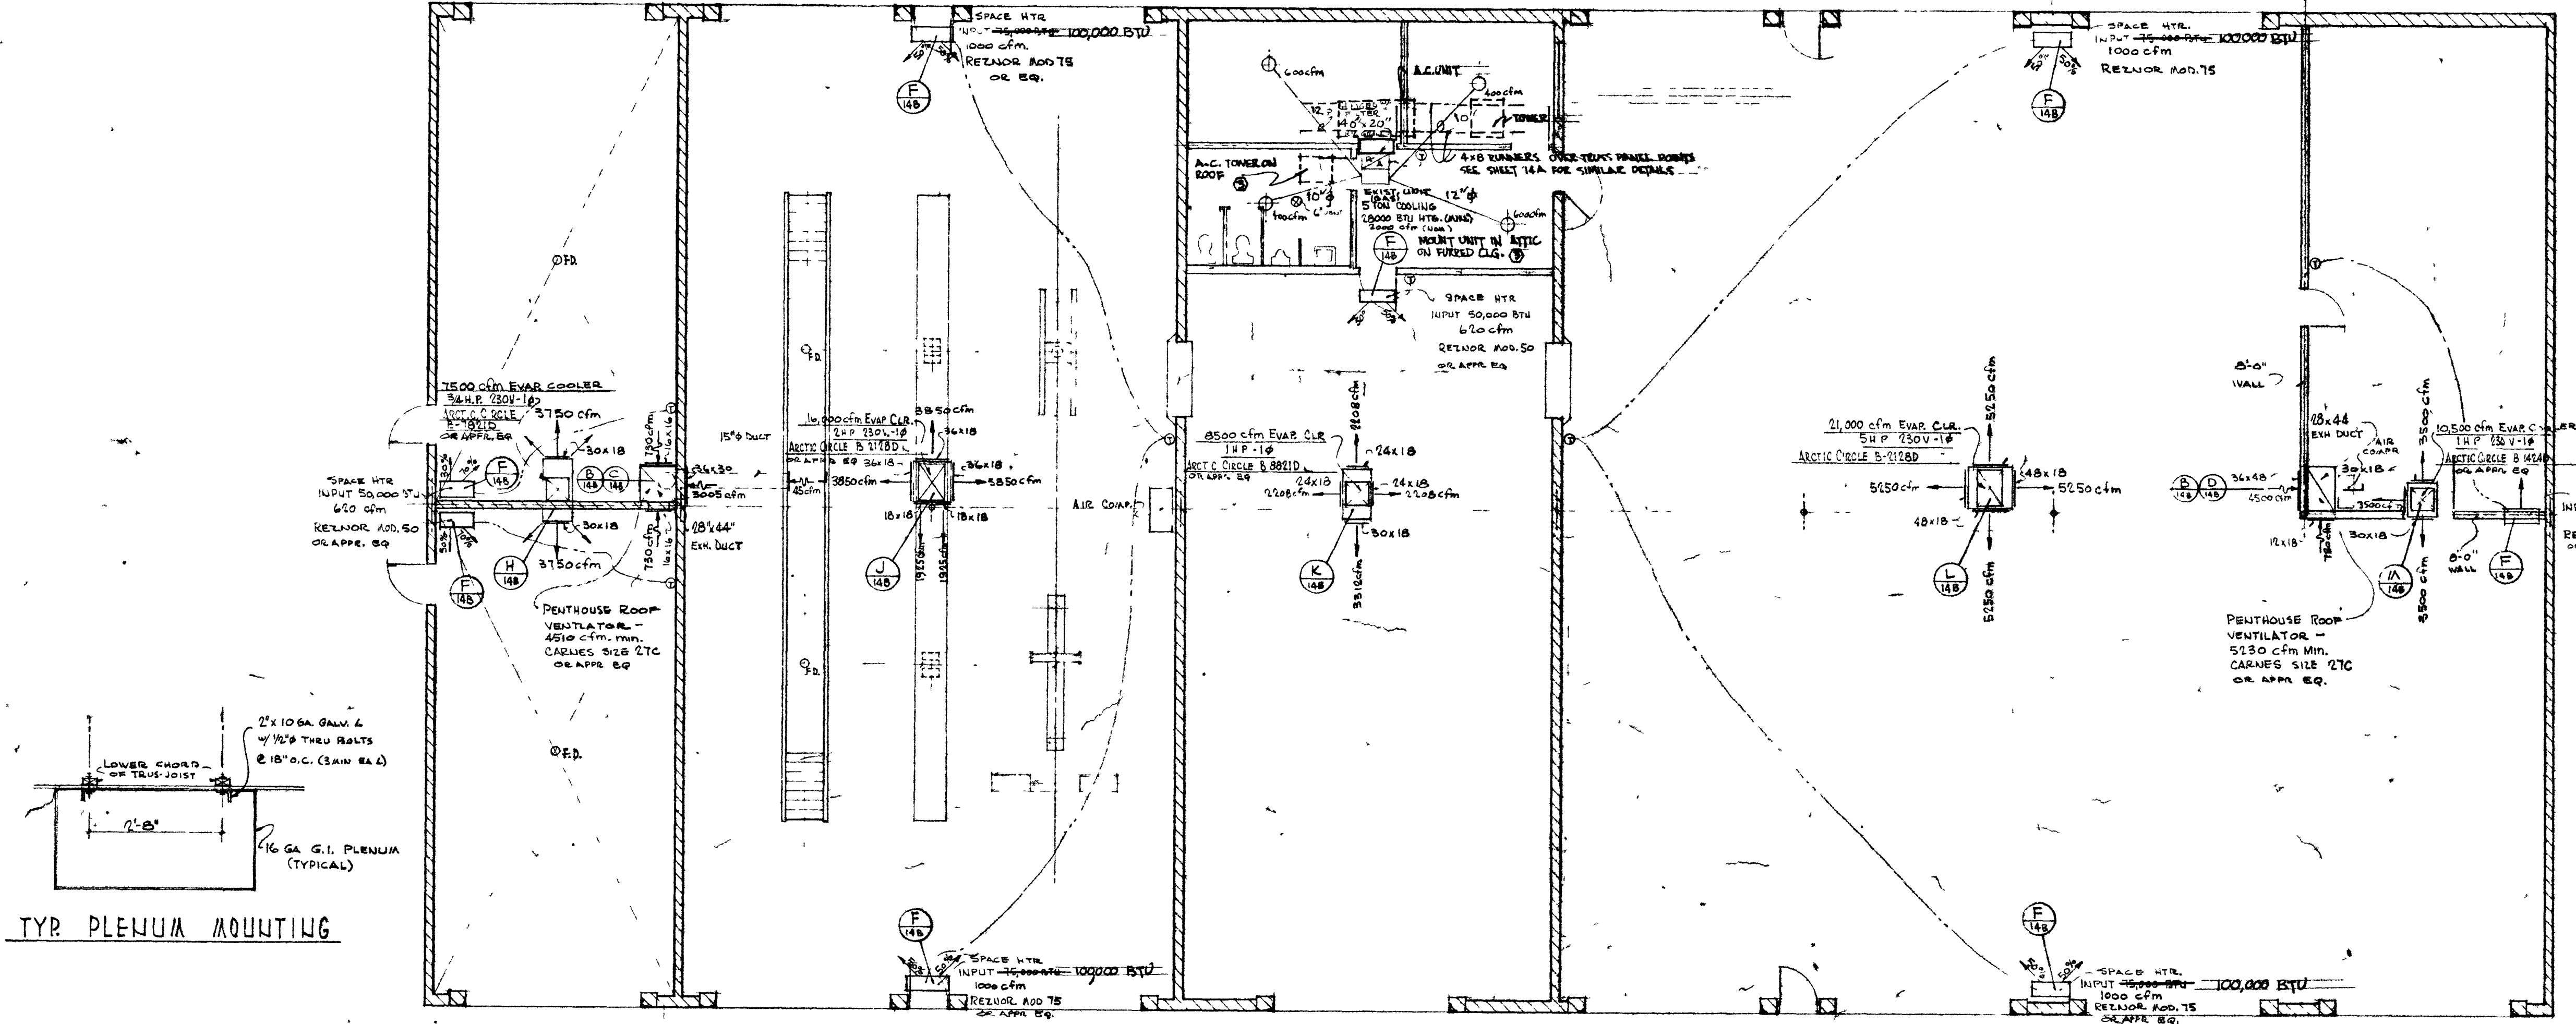
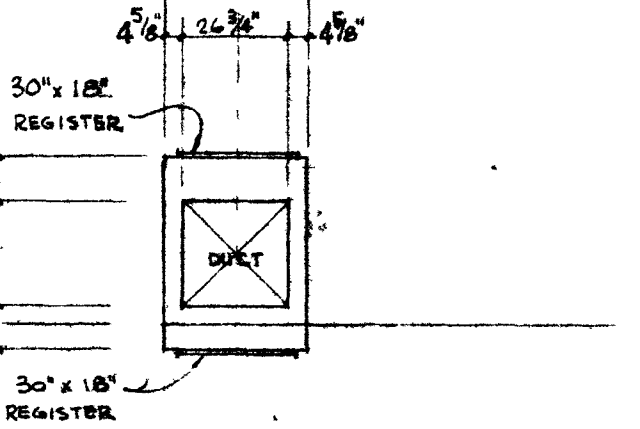
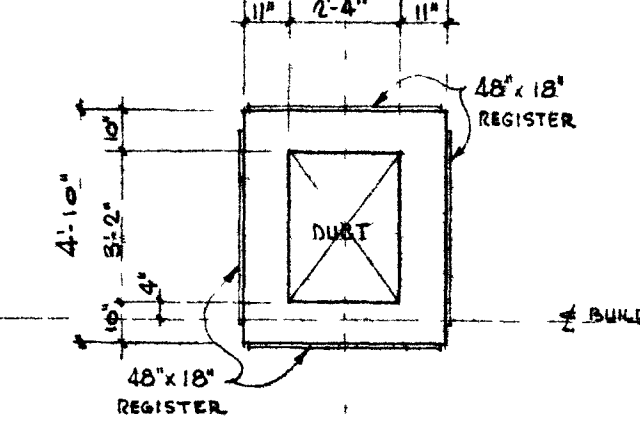
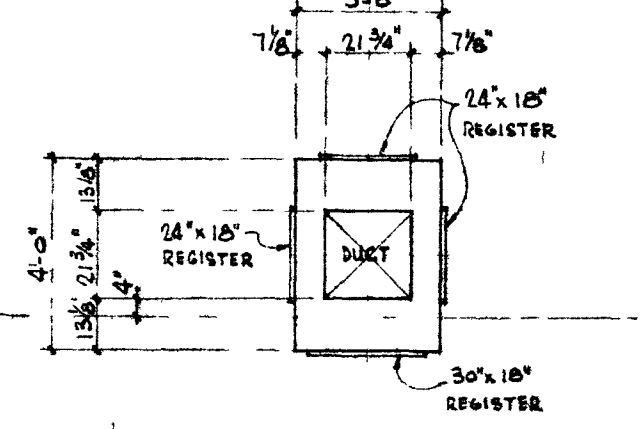



VENTILATOR DETAILS

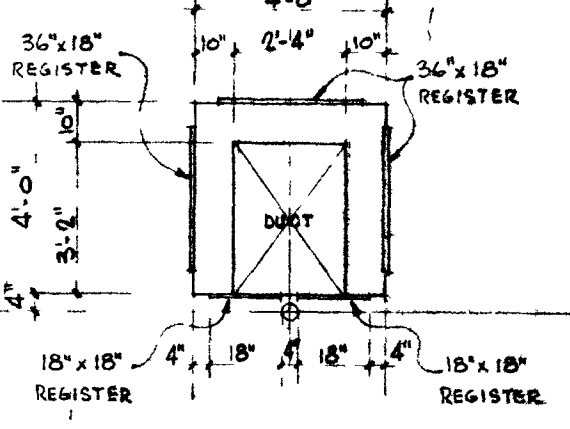

DETAIL C SCALE 1/4" = 1'-0"

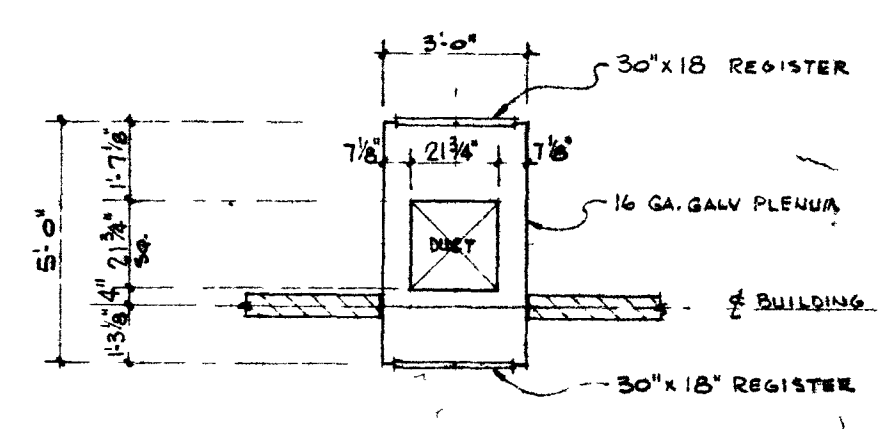

COOLER AND PLENUM DETAILS

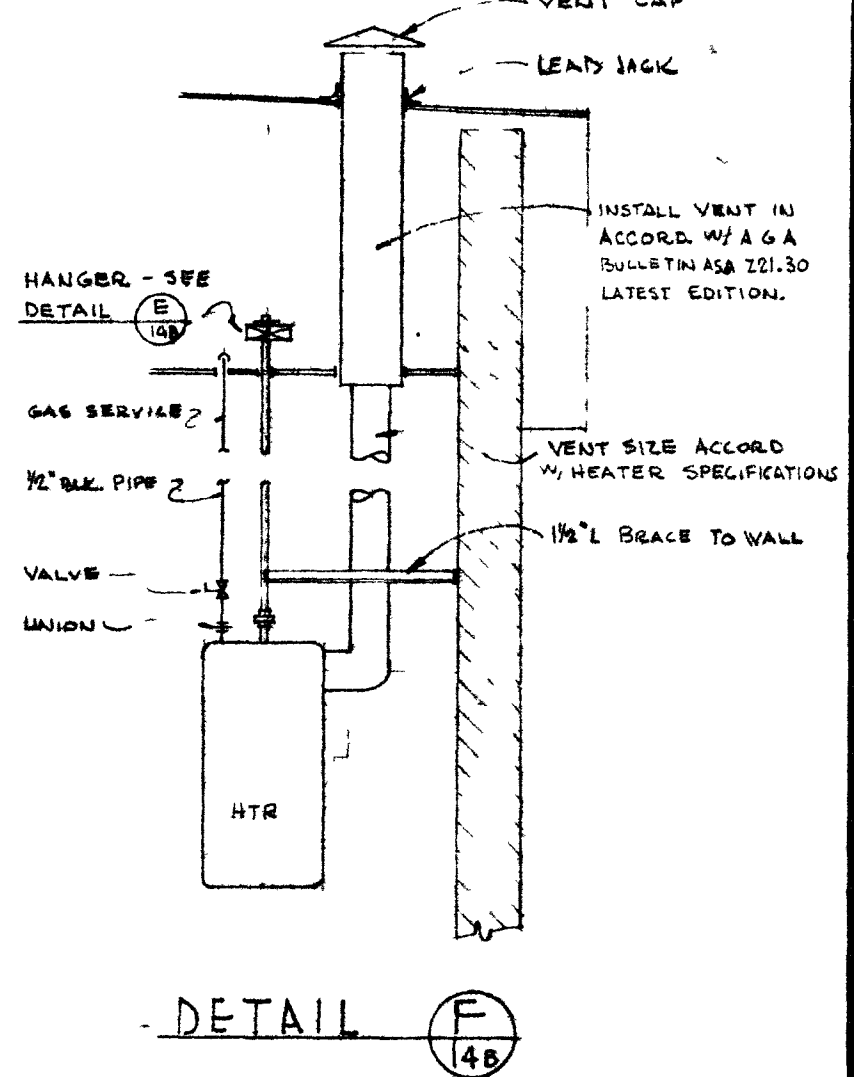

- NOTES:
1. VENTILATOR DUCT SHALL BE 20 GA. G.I. UNLESS NOTED.
 2. VENTILATOR REGISTER GRILLS SHALL BE CARNES MODEL 151 OR EQ. W/ HORIZONTAL ADJUSTABLE BLADES.
 3. GAS SPACE HTS. SHALL BE EQUIPPED W/ SPLITTER NOZZLES TO DIVIDE AIR FLOW AS SHOWN IN PLAN.
 4. COOLER REGISTER GRILLS SHALL BE KUEGER SERIES 820H OR EQ. DOUBLE DEFLECTION GRILL - REAR BANK VERTICAL INDIVIDUALLY ADJUSTABLE FINS. FRONT BANK HORIZONTAL INDIVIDUALLY ADJUSTABLE FINS. FINS TO BE ADJUSTED BY CONTRACTOR TO PROVIDE OPTIMUM AIR CIRCULATION IN ALL AREAS.
 5. ALL COOLERS TO BE SUPPLIED W/ CAULK GASKETS FOR WINTER ISOLATION.

REVISIONS	
1	20 MAY 66
2	22 NOV 66
3	ADD A/C UNIT
4	ADD A/C UNIT
5	LOCATE A/C UNITS
6	LOCATE A/C UNITS
7	LOCATE A/C UNITS
8	LOCATE A/C UNITS
DATE	
3-15-66	
DRAWN BY	
A. K. P.	
CHECKED BY	
A. K. P.	
SHEET TITLE	
HEATING VENTILATING & A/C	
BUILDING "B"	
JOB TITLE	
CITY YARD FACILITIES, FOR THE CITY OF LAS VEGAS, NEVADA	
JOB NO.	
6510	
SHEET	
14B	
OF 30 TOTAL	

