

LIST OF ABBREVIATIONS

A	AMMETER, AMPERE(S)	HPS	HIGH PRESSURE SODIUM	S	SWITCH
AC	ALTERNATING CURRENT	HV	HIGH VOLTAGE	SC	SPEED CONTROL
AF	AMPERE FRAME	HVAC	HEATING, VENTILATING AND AIR CONDITIONING	SCH	SCHEDULE
A.F.F.	ABOVE FINISHED FLOOR			SEC	SECOND/SECONDARY
APPD	APPROVED			SECT	SECTION
ASD	ADJUSTABLE SPEED DRIVE	IC	INTERRUPTING CAPACITY	SEQ	SEQUENCE
ASU	AIR SUPPLY UNIT	I & C	INSTRUMENTATION & CONTROL	SHT	SHEET
ATS	AUTOMATIC TRANSFER SWITCH	INCAND	INCANDESCENT	SHTR	SPACE HEATER
AT	AMPERE TRIP	INST	INSTANTANEOUS/INSTRUMENT	S/N	SOLID NEUTRAL
AUX	AUXILIARY	INSTR	INSTRUMENTATION	SPD	SPEED
		ISOL	ISOLATION	SPEC	SPECIFICATIONS
BC	BARE COPPER	J, J-BOX	JUNCTION BOX	SSTL	STAINLESS STEEL
BKR	BREAKER			STD	STANDARD
BLDG	BUILDING	KV	KILO VOLTS	STLT	STREET LIGHT
		KVA	KILO VOLT-AMPERES	STR	STARTER
		KWH	KILOWATT HOUR	SV	SOLENOID VALVE
C	CONDUIT/CONTROL			SW	SWITCH
CAB	CABINET			SWBD	SWITCHBOARD
CB	CIRCUIT BREAKER			SWGR	SWITCHGEAR
CC	CONTROL CABINET			SYM	SYMMETRICAL
CKT	CIRCUIT	L	LINE		
CL2	CHLORINE	LA	LIGHTNING ARRESTER	T	THERMOSTAT
CLG	CEILING	LC	LOAD CENTER	TB	TERMINAL BOARD
CO	CONDUIT ONLY	LOC	LOCATION	TC	TIME CLOSE
COMM	COMMUNICATIONS	LS	LIMIT SWITCH	TD	TIME DELAY
COND	CONDUCTOR	LSC	LIMIT SWITCH-CLOSED	TD	TIME DELAY
CONT	CONTINUED	LSO	LIMIT SWITCH-OPEN	TD	TIME DELAY
CPNL	CONTROL PANEL	LT FLEX	LIQUID TIGHT FLEX CONDUIT	TD	TIME DELAY
CPT	CONTROL POWER TRANSFORMER	LTG	LIGHTING	TD	TIME DELAY
		LV	LOW VOLTAGE	TD	TIME DELAY
CR	CONTROL RELAY	M	MAGNETIC CONTACTOR COIL/MAIN CONTACT	TD	TIME DELAY
CS	CONTROL STATION			TD	TIME DELAY
CT	CURRENT TRANSFORMER	mA	MILLIAMPERES	TD	TIME DELAY
CORP	CORPORATION	MCC	MAIN CIRCUIT BREAKER	TD	TIME DELAY
CPLG	COUPLING	MCC	MOTOR CONTROL CENTER	TD	TIME DELAY
CU	COPPER	MCP	MOTOR CIRCUIT PROTECTOR	TD	TIME DELAY
		MD	MOTORIZED DAMPER	TD	TIME DELAY
		MECH	MECHANICAL	TD	TIME DELAY
DC	DIRECT CURRENT	MFR	MANUFACTURER	TD	TIME DELAY
D/I	DATA INPUT	MOV	MOTOR OPERATED VALVE	TD	TIME DELAY
DISC	DISCONNECT	MS	MOTOR STARTER	TD	TIME DELAY
DIV	DIVISION	MT	MOUNT	TD	TIME DELAY
		MTD	MOUNTED	TD	TIME DELAY
E	EMPTY/EXISTING	MTG	MOUNTING	TD	TIME DELAY
EF	EXHAUST FAN	MTR	MOTOR	TD	TIME DELAY
ELEC	ELECTRICAL			TD	TIME DELAY
ELEV	ELEVATION	N	NEUTRAL	TD	TIME DELAY
EMER	EMERGENCY	NA	NON-AUTOMATIC	TD	TIME DELAY
ETM	ELAPSED TIME METER	NC	NORMALLY CLOSED	TD	TIME DELAY
		N.E.C.	NATIONAL ELECTRICAL CODE	TD	TIME DELAY
		N.E.M.A.	NATIONAL ELECTRIC MANUFACTURERS ASSOCIATION	TD	TIME DELAY
FCP	FIRE CONTROL PANEL	NO	NORMALLY OPEN	TD	TIME DELAY
FDR	FEEDER	NPC	NEVADA POWER COMPANY	TD	TIME DELAY
F, FU	FUSE			TD	TIME DELAY
FLA	FULL LOAD AMPERES			TD	TIME DELAY
FLR	FLOOR			TD	TIME DELAY
FLUOR	FLUORESCENT			TD	TIME DELAY
FREQ	FREQUENCY	OL	OVERLOAD RELAY	TD	TIME DELAY
FVNR	FULL VOLTAGE NON-REVERSING			TD	TIME DELAY
		PP	POWER POLE	TD	TIME DELAY
		PB	PULL BOX	TD	TIME DELAY
G	GREEN, GROUND	PC	PHOTOCELL	TD	TIME DELAY
GALV	GALVANIZED	PLC	PROGRAMMABLE LOGIC CONTROLLER	TD	TIME DELAY
GFI	GROUND FAULT INTERRUPTER	PS	POWER SWITCH	TD	TIME DELAY
GFR	GROUND FAULT RELAY	PT	POTENTIAL TRANSFORMER	TD	TIME DELAY
GRS	GALVANIZED RIGID STEEL CONDUIT	PVC	POLYVINYL CHLORIDE CONDUIT	TD	TIME DELAY
		PW	PART WINDING	TD	TIME DELAY
H	HIGH SPEED	PWR	POWER	TD	TIME DELAY
HH	HANDHOLE	RECEPT	RECEPTACLE	TD	TIME DELAY
HID	HIGH INTENSITY DISCHARGE	REQ'D.	REQUIRED	TD	TIME DELAY
HP	HORSEPOWER	RL	RELAY	TD	TIME DELAY
HT	HEAT TAPE WITH INSULATION	RM	REMOTE MULTIPLEXER	TD	TIME DELAY
HTR	HEATER	RTD	RESISTANCE TEMPERATURE DETECTOR	TD	TIME DELAY
		RTU	REMOTE TERMINAL UNIT	TD	TIME DELAY


GENERAL NOTES

- PRIOR TO BEGINNING EXCAVATION, VERIFY LOCATIONS OF EXISTING AND NEW UNDERGROUND UTILITIES, PIPING, ETC. PROVIDE EXCAVATION, BACKFILL, SUPPORT, SAWCUTTING, PATCHING, PAVING, ETC. AS REQUIRED. BACKFILL EXCAVATIONS TO 90 PERCENT COMPACTION AND PATCH TO MATCH EXISTING CONDITIONS.
- ALL DIRT AND DEBRIS SHALL BE REMOVED FROM ALL MANHOLES AND PULLBOXES. DISPOSE OF AS DIRECTED BY THE LAS VEGAS VALLEY WATER DISTRICT.
- DO NOT SCALE DRAWINGS. VERIFY DIMENSIONS IN FIELD PRIOR TO BEGINNING WORK.
- FINAL CONNECTIONS TO EQUIPMENT SHALL BE PER MANUFACTURER'S APPROVED WIRING DIAGRAMS, DETAILS AND INSTRUCTIONS. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO PROVIDE MATERIALS AND EQUIPMENT COMPATIBLE WITH EQUIPMENT ACTUALLY SUPPLIED.
- CONTRACTOR SHALL VISIT JOB SITE PRIOR TO BID AND VERIFY THAT CONDITIONS ARE AS INDICATED. CONTRACTOR SHALL INCLUDE IN HIS BID COSTS, THE REQUIREMENTS TO MAKE HIS WORK MEET THE EXISTING CONDITIONS.
- THIS IS A STANDARD LEGEND SHEET. SOME SYMBOLS OR ABBREVIATIONS MAY APPEAR ON THIS SHEET AND NOT ON THE PLANS.

SYMBOL LEGEND

PLANS	POWER DIAGRAM	CONTROL DIAGRAM	DESCRIPTION	PLANS	POWER DIAGRAM	CONTROL DIAGRAM	DESCRIPTION	PLANS	POWER DIAGRAM	CONTROL DIAGRAM	DESCRIPTION
(PE)			120V. PHOTOELECTRIC EYE MOUNTED ATOP W.P. J-BOX	SW	V		METER WITH SWITCH - SCALE RANGE AS SHOWN		OR		CONDUCTORS - NOT CONNECTED
				CP			PANEL, LETTER INDICATES FOLLOWING CP - CONTROL PANEL				CONDUCTORS - CONNECTED
			NEW BRANCH CIRCUIT, FEEDER OR DUCT EXPOSED			100/M	CIRCUIT BREAKER, MAGNETIC TRIP ONLY, FRAME SIZE SHOWN, 3 POLE UNLESS INDICATED OTHERWISE.				CIRCUIT CLOSING - (MAKE) SWITCH, PUSHBUTTON, MOMENTARY (SPRING RETURN)
			BRANCH CIRCUIT, FEEDER OR DUCT CONCEALED OR BELOW GRADE.			400	CIRCUIT BREAKER, THERMAL MAGNETIC TRIP SHOWN, 3 POLE UNLESS INDICATED OTHERWISE.				NORMALLY OPEN LIMIT SWITCH
			HOMERUN TO PANEL, CIRCUIT NUMBER INDICATED ON DWG. CROSSHATCH INDICATES NO. OF CONDUCTORS. FORWARD SLASH INDICATES NEUTRAL. NO MARKS INDICATES TWO CONDUCTORS. SLASH W/ "G" INDICATES GROUND. NO. OF ARROWS INDICATES NO. OF HOMERUNS IN CONDUIT.				DRAWOUT AIR CIRCUIT BREAKER				TIME DELAY ACTION OF CONTACT, ARROW INDICATES DIRECTION OF DELAY IN SWITCH ACTION - NORMALLY OPEN CONTACT SHOWN.
			GROUND				CIRCUIT BREAKER, RATING, NUMBER OF POLES AND AMPERE TRIPS INDICATED WHERE SHOWN. DASHED LINE INDICATES INTERLOCK FEATURE				TIME DELAY ACTION OF CONTACT, ARROW INDICATES DIRECTION OF DELAY IN SWITCH ACTION - NORMALLY CLOSED CONTACT SHOWN.
			EXISTING WIRING AND TEXT				SOLID STATE REDUCED VOLTAGE STARTER				CLOSES ON RISING PRESSURE PRESSURE OR VACUUM ACTUATED SWITCH
			EXISTING EQUIPMENT, CONDUIT AND WIRING TO BE REMOVED				FUSE - AMPERE OR TYPE AS SHOWN				OPENS ON RISING PRESSURE TEMPERATURE ACTUATED SWITCH
			REFERS TO CONDUIT AND WIRE SCHEDULE. NUMBER INDICATES CIRCUIT NAME.				DISCONNECT SWITCH, - RATING AS SHOWN LETTER F INDICATES FUSIBLE				OPENS ON RISING TEMPERATURE TEMPERATURE ACTUATED SWITCH
			CEILING MOUNTED LIGHT FIXTURE								HAND - OFF - AUTO SELECTOR SWITCH - MAINTAINED CONTACT
			FLOURESCENT LIGHT FIXTURE				DRAWOUT FUSED SWITCH, MEDIUM VOLTAGE				SWITCH, SELECTOR, POSITION AND FUNCTION SHOWN ON DRAWINGS. (OFF - AS SHOWN HERE)
			WALL MOUNTED LIGHT FIXTURE				THERMAL OVERLOAD HEATER OR MOTOR OVERCURRENT RELAY				CIRCUIT INTERLOCK - REFERENCE NOTES ON DRAWING FOR CIRCUIT SHOWN.
			FLOOD LIGHTS				COMBINATION MOTOR CIRCUIT PROTECTOR/MAGNETIC STARTER.				NORMALLY OPEN CONTACT, NO TIME DELAY ACTION OF CONTACT.
			LUMINAIRE AND POLE				PICK-UP SETTING TIME CURRENT CHARACTERISTIC				NORMALLY CLOSED CONTACT. NO TIME DELAY ACTION OF CONTACT.
			EMERGENCY LIGHT UNIT				GROUND FAULT INTERRUPT PROTECTION FEATURE (CIRCUIT BREAKERS).				CR = CONTROL RELAY, LC = LIGHTING CONTACTOR, TD = TIME DELAY RELAY, M = MOTOR CONTROLLER COIL. NUMBER INDICATES TYPE OF FUNCTION.
			EXIT LIGHTS				CURRENT TRANSFORMER, RATIO AND NUMBER OF CT'S AS INDICATED				ELAPSED TIME METER, DISPLAYS CUMULATIVE HOURS
			CONVENIENCE RECEPTACLE - DUPLEX SUBSCRIPT WP = WEATHERPROOF, GFI = GROUND FAULT CIRCUIT INTERRUPTER				LIGHTNING ARRESTER				MOTOR DRIVEN TIMER
			WALL SWITCH - NUMBER AND LETTER SUBSCRIPT INDICATE FOLLOWINGS: 2 = DOUBLE POLE, 3 = 3-WAY, 4 = 4-WAY, P = WITH PILOT LIGHT, WP = OUTDOOR WEATHERPROOF, K = KEY OPERATOR, M = MANUAL MOTOR STARTER				CAPACITOR - KVAR AS INDICATED				INDICATING LIGHT R = RED G = GREEN A = AMBER B = BLUE W = WHITE C = CLEAR
			JUNCTION BOX				LIGHTING CONTACTOR, CURRENT RATING INDICATED, NEMA 12 ENCLOSURE UNLESS INDICATED OTHERWISE. SEE CONTROL DIAGRAM FOR NUMBER OF POLES.				TERMINAL IN PLC
			MOTOR CONTROL CENTER OR MAJOR ELECTRICAL COMPONENT OR DEVICE - NAME OR IDENTIFYING SYMBOL AS SHOWN.				STARTER MAGNETIC NEMA SIZE INDICATED, NEMA 12 ENCLOSURE UNLESS INDICATED OTHERWISE. SEE CONTROL DIAGRAM.				TERMINAL AT FIELD DEVICE
			BRANCH CIRCUIT PANELBOARD, LIGHTING OR POWER PANEL				COMBINATION (FUSE OR CIRCUIT BREAKER AS INDICATED) MAGNETIC STARTER, NEMA SIZE INDICATED, NEMA 12 ENCLOSURE UNLESS INDICATED OTHERWISE. SEE CONTROL DIAGRAM.				TERMINAL IN RELAY PANEL
			ELECTRICAL SERVICE METERING EQUIPMENT				MOTOR, NUMBER INDICATES DESIGN (NOMINAL) HORSEPOWER. LETTER "M" INDICATES FRACTIONAL HORSEPOWER MOTOR SIZES				TERMINAL IN RTU
			TRANSFORMER SIZE AND RATING SHOWN ON POWER DIAGRAM. SIZE AND RATING AS REQUIRED BY APPLICATION ON CONTROL DIAGRAM				GENERATOR				TERMINAL IN MOTOR STARTER

ORIGINAL ISSUED
DRAWING SIGNED BY: D. K. BAIRD
ON: 10/05/94

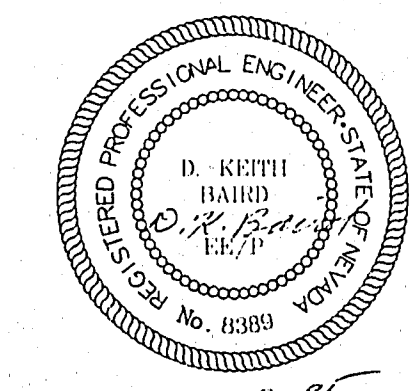

2-2-75

REPLOTTED ORIGINAL	JES	02/95	JOA
REV	DATE	BY	DATE

FILE NAME: C0713E01.DWG	DATE: 07/07/94	RECOMMENDED	8389	2-2-95
DRAWN: J.E. SALDANA	DATE: 07/07/94	D. Keith Baird	R.P.E. NO.	DATE
CHECKED: D.K.B.	DATE: 07/07/94	APPROVED	9651	2-2-95
		SHAWN P. MOKUS	R.P.E. NO.	DATE

LAS VEGAS VALLEY WATER DISTRICT
3700 WEST CHARLESTON BOULEVARD
LAS VEGAS, NEVADA

EQUIP WELL No.s 90 AND 95
**SYMBOL LEGEND AND
GENERAL NOTES**

DRAWING NUMBER
713
REF. SHEET NO. 17 OF 29

F-3 05-310 13-565-249 27-114