




29-15-42

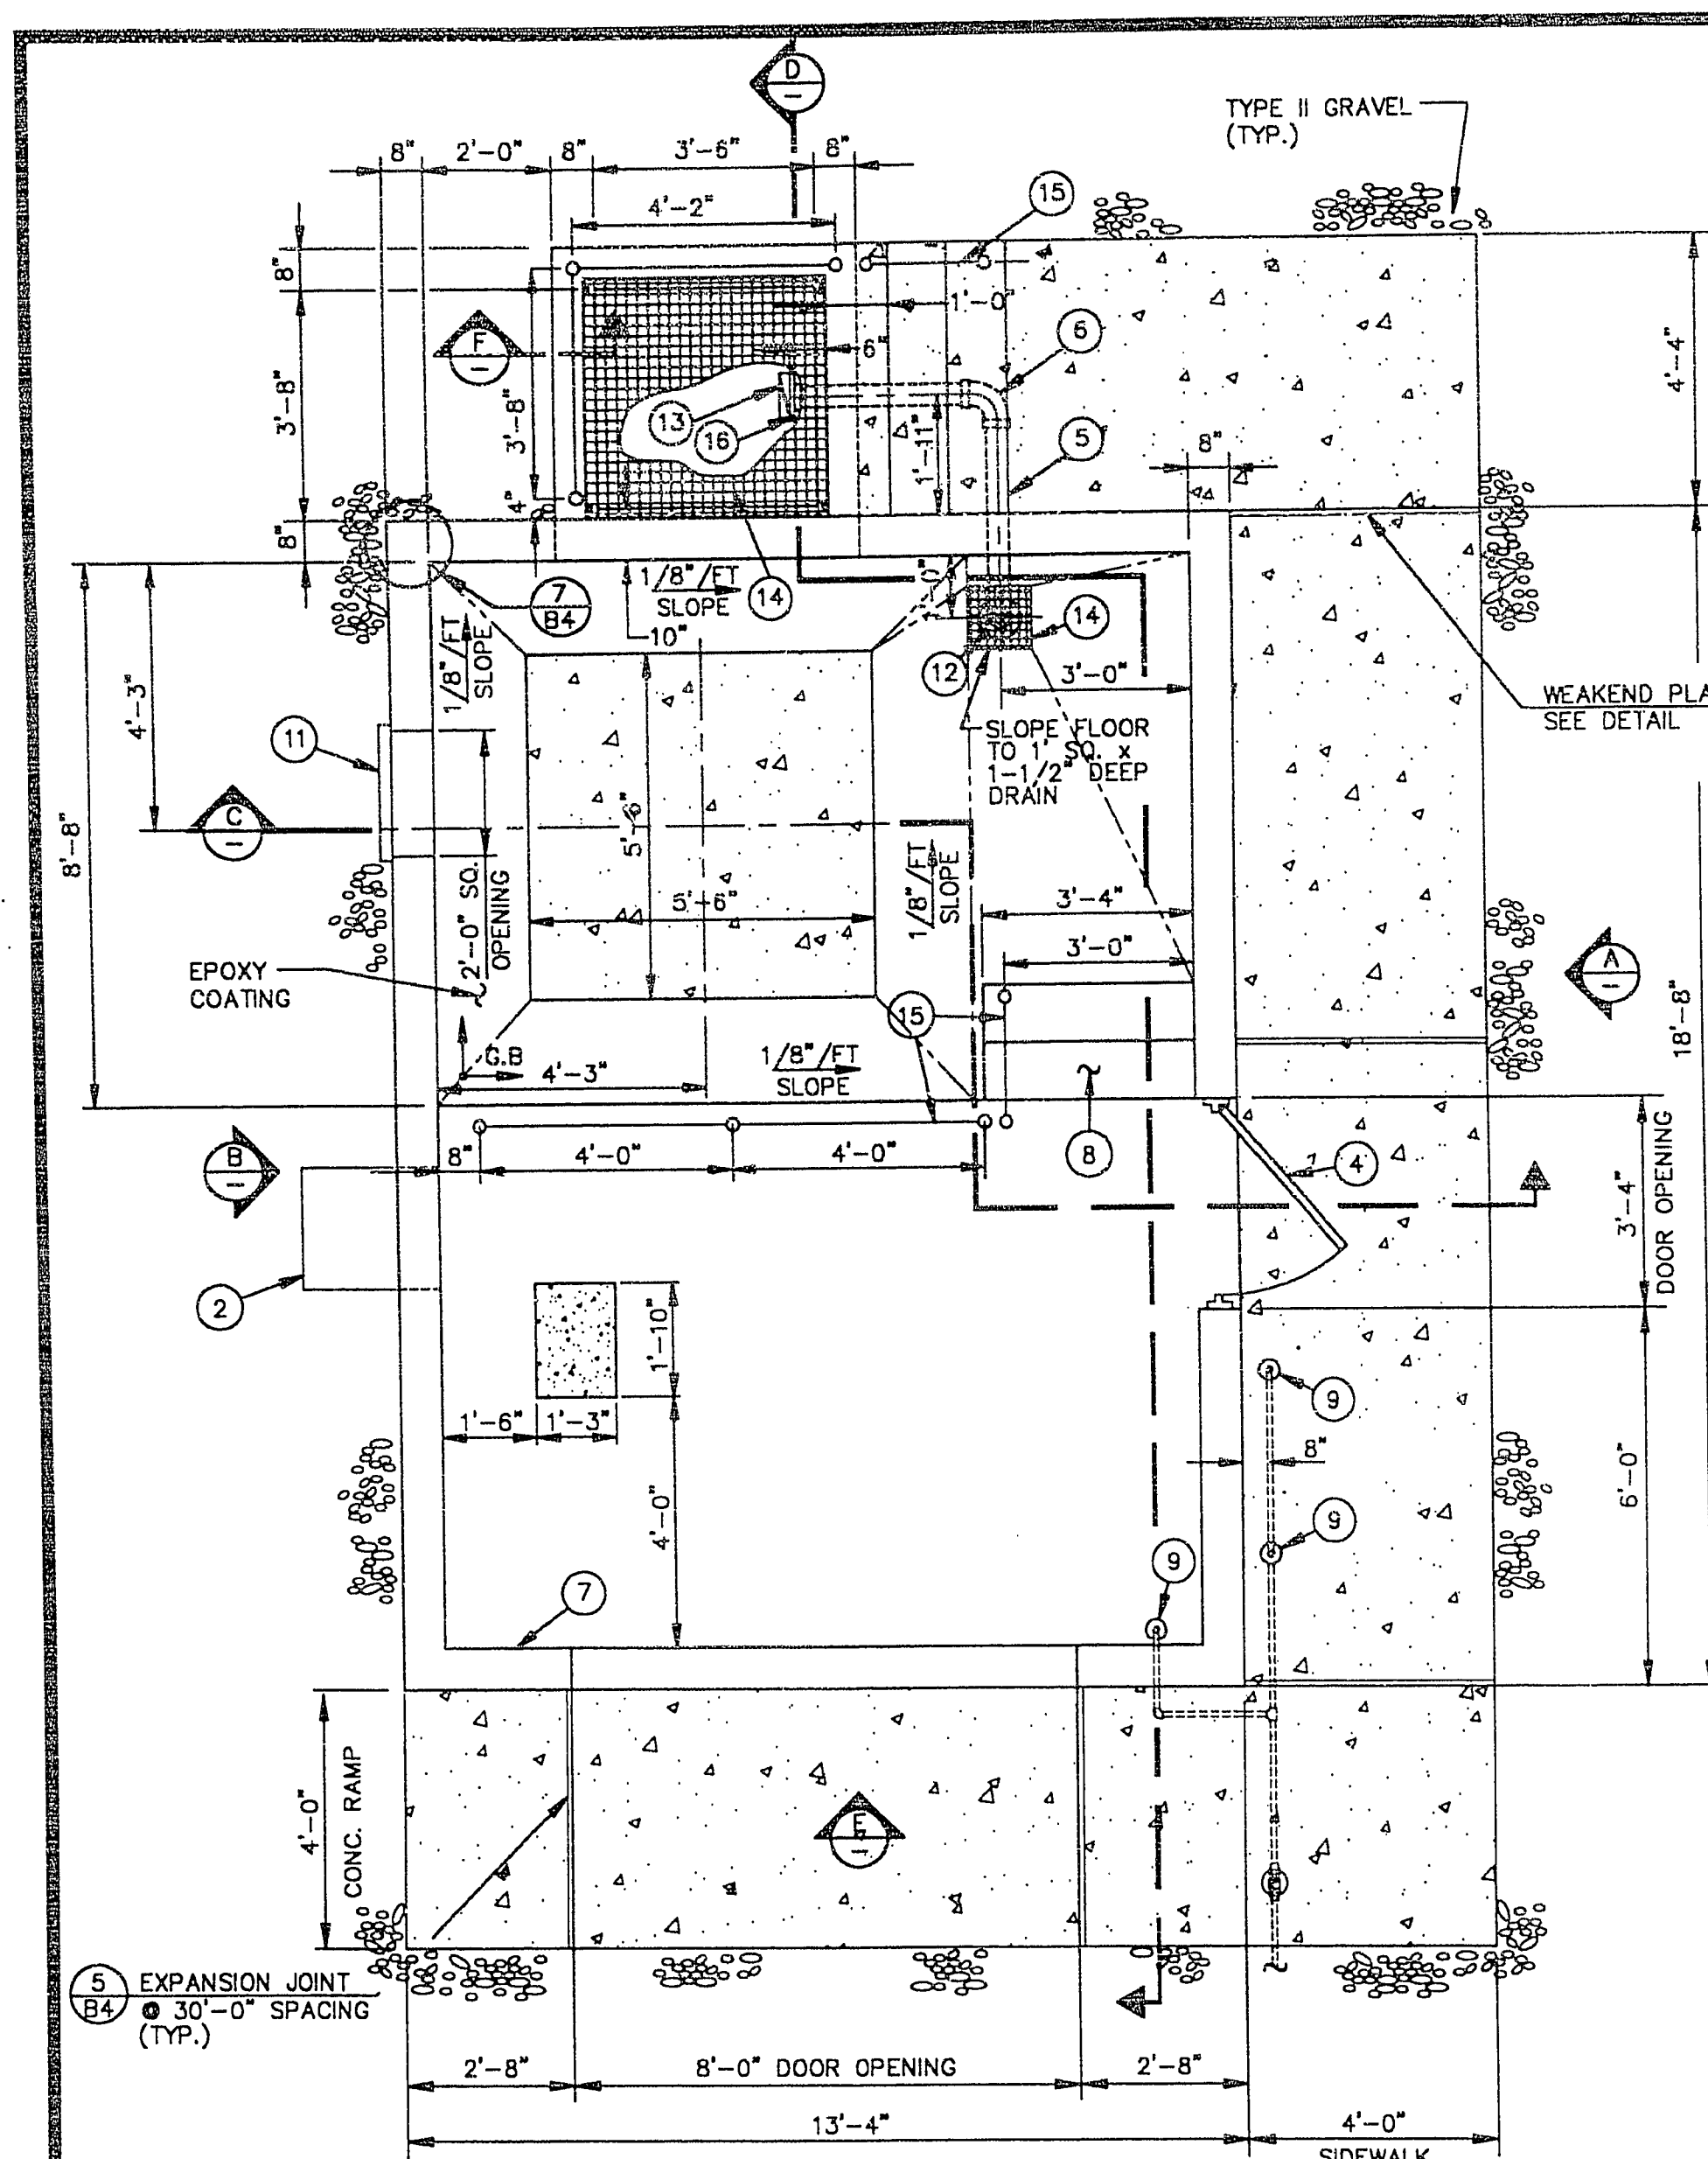


DISINFECTION BUILDING - FLOOR PLAN
SCALE: 3/8"=1'-0"

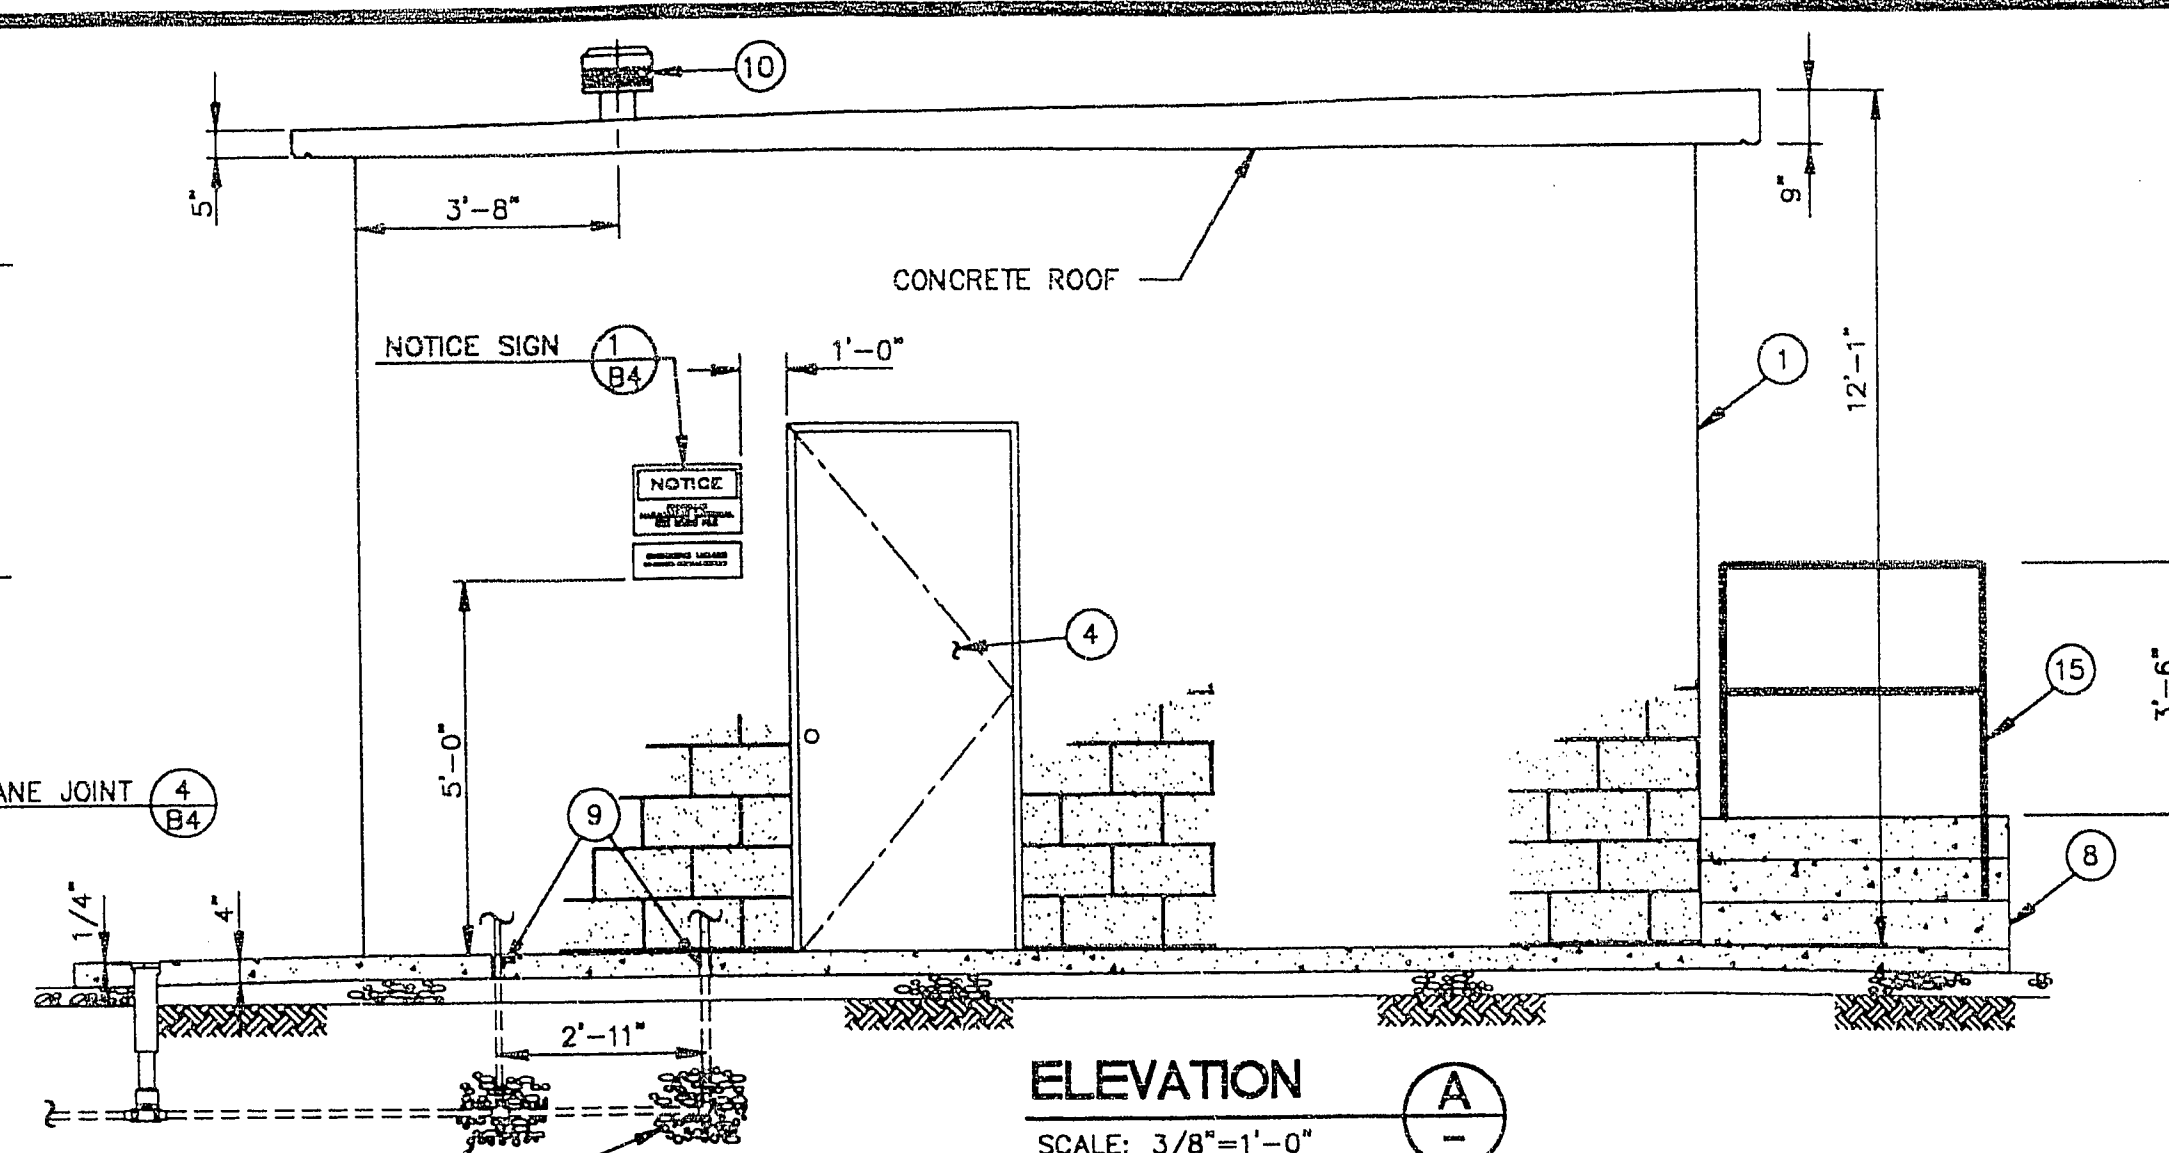


ELEVATION A
SCALE: 3/8"=1'-0"

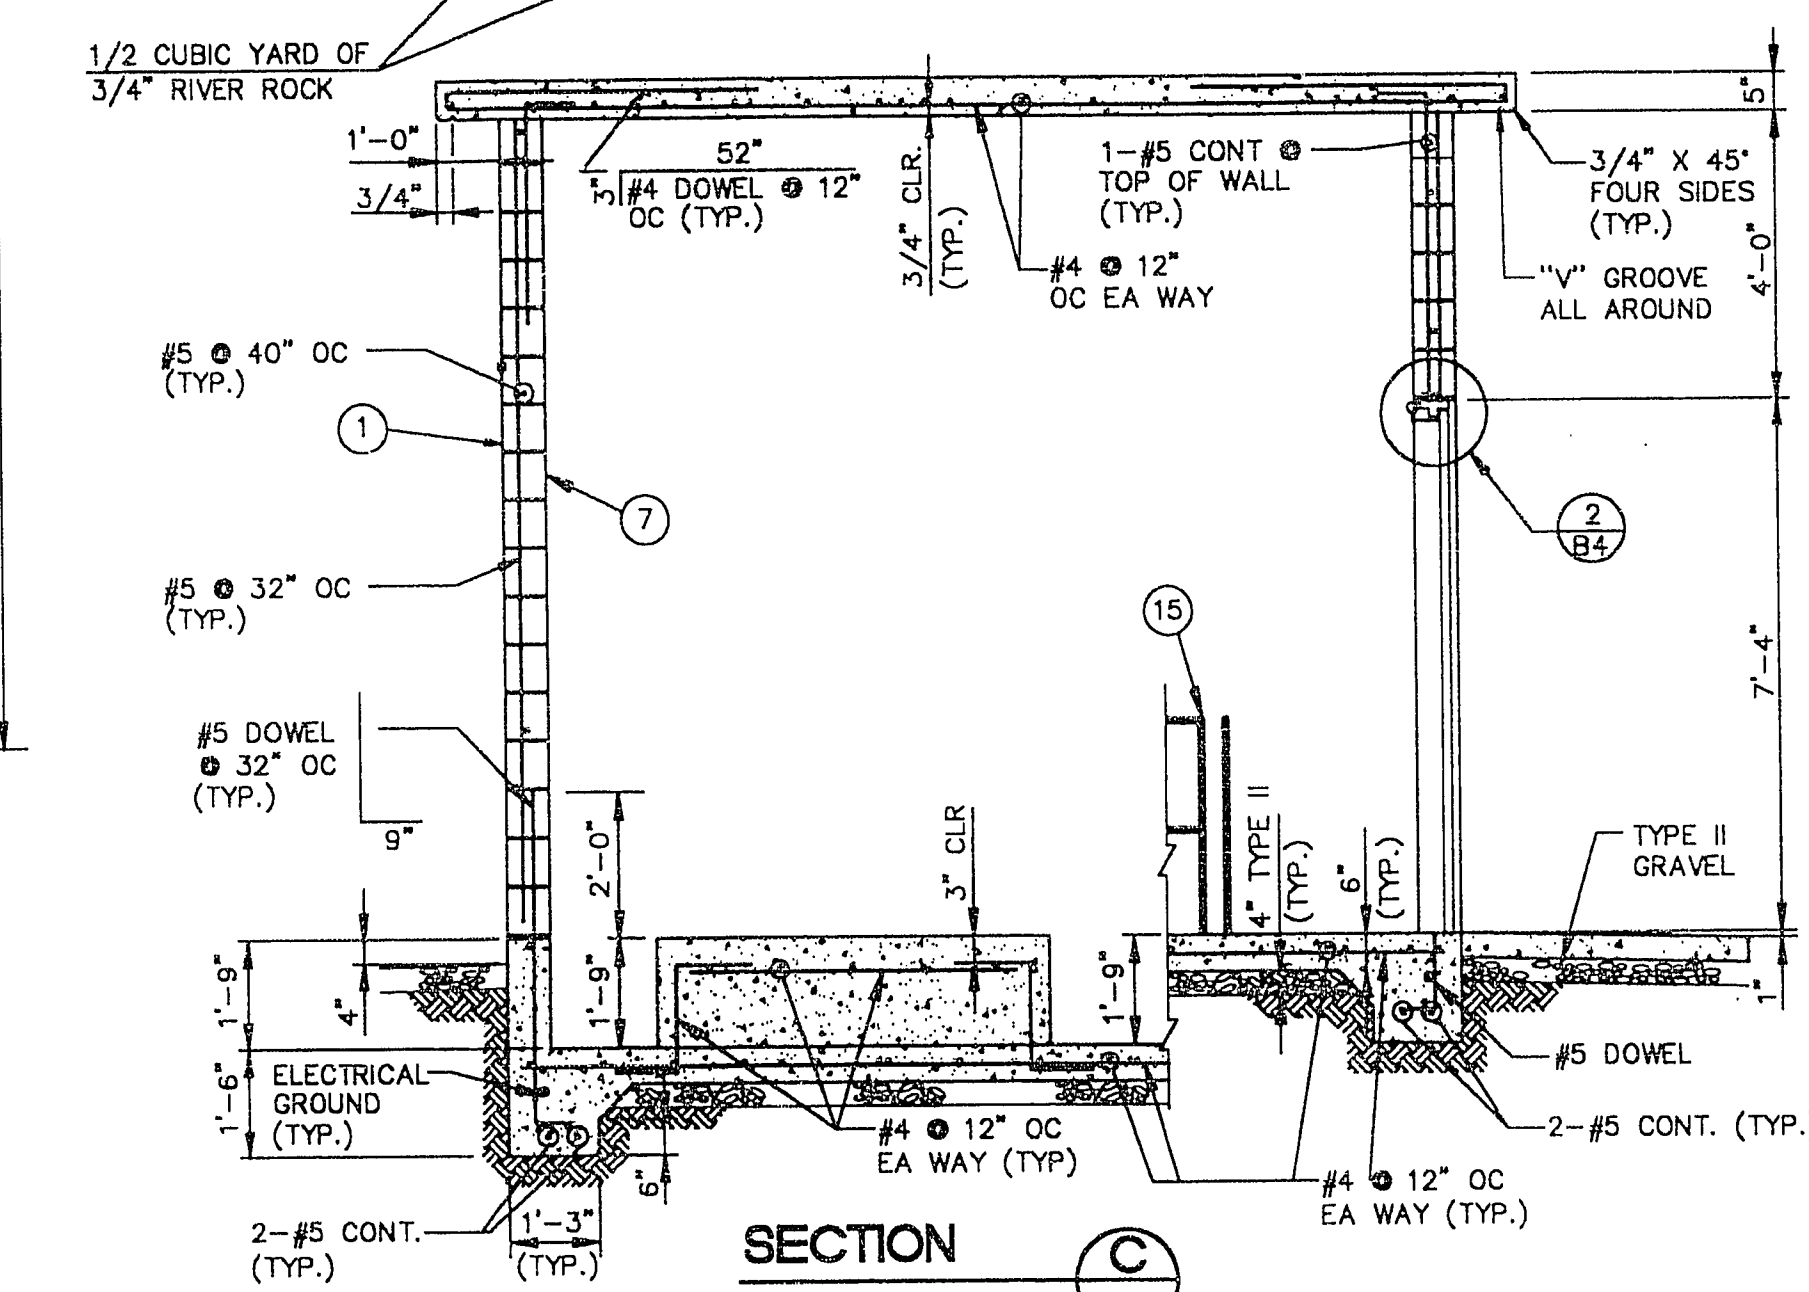


SECTION C
SCALE: 3/8"=1'-0"

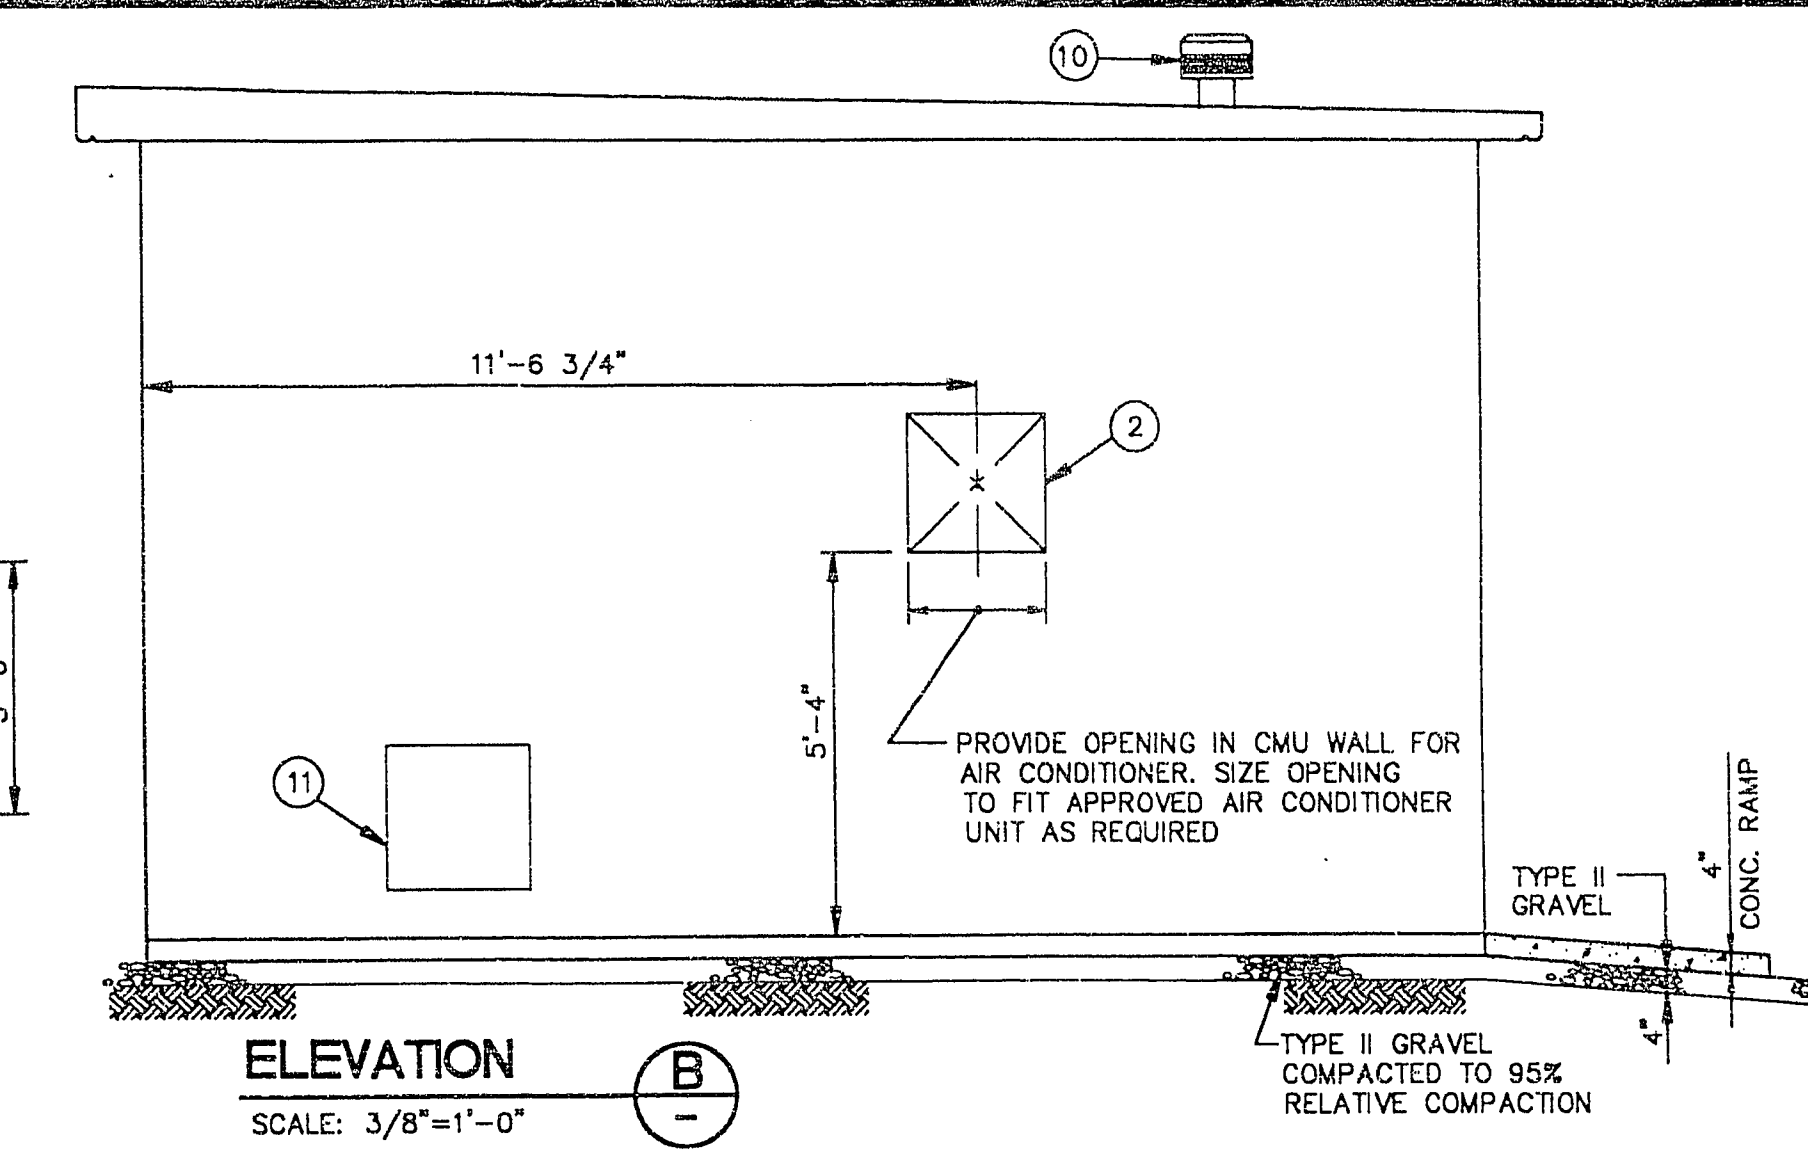


ELEVATION B
SCALE: 3/8"=1'-0"

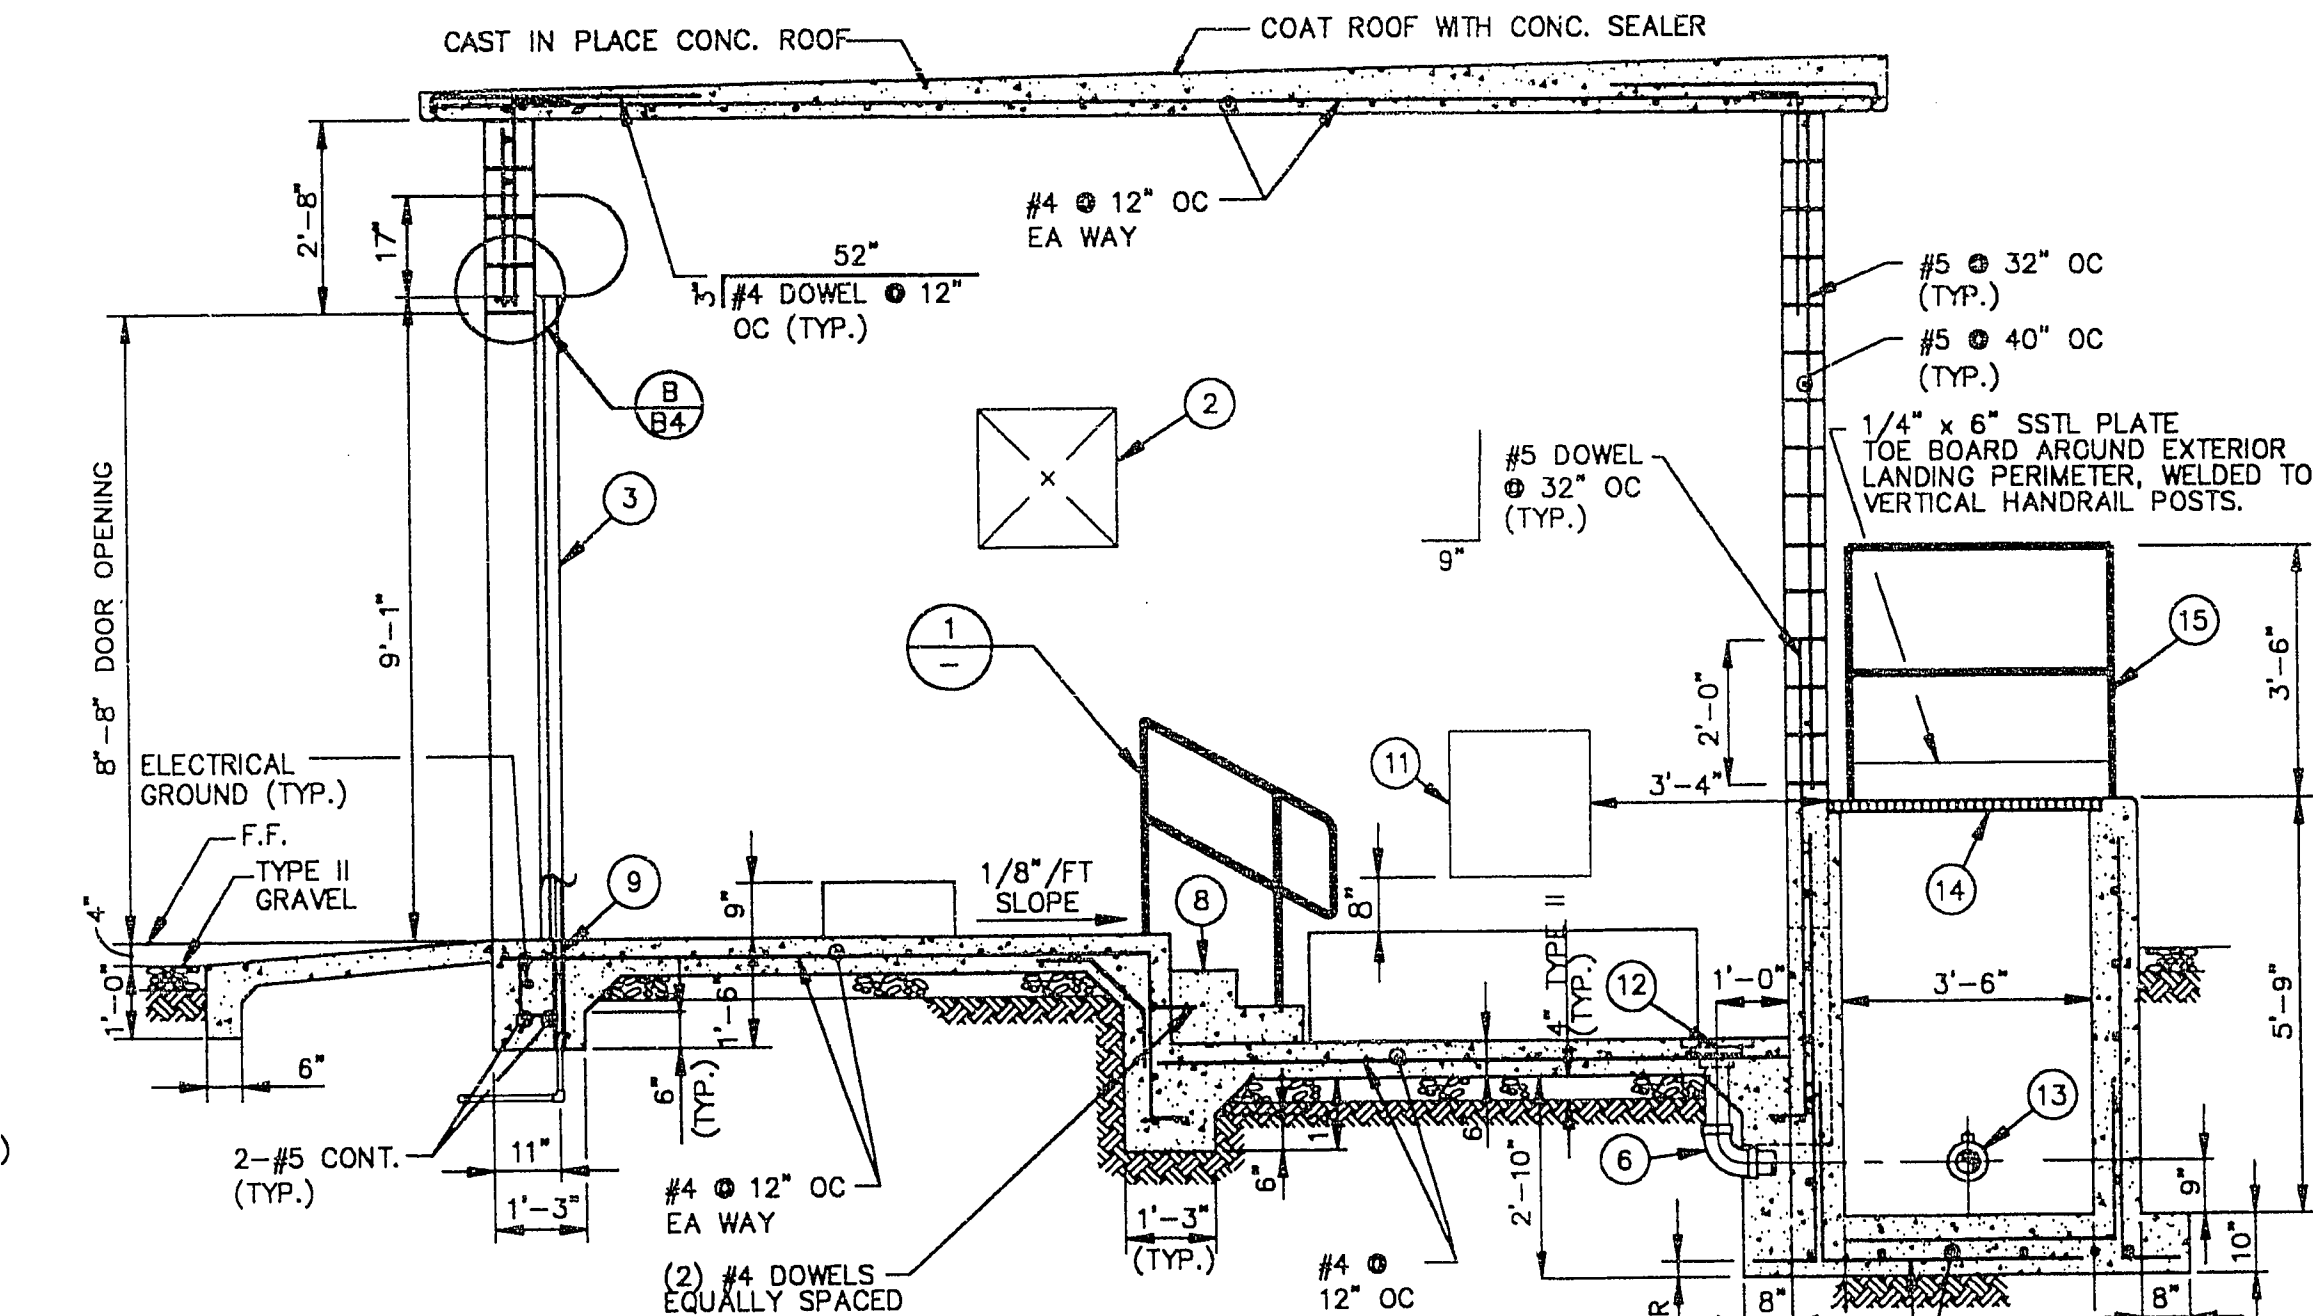


SECTION D
SCALE: 3/8"=1'-0"

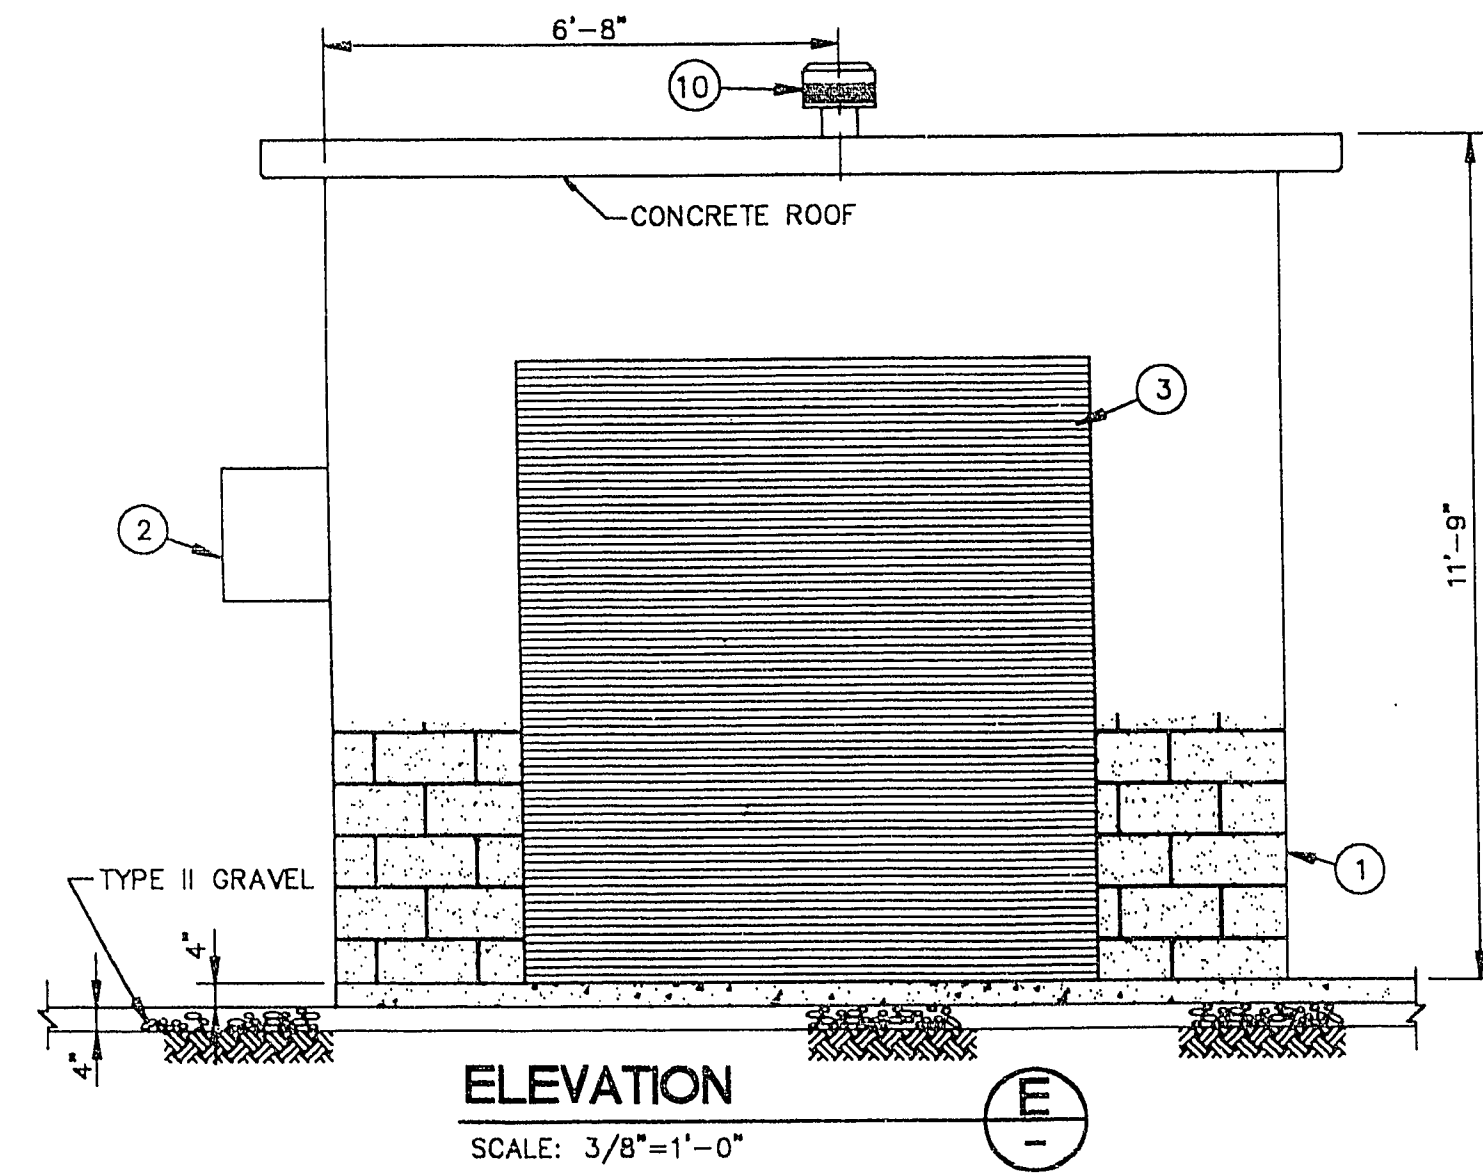


ELEVATION E
SCALE: 3/8"=1'-0"

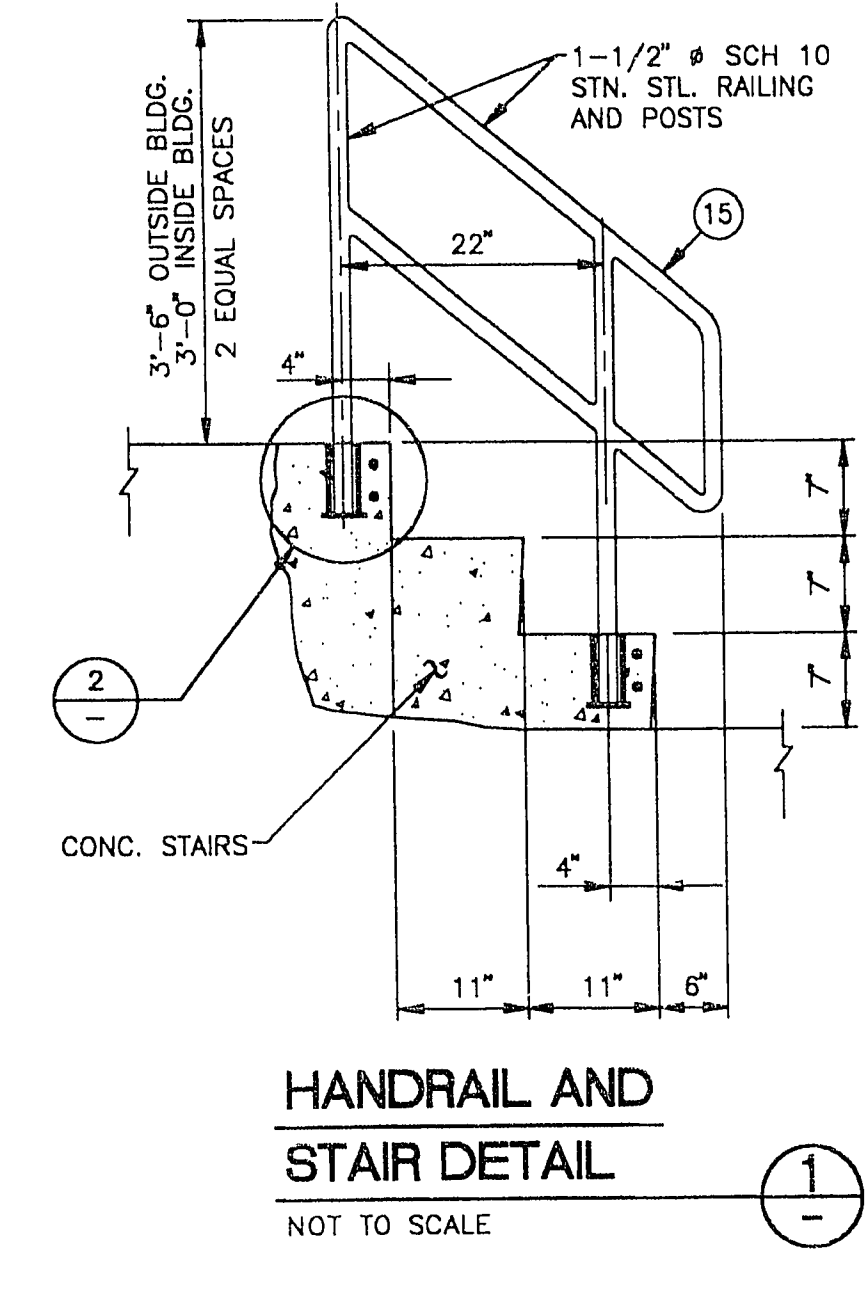

HANDRAIL AND STAIR DETAIL
NOT TO SCALE

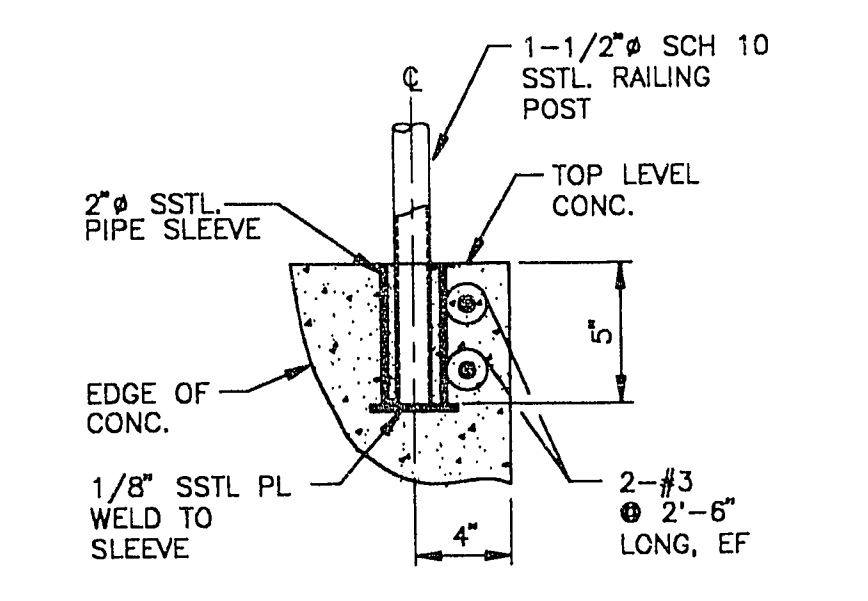

POST INSERT IN CONCRETE DETAIL
NOT TO SCALE

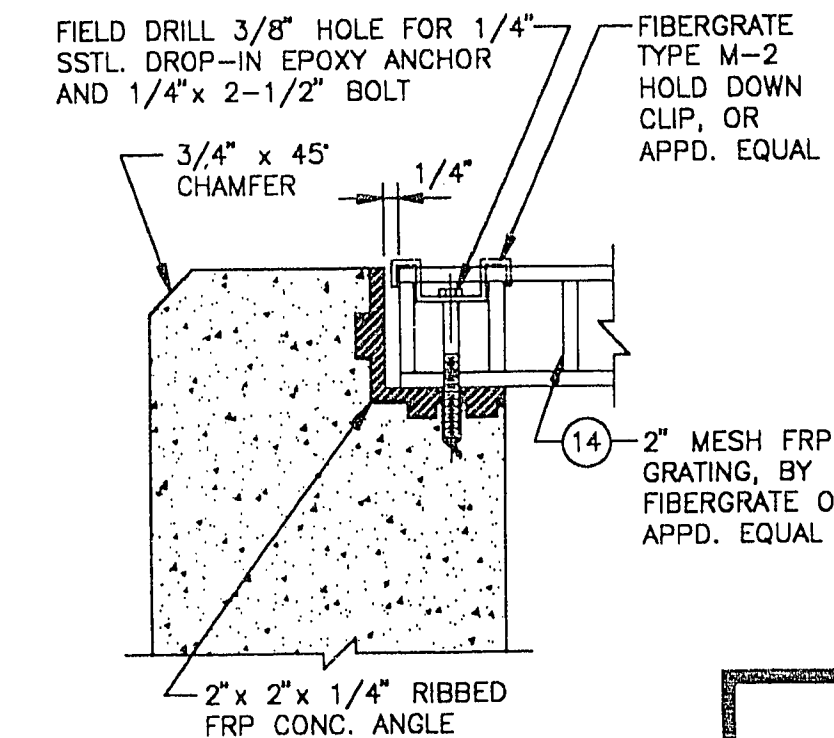

SECTION F
NOT TO SCALE

ITEM	DESCRIPTION	SPEC DIV/SEC
1	SPLIT FACED 8" x 8" x 16" PIGMENTED CMU WALLS, SOLID GROUT ALL CELLS	AS NOTED
2	CONTRACTOR TO SUBMIT COLOR SAMPLES TO MATCH EXISTING PERIMETER WALL	
3	AIR CONDITIONER / HEAT PUMP	43
4	INSULATED STEEL ROLLING SERVICE DOOR WITH WEATHER SEALS, AND MANUAL CHAIN OPERATOR	62
5	FLUSH STEEL DOOR WITH INSULATED HONEY-COMB CORE	62
6	4" CPVC PIPE, SCH. 80	27
7	4" CPVC SCH. 80 90° ELBOW	27
8	PAINT INTERIOR WHITE	15
9	CONC. STAIRS, SEE DETAIL 1	AS NOTED
10	2" SCH. 80 CPVC PIPE SLEEVE	42
11	ROOF VENT: AIRFOIL VENT ALUMINUM CAP W/BIRDPROOF SCREEN	62
12	FAN EXHAUSTER ELECTRICALLY OPERATED AND CONNECTED TO THE FAN, 2 FT. X 2 FT. FREE AREA LOUVERED VENT W/INSECT SCREEN, BLADE AND AND JAMB SEALS, FACTORY MTD. 120V ELECTRIC OPERATOR.	43
13	4" FLOOR DRAIN, SEE DETAIL 6 ON SHEET B4	27
14	4" PVC BUTTERFLY VALVE W/2" SQ. OPERATING NUT, CPVC VALVE DISC, VITON SEALS AND LINING BY HAYWARD OR APPVD. EQUAL (NORMALLY OPEN)	AS NOTED
15	2" THK X 2' X 2' MESH FRP GRATING	AS NOTED
16	1-1/2" SCH. 10 SSTL. RAILING & POSTS, SEE DETAIL 1	20
17	4" CPVC SCH. 80 FLANGE	27

SCALE: AS SHOWN
FILE NAME: C0751B1.DWG DATE: 6/6/95
DRAWN: P.J. DATE: 6/6/95
CHECKED: G. E. WALLACE DATE: 6/20/95

RECOMMENDED
JEROME A. STUEVE
APPROVED
SHAWN P. MOLLIS
10618
7-20-95
8851
7-25-95

LAS VEGAS VALLEY WATER DISTRICT
1001 SOUTH VALLEY VIEW BOULEVARD
LAS VEGAS, NEVADA 89153

EQUIP WELL NOS. 86 AND 104
DISINFECTION BUILDING

PROFESSIONAL ENGINEER
JEROME A. STUEVE
No. 10618
DRAWING NUMBER
751
REF. SHEET NO. 13 OF 31

NOTES: 1. BOTTOM OF FOOTINGS SHALL BEAR AGAINST UNDISTURBED EARTH OR STRUCTURAL FILL AS DIRECTED BY THE ENGINEER.